

**ENVIRONMENTAL
SCIENCE CORP.**

12065 Lebanon Rd.
Mt. Juliet, TN 37122
(615) 758-5858
1-800-767-5859
Nashville 641-6050
FAX (615) 758-5859
Tax ID: 62-0814289
Est. 1970

Total Trihalomethane Laboratory Report

February 4, 1998


Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 01496-98-1

Sample Description : Water Sample - THM's
Collected By : Bruce Trotter
Sample Location: 555 Steele Road
Collection Date/Time : 01/20/98 07:40
Sample Type : M

The following analyses were performed 01/31/98 by Benita Miller.

Parameter	Results	Units
Chloroform	0.016	mg/l
Bromodichloromethane	0.002	mg/l
Chlorodibromomethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.020	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

1998



ENVIRONMENTAL
SCIENCE CORP.

12065 Lebanon Rd.
Mt. Juliet, TN 37122
(615) 758-5858
1-800-767-5859
Nashville 641-6050
FAX (615) 758-5859

Total Trihalomethane Laboratory Report

Tax ID: 62-0814289
Est. 1970

Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

May 14, 1998

PWSID # : 0000191
Sample # : 10011-98-1

Sample Description : Water Sample - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 05/04/98 08:50
Sample Type : M

The following analyses were performed 05/12/98 by Benita Miller.

Parameter	Results	Units
Chloroform	0.020	mg/l
Bromodichloromethane	0.006	mg/l
Chlorodibromomethane	0.002	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.029	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



ENVIRONMENTAL
SCIENCE CORP.

12065 Lebanon Rd.
Mt. Juliet, TN 37122
(615) 758-5858
1-800-767-5859
Nashville 641-6050
FAX (615) 758-5859

Total Trihalomethane Laboratory Report

Tax ID: 62-0814289
Est. 1970

Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055


August 24, 1998

PWSID # : 0000191
Sample # : 19813-98-1

Sample Description : Water Sample - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 08/12/98 08:05
Sample Type : M

The following analyses were performed 08/22/98 by Bill Mock.

Parameter	Results	Units
Chloroform	< 0.0020	mg/l
Bromodichloromethane	< 0.0020	mg/l
Chlorodibromomethane	< 0.0020	mg/l
Bromoform	< 0.0020	mg/l
Total Trihalomethane	0.008	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



**ENVIRONMENTAL
SCIENCE CORP.**

12065 Lebanon Rd.
Mt. Juliet, TN 37122
(615) 758-5858
1-800-767-5859
Nashville 641-6050
FAX (615) 758-5859

Total Trihalomethane Laboratory Report

Tax ID. 62-0814289
Est. 1970

Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055


November 20, 1998

PWSID # : 0000191
Sample # : 30169-98-1

Sample Description : Water Sample - THM
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 11/11/98 08:25
Sample Type : M

The following analyses were performed 11/18/98 by Jimmy Hunt.

Parameter	Results	Units
Chloroform	0.0093	mg/l
Bromodichloromethane	0.0027	mg/l
Chlorodibromomethane	0.0016	mg/l
Bromoform	< 0.0010	mg/l
Total Trihalomethane	0.015	mg/l


Roberto Celia
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



**ENVIRONMENTAL
SCIENCE CORP.**

12065 Lebanon Rd.
Mt. Juliet, TN, 37122-2605
(615) 758-5858
1-800-767-5859
Nashville 641-6050
FAX (615) 758-5859

Tax I.D. 62-0814289

Est. 1970

Total Trihalomethane Laboratory Report

October 31, 1997


Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 25800-97-1

Sample Description : Water Sample - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 10/20/97 08:10
Sample Type : M

The following analyses were performed 10/31/97 by Randy D. Ward.

Parameter	Results	Units
Chloroform	0.019	mg/l
Bromodichloromethane	0.006	mg/l
Chlorodibromomethane	0.004	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.030	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

1997

Total Trihalomethane Laboratory Report

July 31, 1997


Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 17370-97-1

Sample Description : Water Sample - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 07/21/97 08:10
Sample Type : M

The following analyses were performed 07/28/97 by Jill S. Garris.

Parameter	Results	Units
Chloroform	0.024	mg/l
Bromodichloromethane	0.004	mg/l
Chlorodibromomethane	0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.030	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

Total Trihalomethane Laboratory Report

April 28, 1997


Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 09093-97-1

Sample Description : Water Sample - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 04/14/97 08:25
Sample Type : M

The following analyses were performed 04/25/97 by Jimmy Hunt.

Parameter	Results	Units
Chloroform	0.039	mg/l
Bromodichloromethane	0.009	mg/l
Chlorodibromomethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.050	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

**ENVIRONMENTAL
SCIENCE CORP.**

12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
Nashville 641-6050
FAX (615) 758-5859
Tax ID. 62-0814289
Est. 1970

Total Trihalomethane Laboratory Report

January 28, 1997


Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 01005-97-1

Sample Description : Water Sample
Collected By : John Myatt
Sample Location: 555 Steeles Road
Collection Date/Time : 01/14/97 08:05
Sample Type : M

The following analyses were performed 01/27/97 by Jimmy Hunt.

Parameter	Results	Units
Chloroform	0.047	mg/l
Bromodichloromethane	0.009	mg/l
Chlorodibromomethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.058	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

Total Trihalomethane Laboratory Report

Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

October 18, 1996

PWSID # : 0000191
Sample # : 24010-96-1

Sample Description : Drinking Water - THM's
Collected By : Johnny Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 10/07/96 09:00
Sample Type : M

The following analyses were performed 10/17/96 by Randy D. Ward.

Parameter	Results	Units
Chloroform	0.028	mg/l
Bromodichloromethane	0.006	mg/l
Chlorodibromomethane	0.002	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.037	mg/l

Sharon Northcutt
Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

1996



ENVIRONMENTAL
SCIENCE CORP.

1206S Lebanon Rd.
Mt. Juliet, TN 37122-2508
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859

Est. 1970

Total Trihalomethane Laboratory Report

August 29, 1996


Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 19594-96-1

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 08/20/96 08:15
Sample Type : M

The following analyses were performed 08/27/96 by Jimmy Hunt.

Parameter	Results	Units
Chloroform	0.034	mg/l
Bromodichloromethane	0.007	mg/l
Chlorodibromomethane	0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.043	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970



ENVIRONMENTAL
SCIENCE CORP.

Total Trihalomethane Laboratory Report

May 17, 1996


Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 10792-96-1

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 05/14/96 10:30
Sample Type : M

The following analyses were performed 05/16/96 by Jimmy Hunt.

Parameter	Results	Units
Chloroform	0.042	mg/l
Bromodichloromethane	0.004	mg/l
Chlorodibromomethane	0.003	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.050	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



**ENVIRONMENTAL
SCIENCE CORP.**

12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Total Trihalomethane Laboratory Report

Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055


February 9, 1996

PWSID # : 0000191
Sample # : 01854-96-1

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 01/29/96 10:15
Sample Type : M

The following analyses were performed 02/08/96 by Jimmy Hunt.

<u>Parameter</u>	<u>Results</u>	<u>Units</u>
Chloroform	0.027	mg/l
Bromodichloromethane	0.008	mg/l
Chlorodibromomethane	0.003	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.039	mg/l


Sharon Northcutt
ESC Representative

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

**ENVIRONMENTAL
SCIENCE CORP.**

Total Trihalomethane Laboratory Report

Dickson Water Department
Mr. Tony Videau
206 W Chestnut St
Dickson TN 37055

February 9, 1995

PWSID # : 0000191
Sample # : 34204-95-1

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Collection Point : 621 Southerland Road
Collection Date/Time : 02/06/95 09:10
Sample Type : M

The following analyses were performed 02/08/95 by Wendy Ingram.

Parameter	Results	Units
Chloroform	0.036	mg/l
Bromodichloromethane	0.005	mg/l
Chlorodibromomethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.043	mg/l

Source: City Lake


Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

1995



**ENVIRONMENTAL
SCIENCE CORP.**

12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Total Trihalomethane Laboratory Report

Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

April 17, 1995

FWSID # : 0000191
Sample # : 39599-95-1

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Collection Point : 555 Steele Road
Collection Date/Time : 04/10/95 08:35
Sample Type : M

The following analyses were performed 04/11/95 by Wendy Ingram.

Parameter	Results	Units
Chloroform	0.047	mg/l
Bromodichloromethane	0.006	mg/l
Chlorodibromomethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.055	mg/l

City Lake



Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

**ENVIRONMENTAL
SCIENCE CORP.**

12065 Lebanon
Mt. Juliet, TN 37056
(615) 738-3855
1-800-707-3855
FAX (615) 738-3855
Est. 1970

Total Trihalomethane Laboratory Report

Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055


August 17, 1995

PWSID # : 0000191
Sample # : 51304-95-1

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 08/14/95 10:30
Sample Type : M

The following analyses were performed 08/16/95 by Wendy Ingram.

<u>Parameter</u>	<u>Results</u>	<u>Units</u>
Chloroform	0.079	mg/l
Bromodichloromethane	0.015	mg/l
Chlorodibromomethane	0.004	mg/l
Bromoform	0.001	mg/l
Total Trihalomethane	0.099	mg/l


Dewey K. Kohn
Laboratory Manager

Piney River

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Total Trihalomethane Laboratory Report

November 9, 1995

Dickson Water Department
Mr. T L Gardner
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 59944-95-1

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Sample Location: 555 Steele Road
Collection Date/Time : 11/06/95 09:30
Sample Type : M

The following analyses were performed 11/08/95 by Jimmy Hunt.

Parameter	Results	Units
Chloroform	0.021	mg/l
Bromodichloromethane	0.006	mg/l
Chlorodibromomethane	0.002	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.030	mg/l


Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

ENVIRONMENTAL
SCIENCE CORP.

12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859

Est. 1970

Total Trihalomethane Laboratory Report

February 4, 1994

Dickson Water Department
Mr. Tony Videau
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 01419-94-1

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Collection Point : 621 Southerland Road
Collection Date/Time : 01/31/94 11:00
Sample Type : M

The following analyses were performed 02/03/94 by Jerry Brewer.

Parameter	Results	Units
Chloroform	0.023	mg/l
Bromodichloromethane	0.006	mg/l
Chlorodibromomethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.031	mg/l

Source City Lake


Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

1994



ENVIRONMENTAL
SCIENCE CORP.

12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859

Est. 1970

Total Trihalomethane Laboratory Report

May 13, 1994

Dickson Water Department
Mr. Tony Videau
206 W Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 09043-94-1

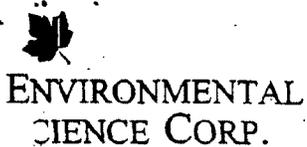
Sample Description : Drinking Water - THM's
Collected By : Tony Videau
Collection Point : 621 Southerland Road
Collection Date/Time : 05/09/94 10:30
Sample Type : M

The following analyses were performed 05/12/94 by Jerry Brewer.

Parameter	Results	Units
Chloroform	0.067	mg/l
Bromodichloromethane	0.004	mg/l
Chlorodibromomethane	<	0.001 mg/l
Bromoform	<	0.001 mg/l
Total Trihalomethane	0.073	mg/l

Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Total Trihalomethane Laboratory Report

Dickson Water Department
Mr. Tony Videau
206 W Chestnut St
Dickson TN 37055

August 4, 1994


PWSID # : 0000191
Sample # : 17678-94-1

Sample Description : Drinking Water - THM's
Collected By : Tony Videau
Collection Point : 621 Southerland Road
Collection Date/Time : 08/01/94 11:25
Sample Type : M

The following analyses were performed 08/03/94 by Jerry Brewer.

Parameter	Results	Units
Chloroform	0.051	mg/l
Bromodichloromethane	0.011	mg/l
Chlorodibromomethane	0.002	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.065	mg/l

Source Priority Review


Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



ENVIRONMENTAL
SCIENCE CORP.

12065 Lebanon Rd.
Mt. Juliet, TN 37122-2605
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Total Trihalomethane Laboratory Report

November 18, 1994


Dickson Water Department
Mr. Tony Videau
206 W. Chestnut St
Dickson TN 37055

PWSID # : 0000191
Sample # : 27762-94-1

Sample Description : Drinking Water - THM's
Collected By : Tony Videau
Collection Point : 621 Southerland Road
Collection Date/Time : 11/14/94 08:20
Sample Type : M

The following analyses were performed 11/17/94 by Jill S. Garris.

Parameter	Results	Units
Chloroform	0.016	mg/l
Bromodichloromethane	0.004	mg/l
Chlorodibromomethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.022	mg/l



Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



ENVIRONMENTAL SCIENCE CORP. Total Trihalomethane Laboratory Report

1910 May's Chapel Rd.
Mt. Juliet, TN 37122
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Report Date: 02/03/93

Public Water Supply: Dickson Water Department

Attn: Mr. Pete VanDoren
206 W. Chestnut St.
Dickson TN 37055

PWSID # : 0000191
Sample # : 00942-93-1
Lab Id # : 02006

Sample Description : Drinking Water - THM's
Collected by : T. Videau
Collection Point : 621 Southerland Road
Collection Date/Time : 01/25/93 09:00
Sample Type : M

The following analysis was performed 01/29/93 by David Fountain

Parameter	Results	Units
Chloroform	0.037	mg/l
Bromodichloromethane	0.011	mg/l
Dibromochloromethane	0.003	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.052	mg/l

*Average for year
1993 0.0527*



Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

1993

Total Trihalomethane Laboratory Report

May 17, 1993

Dickson Water Department
Attn: Mr. Pete VanDoren
205 W. Chestnut St.
Dickson TN 37055

PWSID # : 0000191
Sample # : 07325-93-1
Lab ID # : 02006

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Collection Point : 621 Southerland Road
Collection Date/Time : 04/27/93 11:00
Sample Type : M

The following analyses were performed 05/13/93 by David Fountain.

Parameter	Results	Units
Chloroform	0.062	mg/l
Bromodichloromethane	0.013	mg/l
Dibromochloromethane	0.002	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.078	mg/l

dp:ms_o
init.rev.


Dewey Klahn
Laboratory Manager

4-quarter average
.0675

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.

Total Trihalomethane Laboratory Report

August 16, 1993

Dickson Water Department
Attn: Mr. Pete VanDoren
206 W. Chestnut St.
Dickson TN 37055

PWSID # : 0000191
Sample # : 15993-93-1
Lab ID # : 02006

Sample Description : Drinking Water - THM's
Collected By : John Myatt
Collection Point : 621 Southerland Road
Collection Date/Time : 08/02/93 10:30
Sample Type : M

The following analyses were performed 08/11/93 by David Fountain.

Parameter	Results	Units
Chloroform	0.035	mg/l
Bromodichloromethane	0.008	mg/l
Chlorodibromomethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.045	mg/l

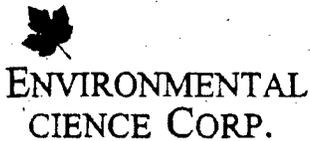
dp: MS 0
init.rev.

Source
Piney
River


Dewey Klahn
Laboratory Manager

5 QUINCY AVE
0.063

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



12065 Lebanon Rd.
 Mt. Juliet, TN 37122-2605
 (615) 758-5858
 1-800-767-5859
 FAX (615) 758-5859
 Est. 1970

Total Trihalomethane Laboratory Report

Dickson Water Department
 Mr. Tony Videau
 206 W. Chestnut St.
 Dickson TN 37055

November 23, 1993

PWSID # : 0000191
 Sample # : 24242-93-1
 Lab ID # : 02006


Sample Description : Drinking Water - THM's
 Collected By : John Myatt
 Collection Point : 621 Southerland Road
 Collection Date/Time : 11/04/93 10:50
 Sample Type : M

The following analyses were performed 11/18/93 by David Fountain.

Parameter	Results	Units
Chloroform	0.027	mg/l
Bromodichloromethane	0.006	mg/l
Chlorodibromomethane	0.002	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane		0.036 mg/l

dp: AC C
 init.rev.

Source
 Piney
 River


 Dewey Klahn
 Laboratory Manager

Please review all information in this report for accuracy and completeness.
 Contact our office within 10 days if there are any questions.

Total Trihalomethane Laboratory Report

Report Date: 01/20/92

Public Water Supply: Dickson Water Department


Attn: Mr. Pete VanDoren
202 South Main Street
Dickson, TN 37055

PWSID # : 0000191
Sample # : 20974-92-1
Lab Id # : 02006

Sample Description : Drinking Water - THM's
Collected by : E. VanDoren
Collection Point : Reed's Truck Stop - Hwy 48 & I40 MAX.
Collection Date/Time : 01/14/92 11:00
Sample Type : M

The following laboratory analysis was performed 01/17/92 by David Fountain

Parameter	Results	Units
Chloroform	0.034	mg/l
Bromodichloromethane	0.005	mg/l
Dibromochloromethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.041	mg/l



Dewey Klahn
Laboratory Manager

1992



1910 May's Chapel Rd.
Mt. Juliet, TN 37122
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Total Trihalomethane Laboratory Report

Report Date: 04/16/92

Public Water Supply: Dickson Water Department

Attn: Mr. Pete VanDoren
202 South Main Street
Dickson TN 37055

PWSID # : 0000191
Sample # : 24568-92-1
Lab Id # : 02006

Sample Description : Drinking Water - THM's
Collected by : E. VanDoren
Collection Point : 621 Southerland Road
Collection Date/Time : 04/13/92 09:30
Sample Type : M

The following analysis was performed 04/15/92 by Randy D. Ward

Parameter	Results	Units
Chloroform	0.072	mg/l
Bromodichloromethane	0.008	mg/l
Dibromochloromethane	<	0.001 mg/l
Bromoform	<	0.001 mg/l
Total Trihalomethane	0.082	mg/l



Dewey Klahn
Laboratory Manager

1992

Total Trihalomethane Laboratory Report

Report Date: 07/10/92

Public Water Supply: Dickson Water Department

Attn: Mr. Pete VanDoren
202 South Main Street
Dickson TN 37055

PWSID # : 0000191
Sample # : 28008-92-1
Lab Id # : 02006

Sample Description : Drinking Water - THM's
Collected by : E. VanDoren
Collection Point : 621 Southerland Road
Collection Date/Time : 07/06/92 10:00
Sample Type : M

The following analysis was performed 07/09/92 by Jill S. Hendrickson, B.S.

Parameter	Results	Units
Chloroform	0.067	mg/l
Bromodichloromethane	0.011	mg/l
Dibromochloromethane	0.005	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.084	mg/l



Dewey Klahn
Laboratory Manager

Total Trihalomethane Laboratory Report

Report Date: 12/11/92

Public Water Supply: Dickson Water Department


Attn: Mr. Pete VanDoren
206 W. Chestnut St.
Dickson TN 37055

PWSID # : 0000191
Sample # : 38240-92-1
Lab Id # : 02006

Sample Description : Drinking Water - THM's
Collected by : E. VanDoren
Collection Point : 621 Southerland Road
Collection Date/Time : 12/01/92 08:30
Sample Type : M

The following analysis was performed 12/11/92 by Dewey Klahn

Parameter	Results	Units
Chloroform	0.042	mg/l
Bromodichloromethane	0.010	mg/l
Dibromochloromethane	0.003	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.056	mg/l



Dewey Klahn
Laboratory Manager

Please review all information in this report for accuracy and completeness.
Contact our office within 10 days if there are any questions.



1910 May's Chapel Rd.
Mt. Juliet, TN 37122
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Total Trihalomethane Laboratory Report

Report Date: 10/11/91

Public Water Supply: Dickson Water Department

Attn: Mr. Pete VanDoren
202 South Main Street
Dickson, TN 37055

PWSID # : 0000191
Sample # : 16794-91-1
Lab Id # : 02006

Sample Description : Drinking Water - THM's
Collected by : E. VanDoren
Collection Point : Reed's Truck Stop - Hwy 48 & I40
Collection Date/Time : 10/07/91 10:00
Sample Type : M

The following laboratory analysis was performed 10/09/91 by Dewey Klahn

Parameter	Results	Units
Chloroform	0.009	mg/l
Bromodichloromethane	0.003	mg/l
Dibromochloromethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.014	mg/l

Sharon Northcutt

Sharon Northcutt, B.S.
Client Services Manager

1991



1910 May's Chapel Rd.
Mt. Juliet, TN 37122
(615) 758-5858
1-800-767-5859
FAX (615) 758-5859
Est. 1970

Total Trihalomethane Laboratory Report

Report Date: 08/28/91

Public Water Supply: Dickson Water Department

Attn: Mr. Pete VanDoren
202 South Main Street
Dickson, TN 37055

PWSID # : 0000191
Sample # : 15044-91-1
Lab Id # : 02006

Sample Description : Drinking Water - THM's
Collected by : E. VanDoren
Collection Point : Reed's Truck Stop - Hwy 48 & I40
Collection Date/Time : 08/20/91 11:10
Sample Type : M

The following laboratory analysis was performed 08/28/91 by Dewey Klahn

Parameter	Results	Units
Chloroform	0.016	mg/l
Bromodichloromethane	0.005	mg/l
Dibromochloromethane	0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.023	mg/l

Sharon C. Northcutt

Sharon Northcutt, B.S.
Client Services Manager



ENVIRONMENTAL SCIENCE

1910 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

FAX
(615) 758-5859

TOLL FREE
1-800-767-5859

Laboratory Report
Total Trihalomethane
Report Date: 05/03/91

REPORT OF ANALYSIS

Public Water Supply: Dickson Water Department
PWSID # : 0000191
Sample # : 10907-91-1
Lab Id # : 02006

*Water source
Cody Lake*

Attn: Mr. Pete VanDoren
202 South Main Street
Dickson, TN 37055

Sample Description : Drinking Water - THM's
Collected by : E. VanDoren
Collection Point : Reed's Truck Stop - Hwy 48 & I40
Collection Date/Time : 04/29/91 10:30
Sample Type : M

The following laboratory analysis was performed 05/02/91 by Dewey Klahn

Parameter	Results	Units
Chloroform	0.058	mg/l
Bromodichloromethane	0.009	mg/l
Dibromochloromethane	< 0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.069	mg/l

Dewey Klahn, B.S.
Senior Organic Chemist

Incorporated 1970



ENVIRONMENTAL SCIENCE

1910 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

FAX
(615) 758-5859

TOLL FREE
1-800-767-5859

Laboratory Report
Total Trihalomethane
Report Date: 01/21/91

REPORT OF ANALYSIS

Public Water Supply: Dickson Water Department

PWSID # : 0000191

Sample # : 07323-91-1

Lab Id # : 02006

Attn: Mr. Mike Shelton
202 South Main Street
Dickson, TN 37055

Sample Description : THM
Collected by : J. Myatt
Collection Point : Reed Truck Stop Hwy 48 & I40
Collection Date/Time : 01/15/91 10:30
Sample Type : M

The following laboratory analysis was performed 01/19/91 by Dewey Klahn

Parameter	Results	Units
Chloroform	0.040	mg/l
Bromodichloromethane	0.005	mg/l
Dibromochloromethane	<	0.001 mg/l
Bromoform	<	0.001 mg/l
Total Trihalomethane	0.047	mg/l



Dewey Klahn, B.S.
Senior Organic Chemist

Incorporated 1970



ENVIRONMENTAL SCIENCE

1910 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

FAX
(615) 758-5859

TOLL FREE
1-800-767-5859

Laboratory Report
Total Trihalomethane
Report Date: 11/14/90

REPORT OF ANALYSIS

Public Water Supply: Dickson Water Department
PWSID # : 0000191
Sample # : 05373-90-1
Lab Id # : 02006

Attn: Mr. Mike Shelton
202 South Main Street
Dickson, TN 37055

Sample Description : THM - Maximum Residence
Collected by : E. Van Doren
Collection Point : Reed Truck Stop Hwy 48 & I40
Collection Date/Time : 10/29/90 10:00
Sample Type : M

The following laboratory analysis was performed 10/30/90 by Dewey Klahn

Parameter	Results	Units
Chloroform	0.012	mg/l
Bromodichloromethane	0.004	mg/l
Chlorodibromomethane	0.001	mg/l
Bromoform	< 0.001	mg/l
Total Trihalomethane	0.018	mg/l

Piney Run 0.0335 yearly average
Dewey Klahn (row)
Dewey Klahn, B.S.
Senior Organic Chemist

1990

Incorporated 1970



ENVIRONMENTAL SCIENCE

1910 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

FAX
(615) 758-5859

TOLL FREE
1-800-767-5859

Laboratory Report
Total Trihalomethane
Report Date: 07/30/90

Lab ID: 02006

Sample #: 2934

Sample Type: M

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: Reed's Truck Stop, Hwy 48, I-40

Sampled By: E. Van Doren

Date: 07/20/90

Time: 1115

RESULTS:

The following laboratory analysis was performed 07/23/90 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.017 mg/l
Bromodichloromethane	0.005 mg/l
Dibromochloromethane	0.001 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.024 mg/l

Looney River source

Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE

1910 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

FAX
(615) 758-5859

TOLL FREE
1-800-767-5859

Laboratory Report
Total Trihalomethane
Report Date: 04/25/90

Lab ID: 02006

Sample #: 2618

Sample Type: M

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: Reed's Truck Stop, Hwy 48, I-40

Sampled By: E. Van Doren

Date: 04/19/90

Time: 1300

RESULTS:

The following laboratory analysis was performed 04/23/90 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.040 mg/l
Bromodichloromethane	0.009 mg/l
Dibromochloromethane	0.001 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.051 mg/l

City Lake source

Randy D. Ward
Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE

1910 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

FAX
(615) 758-5859

TOLL FREE
1-800-767-5859

Laboratory Report
Total Trihalomethane
Report Date: 03/23/90

Lab ID: 02006

Sample #: 2415

Sample Type: M

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: Reed Truck Stop, Hwy 48 & I-40

Sampled By: E. Van Doren

Date: 02/20/90

Time: 1330

RESULTS:

The following laboratory analysis was performed 02/25/90 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.033 mg/l
Bromodichloromethane	0.006 mg/l
Dibromochloromethane	0.001 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.041 mg/l

Randy O. Ward

Dewey Klahn, B.S.
Senior Chemist

Incorporated 1970

CITY OF DICKSON

202 S. MAIN STREET
Water Department
DICKSON, TENNESSEE 37055

January 29, 1990

Mr. David Draughon, Director
Division of Water Supply
Tennessee Department of Health & Environment
150 Ninth Avenue North
Nashville, Tennessee 37219


Re: Reduction in THM analyses for Dickson Filtration Plant
PWSID: 0000191

Dear Mr. Draughon:

I understand that, in accordance with Code of Federal Regulations-141.30 (b) (2), if a utility's water is consistently found to contain less than 0.1 mg/l of TTHM's it is possible to have this monitoring requirement reduced to one sample per quarter instead of four.

I believe the record shows that we have met this criteria over the past year. We therefore respectfully request that you consider granting us this reduction.

Sincerely,



T. Larry Gardner
Superintendent

TLG/bn

cc: WP ✓

Enclosure



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

History of Concentration of Trihalomethanes In Drinking Water

January 25, 1990

Dickson Filtration Plant

Quarter	Date of Samples	Individual Values*	Average for Quarter	Cumulative Average For Year **
Apr-June 1988	Apr 7	64 59 58 59	60.00	
July-Sept 1988	Aug 2	21 26 17 12	19.00	
Oct-Dec 1988	Nov 29	17 22 24 14	19.25	
Jan-Mar 1989	Jan 24	78 69 62 74	70.75	42
Apr-June 1989	Apr 11	89 98 86 88	90.25	50
July-Sept 1989	Sep 12	39 56 21	38.67	55

* All concentration values given in parts per billion (ppb).

** Rounded to the nearest ppb.

Incorporated 1970

January 30, 1990

Mr. David Draughon, Director
Division of Water Supply
Tennessee Dept. of Health
and Environment
150 Ninth Avenue North
Nashville, TN 37219

Subject: Reduction in THM analyses for Dickson Filtration Plant
PWSID: 0000191

Dear Mr. Draughon:

I understand that, in accordance with Code of Federal Regulations-141.30(b)(2), if a utility's water is consistently found to contain less than 0.1 mg/l of TTHM's it is possible to have this monitoring requirement reduced to one sample per quarter instead of four.

I believe the record shows that we have met this criteria over the past year. We therefore respectfully request that you consider granting us this reduction.

Sincerely,

T. Larry Gardner
Supt.

Attn: Bureau of THM in our Drinking Water

ty to: WP



TENNESSEE DEPARTMENT OF HEALTH AND ENVIRONMENT

Bureau of Environment
T.E.R.R.A. BUILDING
150 NINTH AVENUE NORTH
NASHVILLE, TENNESSEE 37219-5404

February 2, 1990

Mr. Larry Gardner, Superintendent
Water Department
City of Dickson
202 S. Main St.
Dickson, TN 37055

RE: Dickson Water System
Reduction in Trihalomethane Samples
PWSID 0000191

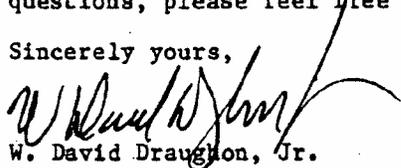
Dear Mr. Gardner:

The Division of Water Supply has reviewed your request for a reduction in the number of trihalomethane samples collected from the distribution system. Under Regulation 1200-5-1-.23(6) the Division of Water Supply has the authority to do this provided the results of one years sampling indicates the system did not exceed the standard based on the quarterly averages. While all of the quarterly averages have been below the standard, there have been some individual samples that have been close to the standard.

The Division of Water Supply is reducing the monitoring frequency to a minimum of one sample per quarter. This sample must be taken at a point which represents the maximum contact time of the water with chlorine. The Dickson Water System may continue to monitor TTHM's at the rate of one maximum contact sample per quarter until at such time as any sample exceeds the standard of 0.10 mg/l. If a check sample confirms that the level of TTHM is above the standard of 0.10 mg/l, the Dickson Water System shall immediately begin monitoring at the rate of four samples per quarter and will continue to monitor at this frequency until the results of at least a years worth of sampling indicates that the water will meet the TTHM standard of 0.10 mg/l. Please review rule 1200-5-1-.23(6) to ensure that you understand all of the requirements associated with this reduction.

This reduced monitoring frequency will begin immediately. If you have any questions, please feel free to call me.

Sincerely yours,


W. David Draughon, Jr.
Director
Division of Water Supply

WDD/E5120032/D4/DWS

cc: Division of Water Supply - Nashville



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 12/12/89

Lab ID: 02006

Sample #: 2250

Sample Type: M

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: Reed Truck Stop, Hwy 48 & I-40

Sampled By: E. Van Doren

Date: 11/14/89

Time: 1100

RESULTS:

The following laboratory analysis was performed 12/04/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.032 mg/l
Bromodichloromethane	0.009 mg/l
Dibromochloromethane	0.002 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.044 mg/l

Dewey Klahn, B.S.
Senior Chemist

1989



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 12/12/89

Lab ID: 02006

Sample #: 2250

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: County Garage, Hwy 48-N

Sampled By: E. Van Doren

Date: 11/14/89

Time: 1130

RESULTS:

The following laboratory analysis was performed 12/04/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.017 mg/l
Bromodichloromethane	0.007 mg/l
Dibromochloromethane	0.002 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.027 mg/l

Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 12/12/89

Lab ID: 02006

Sample #: 2250

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: West Meade Market, Hwy 70-W

Sampled By: E. Van Doren

Date: 11/14/89

Time: 1200

RESULTS:

The following laboratory analysis was performed 12/04/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
richloromethane	0.039 mg/l
Bromodichloromethane	0.008 mg/l
Dibromochloromethane	0.002 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.050 mg/l

Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 12/12/89

Lab ID: 02006

Sample #: 2250

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: All-St. Pest Cont., W. College

Sampled By: E. Van Doren

Date: 11/14/89

Time: 1230

RESULTS:

The following laboratory analysis was performed 12/04/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.013 mg/l
Bromodichloromethane	0.006 mg/l
Dibromochloromethane	0.002 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.022 mg/l

Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

History of Concentration of Trihalomethanes In Drinking Water

December 12, 1989

Dickson Filtration Plant

Quarter	Date of Samples	Individual Values*	Average for Quarter	Cumulative Average For Year **
Apr-June 1988	Apr 7	64 59 58 59	60.00	
July-Sept 1988	Aug 2	21 26 17 12	19.00	
Oct-Dec 1988	Nov 29	17 22 24 14	19.25	
Jan-Mar 1989	Jan 24	78 69 62 74	70.75	42
Apr-June 1989	Apr 11	89 98 86 88	90.25	50
July-Sept 1989	Sep 12	31 39 56 21	36.75	54
Oct-Dec 1989	Nov 14	44 27 50 22	35.75	58

* All concentration values given in parts per billion (ppb).

** Rounded to the nearest ppb.

Incorporated 1970

Tennessee Department of Health and Environment
CHEMICAL ANALYSIS REPORT FORM

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 W. Chestnut Street
Dickson, TN 37055

Sample Type Key
C-Check Sample
D-Regular Distrib.
P-Plant Tap Sample
R-Raw Water Sample
S-Special Sample
M-Maximum Time

FWSID Number							Transaction Code			Mo. Day Yr.				Sample Type	Sample Time							
0	0	0	0	1	9	1	0	9	0	1	2	4	8	9	M	1	2	2	1			
1				7			8	9	36				41	42					43			46

Collected by E. Van Doren

Location

0	0	1
---	---	---

 Reed Truck Stop, Hwy 48 & I-40
Street and House Number
33 35

Lab Name Environmental Science and Engineering Corporation

Lab ID

0	0	2	0	5
---	---	---	---	---

47 51

Cont. ID (10-13)	Name	Method (14-16)	Sign (17)	Results (mg/l) (18-21)	Dec. (22)	Analysis Date (27-32)			Analyzed by													
						Mo.	Day	Yr.														
	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>2</td></tr></table>	0	0	6	2	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn
2	1	5																				
0	0	6	2																			
3																						
0	1	2	6	8	9																	
	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>4</td></tr></table>	0	0	1	4	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn
2	1	5																				
0	0	1	4																			
3																						
0	1	2	6	8	9																	
	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn
2	1	5																				
0	0	0	1																			
3																						
0	1	2	6	8	9																	
	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn
2	1	5																				
0	0	0	1																			
3																						
0	1	2	6	8	9																	
2950	Total Trihalomethane *	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>7</td><td>8</td></tr></table>	0	0	7	8	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn
2	1	5																				
0	0	7	8																			
3																						
0	1	2	6	8	9																	

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

* Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems, analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

* Sign: , , +, -

Tennessee Department of Health and Environment
CHEMICAL ANALYSIS REPORT FORM

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 W. Chestnut Street
Dickson, TN 37055

Sample Type Key
C-Check Sample
D-Regular Distrib.
P-Plant Tap Sample
R-Raw Water Sample
S-Special Sample
M-Maximum Time

PWSID Number						Transaction Code			Mo.	Day	Yr.	Sample Type	Sample Time							
0	0	0	0	1	9	1	0	9	0	1	2	4	8	9	D	1	2	4	7	
1				7			8	9	36				41	42					43	46

Collected by E. Van Doren

Location

0	0	1
---	---	---

 County Garage, Hwy 48-N
Street and House Number
33 35

Lab Name Environmental Science and Engineering Corporation

Lab ID

0	0	2	0	5
---	---	---	---	---

47 51

Cont. ID (10-13)	Name	Method (14-16)	Sign (17)	Results(mg/l) (18-21)	Dec. (22)	Analysis Date (27-32)			Analyzed by														
						Mo.	Day	Yr.															
	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<table border="1"><tr><td></td></tr></table>		<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>2</td></tr></table>	0	0	6	2	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn
2	1	5																					
0	0	6	2																				
3																							
0	1	2	6	8	9																		
	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<table border="1"><tr><td></td></tr></table>		<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>5</td></tr></table>	0	0	0	5	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn
2	1	5																					
0	0	0	5																				
3																							
0	1	2	6	8	9																		
	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn	
2	1	5																					
0	0	0	1																				
3																							
0	1	2	6	8	9																		
	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn	
2	1	5																					
0	0	0	1																				
3																							
0	1	2	6	8	9																		
2950	Total Trihalomethane *	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<table border="1"><tr><td></td></tr></table>		<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>9</td></tr></table>	0	0	6	9	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9		D. Klahn
2	1	5																					
0	0	6	9																				
3																							
0	1	2	6	8	9																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

* Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems, analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

* Sign: , , +, -

Tennessee Department of Health and Environment
CHEMICAL ANALYSIS REPORT FORM

Total Trihalomethane

Sample Type Key
C-Check Sample
D-Regular Distrib.
P-Plant Tap Sample
R-Raw Water Sample
S-Special Sample
M-Maximum Time

Public Water Supply
Name and Address

Dickson Filtration Plant
206 W. Chestnut Street
Dickson, TN 37055

PWSID Number							Transaction Code			Mo.	Day	Yr.	Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	1	2	4	8	9	D	1	3	1	0	
1				7			8	9	36				41	42					43	46

Collected by E. Van Doren

Location

0	0	1
---	---	---

 West Meade Market, Hwy 70-W
Street and House Number
33 35

Lab Name Environmental Science and Engineering Corporation

Lab ID

0	0	2	0	5
---	---	---	---	---

47 51

Cont. ID (10-13)	Name	Method (14-16)	Sign (17)	Results(mg/l) (18-21)	Dec. (22)	Analysis Date (27-32)			Analyzed by														
						Mo.	Day	Yr.															
	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>5</td><td>5</td></tr></table>	0	0	5	5	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	5	5																				
3																							
0	1	2	6	8	9																		
	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>5</td></tr></table>	0	0	0	5	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	0	5																				
3																							
0	1	2	6	8	9																		
	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	0	1																				
3																							
0	1	2	6	8	9																		
	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	0	1																				
3																							
0	1	2	6	8	9																		
2950	Total Trihalomethane *	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>2</td></tr></table>	0	0	6	2	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	6	2																				
3																							
0	1	2	6	8	9																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

* Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems, analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

* Sign: , , +, -

Tennessee Department of Health and Environment
CHEMICAL ANALYSIS REPORT FORM

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 W. Chestnut Street
Dickson, TN 37055

Sample Type Key
C-Check Sample
D-Regular Distrib.
P-Plant Tap Sample
R-Raw Water Sample
S-Special Sample
M-Maximum Time

PWSID Number							Transaction Code			Mo.	Day	Yr.	Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	1	2	4	8	9	D	1	3	2	4	
1				7			8	9	36				41	42					43	46

Collected by E. Van Doren

Location

0	0	1
---	---	---

 All-St. Pest Cont., W. College Street and House Number
33 35

Lab Name Environmental Science and Engineering Corporation

Lab ID

0	0	2	0	5
---	---	---	---	---

47 51

Cont. ID (10-13)	Name	Method (14-16)	Sign (17)	Results(mg/l) (18-21)	Dec. (22)	Analysis Date (27-32)			Analyzed by														
						Mo.	Day	Yr.															
	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>6</td></tr></table>	0	0	6	6	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	6	6																				
3																							
0	1	2	6	8	9																		
	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>6</td></tr></table>	0	0	0	6	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	0	6																				
3																							
0	1	2	6	8	9																		
	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	0	1																				
3																							
0	1	2	6	8	9																		
	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	0	1																				
3																							
0	1	2	6	8	9																		
2950	Total Trihalomethane *	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>7</td><td>4</td></tr></table>	0	0	7	4	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>1</td><td>2</td><td>6</td><td>8</td><td>9</td></tr></table>	0	1	2	6	8	9			D. Klahn
2	1	5																					
0	0	7	4																				
3																							
0	1	2	6	8	9																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

* Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems, analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

* Sign: , , +, -



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 09/28/89

Lab ID: 02006

Sample #: 1897

Sample Type: M

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: Reed Truck Stop, Hwy 48 & I-40

Sampled By: E. Van Doren


Date: 09/12/89

Time: 1100

RESULTS:

The following laboratory analysis was performed 09/21/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.020 mg/l
Bromodichloromethane	0.007 mg/l
Dibromochloromethane	0.003 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.031 mg/l


Dewey Klahn, B.S.
Senior Chemist

Incorporated 1970



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 09/28/89

Lab ID: 02006

Sample #: 1897

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: County Garage, Hwy 48-N

Sampled By: E. Van Doren

Date: 09/12/89

Time: 1130

RESULTS:

The following laboratory analysis was performed 09/21/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.029 mg/l
Bromodichloromethane	0.007 mg/l
Dibromochloromethane	0.002 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.039 mg/l

Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 09/28/89

Lab ID: 02006

Sample #: 1897

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: West Meade Market, Hwy 70-W

Sampled By: E. Van Doren

Date: 09/12/89

Time: 1340

RESULTS:

The following laboratory analysis was performed 09/21/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.045 mg/l
Bromodichloromethane	0.008 mg/l
Dibromochloromethane	0.002 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.056 mg/l

Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 09/28/89

Lab ID: 02006

Sample #: 1897

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: All-St. Pest Cont., W. College

Sampled By: E. Van Doren


Date: 09/12/89

Time: 1350

RESULTS:

The following laboratory analysis was performed 09/21/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.013 mg/l
Bromodichloromethane	0.005 mg/l
Dibromochloromethane	0.002 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.021 mg/l


Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE AND ENGINEERING CORP.

1776 MAYS CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report Total Trihalomethane Report Date: 04/19/89

Lab ID: 00205

Sample #: 1492

Sample Type: M

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: Reed Truck Stop, Hwy 48 & I-40

Sampled By: E. Van Doren

Date: 04/11/89

Time: 1300

RESULTS:

The following laboratory analysis was performed 04/14/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.080 mg/l
Bromodichloromethane	0.007 mg/l
Dibromochloromethane	none detected @ 0.001 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.089 mg/l

Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE
AND ENGINEERING CORP.

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 04/19/89

Lab ID: 00205

Sample #: 1492

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: County Garage, Hwy 48-N

Sampled By: E. Van Doren


Date: 04/11/89

Time: 1330

RESULTS:

The following laboratory analysis was performed 04/14/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.083 mg/l
Bromodichloromethane	0.013 mg/l
Dibromochloromethane	0.001 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.098 mg/l


Dewey Klahn, B.S.
Senior Chemist



ENVIRONMENTAL SCIENCE
AND ENGINEERING CORP.

1776 MAY'S CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 04/19/89

Lab ID: 00205

Sample #: 1492

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: West Meade Market, Hwy 70-W

Sampled By: E. Van Doren


Date: 04/11/89

Time: 1350

RESULTS:

The following laboratory analysis was performed 04/14/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.072 mg/l
monochlorodichloromethane	0.012 mg/l
monobromochloromethane	0.001 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.086 mg/l


Dewey Klahn, B.S.
Senior Chemist

Incorporated 1970



ENVIRONMENTAL SCIENCE AND ENGINEERING CORP.

1776 MAYS CHAPEL ROAD
MT. JULIET, TENN. 37122

PHONE
(615) 758-5858

Laboratory Report
Total Trihalomethane
Report Date: 04/19/89

Lab ID: 00205

Sample #: 1492

Sample Type: D

Public Water Supply: Dickson Filtration Plant

PWSID: 0000191

Sampling Location: All-St. Pest Cont., W. College

Sampled By: E. Van Doren


Date: 04/11/89

Time: 1400

RESULTS:

The following laboratory analysis was performed 04/14/89 by Dewey Klahn utilizing EPA method 501.1 for the following regulated compounds:

Parameter	Concentration
Trichloromethane	0.076 mg/l
Bromodichloromethane	0.010 mg/l
Dibromochloromethane	none detected @ 0.001 mg/l
Tribromomethane	none detected @ 0.001 mg/l
Total Trihalomethane	0.088 mg/l


Dewey Klahn, B.S.
Senior Chemist

Incorporated 1970

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																																								
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> <tr><td>1</td><td></td><td></td><td></td><td></td><td></td><td>7</td></tr> </table>	0	0	0	0	1	9	1	1						7	<table border="1"> <tr><td>0</td><td>9</td></tr> <tr><td>8</td><td>9</td></tr> </table>	0	9	8	9	<table border="1"> <tr><td>1</td><td>1</td><td>2</td><td>9</td><td>8</td><td>8</td></tr> <tr><td>36</td><td></td><td></td><td></td><td></td><td>41</td></tr> </table>	1	1	2	9	8	8	36					41	<table border="1"> <tr><td>0</td></tr> <tr><td>42</td></tr> </table>	0	42	<table border="1"> <tr><td>1</td><td>1</td><td>0</td><td>5</td></tr> <tr><td>43</td><td></td><td></td><td>46</td></tr> </table>	1	1	0	5	43			46
0	0	0	0	1	9	1																																						
1						7																																						
0	9																																											
8	9																																											
1	1	2	9	8	8																																							
36					41																																							
0																																												
42																																												
1	1	0	5																																									
43			46																																									

Collected by F. Van Doren Location 001 All-State Pest Cont., 802 W College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 0 9	3	1	2	0 2 8 8	D. Klahn
2950	Bromodichloromethane	2 1 5		0 0 0 3	3	1	2	0 2 8 8	D. Klahn
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	1	2	0 2 8 8	D. Klahn
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	0 2 8 8	D. Klahn
2950	Total Trihalomethane*	2 1 5		0 0 1 4	3	1	2	0 2 8 8	D. Klahn

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: ., +, -

1988

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date						Sample Type	Sample Time			
0	0	0	0	1	9	1	0	9	1	1	2	9	8	8	D	1	0	5	1
1						7	8	9	36				41	42	43				46

Collected by E. Van Doren Location 0001 West Meade Market, Hwy 70 W
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 1 8	3	1	2	0 2 8 8	D. Klahn
2950	Bromodichloromethane	2 1 5		0 0 0 4	3	1	2	0 2 8 8	D. Klahn
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	1	2	0 2 8 8	D. Klahn
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	0 2 8 8	D. Klahn
2950	Total Trihalomethane*	2 1 5		0 0 2 4	3	1	2	0 2 8 8	D. Klahn

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	<input type="checkbox"/>	Sample Time					
0	0	0	0	1	9	1	0	9	1	1	2	9		8	8	0	1	0	4
1						7	8	9	36			41	42		43				46

Collected by F. Van Doren Location 01011 County Garage, Hwy 48 N
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 1 6	3	1	2	0 2 8 8	D. Klahn
2950	Bromodichloromethane	2 1 5		0 0 0 4	3	1	2	0 2 8 8	D. Klahn
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	1	2	0 2 8 8	D. Klahn
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	0 2 8 8	D. Klahn
2950	Total Trihalomethane*	2 1 5		0 0 2 2	3	1	2	0 2 8 8	D. Klahn

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. **Results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: , , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>1</td><td>2</td><td>9</td><td>8</td><td>8</td></tr> </table>	1	1	2	9	8	8	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>1</td><td>0</td><td>1</td><td>6</td></tr> </table>	1	0	1	6
0	0	0	0	1	9	1																		
0	9																							
1	1	2	9	8	8																			
M																								
1	0	1	6																					
1 7	8 9	36 41	42	43 46																				

Collected by F. Van Doren Location 0001 Reed Truck Stop, I-40 at Hwy 48 S.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID I-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By													
						Mo.	Day	Yr.														
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>2</td></tr></table>	0	0	1	2	3	<table border="1"><tr><td>1</td><td>2</td><td>0</td><td>2</td><td>8</td><td>8</td></tr></table>	1	2	0	2	8	8			D. Klahn
2	1	5																				
0	0	1	2																			
1	2	0	2	8	8																	
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>3</td></tr></table>	0	0	0	3	3	<table border="1"><tr><td>1</td><td>2</td><td>0</td><td>2</td><td>8</td><td>8</td></tr></table>	1	2	0	2	8	8			D. Klahn
2	1	5																				
0	0	0	3																			
1	2	0	2	8	8																	
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	3	<table border="1"><tr><td>1</td><td>2</td><td>0</td><td>2</td><td>8</td><td>8</td></tr></table>	1	2	0	2	8	8			D. Klahn
2	1	5																				
0	0	0	1																			
1	2	0	2	8	8																	
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	3	<table border="1"><tr><td>1</td><td>2</td><td>0</td><td>2</td><td>8</td><td>8</td></tr></table>	1	2	0	2	8	8			D. Klahn
2	1	5																				
0	0	0	1																			
1	2	0	2	8	8																	
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>7</td></tr></table>	0	0	1	7	3	<table border="1"><tr><td>1</td><td>2</td><td>0</td><td>2</td><td>8</td><td>8</td></tr></table>	1	2	0	2	8	8			D. Klahn
2	1	5																				
0	0	1	7																			
1	2	0	2	8	8																	

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 W. Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time
0 0 0 0 1 9 1	0 9	0 4 0 7 8 8	M	0 9 0 5
1 7	8 9	36 41	42	43 46

Collected by E. Van Doren Location 001 Reed Truck Stop
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 5 5	3	0 4 1 5 8 8	R. Celia		
2950	Bromodichloromethane	2 1 5		0 0 0 7	3	0 4 1 5 8 8	R. Celia		
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0 4 1 5 8 8	R. Celia		
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 4 1 5 8 8	R. Celia		
2950	Total Trihalomethane*	2 1 5		0 0 6 4	3	0 4 1 5 8 8	R. Celia		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: ., +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 W. Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	4	0	7	8	8	0	0	9	3	5
1						7	8	9	36			41	42	43				46	

Collected by E. Van Doren Location 0011 County Garage
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (2-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 5 1	3	0	4	1 5 8 8	R. Celia
2950	Bromodichloromethane	2 1 5		0 0 0 6	3	0	4	1 5 8 8	R. Celia
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0	4	1 5 8 8	R. Celia
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	4	1 5 8 8	R. Celia
2950	Total Trihalomethane*	2 1 5		0 0 5 9	3	0	4	1 5 8 8	R. Celia

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 W. Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	4	0	7	8	8	D	1	0	4	0
1						7	8	9	36			41	42	43				46	

Collected by E. Van Doren Location 007 West Meade Market
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 5 0	3	0	4	1 5 8 8	R. Celia
2950	Bromodichloromethane	2 1 5		0 0 0 6	3	0	4	1 5 8 8	R. Celia
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0	4	1 5 8 8	R. Celia
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	4	1 5 8 8	R. Celia
2950	Total Trihalomethane*	2 1 5		0 0 5 8	3	0	4	1 5 8 8	R. Celia

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 W. Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																							
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>Mo.</td><td>Day</td><td>Yr.</td></tr> <tr><td>0</td><td>4</td><td>07</td></tr> <tr><td>8</td><td>8</td><td>8</td></tr> </table>	Mo.	Day	Yr.	0	4	07	8	8	8	<table border="1"> <tr><td>0</td></tr> </table>	0	<table border="1"> <tr><td>1</td><td>0</td><td>5</td><td>0</td></tr> </table>	1	0	5	0
0	0	0	0	1	9	1																					
0	9																										
Mo.	Day	Yr.																									
0	4	07																									
8	8	8																									
0																											
1	0	5	0																								
1 7	8 9	38 41	42	43 46																							

Collected by E. Van Doren Location 001 All State Pest Control
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 5 2	3	0	4	1 5 8 8	R. Celia
2950	Bromodichloromethane	2 1 5		0 0 0 5	3	0	4	1 5 8 8	R. Celia
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0	4	1 5 8 8	R. Celia
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	4	1 5 8 8	R. Celia
2950	Total Trihalomethane*	2 1 5		0 0 5 9	3	0	4	1 5 8 8	R. Celia

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

Tennessee Department of Health and Environment
CHEMICAL ANALYSIS REPORT FORM

PH-2112
WAT 12/81

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 W. Chestnut Street
Dickson, TN 37055

Sample Type Key
C-Check Sample
D-Regular Distribution
P-Plant Tap Sample
R-Raw Water Sample
S-Special Sample
M-Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	8	0	2	8	8	M	1	1	1	6
1						7	8	9	36				41	42	43				46

Collected by: E. Van Doren Location: 0 0 1 Reed's Truck Stop, Hwy 48 & I-
33 35 STREET AND HOUSE NUMBER

Lab Name: Environmental Science and Engineering Corporation Lab ID: 0 0 2 0 5
47 51

Cont. ID (10-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 1 4	3	0	8	2 1 8 8	D. Klahn
	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 5	3	0	8	2 1 8 8	D. Klahn
	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	0	8	2 1 8 8	D. Klahn
	Tribromomethane	2 1 5	<	0 0 0 1	3	0	8	2 1 8 8	D. Klahn
2950	Total Trihalomethane**	2 1 5	<input type="checkbox"/>	0 0 2 1	3	0	8	2 1 8 8	D. Klahn

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system: _____

**Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems, analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

Sign: , , +, -

Tennessee Department of Health and Environment
CHEMICAL ANALYSIS REPORT FORM

PH-2112
 WAT 12/81

Total Trihalomethane

Public Water Supply
 Name and Address

Dickson Water Department
 206 W. Chestnut Street
 Dickson, TN 37055

Sample Type Key
 C-Check Sample
 D-Regular Distribution
 P-Plant Tap Sample
 R-Raw Water Sample
 S-Special Sample
 M-Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	8	0	2	8	8	D	1	3	0	0
1						7	8	9	36				41		42	43			46

Collected by: E. Van Doren Location: 001 County Garage, Hwy 48 N.
33 35 STREET AND HOUSE NUMBER

Lab Name: Environmental Science and Engineering Corporation Lab ID: 00205
47 51

Cont. ID (10-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
	Trichloromethane	215	<input type="checkbox"/>	0016	3	0	8	2188	D. Klahn
	Bromodichloromethane	215	<input type="checkbox"/>	0007	3	0	8	2188	D. Klahn
	Dibromochloromethane	215	<input type="checkbox"/>	0002	3	0	8	2188	D. Klahn
	Tribromomethane	215	<	0001	3	0	8	2188	D. Klahn
2950	Total Trihalomethane**	215	<input type="checkbox"/>	0026	3	0	8	2188	D. Klahn

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system: _____

**Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems, analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The **results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: ., +, -

Tennessee Department of Health and Environment
CHEMICAL ANALYSIS REPORT FORM

PH-2112
 WAT 12/81

Total Trihalomethane

Public Water Supply
 Name and Address

Dickson Water Department
 206 W. Chestnut Street
 Dickson, TN 37055

Sample Type Key
 C-Check Sample
 D-Regular Distribution
 P-Plant Tap Sample
 R-Raw Water Sample
 S-Special Sample
 M-Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	8	0	2	8	8	D	1	3	3	0
1						7	8	9	36				41	42	43			46	

Collected by: E. Van Doren Location: 001 West Meade Mkt., Hwy 70 W.
33 35 STREET AND HOUSE NUMBER

Lab Name: Environmental Science and Engineering Corporation Lab ID: 00205
47 51

Cont. ID (10-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
	Trichloromethane	215		0009	3	0	8	2188	D. Klahn
	Bromodichloromethane	215		0005	3	0	8	2188	D. Klahn
	Dibromochloromethane	215		0002	3	0	8	2188	D. Klahn
	Tribromomethane	215	<	0001	3	0	8	2188	D. Klahn
2950	Total Trihalomethane**	215		0017	3	0	8	2188	D. Klahn

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system: _____

**Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems, analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

Sign: , +, -

Tennessee Department of Health and Environment
CHEMICAL ANALYSIS REPORT FORM

PH-2112
 WAT 12/81

Total Trihalomethane

Public Water Supply
 Name and Address

Dickson Water Department
 206 W. Chestnut Street
 Dickson, TN 37055

Sample Type Key
 C-Check Sample
 D-Regular Distribution
 P-Plant Tap Sample
 R-Raw Water Sample
 S-Special Sample
 M-Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	8	0	2	8	8	D	1	3	4	0
1						7	8	9	36				41	42	43				46

Collected by: E. Van Doren Location: 001 All St. Pest Cont., W. College
33 35 STREET AND HOUSE NUMBER

Lab Name: Environmental Science and Engineering Corporation Lab ID: 00205
47 51

Cont. ID (10-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
	Trichloromethane	215	<input type="checkbox"/>	0007	3	0	8	2188	D. Klahn
	Bromodichloromethane	215	<input type="checkbox"/>	0003	3	0	8	2188	D. Klahn
	Dibromochloromethane	215	<input type="checkbox"/>	0001	3	0	8	2188	D. Klahn
	Tribromomethane	215	<	0001	3	0	8	2188	D. Klahn
2950	Total Trihalomethane**	215	<input type="checkbox"/>	0012	3	0	8	2188	D. Klahn

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system: _____

**Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems, analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: , , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>2</td><td>2</td><td>3</td><td>8</td><td>8</td></tr> </table>	0	2	2	3	8	8	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>1</td><td>1</td><td>0</td><td>5</td></tr> </table>	1	1	0	5
0	0	0	0	1	9	1																		
0	9																							
0	2	2	3	8	8																			
M																								
1	1	0	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 Reed's Truck Stop, Hwy 48 & I-40
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>5</td><td>8</td></tr></table>	0	0	5	8	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	5	8																				
3																							
0	3	0	3	8	8																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>6</td></tr></table>	0	0	0	6	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	0	6																				
3																							
0	3	0	3	8	8																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	3	0	3	8	8																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	3	0	3	8	8																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>6</td></tr></table>	0	0	6	6	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	6	6																				
3																							
0	3	0	3	8	8																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. **Results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>2</td><td>2</td><td>3</td><td>8</td><td>8</td></tr> </table>	0	2	2	3	8	8	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>4</td><td>1</td><td>5</td></tr> </table>	1	4	1	5
0	0	0	0	1	9	1																		
0	9																							
0	2	2	3	8	8																			
D																								
1	4	1	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 County Garage, Hwy 48 North
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>5</td><td>8</td></tr></table>	0	0	5	8	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	5	8																				
3																							
0	3	0	3	8	8																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>5</td></tr></table>	0	0	0	5	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	0	5																				
3																							
0	3	0	3	8	8																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	3	0	3	8	8																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	3	0	3	8	8																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>5</td></tr></table>	0	0	6	5	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>0</td><td>3</td><td>8</td><td>8</td></tr></table>	0	3	0	3	8	8			A. Zeind
2	1	5																					
0	0	6	5																				
3																							
0	3	0	3	8	8																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>2</td><td>2</td><td>3</td><td>8</td><td>8</td></tr> </table>	0	2	2	3	8	8	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>4</td><td>3</td><td>0</td></tr> </table>	1	4	3	0
0	0	0	0	1	9	1																		
0	9																							
0	2	2	3	8	8																			
D																								
1	4	3	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 West Meade Market, Hwy 70 W
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 4 6	3	0 3	0 3	8 8	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 0 4	3	0 3	0 3	8 8	A. Zeind
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0 3	0 3	8 8	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 3	0 3	8 8	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 0 5 2	3	0 3	0 3	8 8	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . +. -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>2</td><td>2</td><td>3</td><td>8</td><td>8</td></tr> </table>	0	2	2	3	8	8	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>4</td><td>4</td><td>0</td></tr> </table>	1	4	4	0
0	0	0	0	1	9	1																		
0	9																							
0	2	2	3	8	8																			
D																								
1	4	4	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 All State Pest Control, W. College St
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 4 9	3	0	3	0 3 8 8	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 4	3	0	3	0 3 8 8	A. Zeind
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0	3	0 3 8 8	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	3	0 3 8 8	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 5 5	3	0	3	0 3 8 8	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date						Sample Type	<input type="checkbox"/>	Sample Time							
0	0	0	0	1	9	1	0	9	1	2	0	8	8	7	M		1	1	3	0				
1						7	8	9	36					41	42					43				46

Collected by E. Van Doren Location 0011 Black Angus Rest., Hwy 40 & 48
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 9	3	1	2	2 3 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 3	3	1	2	2 3 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1	2	2 3 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	2 3 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 1 4	3	1	2	2 3 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed.

Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of the results.

*Sign: . , +, -

1987

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>0</td><td>8</td><td>8</td><td>7</td></tr> </table>	1	2	0	8	8	7	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>1</td><td>5</td><td>0</td></tr> </table>	1	1	5	0
0	0	0	0	1	9	1																		
0	9																							
1	2	0	8	8	7																			
D																								
1	1	5	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 Tenn. Employment Sec.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 6 4	3	1	2	2 3 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 0 6	3	1	2	2 3 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	1	2	2 3 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	2 3 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 0 7 2	3	1	2	2 3 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of .n results.

*Sign: . +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number							Transaction Code		Sample Date						Sample Type	Sample Time				
0	0	0	0	1	9	1	0	9	1	2	0	8	8	7	D	1	3	3	2	
1						7	8	9	38					41	42	43				46

Collected by E. Van Doren Location 001 County Garage
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (I-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 0 7	3	1	2	2 3 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 2	3	1	2	2 3 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	1	2	2 3 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	2 3 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 1 1	3	1	2	2 3 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																							
<table border="1"> <tr> <td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td> </tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr> <td>0</td><td>9</td> </tr> </table>	0	9	<table border="1"> <tr> <td>Mo.</td><td>Day</td><td>Yr.</td> </tr> <tr> <td>1</td><td>2</td><td>0</td> </tr> <tr> <td>8</td><td>8</td><td>7</td> </tr> </table>	Mo.	Day	Yr.	1	2	0	8	8	7	<table border="1"> <tr> <td>D</td> </tr> </table>	D	<table border="1"> <tr> <td>1</td><td>3</td><td>4</td><td>5</td> </tr> </table>	1	3	4	5
0	0	0	0	1	9	1																					
0	9																										
Mo.	Day	Yr.																									
1	2	0																									
8	8	7																									
D																											
1	3	4	5																								
1 7	8 9	36 41	42	43 46																							

Collected by E. Van Doren Location 001 Al State Pest Control
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 7	3	1	2	2 3 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 2	3	1	2	2 3 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1	2	2 3 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	2 3 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 1 1	3	1	2	2 3 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>9</td><td>0</td><td>8</td><td>8</td><td>7</td></tr> </table>	0	9	0	8	8	7	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>0</td><td>9</td><td>1</td><td>0</td></tr> </table>	0	9	1	0
0	0	0	0	1	9	1																		
0	9																							
0	9	0	8	8	7																			
M																								
0	9	1	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 Black Angus Restaurant
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 6 5	3	0	9	3 0 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 9	3	0	9	3 0 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 4	3	0	9	3 0 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	9	3 0 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 8 9	3	0	9	3 0 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed.

Results of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number 1 0 0 0 0 1 9 1 7	Transaction Code 8 0 9 9	Sample Date 36 Mo. 0 9 0 8 8 7 41 Day Yr.	Sample Type 42 D	Sample Time 43 1 0 3 0 46
-----------------------------------	-----------------------------	--	---------------------	------------------------------

Collected by E. Van Doren Location 0011 Hwy 46 South, Employment Office
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 1 0 2	3	0 9	3 0	8 7	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 1 9	3	0 9	3 0	8 7	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 3	3	0 9	3 0	8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 9	3 0	8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 1 2 5	3	0 9	3 0	8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of results.

*Sign: . +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time
Mo. Day Yr.				
1 0 0 0 0 1 9 1 7	8 0 9 9	36 0 9 0 8 8 7 41	42 D	43 1 1 0 0 46

Collected by E. Van Doren Location 001 County Garage
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 6 0	3	0 9 3 0 8 7			A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 7	3	0 9 3 0 8 7			A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 4	3	0 9 3 0 8 7			A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 9 3 0 8 7			A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 8 2	3	0 9 3 0 8 7			A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . . . +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	<input type="checkbox"/>	Sample Time					
0	0	0	0	1	9	1	0	9	0	9	0	8		8	7	D	1	1	2
1						7	8	9	36				41		42	43			46

Collected by E. Van Doren Location 0011 All State Pest Control
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 6 3	3	0	9	3 0 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 1 7	3	0	9	3 0 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5	□	0 0 0 4	3	0	9	3 0 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	9	3 0 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 0 8 5	3	0	9	3 0 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed.

Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of these results.

*Sign: ., +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>6</td><td>0</td><td>2</td><td>8</td><td>7</td></tr> </table>	0	6	0	2	8	7	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>0</td><td>9</td><td>1</td><td>5</td></tr> </table>	0	9	1	5
0	0	0	0	1	9	1																		
0	9																							
0	6	0	2	8	7																			
M																								
0	9	1	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 Black Angus Rest., Hwy 48 & I-40
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (J-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 6 0	3	0 6	0 3	8 7	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 3	3	0 6	0 3	8 7	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0 6	0 3	8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 6	0 3	8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 7 6	3	0 6	0 3	8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>6</td><td>0</td><td>2</td><td>8</td><td>7</td></tr> </table>	0	6	0	2	8	7	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>0</td><td>9</td><td>4</td><td>0</td></tr> </table>	0	9	4	0
0	0	0	0	1	9	1																		
0	9																							
0	6	0	2	8	7																			
D																								
0	9	4	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 Mini Market, Hwy 46 South
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 6 3	3	0	6	0 3 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 3	3	0	6	0 3 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0	6	0 3 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	6	0 3 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 7 9	3	0	6	0 3 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>6</td><td>0</td><td>2</td><td>8</td><td>7</td></tr> </table>	0	6	0	2	8	7	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>0</td><td>0</td><td>0</td></tr> </table>	1	0	0	0
0	0	0	0	1	9	1																		
0	9																							
0	6	0	2	8	7																			
D																								
1	0	0	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0101 County Garage, Hwy 48 North
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 5 3	3	0 6 0	3 8 7		A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 1	3	0 6 0	3 8 7		A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0 6 0	3 8 7		A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 6 0	3 8 7		A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 6 7	3	0 6 0	3 8 7		A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. **results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	0	6	0	2	8	7	D	1	0	4	8
1						7	8	9	36				41	42	43				46

Collected by E. Van Doren Location 001 All State Pest Cont., W. College St.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 3 0	3	0	6	0 3 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 8	3	0	6	0 3 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0	6	0 3 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	6	0 3 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 4 1	3	0	6	0 3 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of the results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number: 0000191 (1-7)
Transaction Code: 09 (8-9)
Sample Date: Mo. 03 Day 24 Yr. 87 (36-41)
Sample Type: M (42)
Sample Time: 0906 (43-46)

Collected by E. Van Doren Location 001 Angus Rest., Hwy 48 & I-40
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (0-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	<u>215</u>	<input type="checkbox"/>	<u>0045</u>	<u>3</u>	<u>03</u>	<u>30</u>	<u>87</u>	A. Zeind
2950	Bromodichloromethane	<u>215</u>	<input type="checkbox"/>	<u>0019</u>	<u>3</u>	<u>03</u>	<u>30</u>	<u>87</u>	A. Zeind
2950	Dibromochloromethane	<u>215</u>	<input type="checkbox"/>	<u>0001</u>	<u>3</u>	<u>03</u>	<u>30</u>	<u>87</u>	A. Zeind
2950	Tribromomethane	<u>215</u>	<u><</u>	<u>0001</u>	<u>3</u>	<u>03</u>	<u>30</u>	<u>87</u>	A. Zeind
2950	Total Trihalomethane*	<u>215</u>	<input type="checkbox"/>	<u>0066</u>	<u>3</u>	<u>03</u>	<u>30</u>	<u>87</u>	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number							Transaction Code		Sample Date						Sample Type	Sample Time			
0	0	0	0	1	9	1	0	9	0	3	2	4	8	7	D	0	9	3	0
1						7	8	9	36					41	42	43			46

Collected by E. Van Doren Location 0001 Mini Mkt., Hwy 46 S.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 4 3	3	0	3	3 0 8 7	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 6	3	0	3	3 0 8 7	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	0	3	3 0 8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	3	3 0 8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 6 1	3	0	3	3 0 8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>3</td><td>2</td><td>4</td><td>8</td><td>7</td></tr> </table>	0	3	2	4	8	7	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>0</td><td>9</td><td>4</td><td>5</td></tr> </table>	0	9	4	5
0	0	0	0	1	9	1																		
0	9																							
0	3	2	4	8	7																			
D																								
0	9	4	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 County Hwy Dept., Hwy 48 N.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 3 2	3	0 3	3 0	8 7	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 2	3	0 3	3 0	8 7	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	0 3	3 0	8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 3	3 0	8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 4 6	3	0 3	3 0	8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. **Results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>3</td><td>2</td><td>4</td><td>8</td><td>7</td></tr> </table>	0	3	2	4	8	7	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>0</td><td>0</td><td>0</td></tr> </table>	1	0	0	0
0	0	0	0	1	9	1																		
0	9																							
0	3	2	4	8	7																			
D																								
1	0	0	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 All St. Pest Cont., 802 W. College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 2 9	3	0 3	3 0	8 7	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 1	3	0 3	3 0	8 7	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	0 3	3 0	8 7	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 3	3 0	8 7	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 4 2	3	0 3	3 0	8 7	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed.

Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number 1 2 3 4 5 6 7 <u>0 0 0 0 1 9 1</u>	Transaction Code 8 9 <u>0 9</u>	Sample Date Mo. Day Yr. 36 41 <u>1 2 0 2 8 6</u>	Sample Type 42 <u>M</u>	Sample Time 43 46 <u>1 2 4 5</u>
---	---------------------------------------	---	-------------------------------	--

Collected by E. Van Doren Location 0001 Black Angus Rest., Hwy 40 & Hwy 48
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 0 0 2 0 5
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	<u>2 1 5</u>	<input type="checkbox"/>	<u>0 0 6 1</u>	<u>3</u>	<u>1</u>	<u>2</u>	<u>1 6 8 6</u>	A. Zeind
2950	Bromodichloromethane	<u>2 1 5</u>	<input type="checkbox"/>	<u>0 0 1 1</u>	<u>3</u>	<u>1</u>	<u>2</u>	<u>1 6 8 6</u>	A. Zeind
2950	Dibromochloromethane	<u>2 1 5</u>	<input type="checkbox"/>	<u>0 0 0 2</u>	<u>3</u>	<u>1</u>	<u>2</u>	<u>1 6 8 6</u>	A. Zeind
2950	Tribromomethane	<u>2 1 5</u>	<u><</u>	<u>0 0 0 1</u>	<u>3</u>	<u>1</u>	<u>2</u>	<u>1 6 8 6</u>	A. Zeind
2950	Total Trihalomethane*	<u>2 1 5</u>	<input type="checkbox"/>	<u>0 0 7 5</u>	<u>3</u>	<u>1</u>	<u>2</u>	<u>1 6 8 6</u>	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of results.

*Sign: . . . +, -

1986

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	Sample Time						
0	0	0	0	1	9	1	0	9	1	2	0	2		8	6	D	1	3	1
1						7	8	9	36			41	42	43					46

Collected by E. Van Doren Location 001 Mini Market, Highway 46 South
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 4 5	3	1	2	1 6 8 6	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 0 5	3	1	2	1 6 8 6	A. Zeind
2950	Dibromochloromethane	2 1 5	□	0 0 0 1	3	1	2	1 6 8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 6 8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 0 5 2	3	1	2	1 6 8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number: 0 0 0 0 1 9 1 (1-7)
Transaction Code: 0 9 (8-9)
Sample Date: Mo. 1 2, Day 0 2, Yr. 8 6 (36-41)
Sample Type: D (42)
Sample Time: 1 3 3 0 (43-46)

Collected by E. Van Doren Location 0 0 1 County Garage, Highway 48 North
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 0 0 2 0 5
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 6 3	3	1 2	1 6	8 6	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 3	3	1 2	1 6	8 6	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	1 2	1 6	8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1 2	1 6	8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 7 9	3	1 2	1 6	8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key.	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>0</td><td>2</td><td>8</td><td>6</td></tr> </table>	1	2	0	2	8	6	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>3</td><td>4</td><td>5</td></tr> </table>	1	3	4	5
0	0	0	0	1	9	1																		
0	9																							
1	2	0	2	8	6																			
D																								
1	3	4	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 All State Pest Control, 802 W. Colleg
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 5 5	3	1	2	1 6 8 6	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 9	3	1	2	1 6 8 6	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	1	2	1 6 8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 6 8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 6 7	3	1	2	1 6 8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of results.

*Sign: , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>9</td><td>2</td><td>2</td><td>8</td><td>6</td></tr> </table>	0	9	2	2	8	6	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>3</td><td>4</td><td>5</td></tr> </table>	1	3	4	5
0	0	0	0	1	9	1																		
0	9																							
0	9	2	2	8	6																			
D																								
1	3	4	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 Mini Market, Hwy 46 South
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (7-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 6 9	3	1	0	0 3 8 6	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 8	3	1	0	0 3 8 6	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	1	0	0 3 8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	0	0 3 8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 7 9	3	1	0	0 3 8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number: Transaction Code: Sample Date: Mo. Day Yr. Sample Type: Sample Time:

Collected by E. Van Doren Location County Garage, Hwy 48 North
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="text"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="2"/> <input type="text" value="4"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/> <input type="text" value="6"/>	<input type="text" value="8"/> <input type="text" value="6"/>	A. Zeind
2950	Bromodichloromethane	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="text"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="8"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/> <input type="text" value="6"/>	<input type="text" value="8"/> <input type="text" value="6"/>	A. Zeind
2950	Dibromochloromethane	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="text"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="2"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/> <input type="text" value="6"/>	<input type="text" value="8"/> <input type="text" value="6"/>	A. Zeind
2950	Tribromomethane	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="text" value="lt"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="1"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/> <input type="text" value="6"/>	<input type="text" value="8"/> <input type="text" value="6"/>	A. Zeind
2950	Total Trihalomethane*	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="text"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="3"/> <input type="text" value="5"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/> <input type="text" value="6"/>	<input type="text" value="8"/> <input type="text" value="6"/>	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: , , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number: (1-7)

Transaction Code: (8-9)

Sample Date: Mo. Day Yr. (36-41)

Sample Type: (42)

Sample Time: (43-46)

Collected by E. Van Doren Location All St. Pest Cont., 207 W. College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID
47 51

Contaminant ID (J-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="checkbox"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="2"/> <input type="text" value="0"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/>	<input type="text" value="6"/>	A. Zeind
2950	Bromodichloromethane	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="checkbox"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="7"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/>	<input type="text" value="6"/>	A. Zeind
2950	Dibromochloromethane	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="checkbox"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="2"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/>	<input type="text" value="6"/>	A. Zeind
2950	Tribromomethane	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="1"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/>	<input type="text" value="6"/>	A. Zeind
2950	Total Trihalomethane*	<input type="text" value="2"/> <input type="text" value="1"/> <input type="text" value="5"/>	<input type="checkbox"/>	<input type="text" value="0"/> <input type="text" value="0"/> <input type="text" value="3"/> <input type="text" value="0"/>	<input type="text" value="3"/>	<input type="text" value="1"/> <input type="text" value="0"/> <input type="text" value="0"/>	<input type="text" value="3"/> <input type="text" value="8"/>	<input type="text" value="6"/>	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: ., +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>4</td><td>1</td><td>5</td><td>8</td><td>6</td></tr> </table>	0	4	1	5	8	6	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>1</td><td>0</td><td>0</td><td>0</td></tr> </table>	1	0	0	0
0	0	0	0	1	9	1																		
0	9																							
0	4	1	5	8	6																			
M																								
1	0	0	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 Black Angus Rest., Hwy 48 & I-40
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID J-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 3 9	3	0 4	1 8	8 6	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 0 8	3	0 4	1 8	8 6	A. Zeind
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0 4	1 8	8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 4	1 8	8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 0 4 9	3	0 4	1 8	8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number 1 2 3 4 5 6 7 0 0 0 0 1 9 1	Transaction Code 8 9 0 9	Sample Date 36 41 Mo. Day Yr. 0 4 1 5 8 6	Sample Type 42 D	Sample Time 43 46 1 0 3 0
---	---------------------------------------	---	-------------------------------	--

Collected by E. Van Doren Location 001 Mini Market, Hwy 46 S.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (9-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 4 8	3	0 4 1 8 8 6			A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 7	3	0 4 1 8 8 6			A. Zeind
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0 4 1 8 8 6			A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 4 1 8 8 6			A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 5 7	3	0 4 1 8 8 6			A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. **Results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date						Sample Type	<input type="checkbox"/>	Sample Time			
0	0	0	0	1	9	1	0	9	0	4	1	5	8	6	D		1	1	0	0
1						7	8	9	36				41	42		43			46	

Collected by E. Van Doren Location 0011 County Garage, Hwy 48 N.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 3 9	3	0	4	1 8 8 6	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 7	3	0	4	1 8 8 6	A. Zeind
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0	4	1 8 8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	4	1 8 8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 4 8	3	0	4	1 8 8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . +. -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>4</td><td>1</td><td>5</td><td>8</td><td>6</td></tr> </table>	0	4	1	5	8	6	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>1</td><td>1</td><td>5</td></tr> </table>	1	1	1	5
0	0	0	0	1	9	1																		
0	9																							
0	4	1	5	8	6																			
D																								
1	1	1	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 All State Pest Cont., 208 W College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 3 5	3	0	4	1 8 8 6	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 6	3	0	4	1 8 8 6	A. Zeind
2950	Dibromochloromethane	2 1 5	<	0 0 0 1	3	0	4	1 8 8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	4	1 8 8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 4 3	3	0	4	1 8 8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number 1 2 3 4 5 6 7 0 0 0 0 1 9 1	Transaction Code 8 9 0 9	Sample Date 36 41 Mo. Day Yr. 0 1 2 8 8 6	Sample Type 42 M	Sample Time 43 46 1 0 3 0
--	--------------------------------	--	------------------------	---------------------------------

Collected by E. Van Doren Location 001 Black Angus Rest., Hwy 48 & I-40
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 1 3	3	0 1 2 9 8 6	A. Zeind		
2950	Bromodichloromethane	2 1 5		0 0 0 8	3	0 1 2 9 8 6	A. Zeind		
2950	Dibromochloromethane	2 1 5		0 0 0 3	3	0 1 2 9 8 6	A. Zeind		
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 1 2 9 8 6	A. Zeind		
2950	Total Trihalomethane*	2 1 5		0 0 2 5	3	0 1 2 9 8 6	A. Zeind		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: . +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																							
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>Mo.</td><td>Day</td><td>Yr.</td></tr> <tr><td>0</td><td>1</td><td>2</td></tr> <tr><td>8</td><td>8</td><td>6</td></tr> </table>	Mo.	Day	Yr.	0	1	2	8	8	6	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>1</td><td>0</td><td>0</td></tr> </table>	1	1	0	0
0	0	0	0	1	9	1																					
0	9																										
Mo.	Day	Yr.																									
0	1	2																									
8	8	6																									
D																											
1	1	0	0																								
1 7	8 9	36 41	42	43 46																							

Collected by E. Van Doren Location 0011 Mini Market, Hwy 46 S.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By			
						Mo.	Day	Yr.				
2950	Trichloromethane	215		0024	3	0	1	2	9	8	6	A. Zeind
2950	Bromodichloromethane	215		0006	3	0	1	2	9	8	6	A. Zeind
2950	Dibromochloromethane	215		0001	3	0	1	2	9	8	6	A. Zeind
2950	Tribromomethane	215	<	0001	3	0	1	2	9	8	6	A. Zeind
2950	Total Trihalomethane*	215		0032	3	0	1	2	9	8	6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number							Transaction Code		Sample Date						Sample Type	Sample Time								
0	0	0	0	1	9	1	0	9	0	1	2	8	8	6	D	1	1	1	5					
1						7	8	9	36					41	42					43				46

Collected by E. Van Doren Location 0011 County Garage, Hwy 48 N.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 0 9	3	0	1	2 9 8 6	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 6	3	0	1	2 9 8 6	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0	1	2 9 8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	1	2 9 8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 1 8	3	0	1	2 9 8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number							Transaction Code		Sample Date						Sample Type	Sample Time			
0	0	0	0	1	9	1	0	9	0	1	2	8	8	6	D	1	1	3	0
1						7	8	9	36				41	42	43			46	

Collected by E. Van Doren Location 0011 Alstate Pest Control, West College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 0 5	3	0	1	2 9 8 6	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 4	3	0	1	2 9 8 6	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0	1	2 9 8 6	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	1	2 9 8 6	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 1 2	3	0	1	2 9 8 6	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>0</td><td>8</td><td>5</td></tr> </table>	1	2	1	0	8	5	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>0</td><td>8</td><td>3</td><td>0</td></tr> </table>	0	8	3	0
0	0	0	0	1	9	1																		
0	9																							
1	2	1	0	8	5																			
M																								
0	8	3	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 Black Angus Rest., Hwy 48 & I-40
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 1 0	3	1	2	1 2 8 5	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 1 1	3	1	2	1 2 8 5	A. Zeind
2950	Dibromochloromethane	2 1 5	□	0 0 0 2	3	1	2	1 2 8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 2 8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 0 2 4	3	1	2	1 2 8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed.

Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of these results.

*Sign: . , +, -

1985

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>0</td><td>8</td><td>5</td></tr> </table>	1	2	1	0	8	5	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>0</td><td>9</td><td>0</td><td>0</td></tr> </table>	0	9	0	0
0	0	0	0	1	9	1																		
0	9																							
1	2	1	0	8	5																			
D																								
0	9	0	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 Mini Market, Hwy 46 S.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 1 6	3	1	2	1 2 8 5	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 8	3	1	2	1 2 8 5	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1	2	1 2 8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 2 8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 2 6	3	1	2	1 2 8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>0</td><td>8</td><td>5</td></tr> </table>	1	2	1	0	8	5	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>0</td><td>0</td><td>0</td></tr> </table>	1	0	0	0
0	0	0	0	1	9	1																		
0	9																							
1	2	1	0	8	5																			
D																								
1	0	0	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0101 County Garage, Hwy 48 N.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 0 7	3	1	2	1 2 8 5	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 8	3	1	2	1 2 8 5	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	1	2	1 2 8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 2 8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 1 7	3	1	2	1 2 8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of n results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>0</td><td>8</td><td>5</td></tr> </table>	1	2	1	0	8	5	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>3</td><td>3</td><td>0</td></tr> </table>	1	3	3	0
0	0	0	0	1	9	1																		
0	9																							
1	2	1	0	8	5																			
D																								
1	3	3	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 Alstate Pest Control, West College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 0 5	3	1	2	1 2 8 5	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 6	3	1	2	1 2 8 5	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	1	2	1 2 8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 2 8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 1 3	3	1	2	1 2 8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. **Results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: . . . +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number							Transaction Code		Sample Date			Sample Type	<input type="checkbox"/>	Sample Time					
0	0	0	0	1	9	1	0	9	0	7	1	5		8	5	M	0	8	3
1						7	8	9	36			41	42		43			46	

Collected by E. Van Doren Location 0011 Reed Truck Stop
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 1 0	3	0	7	3 1 8 5	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 1	3	0	7	3 1 8 5	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 4	3	0	7	3 1 8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	7	3 1 8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 2 6	3	0	7	3 1 8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system, reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . +, -

Average of all samples 0.0465

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																							
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>Mo.</td><td>Day</td><td>Yr.</td></tr> <tr><td>0</td><td>7</td><td>1</td></tr> <tr><td>5</td><td>8</td><td>5</td></tr> </table>	Mo.	Day	Yr.	0	7	1	5	8	5	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>0</td><td>9</td><td>1</td><td>0</td></tr> </table>	0	9	1	0
0	0	0	0	1	9	1																					
0	9																										
Mo.	Day	Yr.																									
0	7	1																									
5	8	5																									
D																											
0	9	1	0																								
1 7	8 9	36 41	42	43 46																							

Collected by E. Van Doren Location 0011 Mini Market
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>2</td></tr></table>	0	0	6	2	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>7</td><td>3</td><td>1</td><td>8</td><td>5</td></tr></table>	0	7	3	1	8	5			A. Zeind
2	1	5																					
0	0	6	2																				
3																							
0	7	3	1	8	5																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>5</td></tr></table>	0	0	1	5	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>7</td><td>3</td><td>1</td><td>8</td><td>5</td></tr></table>	0	7	3	1	8	5			A. Zeind
2	1	5																					
0	0	1	5																				
3																							
0	7	3	1	8	5																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>3</td></tr></table>	0	0	0	3	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>7</td><td>3</td><td>1</td><td>8</td><td>5</td></tr></table>	0	7	3	1	8	5			A. Zeind
2	1	5																					
0	0	0	3																				
3																							
0	7	3	1	8	5																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>7</td><td>3</td><td>1</td><td>8</td><td>5</td></tr></table>	0	7	3	1	8	5			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	7	3	1	8	5																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>8</td><td>1</td></tr></table>	0	0	8	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>7</td><td>3</td><td>1</td><td>8</td><td>5</td></tr></table>	0	7	3	1	8	5			A. Zeind
2	1	5																					
0	0	8	1																				
3																							
0	7	3	1	8	5																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																							
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>Mo.</td><td>Day</td><td>Yr.</td></tr> <tr><td>0</td><td>7</td><td>1</td></tr> <tr><td>5</td><td>8</td><td>5</td></tr> </table>	Mo.	Day	Yr.	0	7	1	5	8	5	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>0</td><td>9</td><td>4</td><td>0</td></tr> </table>	0	9	4	0
0	0	0	0	1	9	1																					
0	9																										
Mo.	Day	Yr.																									
0	7	1																									
5	8	5																									
D																											
0	9	4	0																								
1 7	8 9	36 41	42	43 46																							

Collected by E. Van Doren Location 001 County Garage
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 3 4	3	0 7	3 1	8 5	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 2	3	0 7	3 1	8 5	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 4	3	0 7	3 1	8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 7	3 1	8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 5 1	3	0 7	3 1	8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date					Sample Type	<input type="checkbox"/>	Sample Time			
0	0	0	0	1	9	1	0	9	0	7	1	5	8	5		D	0	9	5
1						7	8	9	36				41		42	43			46

Collected by E. Van Doren Location 001 802 West College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-18)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 1 5	3	0	7	3 1 8 5	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 8	3	0	7	3 1 8 5	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 4	3	0	7	3 1 8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	7	3 1 8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 2 8	3	0	7	3 1 8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>4</td><td>1</td><td>6</td><td>8</td><td>5</td></tr> </table>	0	4	1	6	8	5	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>0</td><td>8</td><td>3</td><td>5</td></tr> </table>	0	8	3	5
0	0	0	0	1	9	1																		
0	9																							
0	4	1	6	8	5																			
M																								
0	8	3	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 Reed Truck Stop
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID

0	0	2	0	5
---	---	---	---	---

47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>7</td></tr></table>	0	0	1	7	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	1	7																				
3																							
0	4	2	5	8	5																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>7</td></tr></table>	0	0	0	7	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	0	7																				
3																							
0	4	2	5	8	5																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>3</td></tr></table>	0	0	0	3	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	0	3																				
3																							
0	4	2	5	8	5																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	4	2	5	8	5																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>2</td><td>8</td></tr></table>	0	0	2	8	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	2	8																				
3																							
0	4	2	5	8	5																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

0295 Ave

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number							Transaction Code		Sample Date					Sample Type	<input type="checkbox"/>	Sample Time			
0	0	0	0	1	9	1	0	9	0	4	1	6	8	5		D	0	9	0
1						7	8	9	36				41		42	43			46

Collected by E. Van Doren Location 001 Mini Market, Hwy 46 S.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (J-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 2 8	3	0	4	2 5 8 5	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 6	3	0	4	2 5 8 5	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0	4	2 5 8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	4	2 5 8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 3 7	3	0	4	2 5 8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. **results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time
0 0 0 0 1 9 1	0 9	Mo. Day Yr. 0 4 1 6 8 5	D	0 9 3 0
1 7	8 9	36 41	42	43 46

Collected by E. Van Doren Location 001 Country Garage, Hwy 48 N.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 0 0 2 0 5
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 2 0	3	0 4 2 5 8 5	A. Zeind		
2950	Bromodichloromethane	2 1 5		0 0 0 8	3	0 4 2 5 8 5	A. Zeind		
2950	Dibromochloromethane	2 1 5		0 0 0 3	3	0 4 2 5 8 5	A. Zeind		
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 4 2 5 8 5	A. Zeind		
2950	Total Trihalomethane*	2 1 5		0 0 3 2	3	0 4 2 5 8 5	A. Zeind		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>4</td><td>1</td><td>6</td><td>8</td><td>5</td></tr> </table>	0	4	1	6	8	5	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>0</td><td>9</td><td>4</td><td>0</td></tr> </table>	0	9	4	0
0	0	0	0	1	9	1																		
0	9																							
0	4	1	6	8	5																			
D																								
0	9	4	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 All State Pest Control
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID

0	0	2	0	5
---	---	---	---	---

47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>2</td></tr></table>	0	0	1	2	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	1	2																				
3																							
0	4	2	5	8	5																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>5</td></tr></table>	0	0	0	5	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	0	5																				
3																							
0	4	2	5	8	5																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>3</td></tr></table>	0	0	0	3	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	0	3																				
3																							
0	4	2	5	8	5																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	4	2	5	8	5																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>2</td><td>1</td></tr></table>	0	0	2	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>4</td><td>2</td><td>5</td><td>8</td><td>5</td></tr></table>	0	4	2	5	8	5			A. Zeind
2	1	5																					
0	0	2	1																				
3																							
0	4	2	5	8	5																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed.

Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>3</td><td>0</td><td>5</td><td>8</td><td>5</td></tr> </table>	0	3	0	5	8	5	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>0</td><td>9</td><td>1</td><td>0</td></tr> </table>	0	9	1	0
0	0	0	0	1	9	1																		
0	9																							
0	3	0	5	8	5																			
M																								
0	9	1	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 01011 I-40 & Hwy 48, Reed Truck Stop
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (10-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 3 0	3	0 3 1 5 8 5	A. Zeind		
2950	Bromodichloromethane	2 1 5		0 0 0 5	3	0 3 1 5 8 5	A. Zeind		
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	0 3 1 5 8 5	A. Zeind		
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 3 1 5 8 5	A. Zeind		
2950	Total Trihalomethane*	2 1 5		0 0 3 7	3	0 3 1 5 8 5	A. Zeind		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of test results.

*Sign: ., +, -

0.02625
Ann Ave 0.0709

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>3</td><td>0</td><td>5</td><td>8</td><td>5</td></tr> </table>	0	3	0	5	8	5	<table border="1"> <tr><td>0</td></tr> </table>	0	<table border="1"> <tr><td>1</td><td>0</td><td>1</td><td>5</td></tr> </table>	1	0	1	5
0	0	0	0	1	9	1																		
0	9																							
0	3	0	5	8	5																			
0																								
1	0	1	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 Hwy 48N, County Garage
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>9</td></tr></table>	0	0	1	9	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>1</td><td>5</td><td>8</td><td>5</td></tr></table>	0	3	1	5	8	5			A. Zeind
2	1	5																					
0	0	1	9																				
3																							
0	3	1	5	8	5																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>4</td></tr></table>	0	0	0	4	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>1</td><td>5</td><td>8</td><td>5</td></tr></table>	0	3	1	5	8	5			A. Zeind
2	1	5																					
0	0	0	4																				
3																							
0	3	1	5	8	5																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>1</td><td>5</td><td>8</td><td>5</td></tr></table>	0	3	1	5	8	5			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	3	1	5	8	5																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>1</td><td>5</td><td>8</td><td>5</td></tr></table>	0	3	1	5	8	5			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	3	1	5	8	5																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>2</td><td>5</td></tr></table>	0	0	2	5	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>3</td><td>1</td><td>5</td><td>8</td><td>5</td></tr></table>	0	3	1	5	8	5			A. Zeind
2	1	5																					
0	0	2	5																				
3																							
0	3	1	5	8	5																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>3</td><td>0</td><td>5</td><td>8</td><td>5</td></tr> </table>	0	3	0	5	8	5	<table border="1"> <tr><td>0</td></tr> </table>	0	<table border="1"> <tr><td>1</td><td>0</td><td>3</td><td>0</td></tr> </table>	1	0	3	0
0	0	0	0	1	9	1																		
0	9																							
0	3	0	5	8	5																			
0																								
1	0	3	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 01011 802 W. College, All State Pest Cont.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (J-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 1 6	3	0	3	1 5 8 5	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 3	3	0	3	1 5 8 5	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	0	3	1 5 8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	3	1 5 8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 2 1	3	0	3	1 5 8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. **Results** of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>3</td><td>0</td><td>5</td><td>8</td><td>5</td></tr> </table>	0	3	0	5	8	5	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>0</td><td>4</td><td>5</td></tr> </table>	1	0	4	5
0	0	0	0	1	9	1																		
0	9																							
0	3	0	5	8	5																			
D																								
1	0	4	5																					
1 7	8 9	38 41	42	43 46																				

Collected by E. Van Doren Location 001 Hwy 46S, Mini Market
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 1 7	3	0 3	1 5	8 5	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 0 3	3	0 3	1 5	8 5	A. Zeind
2950	Dibromochloromethane	2 1 5	□	0 0 0 1	3	0 3	1 5	8 5	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 3	1 5	8 5	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 0 2 2	3	0 3	1 5	8 5	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>8</td><td>8</td><td>4</td></tr> </table>	1	2	1	8	8	4	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>1</td><td>0</td><td>4</td><td>5</td></tr> </table>	1	0	4	5
0	0	0	0	1	9	1																		
0	9																							
1	2	1	8	8	4																			
M																								
1	0	4	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0001 Reed's Truck Stop, I-40 & Hwy 48
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 3 6	3	1 2	2 1	8 4	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 1 0	3	1 2	2 1	8 4	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 2	3	1 2	2 1	8 4	A. Zeind
2950	Tribromomethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1 2	2 1	8 4	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 4 9	3	1 2	2 1	8 4	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

Ave. 04175

*Sign: . , +, -

Ann Ave 0.0726875

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

~~Dickson Water Department~~
~~206 West Chestnut Street~~
~~Dickson, TN 37055~~

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																							
<table border="1"> <tr> <td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td> </tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr> <td>0</td><td>9</td> </tr> </table>	0	9	<table border="1"> <tr> <td>Mo.</td><td>Day</td><td>Yr.</td> </tr> <tr> <td>1</td><td>2</td><td>1</td> </tr> <tr> <td>8</td><td>8</td><td>4</td> </tr> </table>	Mo.	Day	Yr.	1	2	1	8	8	4	<table border="1"> <tr> <td>D</td> </tr> </table>	D	<table border="1"> <tr> <td>1</td><td>1</td><td>1</td><td>0</td> </tr> </table>	1	1	1	0
0	0	0	0	1	9	1																					
0	9																										
Mo.	Day	Yr.																									
1	2	1																									
8	8	4																									
D																											
1	1	1	0																								
1 7	8 9	36 41	42	43 46																							

Collected by E. Van Doren Location 001 Mini-Market, Hwy 46S
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant	Name	Method (14-18)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By	
						Mo.	Day	Yr.		
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 3 1	3	1	2	2	1 8 4	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 7	3	1	2	2	1 8 4	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1	2	2	1 8 4	A. Zeind
2950	Tribromomethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1	2	2	1 8 4	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 4 0	3	1	2	2	1 8 4	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>8</td><td>8</td><td>4</td></tr> </table>	1	2	1	8	8	4	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>1</td><td>2</td><td>5</td></tr> </table>	1	1	2	5
0	0	0	0	1	9	1																		
0	9																							
1	2	1	8	8	4																			
D																								
1	1	2	5																					
1 7	8 9	36 41	42	43 48																				

Collected by E. Van Doren Location 01011 All State Pest Cont., West College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 2 8	3	1	2	2 1 8 4	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 8	3	1	2	2 1 8 4	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1	2	2 1 8 4	A. Zeind
2950	Tribromomethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1	2	2 1 8 4	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 3 8	3	1	2	2 1 8 4	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least **four water samples** for each treatment plant used by the system. At least **25 percent** of the samples shall be taken at locations within the distribution system reflecting the **maximum residence time** of the water in the system. The remaining **75 percent** shall be taken at **representative locations** in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be **arithmetically averaged** and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	—Check Sample
D	—Regular Distribution
P	—Plant Tap Sample
R	—Raw Water Sample
S	—Special Sample
M	—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>8</td><td>8</td><td>4</td></tr> </table>	1	2	1	8	8	4	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>3</td><td>1</td><td>5</td></tr> </table>	1	3	1	5
0	0	0	0	1	9	1																		
0	9																							
1	2	1	8	8	4																			
D																								
1	3	1	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 Senior Citizen Center
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 2 8	3	1	2	2 1 8 4	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 0 9	3	1	2	2 1 8 4	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 2	3	1	2	2 1 8 4	A. Zeind
2950	Tribromomethane	2 1 5	<input type="checkbox"/>	0 0 0 1	3	1	2	2 1 8 4	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 4 0	3	1	2	2 1 8 4	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>8</td><td>0</td><td>3</td><td>8</td><td>4</td></tr> </table>	0	8	0	3	8	4	<table border="1"> <tr><td>M</td></tr> </table>	M	<table border="1"> <tr><td>1</td><td>0</td><td>3</td><td>0</td></tr> </table>	1	0	3	0
0	0	0	0	1	9	1																		
0	9																							
0	8	0	3	8	4																			
M																								
1	0	3	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 001 Angus Rest., Hwy 48 & I-40
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 8 6	3	0 8	0 6	8 4	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 1 3	3	0 8	0 6	8 4	A. Zeind
2950	Dibromochloromethane	2 1 5	□	0 0 0 2	3	0 8	0 6	8 4	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 8	0 6	8 4	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 1 0 2	3	0 8	0 6	8 4	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

Quarterly 0.09775
Ann ave 0.0754375

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>8</td><td>0</td><td>3</td><td>8</td><td>4</td></tr> </table>	0	8	0	3	8	4	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>1</td><td>0</td><td>0</td></tr> </table>	1	1	0	0
0	0	0	0	1	9	1																		
0	9																							
0	8	0	3	8	4																			
D																								
1	1	0	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0101 Mini Mart, Hwy 46 South
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (J-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 8 4	3	0 8	0 6	8 4	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 2	3	0 8	0 6	8 4	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0 8	0 6	8 4	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0 8	0 6	8 4	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 9 9	3	0 8	0 6	8 4	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>8</td><td>0</td><td>3</td><td>8</td><td>4</td></tr> </table>	0	8	0	3	8	4	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>1</td><td>2</td><td>0</td></tr> </table>	1	1	2	0
0	0	0	0	1	9	1																		
0	9																							
0	8	0	3	8	4																			
D																								
1	1	2	0																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 All State Pest Cont., West College
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>7</td><td>6</td></tr></table>	0	0	7	6	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>8</td><td>0</td><td>6</td><td>8</td><td>4</td></tr></table>	0	8	0	6	8	4			A. Zeind
2	1	5																					
0	0	7	6																				
3																							
0	8	0	6	8	4																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>4</td></tr></table>	0	0	1	4	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>8</td><td>0</td><td>6</td><td>8</td><td>4</td></tr></table>	0	8	0	6	8	4			A. Zeind
2	1	5																					
0	0	1	4																				
3																							
0	8	0	6	8	4																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>2</td></tr></table>	0	0	0	2	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>8</td><td>0</td><td>6</td><td>8</td><td>4</td></tr></table>	0	8	0	6	8	4			A. Zeind
2	1	5																					
0	0	0	2																				
3																							
0	8	0	6	8	4																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>8</td><td>0</td><td>6</td><td>8</td><td>4</td></tr></table>	0	8	0	6	8	4			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	8	0	6	8	4																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>9</td><td>3</td></tr></table>	0	0	9	3	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>8</td><td>0</td><td>6</td><td>8</td><td>4</td></tr></table>	0	8	0	6	8	4			A. Zeind
2	1	5																					
0	0	9	3																				
3																							
0	8	0	6	8	4																		

The maximum contaminant level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number							Transaction Code		Sample Date				Sample Type	<input type="checkbox"/>	Sample Time				
0	0	0	0	1	9	1	0	9	0	8	0	3	8		4	D	1	3	1
1						7	8	9	36				41	42		43			46

Collected by E. Van Doren Location 0001 Sr. Citizen Center., Walnut Street
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	<input type="checkbox"/>	0 0 8 0	3	0	8	0 6 8 4	A. Zeind
2950	Bromodichloromethane	2 1 5	<input type="checkbox"/>	0 0 1 4	3	0	8	0 6 8 4	A. Zeind
2950	Dibromochloromethane	2 1 5	<input type="checkbox"/>	0 0 0 2	3	0	8	0 6 8 4	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	8	0 6 8 4	A. Zeind
2950	Total Trihalomethane*	2 1 5	<input type="checkbox"/>	0 0 9 7	3	0	8	0 6 8 4	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>3</td><td>8</td><td>3</td></tr> </table>	1	2	1	3	8	3	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>0</td><td>9</td><td>5</td><td>3</td></tr> </table>	0	9	5	3
0	0	0	0	1	9	1																		
0	9																							
1	2	1	3	8	3																			
D																								
0	9	5	3																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 01011 Piccadilly Rest., 701 West Walnut
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (3-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 3 6	3	1	2	1 5 8 3	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 7	3	1	2	1 5 8 3	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	1	2	1 5 8 3	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 5 8 3	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 4 5	3	1	2	1 5 8 3	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of each results.

*Sign: ., +, -

Annual
0.08755

1983

.05275

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																																								
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> <tr><td>1</td><td></td><td></td><td></td><td></td><td></td><td>7</td></tr> </table>	0	0	0	0	1	9	1	1						7	<table border="1"> <tr><td>0</td><td>9</td></tr> <tr><td>8</td><td>9</td></tr> </table>	0	9	8	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>3</td><td>8</td><td>3</td></tr> <tr><td>36</td><td></td><td></td><td></td><td></td><td>41</td></tr> </table>	1	2	1	3	8	3	36					41	<table border="1"> <tr><td>D</td></tr> <tr><td>42</td></tr> </table>	D	42	<table border="1"> <tr><td>1</td><td>0</td><td>0</td><td>9</td></tr> <tr><td>43</td><td></td><td></td><td>46</td></tr> </table>	1	0	0	9	43			46
0	0	0	0	1	9	1																																						
1						7																																						
0	9																																											
8	9																																											
1	2	1	3	8	3																																							
36					41																																							
D																																												
42																																												
1	0	0	9																																									
43			46																																									

Collected by E. Van Doren Location 0001 Sears, Highway 46 South
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant (D J-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 3 6	3	1	2	1 5 8 3	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 0 6	3	1	2	1 5 8 3	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 1	3	1	2	1 5 8 3	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 5 8 3	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 4 4	3	1	2	1 5 8 3	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>1</td><td>2</td><td>1</td><td>3</td><td>8</td><td>3</td></tr> </table>	1	2	1	3	8	3	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>0</td><td>2</td><td>5</td></tr> </table>	1	0	2	5
0	0	0	0	1	9	1																		
0	9																							
1	2	1	3	8	3																			
D																								
1	0	2	5																					
1 7	8 9	36 41	42	43 46																				

Collected by E. Van Doren Location 0011 J & N Market, Highway 70 East
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID 0-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>4</td><td>9</td></tr></table>	0	0	4	9	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>1</td><td>2</td><td>1</td><td>5</td><td>8</td><td>3</td></tr></table>	1	2	1	5	8	3			A. Zeind
2	1	5																					
0	0	4	9																				
3																							
1	2	1	5	8	3																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>7</td></tr></table>	0	0	0	7	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>1</td><td>2</td><td>1</td><td>5</td><td>8</td><td>3</td></tr></table>	1	2	1	5	8	3			A. Zeind
2	1	5																					
0	0	0	7																				
3																							
1	2	1	5	8	3																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>1</td><td>2</td><td>1</td><td>5</td><td>8</td><td>3</td></tr></table>	1	2	1	5	8	3			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
1	2	1	5	8	3																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>1</td><td>2</td><td>1</td><td>5</td><td>8</td><td>3</td></tr></table>	1	2	1	5	8	3			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
1	2	1	5	8	3																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>5</td><td>8</td></tr></table>	0	0	5	8	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>1</td><td>2</td><td>1</td><td>5</td><td>8</td><td>3</td></tr></table>	1	2	1	5	8	3			A. Zeind
2	1	5																					
0	0	5	8																				
3																							
1	2	1	5	8	3																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed.

The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . . . +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

Dickson Filtration Plant
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date					Sample Type	Sample Time				
0	0	0	0	1	9	1	0	9	1	2	1	3	8	3	M	1	0	4	0
1						7	8	9	36				41		42	43			46

Collected by E. Van Doren Location 0011 County Highway Dept., Rt. 6, Box 39H
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID J-13	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5	□	0 0 5 2	3	1	2	1 5 8 3	A. Zeind
2950	Bromodichloromethane	2 1 5	□	0 0 1 0	3	1	2	1 5 8 3	A. Zeind
2950	Dibromochloromethane	2 1 5	□	0 0 0 1	3	1	2	1 5 8 3	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	1	2	1 5 8 3	A. Zeind
2950	Total Trihalomethane*	2 1 5	□	0 0 6 4	3	1	2	1 5 8 3	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. The results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

City of Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number							Transaction Code		Sample Date					Sample Type	Sample Time					
0	0	0	0	1	9	1	0	9	0	9	2	3	8	3	M	1	3	1	0	
1						7	8	9	36					41	42	43				46

Collected by Larry Gardner Location 0011 Reed's Truck Stop, Highway 48 South
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (10-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 6 0	3	0	9	2 9 8 3	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 5	3	0	9	2 9 8 3	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0	9	2 9 8 3	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	9	2 9 8 3	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 7 8	3	0	9	2 9 8 3	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: ., +, -

071

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

City of Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	— Check Sample
D	— Regular Distribution
P	— Plant Tap Sample
R	— Raw Water Sample
S	— Special Sample
M	— Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																							
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>Mo.</td><td>Day</td><td>Yr.</td></tr> <tr><td>0</td><td>9</td><td>2</td></tr> <tr><td>3</td><td>8</td><td>3</td></tr> </table>	Mo.	Day	Yr.	0	9	2	3	8	3	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>3</td><td>2</td><td>5</td></tr> </table>	1	3	2	5
0	0	0	0	1	9	1																					
0	9																										
Mo.	Day	Yr.																									
0	9	2																									
3	8	3																									
D																											
1	3	2	5																								
1 7	8 9	36 41	42	43 46																							

Collected by Larry Gardner Location 001 Picadilly Restaurant, Walnut Street
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID

0	0	2	0	5
---	---	---	---	---

47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By															
						Mo.	Day	Yr.																
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>5</td><td>1</td></tr></table>	0	0	5	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td></tr></table>	0	9	2	<table border="1"><tr><td>9</td><td>8</td><td>3</td></tr></table>	9	8	3	<table border="1"><tr><td>3</td></tr></table>	3	A. Zeind
2	1	5																						
0	0	5	1																					
3																								
0	9	2																						
9	8	3																						
3																								
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>3</td></tr></table>	0	0	1	3	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td></tr></table>	0	9	2	<table border="1"><tr><td>9</td><td>8</td><td>3</td></tr></table>	9	8	3	<table border="1"><tr><td>3</td></tr></table>	3	A. Zeind
2	1	5																						
0	0	1	3																					
3																								
0	9	2																						
9	8	3																						
3																								
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>2</td></tr></table>	0	0	0	2	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td></tr></table>	0	9	2	<table border="1"><tr><td>9</td><td>8</td><td>3</td></tr></table>	9	8	3	<table border="1"><tr><td>3</td></tr></table>	3	A. Zeind
2	1	5																						
0	0	0	2																					
3																								
0	9	2																						
9	8	3																						
3																								
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td></tr></table>	0	9	2	<table border="1"><tr><td>9</td><td>8</td><td>3</td></tr></table>	9	8	3	<table border="1"><tr><td>3</td></tr></table>	3	A. Zeind
2	1	5																						
0	0	0	1																					
3																								
0	9	2																						
9	8	3																						
3																								
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>6</td><td>7</td></tr></table>	0	0	6	7	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td></tr></table>	0	9	2	<table border="1"><tr><td>9</td><td>8</td><td>3</td></tr></table>	9	8	3	<table border="1"><tr><td>3</td></tr></table>	3	A. Zeind
2	1	5																						
0	0	6	7																					
3																								
0	9	2																						
9	8	3																						
3																								

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

City of Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key	
C	Check Sample
D	Regular Distribution
P	Plant Tap Sample
R	Raw Water Sample
S	Special Sample
M	Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>9</td><td>2</td><td>3</td><td>8</td><td>3</td></tr> </table>	0	9	2	3	8	3	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>3</td><td>5</td><td>8</td></tr> </table>	1	3	5	8
0	0	0	0	1	9	1																		
0	9																							
0	9	2	3	8	3																			
D																								
1	3	5	8																					
1 7	8 9	36 41	42	43 48																				

Collected by Larry Gardner Location 01011 Kentucky Fried Chicken, Henslee Dr.
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID 00205
47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By
						Mo.	Day	Yr.	
2950	Trichloromethane	2 1 5		0 0 5 1	3	0	9	2 9 8 3	A. Zeind
2950	Bromodichloromethane	2 1 5		0 0 1 3	3	0	9	2 9 8 3	A. Zeind
2950	Dibromochloromethane	2 1 5		0 0 0 2	3	0	9	2 9 8 3	A. Zeind
2950	Tribromomethane	2 1 5	<	0 0 0 1	3	0	9	2 9 8 3	A. Zeind
2950	Total Trihalomethane*	2 1 5		0 0 6 7	3	0	9	2 9 8 3	A. Zeind

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -

**Tennessee Public Health Department
CHEMICAL ANALYSIS REPORT FORM**

Total Trihalomethane

Public Water Supply
Name and Address

City of Dickson Water Department
206 West Chestnut Street
Dickson, TN 37055

Sample Type Key
C—Check Sample
D—Regular Distribution
P—Plant Tap Sample
R—Raw Water Sample
S—Special Sample
M—Maximum Time

PWSID Number	Transaction Code	Sample Date	Sample Type	Sample Time																				
<table border="1"> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>9</td><td>1</td></tr> </table>	0	0	0	0	1	9	1	<table border="1"> <tr><td>0</td><td>9</td></tr> </table>	0	9	<table border="1"> <tr><td>0</td><td>9</td><td>2</td><td>3</td><td>8</td><td>3</td></tr> </table>	0	9	2	3	8	3	<table border="1"> <tr><td>D</td></tr> </table>	D	<table border="1"> <tr><td>1</td><td>3</td><td>4</td><td>2</td></tr> </table>	1	3	4	2
0	0	0	0	1	9	1																		
0	9																							
0	9	2	3	8	3																			
D																								
1	3	4	2																					
1 7	8 9	36 41	42	43 46																				

Collected by Larry Gardner Location 0011 West Side Restaurant, Hwy 70 West
33 35 Street and House Number

Lab Name Environmental Science and Engineering Corporation Lab ID

0	0	2	0	5
---	---	---	---	---

47 51

Contaminant ID (1-13)	Name	Method (14-16)	Sign* (17)	Results (mg/l) (18-21)	Decimal (22)	Analysis Date (27-32)			Analyzed By														
						Mo.	Day	Yr.															
2950	Trichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>5</td><td>6</td></tr></table>	0	0	5	6	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td><td>9</td><td>8</td><td>3</td></tr></table>	0	9	2	9	8	3			A. Zeind
2	1	5																					
0	0	5	6																				
3																							
0	9	2	9	8	3																		
2950	Bromodichloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>1</td><td>4</td></tr></table>	0	0	1	4	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td><td>9</td><td>8</td><td>3</td></tr></table>	0	9	2	9	8	3			A. Zeind
2	1	5																					
0	0	1	4																				
3																							
0	9	2	9	8	3																		
2950	Dibromochloromethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td><td>9</td><td>8</td><td>3</td></tr></table>	0	9	2	9	8	3			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	9	2	9	8	3																		
2950	Tribromomethane	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<	<table border="1"><tr><td>0</td><td>0</td><td>0</td><td>1</td></tr></table>	0	0	0	1	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td><td>9</td><td>8</td><td>3</td></tr></table>	0	9	2	9	8	3			A. Zeind
2	1	5																					
0	0	0	1																				
3																							
0	9	2	9	8	3																		
2950	Total Trihalomethane*	<table border="1"><tr><td>2</td><td>1</td><td>5</td></tr></table>	2	1	5	<input type="checkbox"/>	<table border="1"><tr><td>0</td><td>0</td><td>7</td><td>2</td></tr></table>	0	0	7	2	<table border="1"><tr><td>3</td></tr></table>	3	<table border="1"><tr><td>0</td><td>9</td><td>2</td><td>9</td><td>8</td><td>3</td></tr></table>	0	9	2	9	8	3			A. Zeind
2	1	5																					
0	0	7	2																				
3																							
0	9	2	9	8	3																		

The maximum contaminate level for Total Trihalomethane is 0.10 mg/l.

Name of Water Treatment Plant serving this distribution system _____

*Total Trihalomethane is determined by adding together the results of the trichloromethane, bromodichloromethane, chlorodibromomethane, and tribromomethane results.

For all community water systems analyses for total trihalomethanes shall be performed at quarterly intervals on at least four water samples for each treatment plant used by the system. At least 25 percent of the samples shall be taken at locations within the distribution system reflecting the maximum residence time of the water in the system. The remaining 75 percent shall be taken at representative locations in the distribution system, taking into account number of persons served, different sources of water and different treatment methods employed. Results of all analyses per quarter shall be arithmetically averaged and reported to the State within 30 days of the system's receipt of such results.

*Sign: . , +, -