


Site 3039, Kitchen Sink Faucet, 11/10/2016 and 12/8/2016

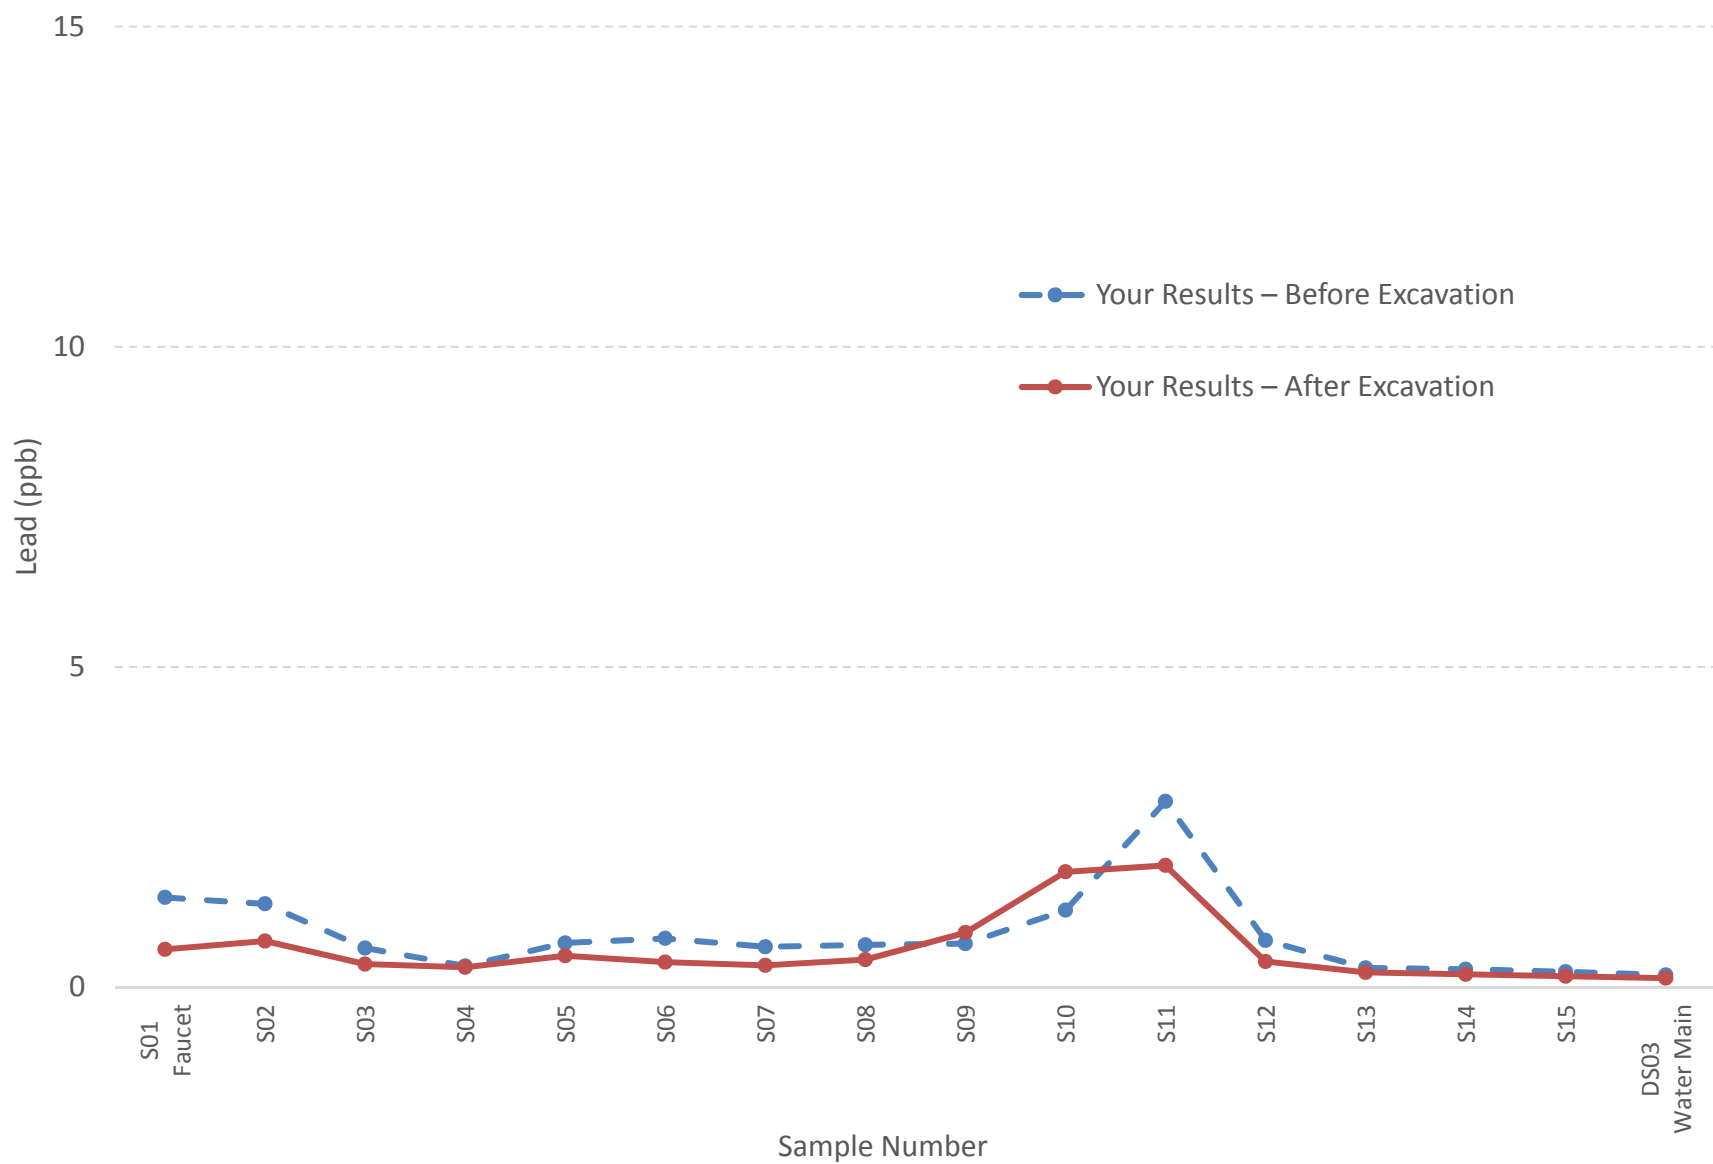

Site 3039 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 11/10/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	0.49	0.86	0.43	0.11 J	0.11 J	0.12 J	0.11 J	0.12 J	0.13 J	0.08 J	0.06 J	0.08 J	0.06 J	0.07 J	0.05 J	0.04 J	5	--	5	--	
Chromium	µg/L	0.64 U	0.68 U	0.58 U	0.64 U	0.65 U	0.67 U	0.67 U	0.67 U	0.67 U	0.63 U	0.66 U	0.68 U	0.89 U	0.72 U	0.65 U	0.69 U	100	--	100	--	
Copper	µg/L	10.3	2.0	1.7	1.9	4.4	3.0	1.9	1.8	2.2	7.3	4.7	2.0	1.7	1.6	1.5	1.2	--	1300	1300	1000	
Lead	µg/L	1.4	1.3	0.61 J	0.33 J	0.69 J	0.76 J	0.63 J	0.66 J	0.68 J	1.2	2.9	0.73 J	0.30 J	0.28 J	0.24 J	0.19 J	--	15	0	--	
Manganese	µg/L	7.1	3.8	4.4	1.9	2.0	1.7	1.3	1.2	1.6	1.8	1.3	1.2	1.2	1.2	1.1	1.0	--	--	--	50	
Nickel	µg/L	5.2	1.2	2.1	1.3	3.5	3.3	1.7	1.2	0.82	1.8	0.94	0.89	1.4	1.5	0.88	1.5	--	--	--	--	
Tin	µg/L	0.07 U	0.09 U	3.1	0.17 U	0.07 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.07 U	1.0 U	--	--	--	--	
Zinc	µg/L	262 J+	309 J+	132 J+	54.9 J+	58.8 J+	74.4 J+	77.9 J+	93.1 J+	81.7 J+	53.4 J+	38.2 J+	32.2 J+	30.3 J+	29.9 J+	27.1 J+	19.7 J+	--	--	--	5000	
Aluminum	mg/L	0.0614	0.0663	0.0841	0.085	0.0844	0.0823	0.0757	0.0759	0.0748	0.0768	0.0779	0.0748	0.0745	0.0751	0.0699	0.0733	--	--	--	0.05 to 0.2	
Calcium	mg/L	33.8	33.4	34.0	35.1	34.4	34.6	34.3	33.9	34.6	34.2	34.2	34.9	34.2	34.0	33.7	35.1	--	--	--	--	
Iron	mg/L	0.113	0.0644 J	0.0382 J	0.0325 J	0.0572 J	0.0451 J	0.100 U	0.0220 J	0.0678 J	0.0971 J	0.0315 J	0.100 U	0.100 U	0.0242 J	0.0139 J	0.100 U	--	--	--	0.3	
Magnesium	mg/L	12.3	12.0	12.2	12.3	12.1	12.3	12.2	12.0	12.3	12.2	12.1	12.4	12.2	12.1	12.0	12.5	--	--	--	--	
Potassium	mg/L	1.68	1.67	1.67	1.73	1.71	1.71	1.69	1.70	1.77	1.68	1.74	1.72	1.71	1.72	1.69	1.76	--	--	--	--	
Sodium	mg/L	11.8	11.8	11.8	12.0	12.0	12.0	11.9	11.8	12.1	12.0	12.0	12.4	12.3	12.2	12.1	12.4	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															103	--	--	--	--	
Chloride	mg/L	Not Sampled															19.0	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.135	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															28.2	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															0.144	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3039 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/8/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.48	0.77	0.34	0.11 J	0.09 J	0.09 J	0.10 J	0.11 J	0.09 J	0.07 J	0.20 U	0.20 U	0.07 J	0.20 U	0.20 U	0.20 U	5	--	5	--
Chromium	µg/L	0.48 J	0.45 J	0.44 J	0.42 J	0.47 J	0.43 J	0.41 J	0.40 J	0.38 J	0.36 J	0.40 J	0.42 J	0.47 J	0.45 J	0.43 J	0.42 J	100	--	100	--
Copper	µg/L	8.1	1.9	1.5	2.2	4.0	2.2	1.7	1.7	3.0	6.6	3.5	1.5	1.3	1.1	1.2	0.86 J	--	1300	1300	1000
Lead	µg/L	0.59 J	0.72 J	0.36 J	0.31 J	0.49 J	0.39 J	0.34 J	0.43 J	0.85 J	1.8	1.9	0.40 J	0.23 J	0.20 J	0.17 J	0.14 J	--	15	0	--
Manganese	µg/L	2.0	0.99 U	1.8	1.0	0.96 U	0.82 U	0.69 U	0.81 U	1.4	1.3	1.1	1.2	1.1	1.1	1.1	0.99 U	--	--	--	50
Nickel	µg/L	6.4	0.95	1.4	0.68	0.63	0.66	0.60	0.61	0.55	0.72	0.59	0.68	0.87	0.56	0.58	0.50 J	--	--	--	--
Tin	µg/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	--	--	--	--
Zinc	µg/L	277	281	125	56.2	50.7	75.7	87.2	99.8	79.4	49.6	35.1	29.8	27.5	26.4	26.6	17.2	--	--	--	5000
Aluminum	mg/L	0.0416 J	0.0490 J	0.0586 J	0.0677 J	0.0598 J	0.0508 J	0.0485 J	0.0504 J	0.0448 J	0.0432 J	0.0450 J	0.0430 J	0.0434 J	0.0410 J	0.0431 J	0.0392 J	--	--	--	0.05 to 0.2
Calcium	mg/L	36.3	35.9	35.7	37.5	37.2	37.3	36.7	36.3	36.2	36.6	36.8	37.4	36.7	36.2	36.7	36.5	--	--	--	--
Iron	mg/L	0.0890 U	0.0479 U	0.0444 U	0.0470 U	0.0467 U	0.100 U	0.016 U	0.0421 U	0.122	0.0796 U	0.0347 U	0.0266 U	0.0183 U	0.0250 U	0.0269 U	0.0236 U	--	--	--	0.3
Magnesium	mg/L	12.6	12.4	12.3	12.6	12.6	12.8	12.6	12.5	12.5	12.6	12.7	12.9	12.7	12.4	12.6	12.6	--	--	--	--
Potassium	mg/L	1.80	1.73	1.78	1.90	1.82	1.85	1.76	1.74	1.79	1.82	1.82	1.81	1.78	1.76	1.82	1.77	--	--	--	--
Sodium	mg/L	11.9	11.7	11.7	12.1	12.0	12.1	11.9	11.8	11.9	11.9	12.0	12.2	12.0	11.8	12.0	12.0	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															106	--	--	--	--
Chloride	mg/L	Not Sampled															16.8	--	--	--	250
Fluoride	mg/L	Not Sampled															0.115	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															26.4	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.198	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3087, Kitchen Faucet, 10/3/2016 and 10/12/2016

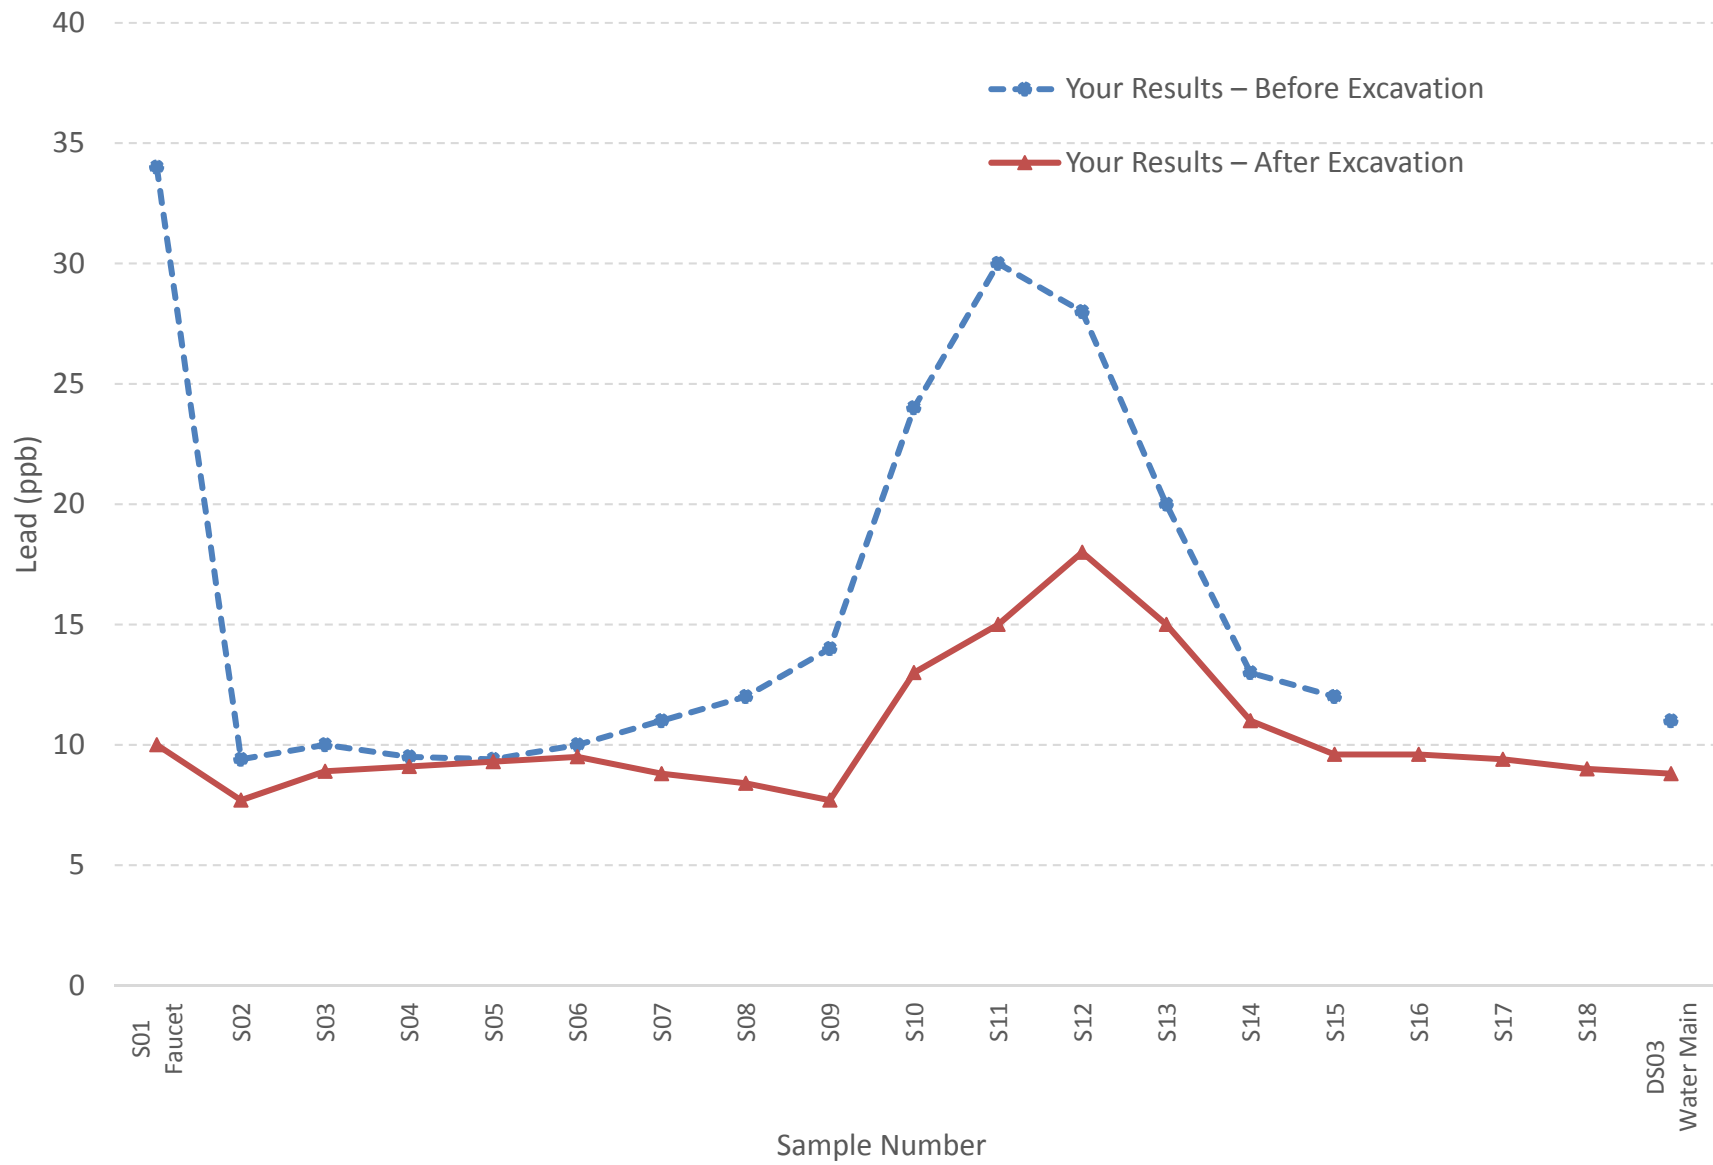

Site 3087 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/3/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	2.6 U	2.6 U	2.6 U	2.8 U	2.6 U	2.7 U	2.9 U	2.5 U	2.8 U	2.9 U	3.3 U	3.0 U	2.8 U	3.0 U	3.0 U	2.4 U	100	--	100	--
Copper	µg/L	25	4.8 U	4.2 U	3.9 U	4.0 U	2.9 U	3.3 U	3.3 U	4.9 U	6.7 U	4.9 U	3.3 U	3.0 U	3.2 U	3.2 U	2.6 U	--	1300	1300	1000
Lead	µg/L	34	9.4	10	9.5	9.4	10	11	12	14	24	30	28	20	13	12	11	--	15	0	--
Manganese	µg/L	34	18	8.6	3.1 J	2.7 J	2.7 J	2.9 J	2.5 J	2.6 J	2.6 J	3.3 J	2.7 J	2.6 J	3.0 J	3.1 J	2.3 J	--	--	--	50
Nickel	µg/L	5.1	2.2 U	2.3 U	1.9 U	1.8 U	1.9 U	2.0 U	1.9 U	2.0 U	2.1 U	2.4 U	2.2 U	2.1 U	2.2 U	2.3 U	1.9 U	--	--	--	--
Zinc	µg/L	140	220	110	40	42	34	38	35	31	27	29	25	24	28	270	18 J	--	--	--	5000
Aluminum	mg/L	0.11 J-	0.085 J-	0.12	0.12 J-	0.12 J-	0.11 J-	0.10 J-	0.099 J-	0.12 J-	0.10 J-	0.11 J-	0.10 J-	0.095 J-	0.11 J-	0.099 J-	0.090 J-	--	--	--	0.05 to 0.2
Calcium	mg/L	38	38	47	43	45	40	39	37	44	37	40	37	36	39	39	35	--	--	--	--
Iron	mg/L	0.21	0.31	0.19	0.076 U	0.082 U	0.071 U	0.069 U	0.063 U	0.076 U	0.063 U	0.070 U	0.063 U	0.059 U	0.069 U	0.065 U	0.081 U	--	--	--	0.3
Magnesium	mg/L	16	15	18	17	17	15	15	14	17	14	16	14	14	15	15.0	13	--	--	--	--
Potassium	mg/L	2.3 J-	2.3 J-	2.9 J-	2.5 J-	2.6 J-	2.3 J-	2.2 J-	2.1 J-	2.5 J-	2.1 J-	2.3 J-	2.1 J-	2.0 J-	2.2 J-	2.2 J-	2.0 J-	--	--	--	--
Sodium	mg/L	14	14	17 J+	15 J+	16 J+	14 J+	14 J+	13 J+	16 J+	13 J+	14 J+	13 J+	13 J+	14 J+	14 J+	12	--	--	--	--
Tin	mg/L	0.0036 U	0.0025 U	0.0036 U	0.0021 U	0.0019 U	0.0016 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.0026 U	0.0022 U	0.020 U	0.020 U	0.0020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															3.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															48.8 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

U = Not detected above the listed reporting limit

J = Estimated

J+ = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

J- = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3087 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 10/12/2016																			Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																	Distribution System					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)						
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--	
Chromium	µg/L	2.4 U	2.7 U	2.7 U	2.7 U	2.7 U	2.7 U	3.3 U	2.6 U	2.5 U	2.3 U	2.5 U	2.6 U	2.7 U	2.8 U	2.6 U	2.6 U	2.7 U	2.2 U	2.8 U	100	--	100	--	
Copper	µg/L	14	3.8 U	4.3 U	2.6 U	3.3 U	2.7 U	2.8 U	3.3 U	3.3 U	5.1 U	2.1 U	2.1 U	2.6 U	2.7 U	2.1 U	1.6 U	2.0 U	1.6 U	1.6 U	--	1300	1300	1000	
Lead	µg/L	10	7.7	8.9	9.1	9.3	9.5	8.8	8.4	7.7	13	15	18	15	11	9.6	9.6	9.4	9.0	8.8	--	15	0	--	
Manganese	µg/L	8.7	5.6	2.4 J	1.9 J	2.2 J	2.0 J	2.0 J	1.9 J	1.7 J	2.0 J	1.6 J	1.8 J	1.8 J	1.8 J	1.8 J	1.9 J	1.9 J	1.8 J	2.0 J	--	--	--	50	
Nickel	µg/L	5.9	1.5 J	1.2 J	1.0 J	1.2 J	1.1 J	1.2 J	1.2 J	0.96 J	1.1 J	0.93 J	1.1 J	1.1 J	1.0 J	0.95 J	1.1 J	1.0 J	0.76 J	1.1 J	--	--	--	--	
Zinc	µg/L	250	170	78	34	34	34	32	32	29	31	22	28	23	24	21	22	23	22	18	--	--	--	5000	
Aluminum	mg/L	0.080	0.080	0.098	0.095	0.10	0.10	0.10	0.098	0.10	0.099	0.097	0.11	0.091	0.096	0.098	0.096	0.11	0.10	0.10	--	--	--	0.05 to 0.2	
Calcium	mg/L	39	38	38	37	38	39	38	38	38	38	37	40	36	37	37	37	39	36	39	--	--	--	--	
Iron	mg/L	0.20	0.081 U	0.077 U	0.072 U	0.072 U	0.072 U	0.076 U	0.068 U	0.11	0.074 U	0.085 U	0.083 U	0.074 U	0.071 U	0.071 U	0.070 U	0.075 U	0.069 U	0.064 U	--	--	--	0.3	
Magnesium	mg/L	14	13	13	13	13	13	14	13	13	13	13	13	12	13	13	13	13	12	13	--	--	--	--	
Potassium	mg/L	1.8	1.7	1.8	1.7	1.7	1.8	1.8	1.7	1.9	1.8	1.8	1.9	1.7	1.7	1.7	1.7	1.8	1.7	1.8	--	--	--	--	
Sodium	mg/L	12 J+	12 J+	12 J+	12 J+	12 J+	12 J+	12 J+	12 J+	12 J+	12 J+	12 J+	13 J+	11 J+	12 J+	12 J+	12 J+	12 J+	11 J+	12	--	--	--	--	
Tin	mg/L	0.0016 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.0020 U	0.020 U	0.020 U	0.020 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled																			120	--	--	--	--
Chloride	mg/L	Not Sampled																			1.0 J	--	--	--	250
Fluoride	mg/L	Not Sampled																			0.15 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																			23.9 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																			0.018 J	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

U = Not detected above the listed reporting limit

J = Estimated

J+ = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

J- = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3097, Kitchen Faucet, 10/29/2016 and 12/3/2016

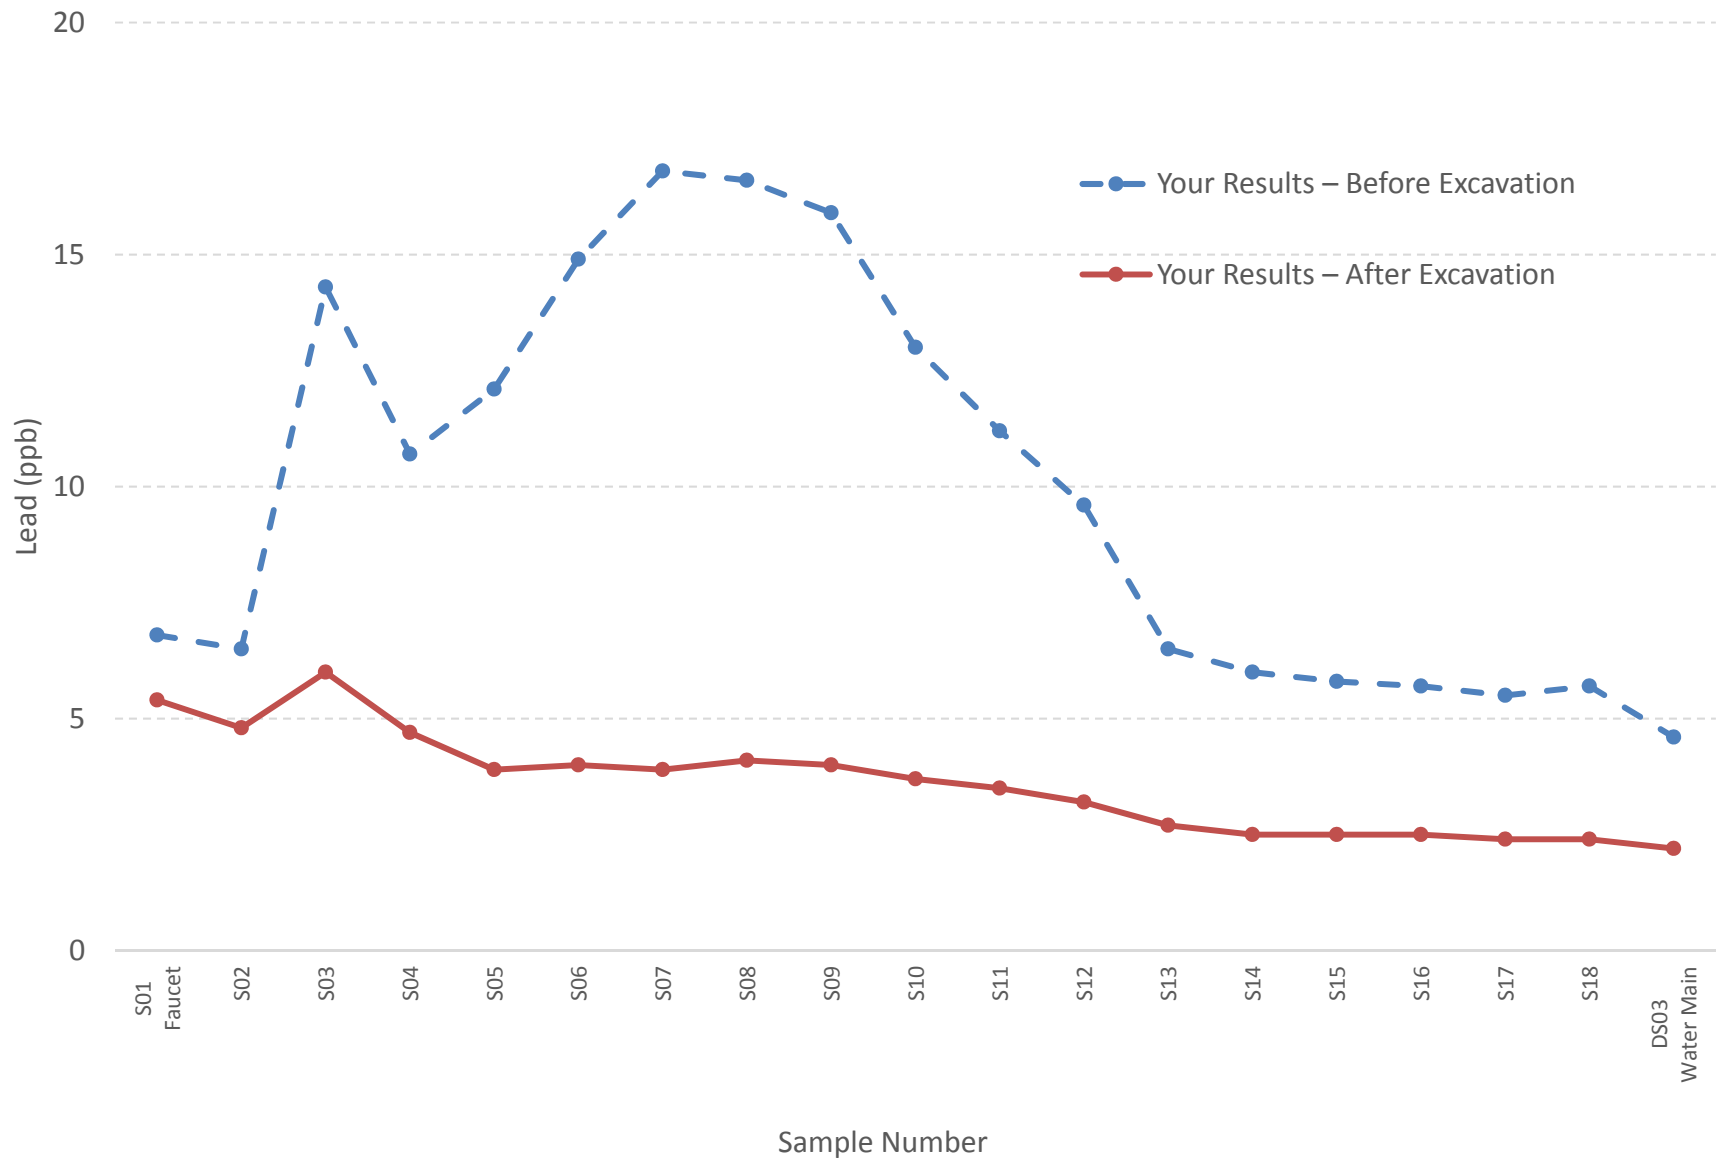

Site 3097 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/29/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	5	--	5	--
Chromium	µg/L	0.63 U	0.66 U	0.62 U	0.65 U	0.63 U	0.63 U	0.64 U	0.64 U	0.67 U	0.60 U	0.60 U	0.60 U	0.67 U	0.65 U	0.66 U	0.64 U	0.63 U	0.66 U	0.62 U	100	--	100	--
Copper	µg/L	15.8	3.2 U	31.4	2.0 U	2.6 U	1.8 U	1.6 U	1.6 U	1.7 U	1.7 U	1.3 U	1.4 U	1.3 U	1.2 U	1.1 U	1.1 U	1.2 U	1.2 U	0.93 U	--	1300	1300	1000
Lead	µg/L	6.8	6.5	14.3	10.7	12.1	14.9	16.8	16.6	15.9	13.0	11.2	9.6	6.5	6.0	5.8	5.7	5.5	5.7	4.6	--	15	0	--
Manganese	µg/L	4.8	0.59 U	2.6	1.3 U	4.1	1.5 U	1.1 U	1.2 U	1.2 U	1.2 U	1.0 U	1.1 U	0.96 U	0.89 U	0.95 U	0.86 U	1.1 U	0.92 U	0.85 U	--	--	--	50
Nickel	µg/L	0.93 U	0.65 U	1.4 U	0.66 U	0.76 U	0.62 U	0.82 U	0.68 U	0.64 U	0.60 U	0.70 U	0.64 U	0.72 U	0.78 U	0.62 U	0.64 U	0.65 U	0.65 U	0.64 U	--	--	--	--
Tin	µg/L	0.32 U	1.0 U	0.16 U	1.0 U	0.18 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	238 J	71.9 J	660 J	32.5 J	18.5 J	12.8 J	12.5 J	12.7 J	11.3 J	11.6 J	9.4 J	10.4 J	10.2 J	9.5 J	9.2 J	8.9 J	10.4 J	9.2 J	6.8 J	--	--	--	5000
Aluminum	mg/L	0.0771	0.0750	0.109	0.0761	0.0767	0.0796	0.0798	0.0799	0.0778	0.0736	0.0757	0.0768	0.0749	0.0711	0.0739	0.0716	0.0708	0.0704	0.0663	--	--	--	0.05 to 0.2
Calcium	mg/L	32.8	34.0	34.3	33.6	34.0	33.6	34.2	33.4	34.5	33.5	33.2	34.2	34.0	33.4	33.7	33.4	33.9	33.5	33.6	--	--	--	--
Iron	mg/L	0.0586 J	0.1 U	0.0187 J	0.1 U	0.1 U	0.0249 J	0.0238 J	0.044 J	0.0209 J	0.026 J	0.1 U	0.1 U	0.1 U	0.1 U	0.0315 J	0.1 U	0.0183 J	0.0248 J	0.1 U	--	--	--	0.3
Magnesium	mg/L	12.0	11.9	12.0	11.9	12.0	11.8	12.1	11.8	12.2	11.9	11.8	12.1	12.0	11.8	11.9	11.8	12.0	11.9	12.0	--	--	--	--
Potassium	mg/L	1.68	1.63	1.64	1.64	1.61	1.62	1.6	1.65	1.65	1.63	1.66	1.70	1.66	1.62	1.64	1.66	1.66	1.64	1.65	--	--	--	--
Sodium	mg/L	11.2	10.9	10.9	10.9	11.1	10.9	11.0	11.1	11.4	11.2	11.1	11.4	11.4	11.2	11.2	11.2	11.4	11.2	11.4	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		104	--	--	--	--
Chloride	mg/L	Not Sampled																		16.5	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.143	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		26.5	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.120	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3097 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/3/2016																		Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U				
Chromium	µg/L	0.42 U	0.42 U	0.39 U	0.35 U	0.38 U	0.41 U	0.71 U	0.38 U	0.39 U	0.42 U	0.38 U	0.40 U	0.41 U	0.42 U	0.38 U	0.36 U	0.39 U	0.42 U	0.39 U	100	--	100	--
Copper	µg/L	13.6	2.3	2.2	1.6	1.5	1.5	1.2	1.1	1.2	1.2	1.1	1.1	0.99 J	0.98 J	0.98 J	1.0	0.93 J	0.98 J	0.85 J	--	1300	1300	1000
Lead	µg/L	5.4	4.8	6.0	4.7	3.9	4.0	3.9	4.1	4.0	3.7	3.5	3.2	2.7	2.5	2.5	2.5	2.4	2.4	2.2	--	15	0	--
Manganese	µg/L	1.8	0.24 U	0.28 U	0.60 J	1.0	0.97 J	0.90 J	0.89 J	0.93 J	1.0 J	0.91 J	0.97 J	0.99 J	1.0	1.0	1.1	1.0	1.0	0.98 J	--	--	--	50
Nickel	µg/L	0.70 U	0.47 U	0.49 U	0.49 U	0.55 U	0.59 U	0.52 U	0.50 U	0.54 U	0.58 U	0.54 U	0.63 U	0.54 U	0.52 U	0.50 U	0.54 U	0.50 U	0.50 U	0.50 U	--	--	--	--
Tin	µg/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	0.13 J	1 U	1 U	1 U	--	--	--	--
Zinc	µg/L	119	60.6	52.0	29.5	15.8	17.9	11.0	10.7	10.4	11.0	8.7	8.5	8.6	8.3	8.3	8.1	7.3	7.9	5.8	--	--	--	5000
Aluminum	mg/L	0.0527	0.0570	0.0695	0.0593	0.0497	0.0445	0.0425	0.0445	0.0443	0.0441	0.0448	0.0452	0.0465	0.0444	0.0457	0.0451	0.0446	0.0439	0.0431	--	--	--	0.05 to 0.2
Calcium	mg/L	35.0	35.0	33.6	35.5	35.3	35.5	31.4	34.6	35.7	36.0	35.3	31.0	35.5	36.0	35.1	35.3	35.1	35.3	34.7	--	--	--	--
Iron	mg/L	0.0582 J	0.1 U	0.1 U	0.1 U	0.0209 J	0.0296 J	0.0228 J	0.0300 J	0.0303 J	0.0277 J	0.0261 J	0.0213 J	0.023 J	0.0332 J	0.0265 J	0.0333 J	0.1 U	0.0286 J	0.0198 J	--	--	--	0.3
Magnesium	mg/L	12.3	12.1	11.5	12.2	12.3	12.3	10.9	12.1	12.4	12.5	12.3	10.8	12.3	12.5	12.2	12.3	12.2	12.3	12.1	--	--	--	--
Potassium	mg/L	1.62	1.62	1.62	1.59	1.66	1.73	1.48	1.58	1.66	1.66	1.61	1.42	1.61	1.68	1.63	1.6	1.62	1.58	1.57	--	--	--	--
Sodium	mg/L	11.2	11.2	11.2	11.1	11.2	11.3	10.2	11.0	11.3	11.4	11.2	10.0	11.2	11.4	11.0	11.2	11.1	11.1	10.9	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		104	--	--	--	--
Chloride	mg/L	Not Sampled																		17.1	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.126	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		26.8	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.193	--	--	--	--


Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3121, Bathroom Sink Faucet, 10/11/2016 and 11/16/2016

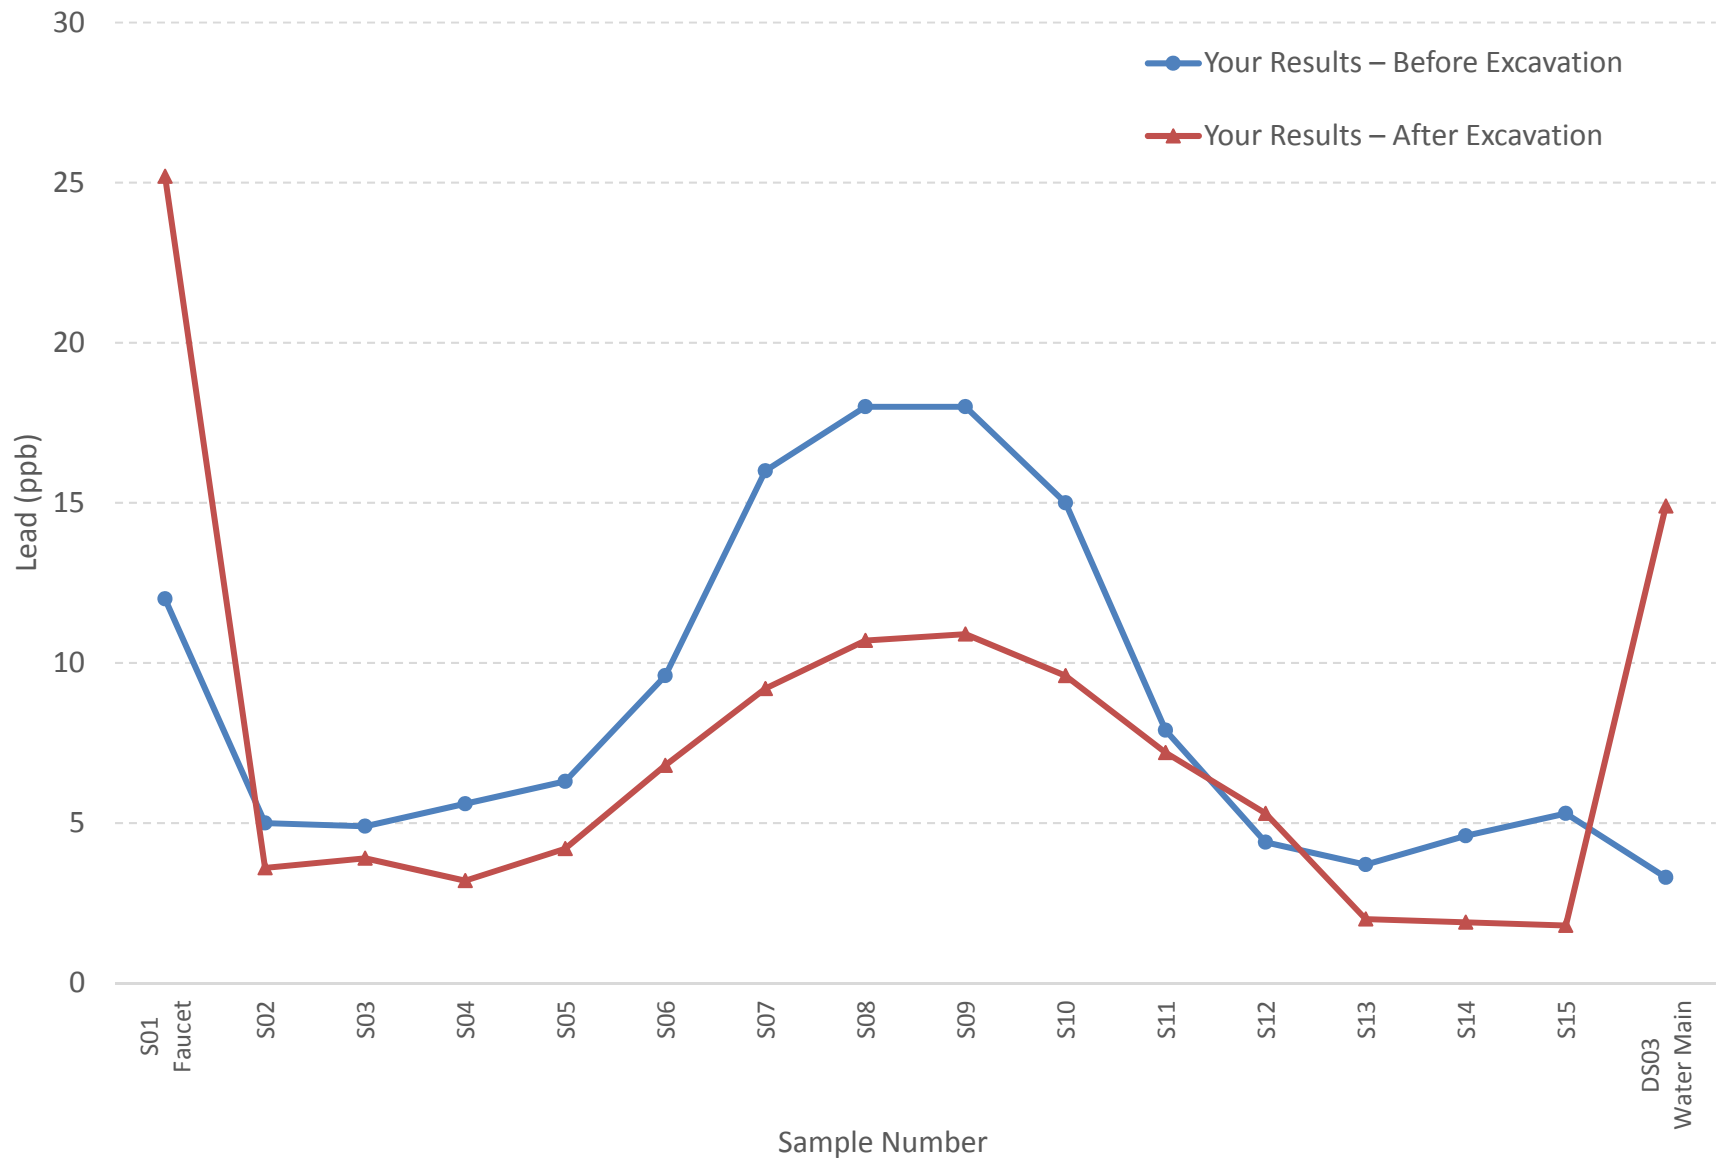

Site 3121 -- Bathroom Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/11/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	1.1 J	1.5 J	0.72 J	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	1.1 J	1.7 J	2.0 U	5	--	5	--	
Chromium	µg/L	2.9 U	3.2 U	3.4 U	4.4	5.1	4.1	3.4 U	3.5 U	3.4 U	3.1 U	3.3 U	3.4 U	3.5 U	4.5	5.2	2.7 U	100	--	100	--	
Copper	µg/L	76	8.4 U	6.6 U	5.2 U	4.9 U	4.0 U	2.5 U	2.4 U	2.3 U	3.1 U	3.0 U	2.4 U	2.7 U	3.1 U	4.1 U	2.2 U	--	1300	1300	1000	
Lead	µg/L	12	5.0	4.9	5.6	6.3	9.6	16	18	18	15	7.9	4.4	3.7	4.6	5.3	3.3	--	15	0	--	
Manganese	µg/L	1.7 J	1.4 J	1.2 J	2.1 J	2.6 J	1.7 J	0.98 J	1.2 J	1.0 J	1.1 J	1.5 J	2.1 J	2.2 J	3.3 J	4.1	2.4 U	--	--	--	50	
Nickel	µg/L	40	4.0 U	3.6 U	3.3 U	3.8 U	2.9 U	2.0 U	2.0 U	1.9 U	1.9 U	2.0 U	1.9 U	1.9 U	2.9 U	3.6 U	2.0 U	--	--	--	--	
Zinc	µg/L	290	31	23	15 J	18 J	9.8 J	6.2 J	9.2 J	5.6 J	7.5 J	5.0 J	6.1 J	5.8 J	8.4 J	9.4 J	5.2 J	--	--	--	5000	
Aluminum	mg/L	0.090	0.088	0.098	0.098	0.10	0.093	0.097	0.096	0.093	0.094	0.092	0.13	0.094	0.091	0.093	0.096	--	--	--	0.05 to 0.2	
Calcium	mg/L	37	36	39	38	39	37	39	39	38	38	38	38	37	38	38	38	--	--	--	--	
Iron	mg/L	0.077 J	0.032 J	0.029 J	0.024 J	0.027 J	0.031 J	0.025 J	0.024 J	0.029 J	0.023 J	0.040 J	0.12	0.069 J	0.069 J	0.072 J	0.087 J	--	--	--	0.3	
Magnesium	mg/L	13	13	14	14	14	13	14	14	13	14	14	14	13	13	14.0	14	--	--	--	--	
Potassium	mg/L	1.7	1.6	1.8	1.8	1.7	1.7	1.8	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.8	--	--	--	--	
Sodium	mg/L	12	12	13	13	13	12	13	13	12	13	13	13	12	13	13	13	--	--	--	--	
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--	
Chloride	mg/L	Not Sampled															5.0	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.15 U	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															23.9 J	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															0.018 J	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3121 -- Bathroom Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/16/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.18 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.03 J				
Chromium	µg/L	0.74 U	0.76 U	0.83 U	0.84 U	0.78 U	0.82 U	0.75 U	0.80 U	0.75 U	0.78 U	0.82 U	0.79 U	0.81 U	0.77 U	0.85 U	0.85 U	100	--	100	--
Copper	µg/L	380	15.0	18.2	6.0	3.5	4.2	2.3	1.8	2.3	1.9	1.9	1.6	1.4	1.6	1.7	11.5	--	1300	1300	1000
Lead	µg/L	25.2	3.6	3.9	3.2	4.2	6.8	9.2	10.7	10.9	9.6	7.2	5.3	2.0	1.9	1.8	14.9	--	15	0	--
Manganese	µg/L	1.3	0.43 J	0.49 J	0.51 J	0.42 J	0.47 J	0.44 J	0.45 J	0.40 J	0.47 J	0.79 J	0.66 J	0.76 J	0.75 J	0.81 J	4.8	--	--	--	50
Nickel	µg/L	101	3.5	4.6	2.0	1.3	1.2	0.92	0.93	0.79	0.77	0.89	0.88	0.81	0.82	0.88	2.0	--	--	--	--
Tin	µg/L	1.1	0.07 J	0.12 J	0.07 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.11 J	--	--	--	--
Zinc	µg/L	1230	37.9	40.7	16.0	11.2	10.9	6.2	5.3	5.0	4.4	4.8	4.2	4.4	4.7	5.9	190	--	--	--	5000
Aluminum	mg/L	0.0581	0.0544	0.0574	0.0537	0.0519	0.0502	0.0461	0.0446	0.0445	0.0443	0.0440	0.0424	0.0415	0.0423	0.0421	0.102	--	--	--	0.05 to 0.2
Calcium	mg/L	35.4	35.3	35.0	35.3	35.8	35.1	35.5	34.7	35.2	34.5	35.3	35.4	34.4	34.7	34.9	34.7	--	--	--	--
Iron	mg/L	0.0594 U	0.0459 U	0.0228 U	0.100 U	0.0263 U	0.0138 U	0.0308 U	0.0346 U	0.0157 U	0.0632 U	0.0212 U	0.0263 U	0.0238 U	0.0234 U	0.100 U	0.134	--	--	--	0.3
Magnesium	mg/L	12.1	12.0	11.8	12.0	12.2	12.0	12.1	11.8	12.1	11.8	12.1	12.2	11.8	11.9	12.0	11.9	--	--	--	--
Potassium	mg/L	1.61	1.55	1.60	1.57	1.63	1.60	1.57	1.54	1.60	1.56	1.59	1.60	1.55	1.57	1.61	1.58	--	--	--	--
Sodium	mg/L	11.2	11.0	11.1	11.1	11.3	11.1	11.1	10.8	11.1	11.1	11.2	11.3	10.8	11.1	11.0	11.0	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															104	--	--	--	--
Chloride	mg/L	Not Sampled															17.2	--	--	--	250
Fluoride	mg/L	Not Sampled															0.114	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															29.1	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.183	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3135, Kitchen Faucet, 10/12/2016 and 11/3/2016

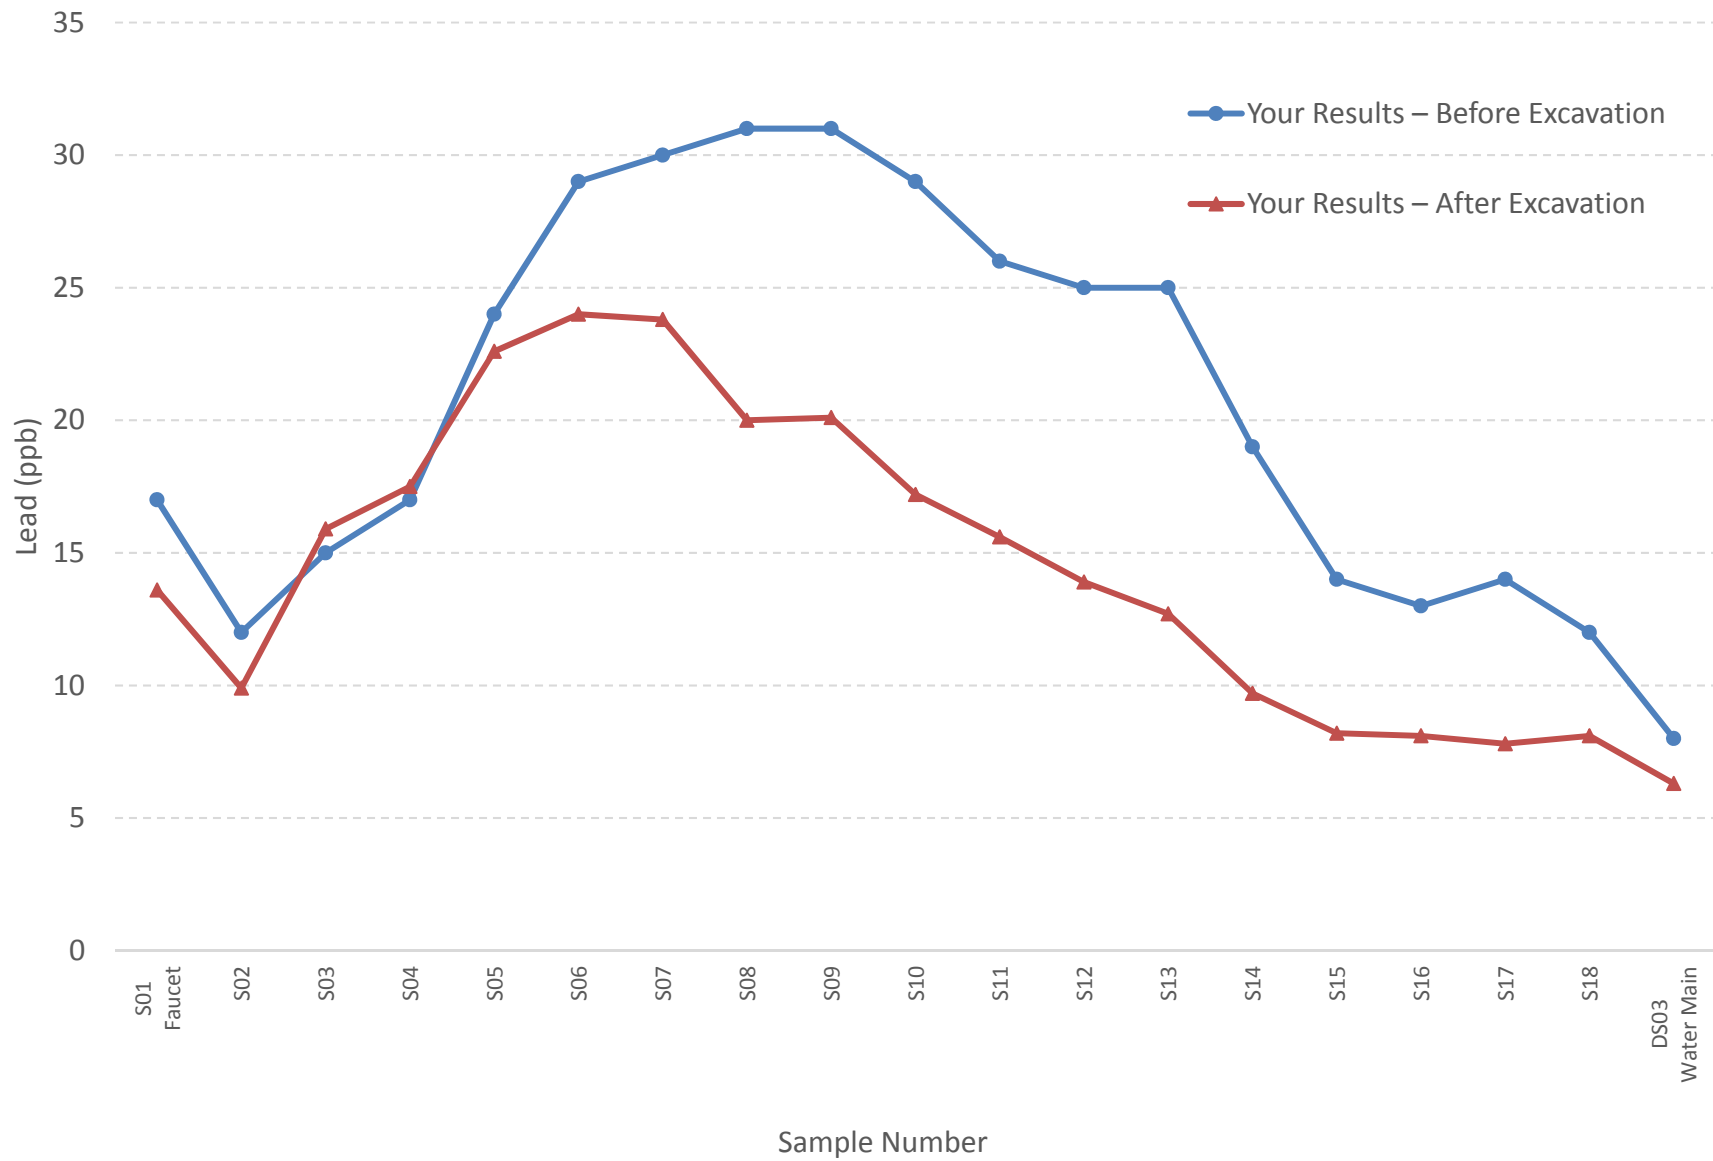

Site 3135 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/12/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	2.8 U	3.2 U	3.1 U	2.6 U	2.7 U	2.7 U	2.8 U	4.8 U	2.8 U	2.8 U	3.2 U	2.8 U	3.1 U	3.1 U	3.1 U	3.0 U	4.5 U	3.0 U	4.4 U	100	--	100	--
Copper	µg/L	2.0 U	1.9 U	1.6 U	1.7 U	1.8 U	10 U	10 U	1.7 U	2.1 U	3.9 U	6.4 U	2.5 U	7.2 U	4.5 U	11 U	2.0 U	2.7 U	7.2 U	1.9 U	--	1300	1300	1000
Lead	µg/L	17	12	15	17	24	29	30	31	31	29	26	25	25	19	14	13	14	12	8.0	--	15	0	--
Manganese	µg/L	3.1 J	1.4 J	1.6 J	1.6 J	1.7 J	1.4 J	1.4 J	1.6 J	1.8 J	1.5 J	1.9 J	1.9 J	1.8 J	1.6 J	2.1 J	1.9 J	3.3 J	1.8 J	1.5 J	--	--	--	50
Nickel	µg/L	6.4	2.7 U	2.8 U	1.9 U	2.3 U	2.6 U	1.8 U	2.9 U	1.8 U	1.7 U	2.2 U	1.8 U	2.0 U	1.8 U	1.8 U	1.9 U	3.4 U	1.8 J	3.3 U	--	--	--	--
Zinc	µg/L	130	48	35	18 J	15 J	13 J	9.7 J	12 J	11 J	11 J	11 J	11 J	15 J	11 J	10 J	8.2 J	9.3 J	9.0 J	5.0 U	--	--	--	5000
Aluminum	mg/L	0.10 J-	0.10 J-	0.12 J-	0.11 J-	0.11 J-	0.11 J-	0.11 J-	0.11 J-	0.11 J-	0.11 J-	0.12 J-	0.11 J-	0.12 J-	0.11 J-	0.12 J-	0.11 J-	0.11 J-	0.11 J-	0.11 J-	--	--	--	0.05 to 0.2
Calcium	mg/L	37	38	40	39	38	39	39	40	39	39	39	37	39	39	39	38	38	38	39	--	--	--	--
Iron	mg/L	0.15	0.073 U	0.062 U	0.067 U	0.074 U	0.059 U	0.057 U	0.061 U	0.064 U	0.060 U	0.054 U	0.088 U	0.052 U	0.051 U	0.094 U	0.061 U	0.050 U	0.054 U	0.049 U	--	--	--	0.3
Magnesium	mg/L	12 J-	13 J-	13 J-	13 J-	13 J-	13 J-	13 J-	14 J-	13 J-	13 J-	13 J-	13 J-	13 J-	13 J-	13 J-	13 J-	13 J-	13 J-	13 J-	--	--	--	--
Potassium	mg/L	1.7	1.8	1.9	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.7	1.8	1.8	1.8	1.8	1.7	1.7	1.8	--	--	--	--
Sodium	mg/L	11	11	12	12	11	12	11	12	12	12	12	11	11	12	12	11	12	11	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.0018 U	0.0017 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.0021 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110 J	--	--	--	--
Chloride	mg/L	Not Sampled																		1.0 J	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.18 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		32.3 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.
Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3135 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/3/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.04 J	0.03 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U				
Chromium	µg/L	0.66 U	0.47 U	0.53 U	0.55 U	0.54 U	0.53 U	0.55 U	0.56 U	0.59 U	0.55 U	0.60 U	0.54 U	0.59 U	0.58 U	0.56 U	0.54 U	0.57 U	0.62 U	0.56 U	100	--	100	--
Copper	µg/L	4.8	1.3 U	1.5 U	1.4 U	1.2 U	1.1 U	1.1 U	5.8	1.4 U	1.4 U	1.4 U	0.92 U	0.92 U	0.96 U	0.73 U	0.76 U	0.84 U	0.73 U	0.66 U	--	1300	1300	1000
Lead	µg/L	13.6	9.9	15.9	17.5	22.6	24.0	23.8	20.0	20.1	17.2	15.6	13.9	12.7	9.7	8.2	8.1	7.8	8.1	6.3	--	15	0	--
Manganese	µg/L	3.0	0.76 J	0.91 J	1.1	0.64 J	0.58 J	0.56 J	0.67 J	0.60 J	0.53 J	0.65 J	0.64 J	0.67 J	0.85 J	0.83 J	0.88 J	0.83 J	0.86 J	0.79 J	--	--	--	50
Nickel	µg/L	141	14.8	4.1	1.5	1.4	4.7	0.96	5.4	1.3	0.79	1.0	1.0	1.7	1.0	1.2	1.0	2.2	2.4	1.3	--	--	--	--
Tin	µg/L	0.09 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.12 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	211	56.5	38.5	24.2	10.9	29.2	9.4	18.4	10.4	8.0	8.0	7.2	7.6	7.8	6.8	8.2	8.0	6.7	4.7	--	--	--	5000
Aluminum	mg/L	0.411	0.0901	0.0812	0.0810	0.0762	0.0751	0.0748	0.0718	0.0730	0.0711	0.0741	0.0721	0.0725	0.0704	0.0696	0.0705	0.0683	0.0724	0.0681	--	--	--	0.05 to 0.2
Calcium	mg/L	37.3	36.7	37.0	36.2	36.7	36.5	36.1	36.0	35.4	36.4	35.7	36.5	35.2	35.9	35.8	35.9	36.1	35.6	35.8	--	--	--	--
Iron	mg/L	0.136	0.0191 J	0.0541 J	0.0280 J	0.0174 J	0.0212 J	0.0274 J	0.100 U	0.100 U	0.100 U	0.0205 J	0.100 U	0.100 U	0.100 U	0.100 U	0.0186 J	0.0288 J	0.0166 J	0.100 U	--	--	--	0.3
Magnesium	mg/L	12.4	12.6	12.6	12.5	12.6	12.6	12.5	12.4	12.3	12.6	12.4	12.6	12.1	12.5	12.4	12.6	12.5	12.3	12.5	--	--	--	--
Potassium	mg/L	1.68	1.73	1.76	1.76	1.74	1.77	1.72	1.74	1.73	1.73	1.76	1.76	1.74	1.73	1.74	1.69	1.72	1.70	1.74	--	--	--	--
Sodium	mg/L	12.4	11.9	11.9	11.8	11.8	11.9	11.8	11.7	11.7	11.7	11.7	11.9	11.6	11.7	11.8	11.8	11.8	11.6	11.7	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		105	--	--	--	--
Chloride	mg/L	Not Sampled																		16.3	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.124	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		25.7	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.135	--	--	--	--


Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3277, Kitchen Faucet, 11/1/2016 and 11/19/2016

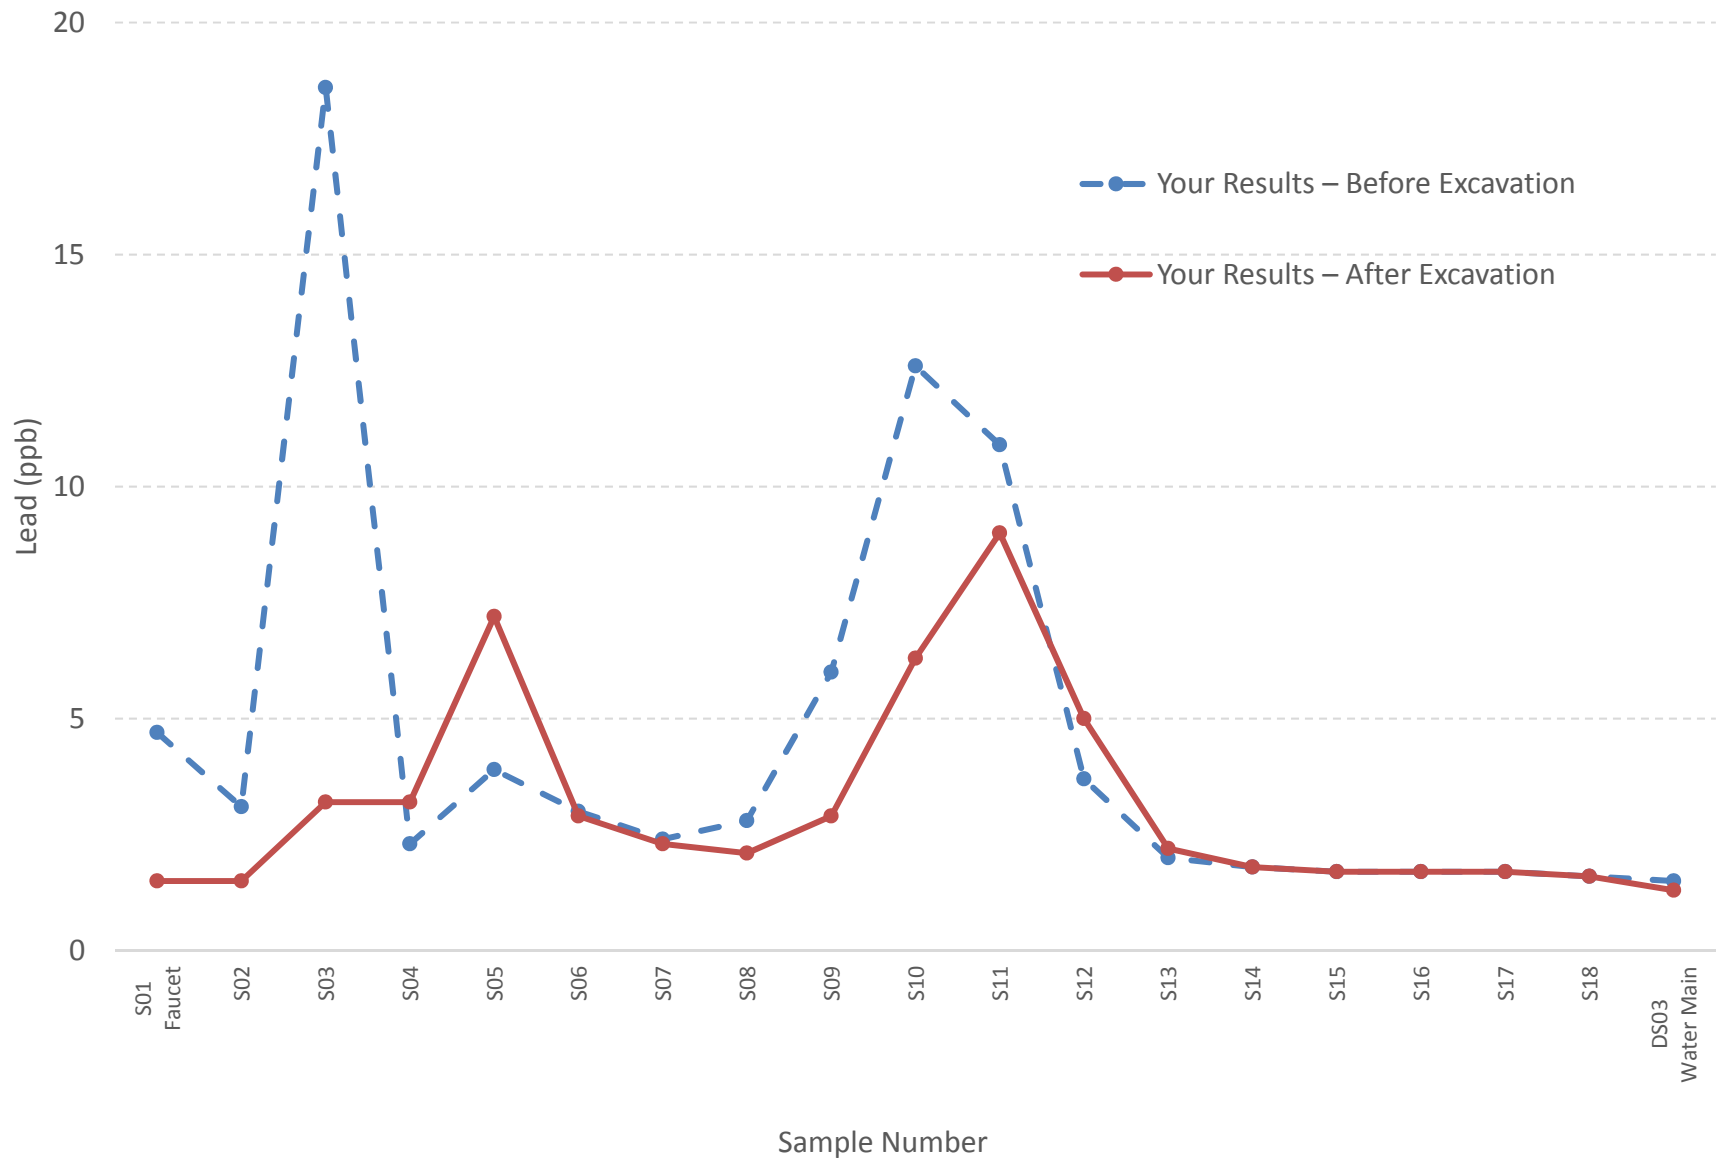

Site 3277 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 11/1/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.24	0.42	0.31	0.11 J	0.080 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	5	--	5	--
Chromium	µg/L	0.56 U	0.46 U	0.49 U	0.41 U	0.49 U	0.50 U	0.44 U	0.47 U	0.75 U	0.50 U	0.52 U	0.46 U	0.51 U	0.51 U	0.48 U	0.47 U	0.45 U	0.44 U	0.44 U	100	--	100	--
Copper	µg/L	42.2	6.8	16.0	4.1	5.6	4.2	2.8	3.2	4.1	3.4	3.2	3.0	3.1	3.1	3.1	2.9	2.9	2.8	1.7	--	1300	1300	1000
Lead	µg/L	4.7	3.1	18.6	2.3	3.9	3.0	2.4	2.8	6.0	12.6	10.9	3.7	2.0	1.8	1.7	1.7	1.7	1.6	1.5	--	15	0	--
Manganese	µg/L	2.0	3.7	4.8	0.77 U	1.1 U	1.1 U	0.77 U	0.88 U	1.3 U	0.95 U	0.96 U	1.2 U	1.4 U	1.8	1.3 U	1.3 U	1.3 U	1.3 U	1.3 U	--	--	--	50
Nickel	µg/L	2.8	0.61 U	0.65 U	0.66 U	0.79 U	0.65 U	0.60 U	0.54 U	0.73 U	2.3	0.65 U	0.93 U	0.63 U	0.74 U	3.1	0.66 U	0.65 U	0.58 U	0.64 U	--	--	--	--
Tin	µg/L	0.14 U	0.19 U	0.18 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.14 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	108	96.2	90.8	19.6	16.4	19.2	16.5	15.8	21.3	12.6	10.0	9.0 U	9.5 U	9.7	8.9 U	9.3 U	8.7 U	8.1 U	7.4 U	--	--	--	5000
Aluminum	mg/L	0.0693	0.0710	0.0978	0.0706	0.0712	0.0685	0.0719	0.0690	0.0712	0.0685	0.0688	0.0675	0.0675	0.0702	0.0708	0.0682	0.0698	0.0684	0.0650	--	--	--	0.05 to 0.2
Calcium	mg/L	34.7	33.7	34.5	34.0	33.5	36.2	34.2	34.0	34.2	34.5	34.6	33.9	34.0	34.7	34.2	34.4	35.1	35.0	35.5	--	--	--	--
Iron	mg/L	0.0601 J	0.125	0.413	0.0163 J	0.0456 J	0.0200 J	0.0147 J	0.0208 J	0.0286 J	0.0187 J	0.100 U	0.0147 J	0.0231 J	0.0223 J	0.0311 J	0.0233 J	0.0160 J	0.0251 J	0.0244 J	--	--	--	0.3
Magnesium	mg/L	12.4	11.8	12.1	11.9	11.7	12.6	11.9	11.8	11.9	12.2	12.1	11.9	11.9	12.1	12.0	12.1	12.4	12.4	12.6	--	--	--	--
Potassium	mg/L	1.61	1.63	1.74	1.72	1.66	1.71	1.72	1.69	1.74	1.56	1.70	1.68	1.72	1.68	1.66	1.66	1.70	1.69	1.70	--	--	--	--
Sodium	mg/L	11.3	11.4	11.7	11.6	11.4	11.8	11.7	11.5	11.6	11.2	11.7	11.4	11.9	11.7	11.4	11.4	11.6	11.6	11.6	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		106	--	--	--	--
Chloride	mg/L	Not Sampled																		17.5	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.155	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		27.1	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.120	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3277 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results


Parameter	Units	Your Results - After Excavation on 11/19/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.25	0.21	0.33	0.09 J	0.13 J	0.05 J	0.05 J	0.04 J	0.05 J	0.04 J	0.04 J	0.04 J	0.03 J	0.03 J	0.03 J	0.03 J	0.03 J	0.02 J	5				
Chromium	µg/L	0.81 U	0.85 U	0.87 U	0.77 U	0.91 U	0.90 U	0.85 U	0.88 U	0.90 U	0.86 U	0.91 U	0.86 U	0.88 U	0.90 U	0.88 U	0.95 U	0.91 U	0.93 U	0.88 U	100	--	100	--
Copper	µg/L	39.8 J+	15.2 J+	8.8 J+	2.7 J+	17.5 J+	5.7 J+	3.5 J+	3.0 J+	4.7 J+	4.0 J+	10.2 J+	10.0 J+	6.8 J+	4.5 J+	4.4 J+	4.2 J+	3.7 J+	3.9 J+	1.6 J+	--	1300	1300	1000
Lead	µg/L	1.5	1.5	3.2	3.2	7.2	2.9	2.3	2.1	2.9	6.3	9.0	5.0	2.2	1.8	1.7	1.7	1.7	1.6	1.3	--	15	0	--
Manganese	µg/L	0.53 J	1.5	0.68 J	0.47 J	1.6	0.73 J	0.58 J	0.58 J	0.77 J	0.71 J	0.76 J	0.76 J	0.87 J	0.83 J	0.83 J	0.88 J	1.0	0.82 J	0.83 J	--	--	--	50
Nickel	µg/L	2.7	0.74	1.4	0.88	1.9	1.1	0.92	0.78	1.0	1.0	2.5	2.1	1.5	1.1	1.1	1.0	1.2	1.0	0.72	--	--	--	--
Tin	µg/L	0.12 J	1.0 U	1.4	1.0 U	0.44 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.12 J	0.26 J	0.08 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	189	66.5	66.3	18.6	45.8	20.5	16.5	14.9	19.6	14.5	21.6	20.6	17.5	12.5	11.0	10.5	10.3	10.5	7.1	--	--	--	5000
Aluminum	mg/L	0.0412	0.0504	0.0565	0.0486	0.0565	0.0480	0.0487	0.0479	0.0466	0.0464	0.0470	0.0463	0.0456	0.0449	0.0438	0.0460	0.0482	0.0469	0.0466	--	--	--	0.05 to 0.2
Calcium	mg/L	34.8	34.7	34.7	34.6	35.0	34.2	34.5	34.4	33.9	33.9	34.2	33.5	34.5	34.0	34.0	34.1	34.0	34.0	34.3	--	--	--	--
Iron	mg/L	0.0157 U	0.0817 U	0.0206 U	0.100 U	0.0972 U	0.0258 U	0.100 U	0.0235 U	0.0143 U	0.0211 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	--	--	--	0.3
Magnesium	mg/L	12.3	12.1	12.1	12.1	12.3	12.0	12.1	12.1	12.0	11.9	12.1	11.9	12.2	12.0	12.0	12.1	12.1	12.1	12.2	--	--	--	--
Potassium	mg/L	1.62	1.61	1.64	1.62	1.61	1.56	1.59	1.57	1.58	1.56	1.57	1.57	1.58	1.59	1.58	1.58	1.60	1.58	1.58	--	--	--	--
Sodium	mg/L	11.4	11.3	11.3	11.2	11.4	11.1	11.2	11.2	11.1	11.0	11.2	11.0	11.3	11.0	11.1	11.2	11.2	11.1	11.3	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		103	--	--	--	--
Chloride	mg/L	Not Sampled																		17.1	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.121	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		28.5	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.197	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.
Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3302, Kitchen Faucet, 10/25/2016 and 11/18/2016

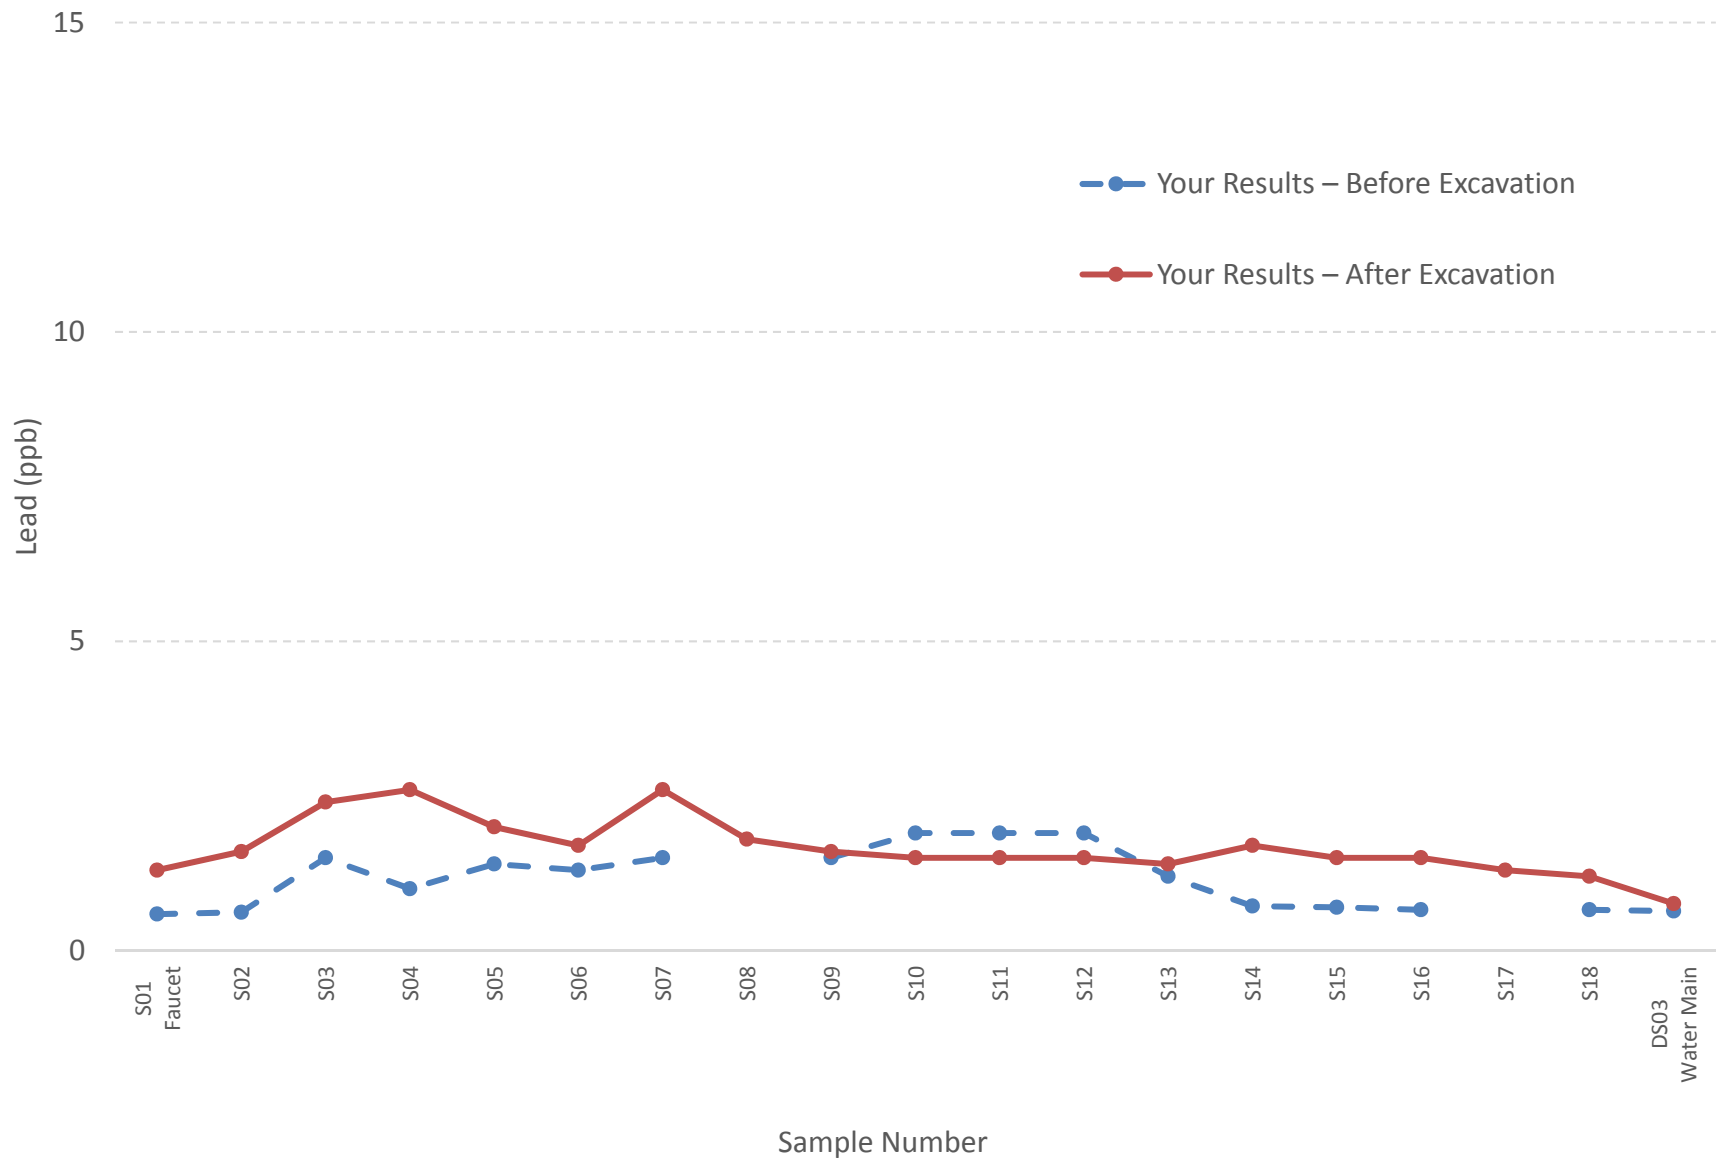

Site 3302 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/25/2016																			Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																	Distribution System					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)						
Cadmium	µg/L	0.08 J	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	Not Analyzed (breakage)	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	Not Analyzed (breakage)	0.2 U	0.2 U	5	--	5	--	
Chromium	µg/L	0.6 U	0.66 U	0.65 U	0.62 U	0.62 U	0.66 U	0.59 U		0.59 U	0.6 U	0.61 U	0.61 U	0.62 U	0.59 U	0.61 U	0.62 U		0.62 U	0.62 U	0.69 U	100	--	100	--
Copper	µg/L	11.8	2.4 U	5.3 U	1.7 U	1.5 U	1.5 U	1.6 U		1.2 U	1.3 U	1.2 U	1.0 U	1.1 U	1.0 U	1.0 U	1.2 U		1.0 U	1.0 U	1.0 U	--	1300	1300	1000
Lead	µg/L	0.59 J	0.62 J	1.5	1.0	1.4	1.3	1.5		1.5	1.9	1.9	1.9	1.2	0.72 J	0.70 J	0.66 J		0.66 J	0.66 J	0.64 J	--	15	0	--
Manganese	µg/L	4.5	2.2	1.1 U	0.80 U	1.1 U	0.95 U	0.91 U		0.88 U	0.77 U	0.49 U	0.51 U	0.8 U	0.68 U	0.69 U	0.66 U		0.67 U	0.67 U	0.67 U	--	--	--	50
Nickel	µg/L	2.9	0.97 U	2.3	0.90 U	0.76 U	0.77 U	0.68 U		0.70 U	0.61 U	0.75 U	0.82 U	0.60 U	0.69 U	0.67 U	0.81 U		0.76 U	0.61 U	0.61 U	--	--	--	--
Tin	µg/L	0.14 U	1 U	1 U	1 U	1 U	1 U	1 U		1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U		1 U	1 U	1 U	--	--	--	--
Zinc	µg/L	153	41.4	20.2	13.9	11.1	10.7	11.0		12.7	11.9	8.3	7.3	7.2	6.8	6.8	7.3		7.1	5.0	5.0	--	--	--	5000
Aluminum	mg/L	0.0693	0.0931	0.0923	0.0898	0.0883	0.084	0.0851		0.0799	0.0768	0.0804	0.081	0.0816	0.0775	0.0823	0.0816		0.0783	0.0786	0.0786	--	--	--	0.05 to 0.2
Calcium	mg/L	34.2	34.4	35.5	35.4	35.3	35.4	34.6		34.8	35.4	35.6	35.9	35.1	35.2	34.8	36.0		36.1	34.9	34.9	--	--	--	--
Iron	mg/L	0.143	0.147	0.0514 J	0.0818 J	0.0554 J	0.0237 U	0.0252 U		0.0319 J	0.0146 U	0.0148 U	0.0155 U	0.0211 U	0.100 U	1.1	0.0259 U		0.0287 U	0.0178 U	0.0178 U	--	--	--	0.3
Magnesium	mg/L	11.8	11.8	12	12.0	11.9	12.1	11.9		12.0	12.2	12.2	12.3	12.0	12.1	11.9	12.4		12.5	12.1	12.1	--	--	--	--
Potassium	mg/L	1.65	1.74	1.74	1.75	1.76	1.74	1.71		1.78	1.75	1.76	1.80	1.76	1.72	1.75	1.76		1.81	1.70	1.70	--	--	--	--
Sodium	mg/L	10.9	11.1	11.4	11.6	11.6	11.6	11.4	11.4	11.6	11.5	11.7	11.4	11.5	11.4	11.7	11.8	11.4	11.4	--	--	--	--		
Total Alkalinity	mg CaCO3/L	Not Sampled																		104	--	--	--	--	
Chloride	mg/L	Not Sampled																		17.5	--	--	--	250	
Fluoride	mg/L	Not Sampled																		0.132	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled																		27.4	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled																		0.116	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3302 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/18/2016																		Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.06 J	0.06 J	0.03 J	0.04 J	0.02 J	0.02 J	0.02 J	0.03 J	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U				
Chromium	µg/L	0.83 U	0.82 U	0.78 U	0.79 U	0.81 U	0.82 U	0.81 U	0.82 U	0.88 U	0.8 U	0.81 U	0.82 U	0.82 U	0.84 U	0.85 U	0.73 U	0.85 U	0.85 U	0.82 U	100	--	100	--
Copper	µg/L	10.4	5.1	4.1	3.3	2.0	2.0	2.4	2.0	1.8	1.8	1.7	1.6	1.6	1.8	1.7	1.8	1.6	1.6	1.4	--	1300	1300	1000
Lead	µg/L	1.3	1.6	2.4	2.6	2.0	1.7	2.6	1.8	1.6	1.5	1.5	1.5	1.4	1.7	1.5	1.5	1.3	1.2	0.76 J	--	15	0	--
Manganese	µg/L	3.4	2.4	1.5	1.6	1.1	1.2	1.7	1.5	1.1	0.98 J	1.0 J	0.92 J	0.92 J	1.0	1.1	1.1	0.96 J	0.88 J	0.73 J	--	--	--	50
Nickel	µg/L	2.5	2.5	1.0	1.4	0.70	0.75	0.72	0.70	0.69	0.78	0.63	0.65	0.67	0.69	0.73	0.61	0.68	0.64	0.64	--	--	--	--
Tin	µg/L	0.1 J	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	--	--	--	--
Zinc	µg/L	135	53.6	25.1	33.9	15.1	16.0	26.7	22.3	13.6	12.5	10.8	10.0	9.8	23.7	13.2	10.3	9.6	9.6	21.0	--	--	--	5000
Aluminum	mg/L	0.0554	0.0891	0.0588	0.0564	0.0488	0.0501	0.0595	0.0487	0.0482	0.0455	0.0439	0.0431	0.0458	0.0487	0.0462	0.0469	0.0438	0.0424	0.0430	--	--	--	0.05 to 0.2
Calcium	mg/L	37.3	37.3	36.5	36.9	36.7	37.1	37.6	36.8	37.3	37.3	36.8	37.4	36.4	35.8	36.2	36.0	36.4	36.6	36.8	--	--	--	--
Iron	mg/L	0.0945 U	0.118	0.0924 U	0.179	0.0785 U	0.0818 U	0.117	0.0728 U	0.0667 U	0.0534 U	0.0565 U	0.0455 U	0.0345 U	0.0326 U	0.0462 U	0.0536 U	0.0281 U	0.0282 U	0.100 U	--	--	--	0.3
Magnesium	mg/L	12.2	11.8	12.2	12.5	12.4	12.5	12.7	12.4	12.6	12.6	12.4	12.6	12.3	12.1	12.3	12.2	12.4	12.4	12.5	--	--	--	--
Potassium	mg/L	1.87	1.78	1.72	1.78	1.77	1.81	1.79	1.80	1.82	1.84	1.81	1.79	1.74	1.73	1.78	1.71	1.76	1.78	1.81	--	--	--	--
Sodium	mg/L	12.0	11.8	11.7	11.9	11.8	12.0	12.0	11.9	12.0	12.1	12.1	12.2	11.8	11.6	11.8	11.8	11.8	11.9	11.9	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		103	--	--	--	--
Chloride	mg/L	Not Sampled																		18.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.126	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		30.0	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.169	--	--	--	--


Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2094 -- Kitchen Sink Faucet, 10/26/2016 and 11/9/2016

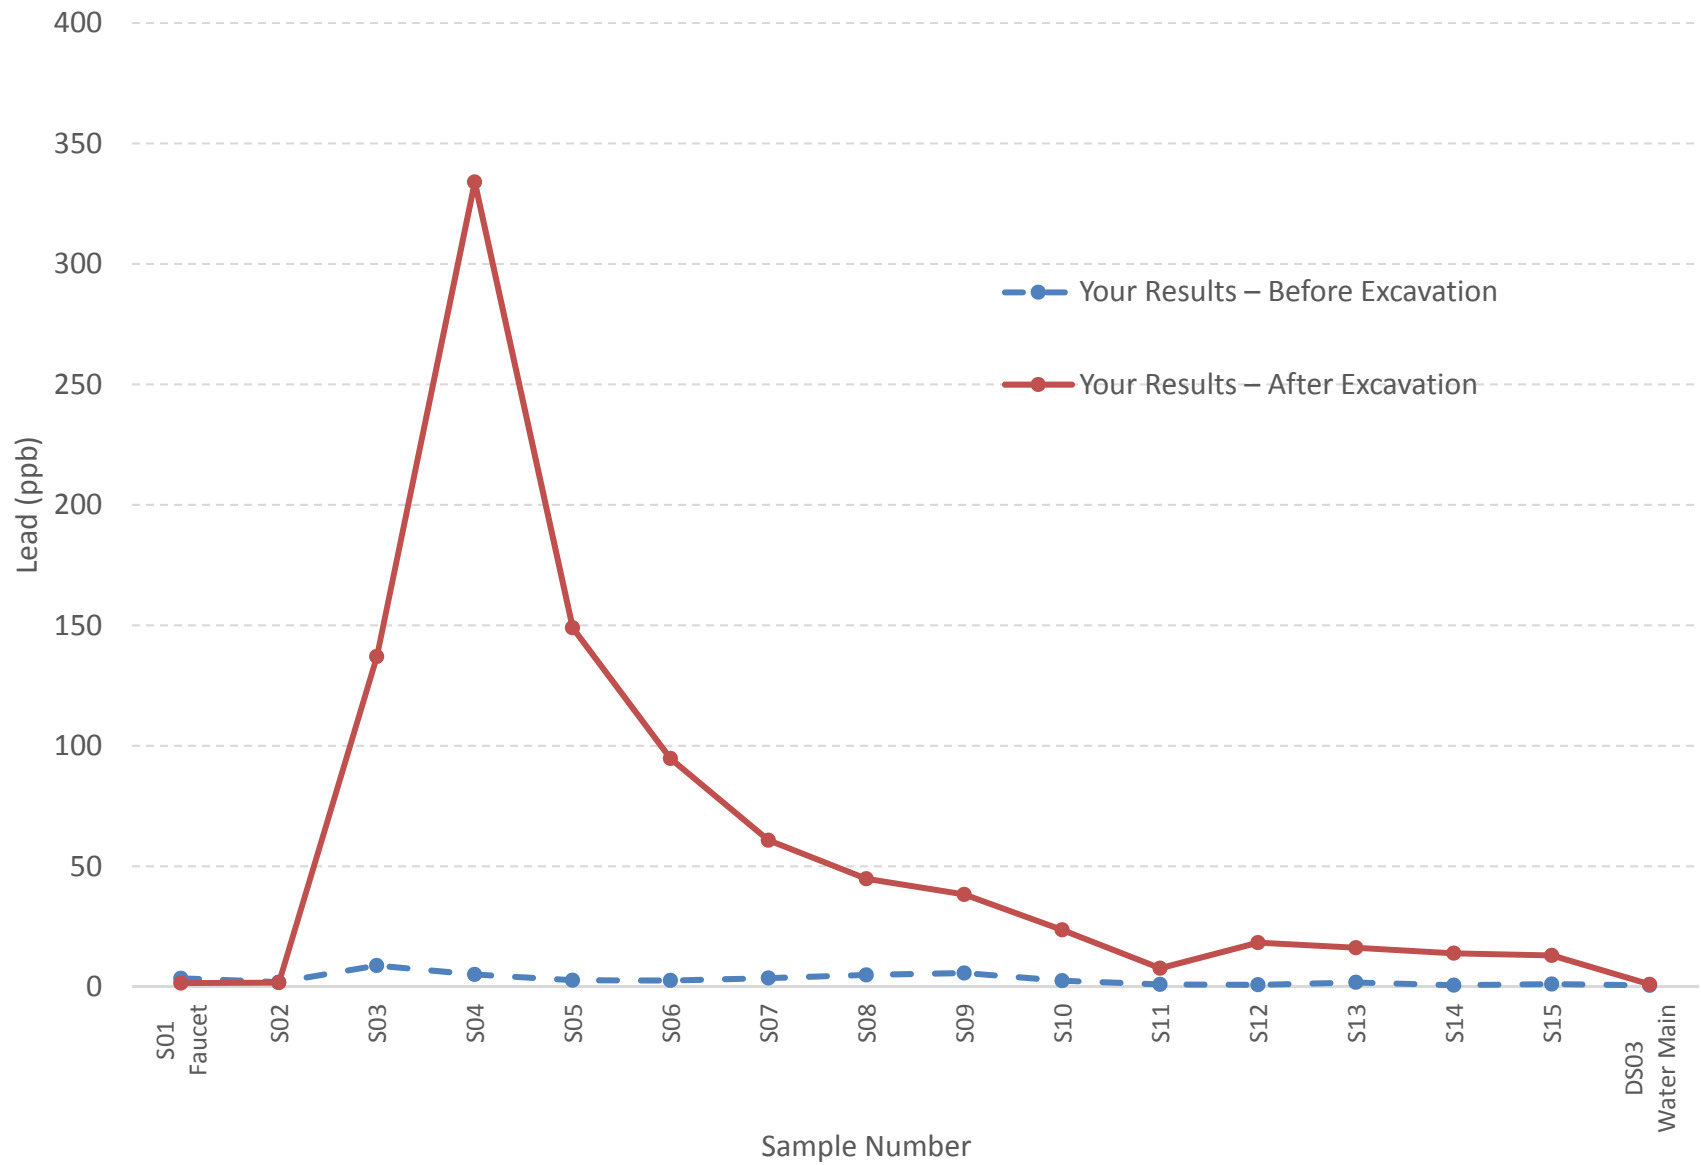

Site 2094 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/26/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--	
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--	
Copper	µg/L	24.7	11.3	9.6	4.3 J	5.6 J	4.1 J	8.0	6.0 J	4.6 J	1.3 J	7 U	3.4 J	3.1 J	7 U	2.1 J	7 U	--	1300	1300	1000	
Lead	µg/L	3.5	1.9	8.8 J-	5.1	2.7	2.6	3.6	4.9	5.7	2.5	1.0 J	0.81 J	1.8	0.65 J	1.1 J	0.60 J	--	15	0	--	
Manganese	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	--	--	--	50	
Nickel	µg/L	16.7	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--	
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 UJ	--	--	--	--	
Zinc	µg/L	308	225	218	147	144	169	158	91.9	66.6	46.5	43.1	56.0	58.6	42.5	48.5	35.5 J+	--	--	--	5000	
Aluminum	mg/L	0.0735	0.0969	0.0905	0.0885	0.0794	0.0654	0.0702	0.0698	0.0646	0.0696	0.066	0.0647	0.0674	0.0584	0.0661	0.0680	--	--	--	0.05 to 0.2	
Calcium	mg/L	34.5	34.5	34.9	34.9	34.6	34.8	34.6	35.2	34.8	34.6	34.8	34.8	35.5	34.8	34.6	34.8	--	--	--	--	
Iron	mg/L	0.128	0.1 U	0.311	0.168	0.0674 J	0.056 J	0.0305 J	0.0215 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3	
Magnesium	mg/L	11.3 J-	11.3 J-	11.0 J-	11.3 J-	11.3 J-	11.4 J-	11.5 J-	11.3 J-	11.4 J-	11.5	11.4	11.6	11.4	11.2	11.2	11.3 J	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--	
Chloride	mg/L	Not Sampled															19	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.093 J	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															28	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2094 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/9/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	2 U	2 U	0.71 J	1.1 J	0.6 J	0.38 J	2 U	2 U	2 U	2 U	2 U	2 U	0.32 J	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	9.6	5.7 J	34.9	46.5	32.5	25.4	8.8	10.4	9.6	4.8 J	2.4 J	3.7 J	5.3 J	3.4 J	2.7 J	1.2 J	--	1300	1300	1000
Lead	µg/L	1.5 J	1.7 J	137	334	149	94.7	60.8	44.8	38.3	23.6	7.7	18.3 J+	16.2	13.9	13.0	1.0 J	--	15	0	--
Manganese	µg/L	4.1	2.2 J	64.4	189	62.9	44.7	18	21.5	13.7	10.7	3.6 J	7.1	9.9	7.2	5.6	4 U	--	--	--	50
Nickel	µg/L	6 U	6 U	6 U	1.2 J	1.1 J	1.3 J	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	1.8 J	10 U	10 U	10 U	10 U	10 U	10 U	3.6 J	10 U	10 U	--	--	--	--
Zinc	µg/L	155	154	750	1570 J-	667	435	192	203	133	101	36.6	71.7	109	71.4	57.8	17.9	--	--	--	5000
Aluminum	mg/L	0.0554	0.0683	0.366	0.753	0.377	0.264	0.117	0.15	0.106	0.098	0.036 U	0.0813	0.117	0.0814	0.08	0.0592	--	--	--	0.05 to 0.2
Calcium	mg/L	34.3	34.2	35.5	32.7 J	34.9	34.5	31.8	34.3	33.1	32.4	8.77	31.9	35.2 J	34.3	32.8	32.4	--	--	--	--
Iron	mg/L	0.0664 J	0.0212 J	2.43	5.91 J-	1.85	1.16	0.327	0.575	0.276	0.209	0.0855 J	0.125	0.321 J+	0.157	0.0948 J	0.1 U	--	--	--	0.3
Magnesium	mg/L	11.3	11.3	11.5	11.1 J	11.5	11.5	10.6	11.5	11.1	10.9	2.93	10.9	11.7 J	11.4	10.9	10.8	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															19	--	--	--	250
Fluoride	mg/L	Not Sampled															0.2 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															29 J-	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2099, Kitchen Faucet, 11/13/2016 and 11/23/2016

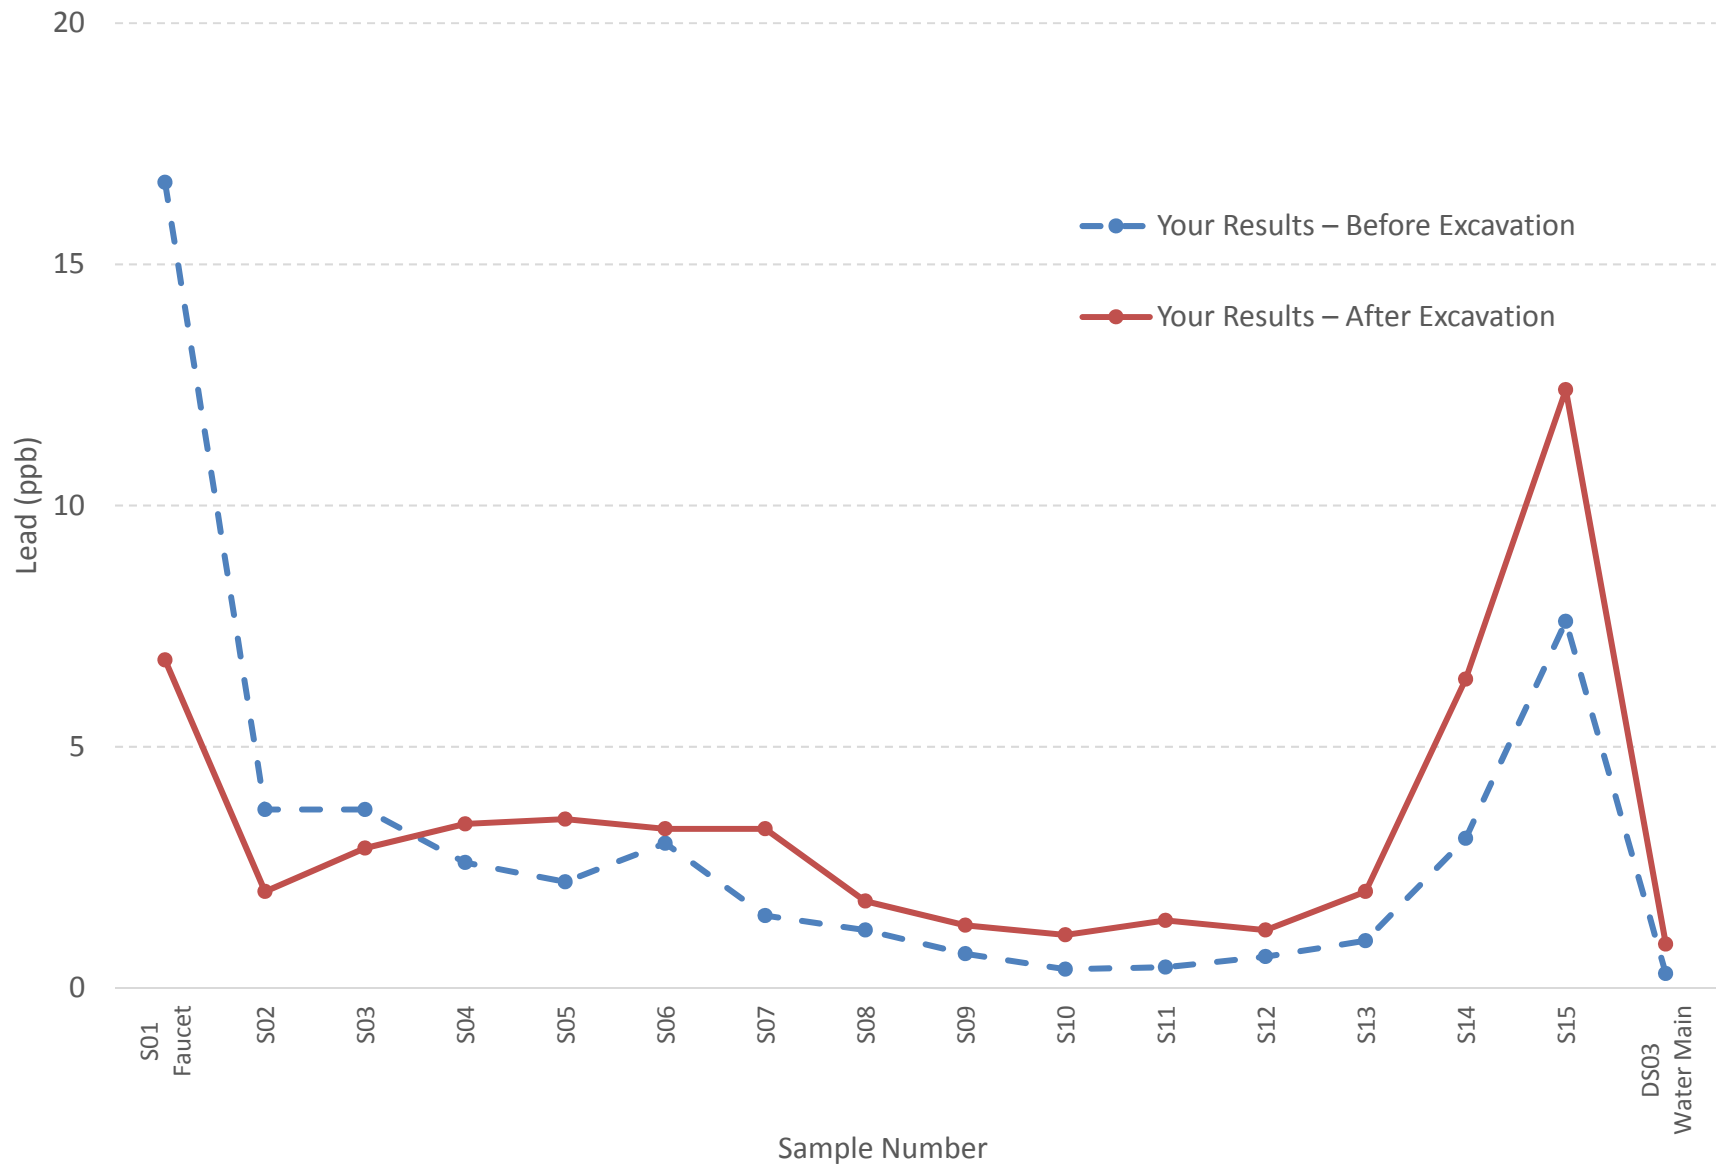

Site 2099 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 11/13/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	0.4 J	0.5 J	2 U	2 U	0.37 J	0.32 J	2 U	2 U	0.34 J	0.38 J	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--	
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--	
Copper	µg/L	7.9	1.9 J	1.4 J	7 U	7 U	2.3 J	2.5 J	7 U	1.4 J	7 U	1.2 J	7 U	1.2 J	7 U	1.3 J	7 U	--	1300	1300	1000	
Lead	µg/L	16.7	3.7	3.7	2.6	2.2	3.0	1.5 J	1.2 J	0.71 J	0.39 J	0.43 J	0.65 J	0.98 J	3.1	7.6 J-	1.8 U	--	15	0	--	
Manganese	µg/L	12.9	25	5.7	2.6 J	2.3 J	1.8 J	1.5 J	0.85 J	0.71 J	4 U	4 U	4 U	4 U	4 U	4 U	4 U	--	--	--	50	
Nickel	µg/L	25.7	1.7 J	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--	
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--	
Zinc	µg/L	406	181	97.6	137	103	55.3	44.7	49.5	46.0	49.3	36.7	33.3	27.9	25.2	22.0	17.6	--	--	--	5000	
Aluminum	mg/L	0.0098 J	0.038	0.0455	0.0438	0.0446	0.0458	0.0455	0.0504	0.0514	0.0505	0.0521	0.0531	0.0489	0.0507	0.0509	0.0377	--	--	--	0.05 to 0.2	
Calcium	mg/L	29.0	28.2	32.7	32.7	32.7	31.9	32.4	32.8	32.8	31.7	31.4	32.1	31.2	32.3	33.2	32.8	--	--	--	--	
Iron	mg/L	0.0828 J	0.115	0.0666 J	0.0789 J	0.0745 J	0.055 J	0.0325 J	0.0248 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3	
Magnesium	mg/L	11.9	11.0	12.1	12.2	12.0	11.7	12.0	12.1	12.1	11.7	11.7	11.9	11.5	12.0	12.1	12.1	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--	
Chloride	mg/L	Not Sampled															19	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.19 J	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															31	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2099 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/23/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.32 J	0.72 J	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U				
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4.0	4 U	4 U	100	--	100	--
Copper	µg/L	9 J	7 U	7 U	7 U	7 U	1.5 J	1.6 J	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	--	1300	1300	1000
Lead	µg/L	6.8	2.0	2.9	3.4	3.5	3.3	3.3	1.8	1.3 J	1.1 J	1.4 J	1.2 J	2.0	6.4	12.4	0.91 J	--	15	0	--
Manganese	µg/L	7.2	18.1	3.5 J	1.6 J	2 J	1.3 J	1.2 J	4 U	4 U	4 U	4 U	4 U	4 U	10.4	4 U	4 U	--	--	--	50
Nickel	µg/L	26.3	2.3 J	1.2 J	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	1.4 J	1.3 J	--	--	--	--
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	633 J+	271	95.5	93.6	93.7	52.5	44.4	46.7	45.0	49.8	35.6	31.2	27.8	21.0	19.2	12.9	--	--	--	5000
Aluminum	mg/L	0.0375 J+	0.047 J+	0.0661 J+	0.0515 J+	0.0635 J+	0.0752 J+	0.061 J+	0.073 J+	0.0563 J+	0.0617 J+	0.0839 J+	0.0774 J+	0.0614 J+	0.036 U	0.0749 J+	0.0437 J+	--	--	--	0.05 to 0.2
Calcium	mg/L	33.6 J	33.5	32.7	31.0	34.6	33.7	33.6	33.4	33.0	32.2	32.6	33.4	33.2	34.4	34.9	35.8	--	--	--	--
Iron	mg/L	0.0471 J	0.0651 J	0.0308 J	0.033 J	0.0856 J	0.0355 J	0.0251 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.622	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	11.2 J	11.5	11.2	10.5	11.8	11.3	11.5	11.5	11.4	11.2	11.2	11.3	11.2	4.54	11.9	12.1	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															20	--	--	--	250
Fluoride	mg/L	Not Sampled															0.22 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															28	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2121, Kitchen Faucet, 10/27/2016 and 11/21/2016

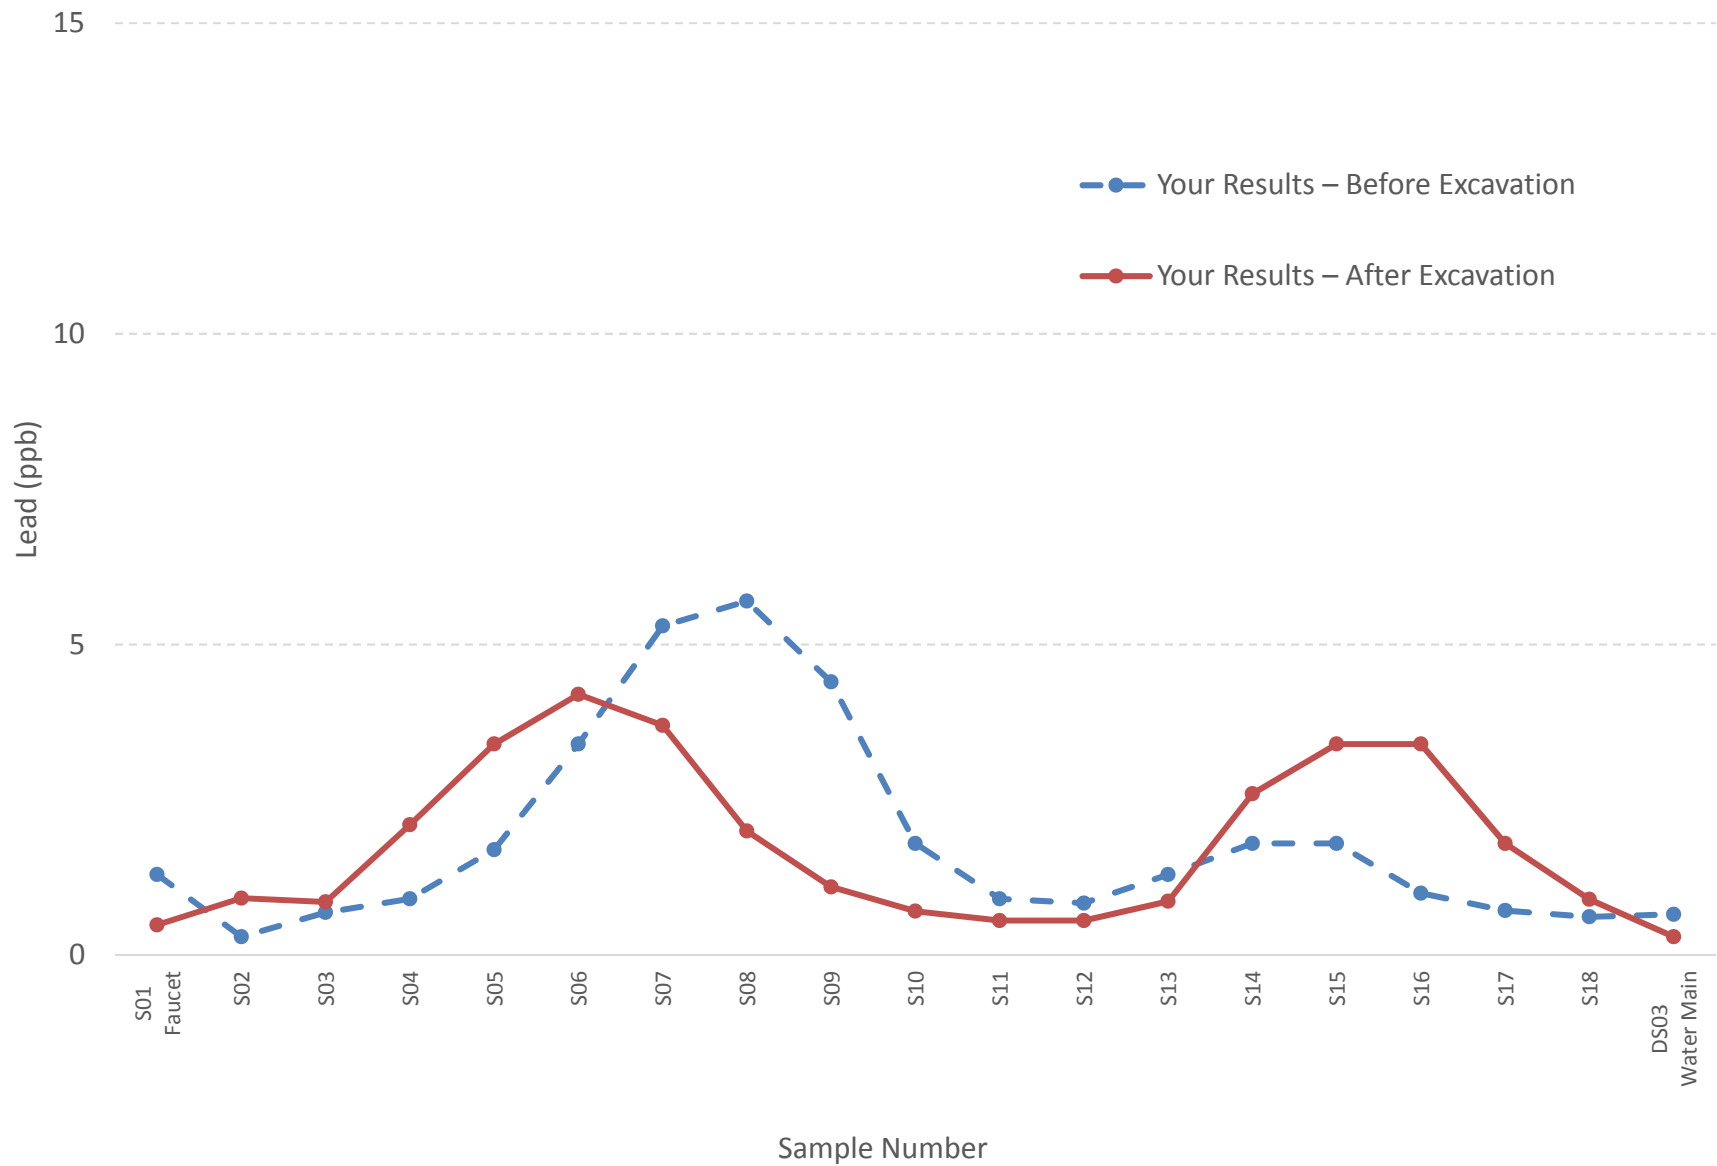

Site 2121 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/27/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	5.8 J	2.4 J	7 U	1.9 J	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	7 U	--	1300	1300	1000
Lead	µg/L	1.3 J	1.8 U	0.69 J	0.91 J	1.7 J	3.4	5.3	5.7	4.4	1.8	0.91 J	0.84 J	1.3 J	1.8	1.8	1.0 J	0.72 J	0.62 J	0.66 J	--	15	0	--
Manganese	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	3.3 J	--	--	--	50
Nickel	µg/L	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	36.1	38.6	44.1	54.6 J	37.5	73.6	33.7	33.4	43.2	36.2	38.0	21.7	32.8	18.1	18.9	16.7	12.6	16.1	33.4 J	--	--	--	5000
Aluminum	mg/L	0.0312 J	0.0568	0.0583	0.0641	0.0631 J+	0.0621 J+	0.0583 J+	0.0572 J+	0.0577 J+	0.0552 J+	0.0618 J+	0.0572 J+	0.0561 J+	0.0622 J+	0.0613	0.0551	0.0273 J	0.0912	0.0718	--	--	--	0.05 to 0.2
Calcium	mg/L	26.8	35.7	34.3	33.7	34.2	33.7	33.9	33.2	33.7	32.9	34.7	34.4	32.9	33.2	33.8	32.8	32.3	32.9	34.2	--	--	--	--
Iron	mg/L	0.1 U	0.0228 J	0.1 U	0.1 U	0.1 U	0.0418 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	10.5	11.5	11.1	10.8	11.1	11.0	11.1	10.8	10.9	10.8	11.4	11.2	10.8	10.9	11.2	10.8	10.7	10.8	11.1	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		180	--	--	--	--
Chloride	mg/L	Not Sampled																		19	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.091 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		28	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		1 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2121 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/21/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U				
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	1.9 J	2 J	1.3 J	2.4 J	1.6 J	1.5 J	1.8 J	5.9 J	1.7 J	1.6 J	7 U	1.4 J	1.9 J	1.7 J	7 U	1.2 J	7 U	1.6 J	7 U	--	1300	1300	1000
Lead	µg/L	0.49 J	0.92 J	0.86 J	2.1	3.4	4.2	3.7	2.0	1.1 J	0.71 J	0.56 J	0.56 J	0.87 J	2.6	3.4	3.4 J-	1.8	0.90 J	1.8 U	--	15	0	--
Manganese	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	--	--	--	50
Nickel	µg/L	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	45.4	138	44.9	54.9	33.9	26.7	24.4	47.2	88.5	90.2	81.4	72.5	60.8	31.6	21.7	17.8	17.1	17.5	11.9	--	--	--	5000
Aluminum	mg/L	0.0231 J	0.036 U	0.036 U	0.036 U	0.036 U	0.036 U	0.036 U	0.0368 J+	0.0431 J+	0.0388 J+	0.0423 J+	0.0381	0.0402	0.0358 J	0.0348 J	0.0413	0.0385	0.0449	0.0332 J	--	--	--	0.05 to 0.2
Calcium	mg/L	31.4 J	29.9	31.6	27.2	28.0	26.4	27.9	28.1	30.0	30.1	28.5	26.8	29.1	27.8	29.5	27.1	28.3	31.0	27.8	--	--	--	--
Iron	mg/L	0.1 U	0.1 U	0.1 U	0.0393 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.0195 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	10.9 J	10.2	10.8	9.48	9.80	9.26	9.61	9.71	10.2	10.3	9.96	9.35	10.1	9.65	10.1	9.4	9.83	10.6	9.8	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		110	--	--	--	--
Chloride	mg/L	Not Sampled																		19	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.2 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		29	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		1 U	--	--	--	--


Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
(B) = Low levels were also present in the laboratory blank samples, indicating a potential high bias (the actual value may be lower than what is reported here).
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2148, Kitchen Faucet, 10/27/2016 and 11/22/2016

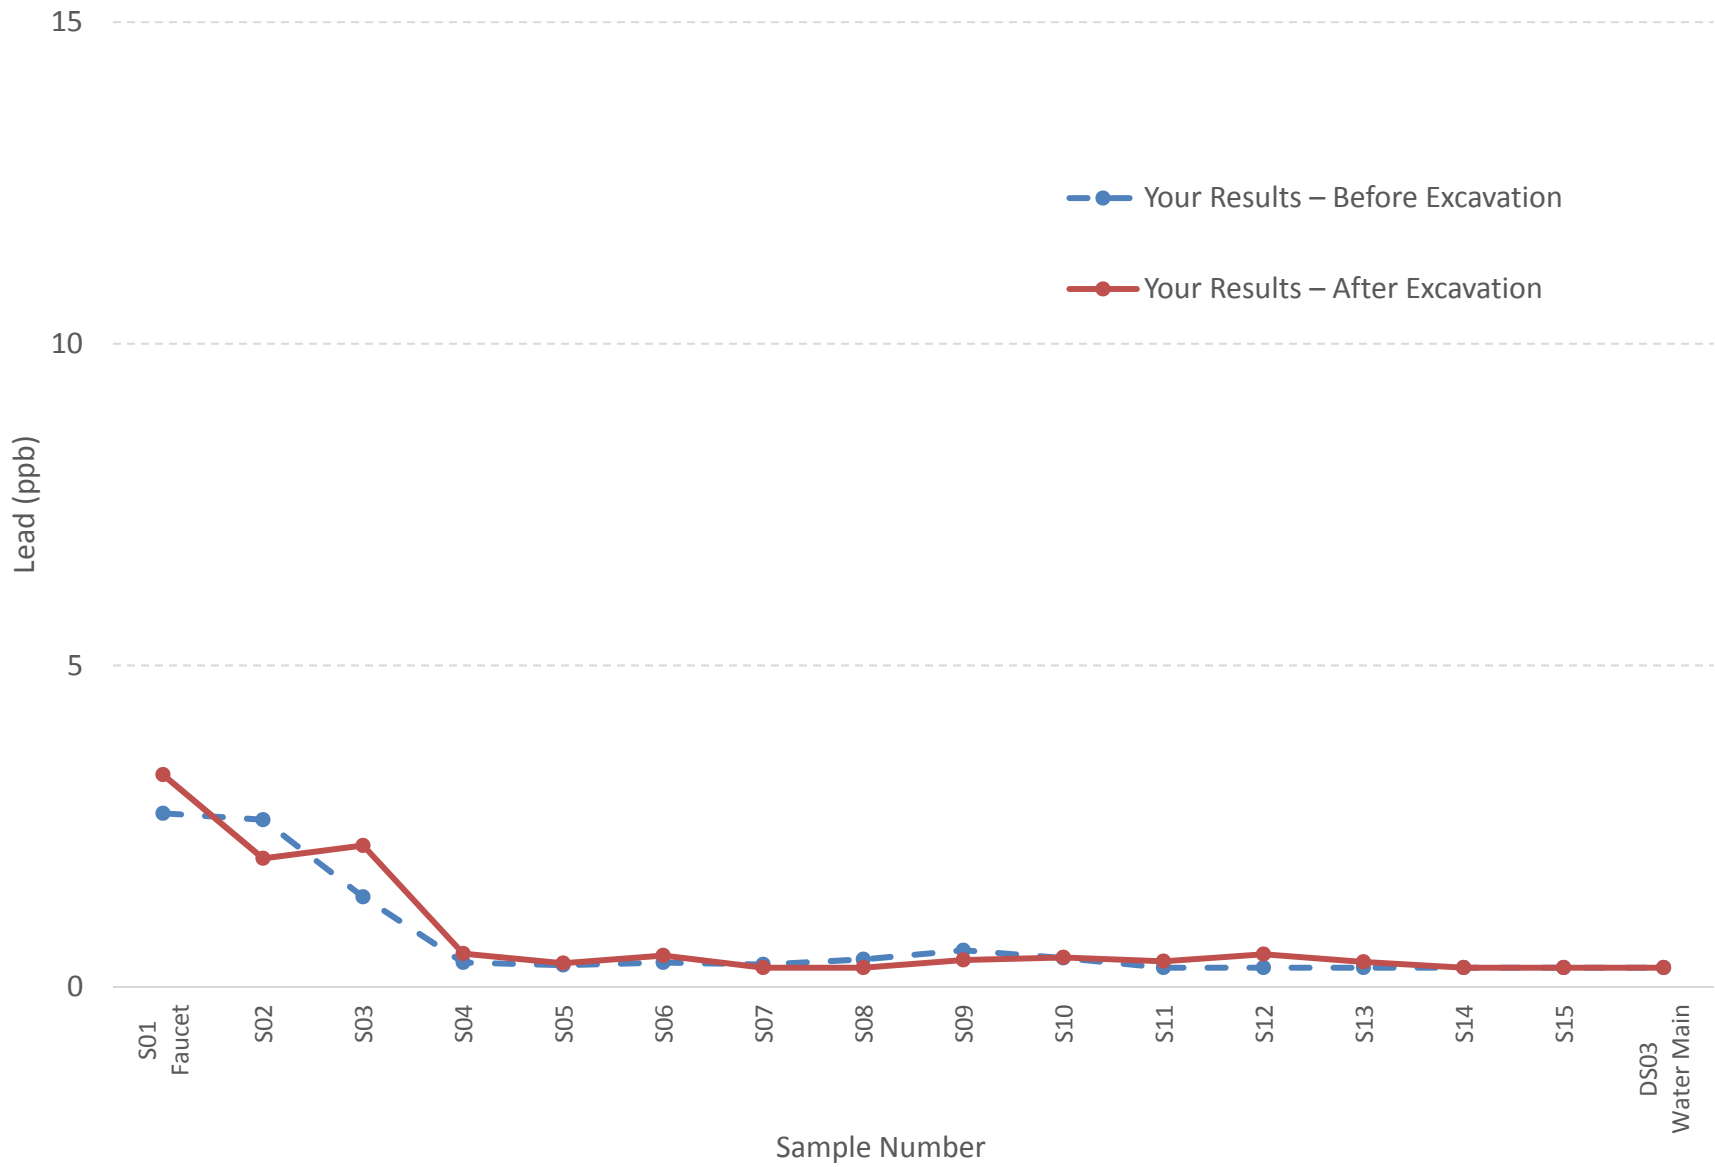

Site 2148 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/27/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2 U	0.38 J	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--	
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--	
Copper	µg/L	13.2	2.6 J	1.6 J	1.5 J	7 U	7 U	7 U	7 U	1.3 J	1.3 J	7 U	7 U	1.2 J	7 U	7 U	7 U	--	1300	1300	1000	
Lead	µg/L	2.7 J-	2.6	1.4 J	0.38 J	0.34 J	0.38 J	0.35 J	0.43 J	0.57 J	0.45 J	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	--	15	0	--	
Manganese	µg/L	6.0	10.6	1.6 J	4.8	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	2.2 J	4 U	--	--	--	50	
Nickel	µg/L	3.6 J	6 U	6 U	6 U	1.3 J	1.1 J	2.8 J	6 U	10.9	6 U	6 U	1.1 J	6 U	6 U	6 U	1.4 J	--	--	--	--	
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--	
Zinc	µg/L	362	217	124	39.2	35.1	31.4	31.3	26.8	26.8	23.0	23.7	22.1	21.8	21.0	19.8	17.1	--	--	--	5000	
Aluminum	mg/L	0.0639	0.0981	0.0803	0.0729	0.0712	0.0756	0.0792	0.071	0.0661	0.0671	0.0664	0.0657	0.0659	0.0626	0.0666	0.0617	--	--	--	0.05 to 0.2	
Calcium	mg/L	27.5	27.3	32.6	31.9	31.2	31.3	32.1	31.0	31.5	29.0	32.4	31.5	32.5	31.6	31.2	32.4	--	--	--	--	
Iron	mg/L	0.1 U	0.0267 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3	
Magnesium	mg/L	10.9	10.6	12.3	12.2	11.9	12.0	12.3	11.8	11.9	11.0	12.3	11.9	12.3	11.9	11.8	12.3	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															150	--	--	--	--	
Chloride	mg/L	Not Sampled															19	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.087 J	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															28 J-	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2148 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/22/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2 U	0.35 J	0.34 J	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--	
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--	
Copper	µg/L	16.9	3.1 J	3.3 J	2.7 J	7 U	1.7 J	1.3 J	1.4 J	7 U	1.5 J	1.6 J	1.3 J	1.4 J	1.4 J	1.3 J	7 U	--	1300	1300	1000	
Lead	µg/L	3.3	2.0	2.2	0.52 J	0.37 J	0.49 J	1.8 U	1.8 U	0.42 J	0.46 J	0.40 J	0.51 J-	0.39 J	1.8 U	0.30 J	1.8 U	--	15	0	--	
Manganese	µg/L	4.5	6.0	2.4 J	1.4 J	1.4 J	1.4 J	1.3 J	1.2 J	1.3 J	1.8 J	1.2 J	1.3 J	3.1 J	1.6 J	1.6 J	1.4 J	--	--	--	50	
Nickel	µg/L	2.2 J	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--	
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--	
Zinc	µg/L	337	166	107	31.6	27.4	25.3	23.7	23.1	22.7	25.5	19.7	19.6	18.3	16.4	16.5	14.3	--	--	--	5000	
Aluminum	mg/L	0.0394	0.0836	0.0479	0.0498	0.0471	0.045	0.0463	0.0459	0.0523	0.0579	0.0522	0.0416	0.0532	0.0502	0.0531	0.0492	--	--	--	0.05 to 0.2	
Calcium	mg/L	28.1	27.2 J	26.0	26.4	26.6	26.5	26.0	25.9	27.8	33.2	28.2	28.1	27.9	27.4	27.3	28.8	--	--	--	--	
Iron	mg/L	0.0555 J	0.0238 J	0.0201 J	0.0302 J	0.0307 J	0.03 J	0.028 J	0.0281 J	0.0293 J	0.0325 J	0.0289 J	0.0296 J	0.0338 J	0.0336 J	0.0341 J	0.0326 J	--	--	--	0.3	
Magnesium	mg/L	9.76	9.04 J	9.06	9.36	9.39	9.31	9.20	9.10	9.88	11.4	9.97	9.92	9.83	9.51	9.62	9.99	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															110	--	--	--	--	
Chloride	mg/L	Not Sampled															19	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.21 J	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															28	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--	

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2166, Kitchen Faucet, 10/29/2016 and 11/13/2016

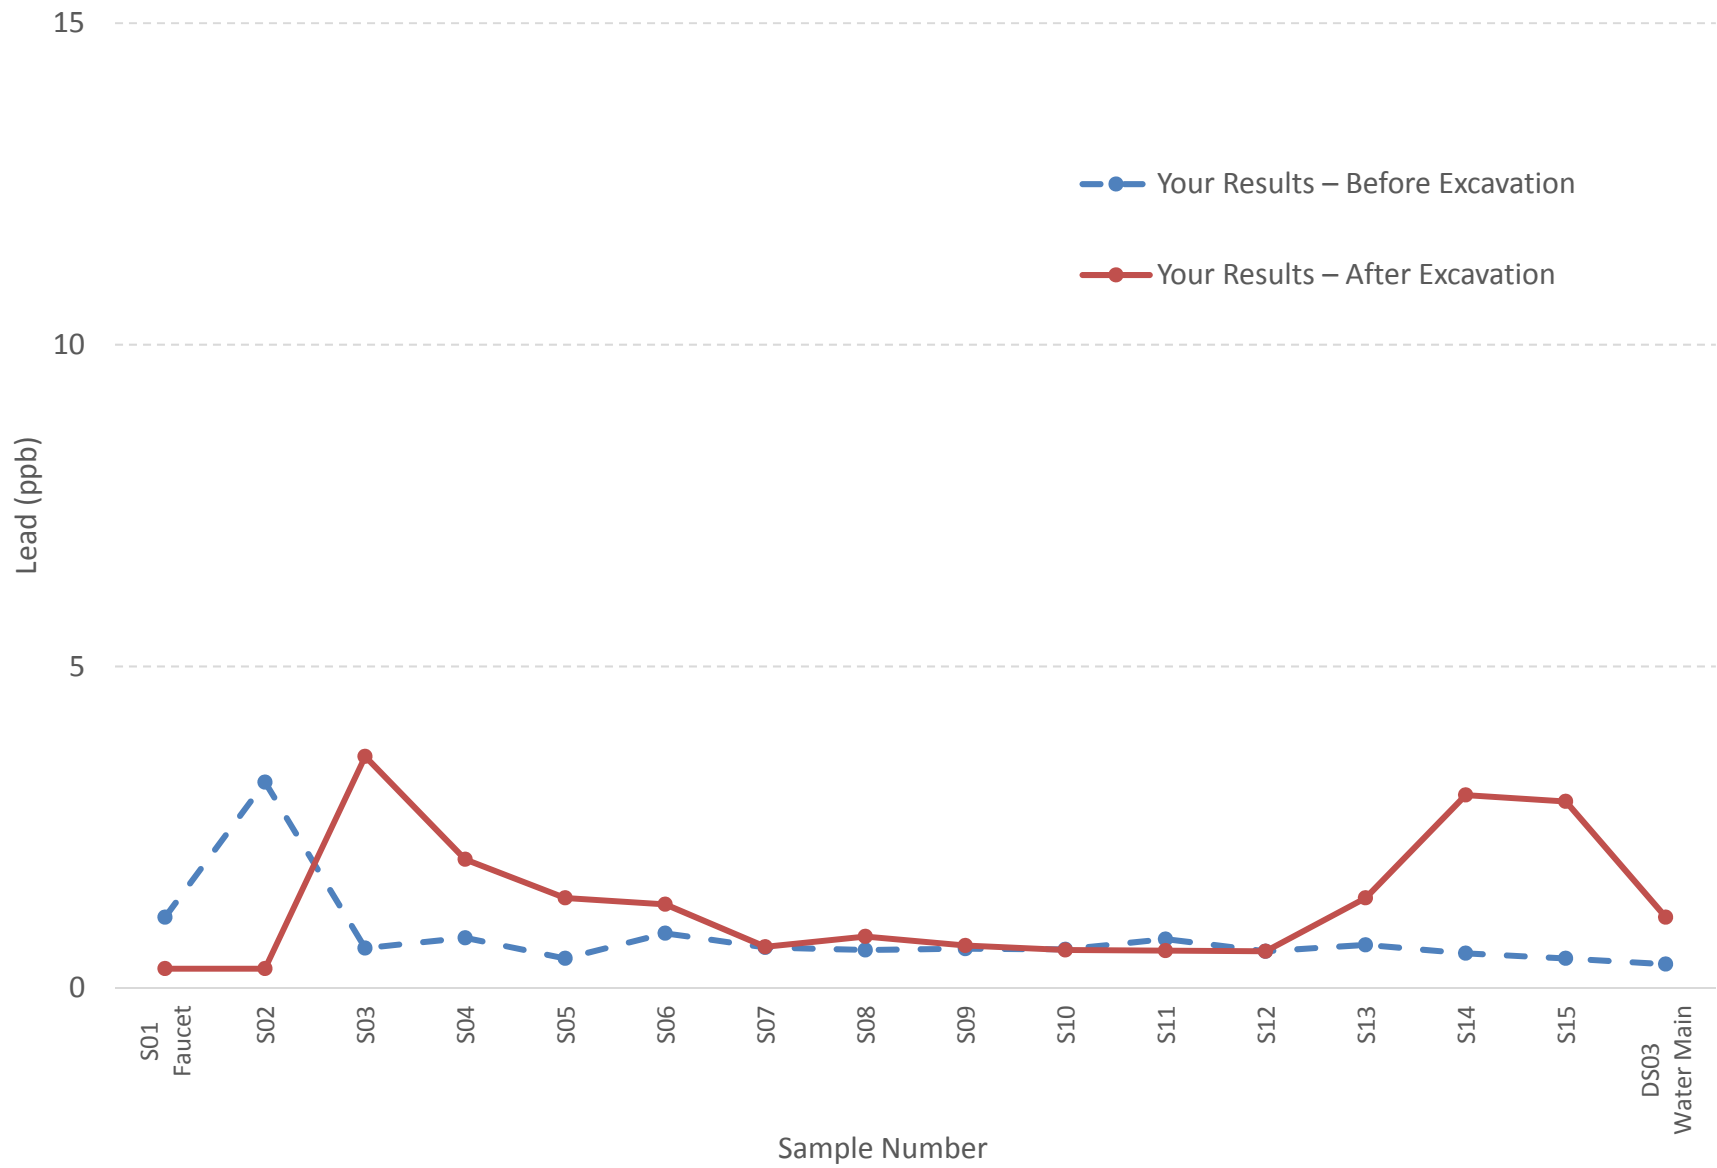

Site 2166 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/29/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	0.3 J	2 U	2 U	2 U	2 U	5	--	5	--	
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--	
Copper	µg/L	152	334	112	31.6	12.3 J+	12.4 J+	10.6 J+	9.6 J+	7.7 J+	7.9 J+	7.2 J+	7 U	7 U	7 U	6.7 J	5.5 J	--	1300	1300	1000	
Lead	µg/L	1.1 J	3.2	0.62 J	0.78 J	0.46 J	0.85 J	0.63 J	0.59 J	0.61 J	0.60 J	0.76 J	0.57 J	0.67 J	0.54 J	0.46 J	0.37 J	--	15	0	--	
Manganese	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	--	--	--	50	
Nickel	µg/L	7.1	5.6 J	1.4 J	1.4 J	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--	
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--	
Zinc	µg/L	563	379	31.4	10.7	5.1 J	4.8 J	3.4 J	3.4 J	2.8 J	3.2 J	2.2 J	1.8 J	10 U	10 U	10 U	10 U	--	--	--	5000	
Aluminum	mg/L	0.0459	0.0465	0.0546	0.0678	0.0533 J+	0.0569 J+	0.0559 J+	0.056 J+	0.055 J+	0.0585 J+	0.0567 J+	0.0558 J+	0.0608 J+	0.0517 J+	0.0537 J+	0.0564 J+	--	--	--	0.05 to 0.2	
Calcium	mg/L	32.5	32.2	32.8	32.9	30.1	29.5	30.8	31.3	30.8	30.5	30.5	30.2	30.3	30.4	30.5	29.5	--	--	--	--	
Iron	mg/L	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3	
Magnesium	mg/L	11.3	10.9	11.0	11.2	10.2	10.1	10.3	10.5	10.3	10.3	10.3	10.3	10.2	10.3	10.3	10.0	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															160	--	--	--	--	
Chloride	mg/L	Not Sampled															18	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.089 J	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															27	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2166 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/13/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	77.0	184	45.8	18.7	10.0	10.3	8.5	8.0	6.6 J	6.3 J	5.6 J	5.3 J	5.8 J	5.3 J	5.7 J	4.7 J	--	1300	1300	1000
Lead	µg/L	1.8 U	1.8 U	3.6	2.0	1.4 J	1.3 J	0.64 J	0.80 J	0.66 J	0.59 J	0.58 J	0.57 J	1.4 J	3.0	2.9 J-	1.1 J	--	15	0	--
Manganese	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	--	--	--	50
Nickel	µg/L	1.3 J	2.0 J	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	245	418	21.7	7.8 J	6.7 J	6.1 J	5.2 J	4.5 J	4.2 J	4.4 J	4.0 J	3.5 J	3.3 J	3.2 J	4.1 J	2.2 J	--	--	--	5000
Aluminum	mg/L	0.0519	0.0317 J	0.0362	0.0394	0.0388	0.0428	0.0388	0.0424	0.0378	0.0397	0.0424	0.0381	0.0337 J	0.0405	0.0441	0.0416	--	--	--	0.05 to 0.2
Calcium	mg/L	33.9	32.8	31.7	31.2	33.5	34.1	32.9	32.5	31.8	32.5	33.0	31.1	33.0	33.5	34.6	33.6	--	--	--	--
Iron	mg/L	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	12.4	11.4	11.2	11.0	11.6 J	11.9	11.8	11.6	11.5	11.5	11.8	11.2	11.5	11.8	12.2	12.0	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															19	--	--	--	250
Fluoride	mg/L	Not Sampled															0.19 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															30	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2178, Kitchen Faucet, 10/29/2016 and 11/13/2016

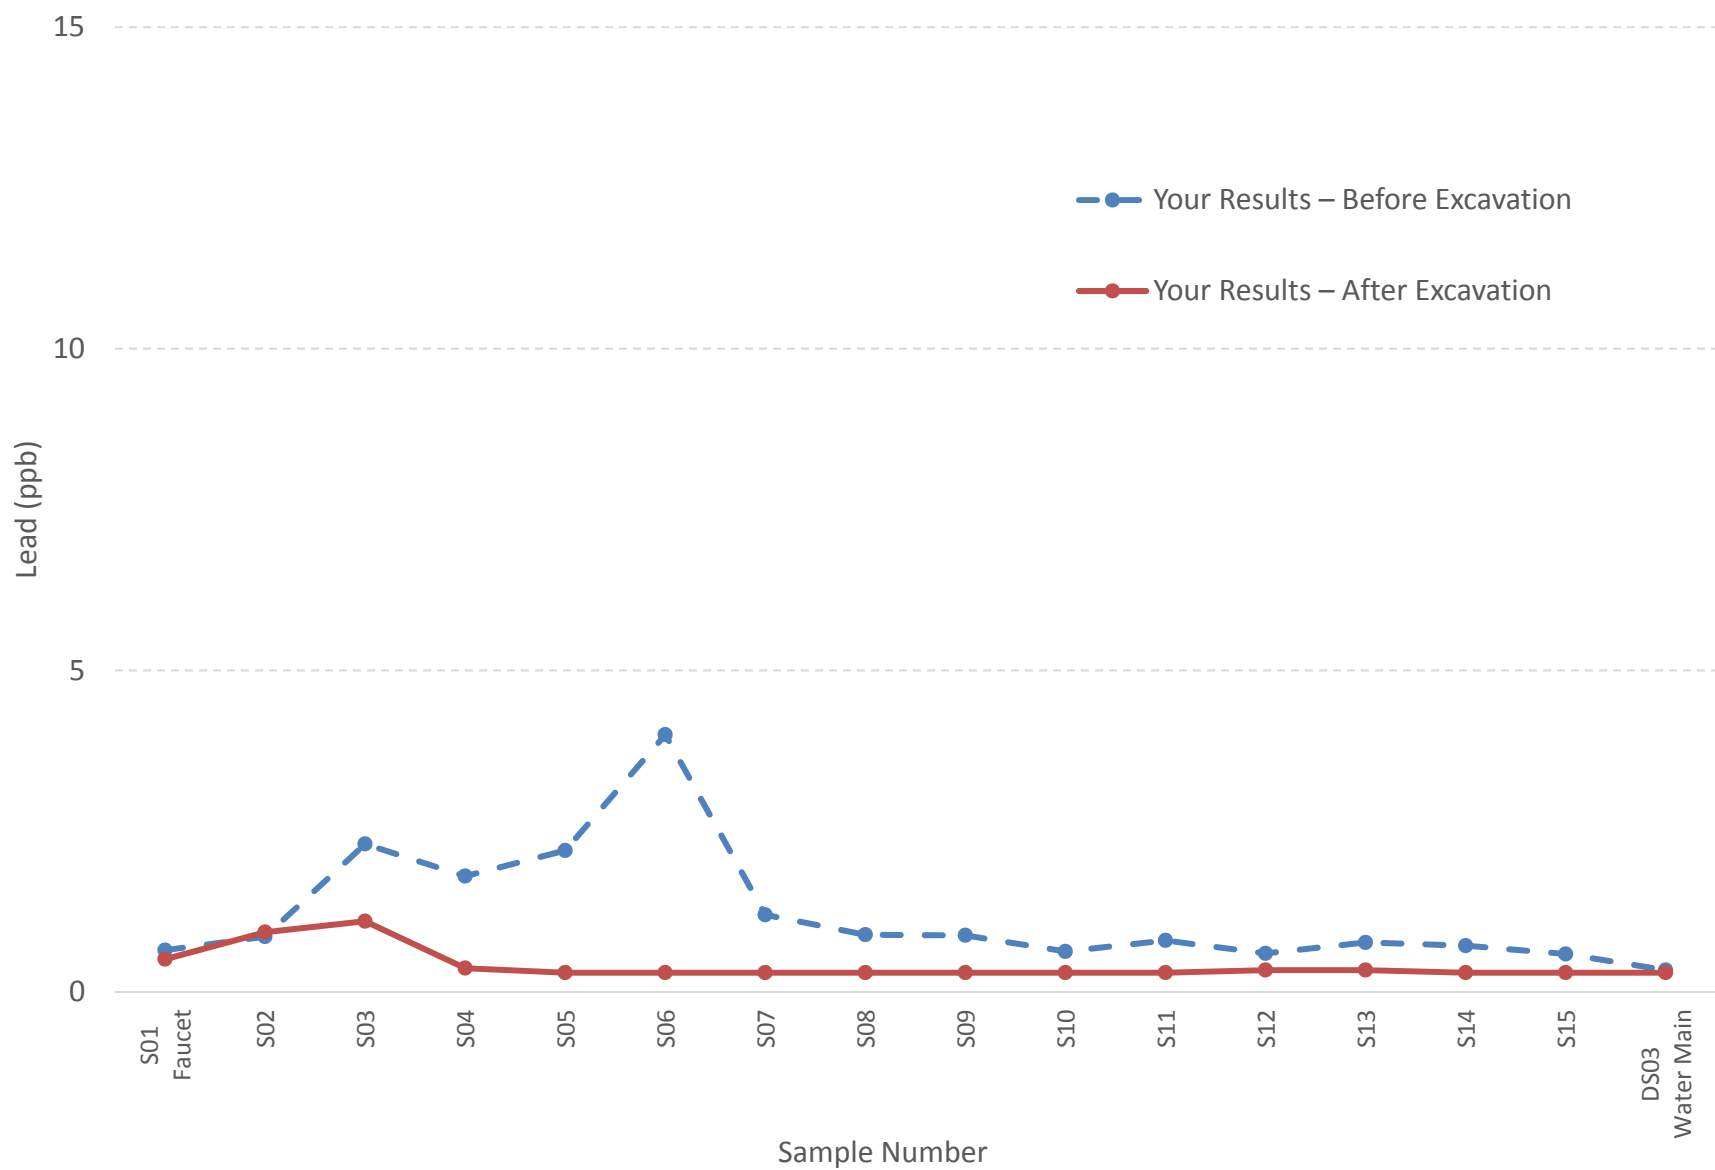

Site 2178 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/29/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	0.99 J	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	94.6	92.5	135	94.5	60.4	26.5	21	12.1	9.8	9.7	9.0	22.9	9.3	8.5	8.9	4 J	--	1300	1300	1000
Lead	µg/L	0.65 J	0.86 J	2.3	1.8	2.2	4.0	1.2 J	0.89 J	0.88 J	0.63 J	0.80 J	0.60 J	0.77 J	0.72 J	0.59 J	0.34 J	--	15	0	--
Manganese	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	2.1 J	4 U	4 U	4 U	4 U	--	--	--	50
Nickel	µg/L	6 U	2.3 J	6 U	6 U	6 U	6 U	1.3 J	6 U	6 U	6 U	1.2 J	8.4	5.4 J	3.0 J	1.4 J	1.7 J	--	--	--	--
Tin	µg/L	10 U	5.9 J	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	44.1	15.1	11.4	10.9	13.9	14.1	24.1	15.0	17.3	18.2	19.9	48.4	23.8	15.5	7.6 J	3.9 J	--	--	--	5000
Aluminum	mg/L	0.0784	0.0626	0.0652	0.0619	0.0664	0.0592	0.0636	0.0559	0.0525	0.0565	0.0568	0.0579	0.0615	0.061	0.0609	0.0584	--	--	--	0.05 to 0.2
Calcium	mg/L	32.2 J	32.6 J-	33.1 J-	32.3 J-	33.0 J-	32.3 J-	32.7 J-	32.6	32.7	33.1	32.7	32.2	31.9	32.0	32.2	32.5	--	--	--	--
Iron	mg/L	0.1 UJ	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	10.5 J	10.5	10.9	10.6	10.8	10.6	10.7	10.8	10.7	10.9	10.8	10.6	11.3	11.3	11.2	11.2	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															190	--	--	--	--
Chloride	mg/L	Not Sampled															18	--	--	--	250
Fluoride	mg/L	Not Sampled															0.088 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															27	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2178 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/13/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	90.4	95.9	102	87.9	60.9	21.1	11.4	8.5	7.3	6.8 J	6.8 J	6.3 J	6.3 J	6.1 J	5.6 J	4.3 J	--	1300	1300	1000
Lead	µg/L	0.51 J	0.93 J	1.1 J	0.37 J	1.8 U	1.8 U	1.8 U	0.30 J	1.8 U	1.8 U	1.8 U	0.34 J	0.34 J	1.8 U	1.8 U	1.8 U	--	15	0	--
Manganese	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	--	--	--	50
Nickel	µg/L	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	64.8	11.5	8.4 J	7.5 J	7.9 J	11.8	12.5	13.2	13.2	14.5	15.6	15.5	13.8	7.9 J	6.3 J	4.2 J	--	--	--	5000
Aluminum	mg/L	0.0644	0.0449	0.0531	0.0561	0.0691	0.0645	0.0552	0.0499	0.0521	0.0534	0.0501	0.0438	0.0446	0.0468	0.0491	0.0452	--	--	--	0.05 to 0.2
Calcium	mg/L	32.9 J	32.4	32.4	33.4	33.3	32.6	32.6	31.9	31.5	33.0	33.9	32.8	31.7	31.8	32.5	33.0	--	--	--	--
Iron	mg/L	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	11.8 J	11.9	11.8	12.1	12.0	11.6	11.2	11.3	10.9	11.4	11.8	11.4	11.1	11.4	11.5	11.5	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															140	--	--	--	--
Chloride	mg/L	Not Sampled															19	--	--	--	250
Fluoride	mg/L	Not Sampled															0.2 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															29	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2183, Kitchen Faucet, 10/29/2016 and 11/18/2016

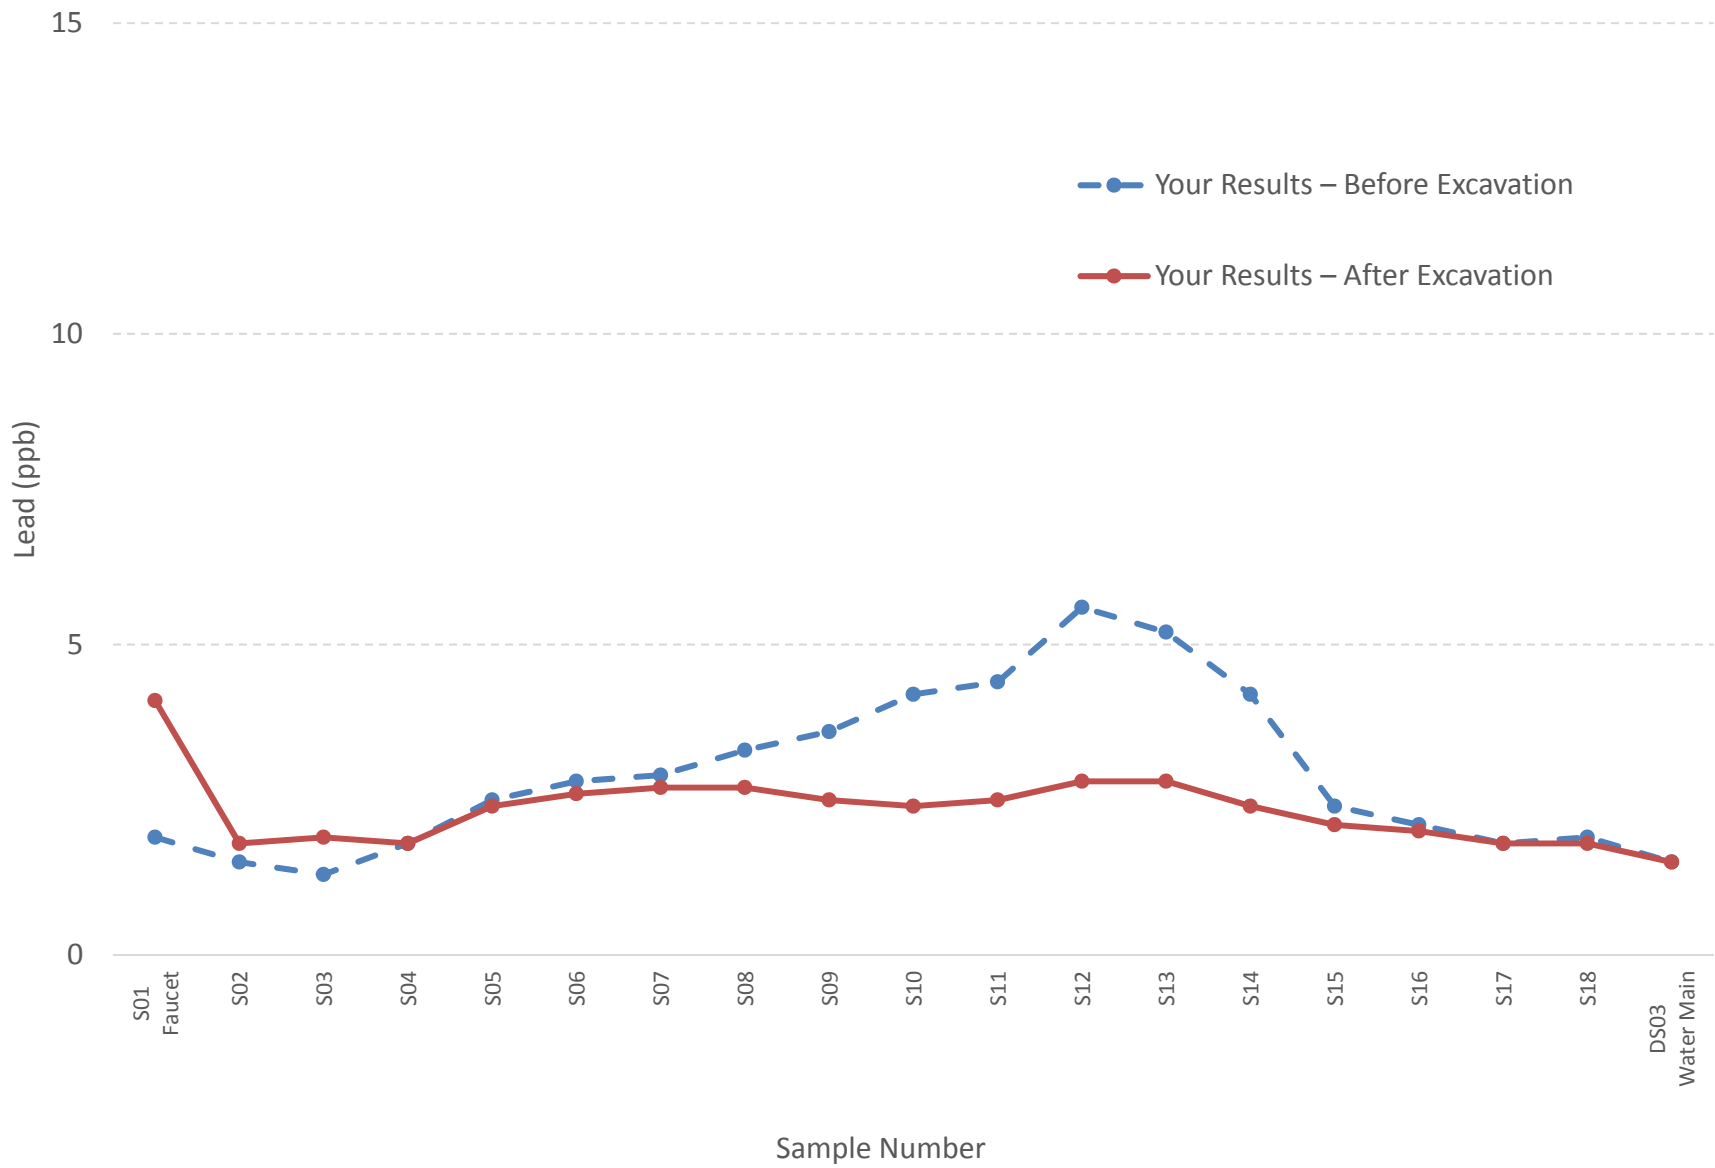

Site 2183 -- Basement Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/29/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.35 J	2 U	0.34 J	0.35 J	2 U	0.34 J	0.31 J	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	15.5	10.9	9.8	8.5	8.5	8.4	5.1 J	4.1 J	3.9 J	3.8 J	4.2 J	3.8 J	1.6 J	1.7 J	1.6 J	1.4 J	1.5 J	1.3 J	1.2 J	--	1300	1300	1000
Lead	µg/L	1.9	1.5 J	1.3 J	1.8	2.5	2.8	2.9	3.3	3.6	4.2	4.4	5.6	5.2	4.2	2.4	2.1 J	1.8	1.9	1.5 J	--	15	0	--
Manganese	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	--	--	--	50
Nickel	µg/L	3.5 J	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	216	25.2	6.4 J	5.2 J	5.9 J	5.2 J	3.8 J	4.1 J	5.8 J	6.1 J	6.9 J	6.4 J	3.2 J	2.6 J	2.4 J	2 J	2 J	1.8 J	10 U	--	--	--	5000
Aluminum	mg/L	0.0497 J+	0.0589 J+	0.0551 J+	0.0614 J+	0.054 J+	0.0572 J+	0.0553 J+	0.0548 J+	0.0566	0.0537	0.0487	0.056	0.046	0.0569	0.0547	0.0502	0.0444	0.0525	0.0436	--	--	--	0.05 to 0.2
Calcium	mg/L	31.5	31.2	29.8	28.4	30.3	29.6	29.8	29.2	31.5	29.3	28.9	28.8	29.2	29.7	30.0	29.8	29.7	29.6	30.4	--	--	--	--
Iron	mg/L	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 UJ	0.1 UJ	0.1 UJ	0.1 UJ	0.1 UJ	0.1 UJ	0.1 UJ	--	--	--	0.3
Magnesium	mg/L	10.6	10.5	10.1	9.62	10.2	10.1	10.1	9.95	10.8	10.1	10.0	9.9	9.96	10.2	10.1	10.0	9.91	9.92	10.1	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		170	--	--	--	--
Chloride	mg/L	Not Sampled																		18	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.084 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		29	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		1 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2183 -- Basement Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/18/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	23.3	2.0 J	6.4 J	4.8 J	3.8 J	3.9 J	3.4 J	2.7 J	2.5 J	2.7 J	2.6 J	3 J	2.4 J	1.8 J	2.1 J	2 J	2.2 J	1.4 J	1.5 J	--	1300	1300	1000
Lead	µg/L	4.1	1.8	1.9	1.8	2.4	2.6	2.7	2.7	2.5	2.4	2.5	2.8	2.8	2.4	2.1	2.0	1.8	1.8 J-	1.5 J	--	15	0	--
Manganese	µg/L	1.9 J	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	--	--	--	50
Nickel	µg/L	15.4	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--
Tin	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	832	1.8 J	15.0	7.6 J	6.3 J	5.9 J	5.3 J	4.8 J	4.2 J	3.9 J	4.0 J	4.5 J	3.7 J	3.3 J	2.9 J	2.7 J	2.9 J	2.7 J	10 U	--	--	--	5000
Aluminum	mg/L	0.036 U	0.0372 J+	0.0435 J+	0.045 J+	0.0427 J+	0.0459 J+	0.0407 J+	0.0539 J+	0.0458 J+	0.0407 J+	0.041 J+	0.0506 J+	0.036 U	0.0381 J+	0.0428 J+	0.0416 J+	0.0427 J+	0.0417 J+	0.0405 J+	--	--	--	0.05 to 0.2
Calcium	mg/L	31.8	33.3	30.3	29.6	29.5	31.1	31.8	32.2	30.3	29.7	31.3	31.8	31.4	32.5	32.0	32.4	32.0	30.9	32.1	--	--	--	--
Iron	mg/L	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	10.7	11.0	9.87	9.48	9.49	9.97	10.1	10.1	9.63	9.46	10.1	10.3	10.0	10.4	10.2	10.4	10.3	10.1	10.5	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		17	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.19 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		28	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		1 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2187, Kitchen Faucet, 10/25/2016 and 11/16/2016

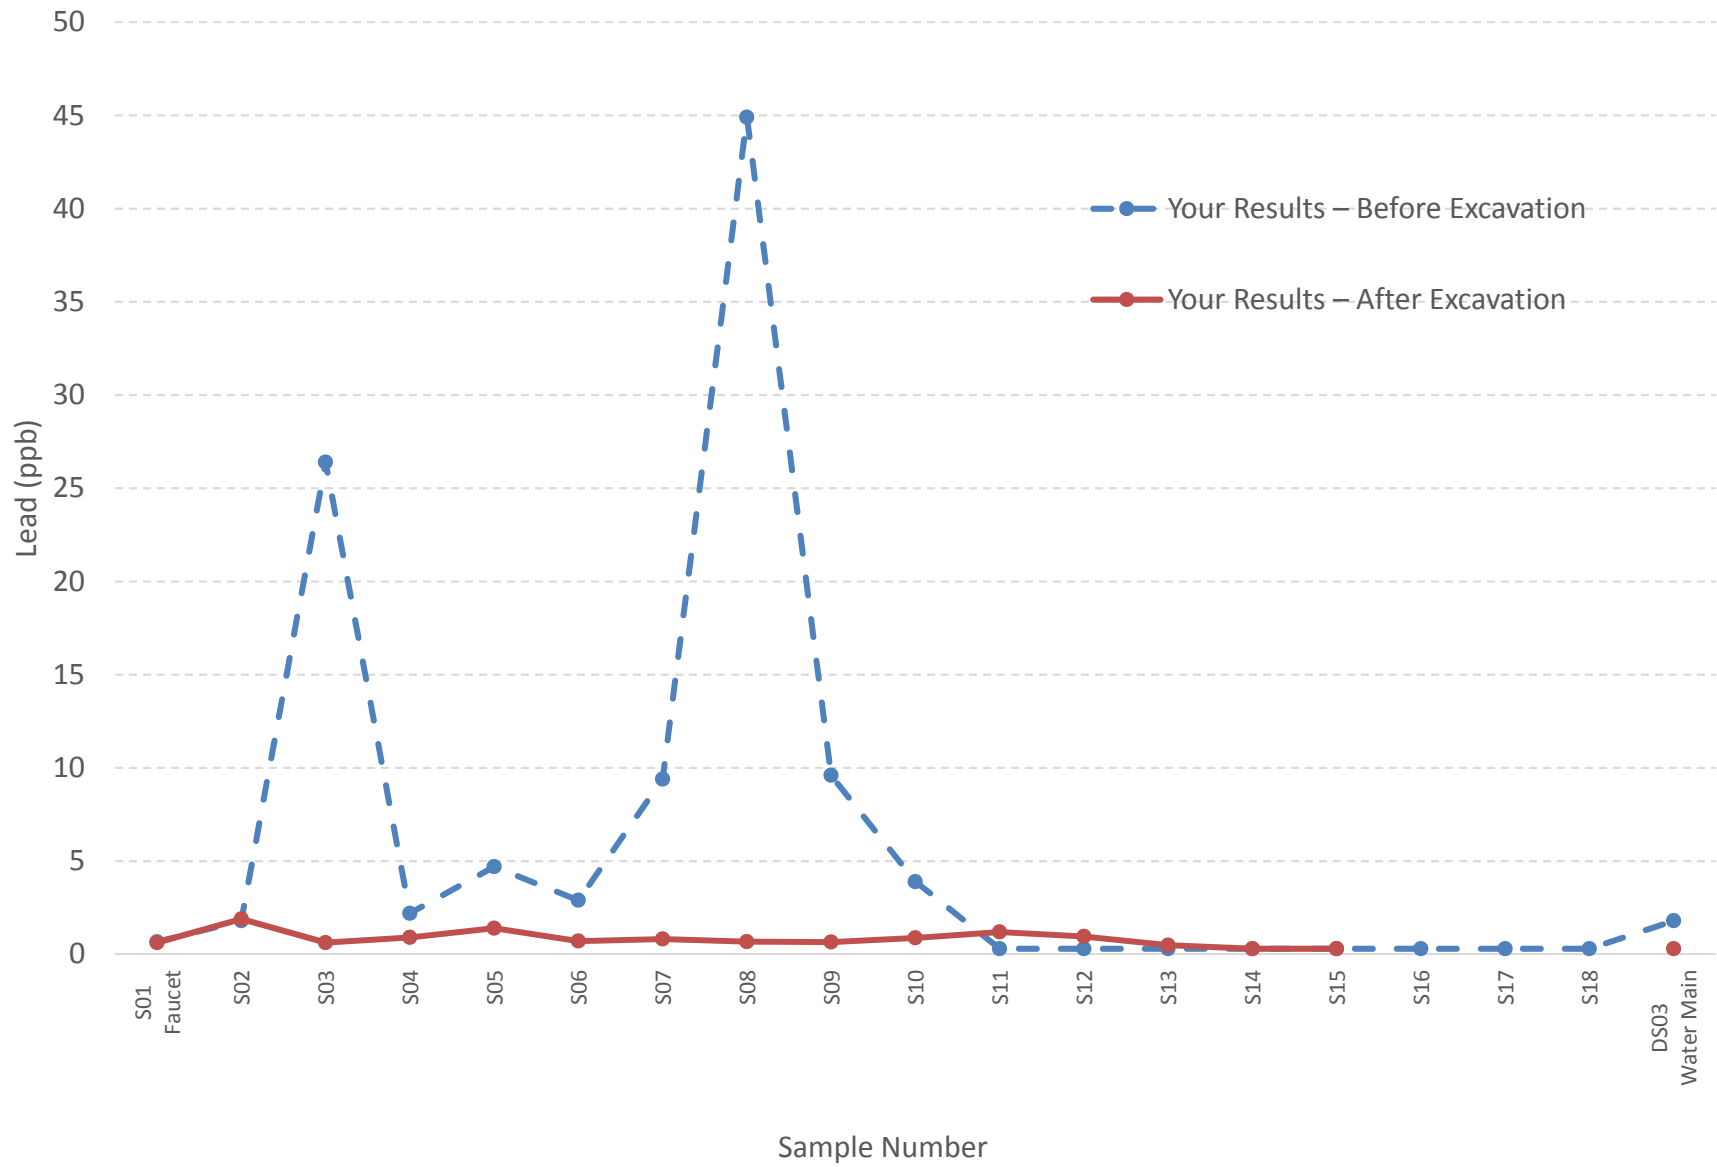

Site 2187 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/25/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2 U	2 U	2 UJ	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	42.8	98.0	428 J	48.7	54.0	37.7	77.6	142.0	73.9	34.0	12.0	10.8	9.2	8.9	8.7	8.2	8.0	7.7	6.2 J	--	1300	1300	1000
Lead	µg/L	0.67 J	1.8 U	26.4 J	2.2	4.7	2.9	9.4	44.9	9.6	3.9	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 UJ	--	15	0	--
Manganese	µg/L	1.1 J	0.75 J	66 J-	6.4	6.6	3.4 J	11.2	20.6	11.5	6.0	1.1 J	0.92 J	4 U	4 U	4 U	0.71 J	0.75 J	4 U	4 U	--	--	--	50
Nickel	µg/L	9.1	2.6 J	6 UJ	1.8 J	1.8 J	6 U	1.3 J	1.7 J	2.7 J	1.6 J	1.2 J	6 U	1.3 J	1.2 J	1.3 J	1.1 J	1.1 J	6 U	6 U	--	--	--	--
Tin	µg/L	10 U	10 U	27.8 J-	10 U	10 U	10 U	10 U	10 U	28	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	191	51.7	271 J	61.5	26.1	16.6	53.3	59.1	34.2	20.2	13.7	7.3 J	6.6 J	6.9 J	18.3	6.8 J	9.6 J	6.5 J	4.1 J	--	--	--	5000
Aluminum	mg/L	0.0571	0.0484	0.314	0.114	0.106	0.0886	0.117	0.199	0.131	0.112	0.0807	0.0792	0.0717	0.0763	0.0776	0.0753	0.0756	0.0772	0.0729	--	--	--	0.05 to 0.2
Calcium	mg/L	33.9 J	34.5	35.3 J	35.7	35.0	34.5	34.1	34.5	34.3	34.3	34.3	34.3	32.8	34.7	34.2	34.6	34.2	34.3	34.2	--	--	--	--
Iron	mg/L	0.1 U	0.1 U	1.31	0.088 J	0.0675 J	0.025 J	0.132	0.238	0.119	0.0471 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	11.8 J	12.0	11.1 J	11.3	11.2	11.0	11.0	11.1	11.0	11.0	11.0	11.0	10.6	11.2	11.0	11.1	11.0	11.0	10.9	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110	--	--	--	--
Chloride	mg/L	Not Sampled																		19	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.2 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		30 J-	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		1 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 2187 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/16/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	5	--	5	--
Chromium	µg/L	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	4 U	100	--	100	--
Copper	µg/L	57.3	87.1	41.9	22.0	25.3	23.7	30.6	29.9	26.6	23.8	19.8	12.3	11.2	10.7	9.3	4.7 J	--	1300	1300	1000
Lead	µg/L	0.63 J	1.9	0.63 J	0.91 J	1.4 J	0.71 J	0.82 J	0.68 J	0.66 J	0.88 J	1.2 J	0.96 J	0.49 J-	1.8 U	1.8 U	1.8 U	--	15	0	--
Manganese	µg/L	2.5 J	4 U	0.88 J	2.1 J	2.9 J	1.8 J	2.2 J	3.7 J	1.5 J	1.4 J	1.5 J	1.1 J	1.1 J	0.9 J	0.8 J	4 U	--	--	--	50
Nickel	µg/L	6.2	7.5	6 U	6 U	6 U	6 U	1.1 J	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	6 U	--	--	--	--
Tin	µg/L	36.7	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	--	--	--
Zinc	µg/L	191	250	28.4	29.3	16.5	11.0	9.9 J	17.7	7.2 J	8.7 J	16.9	5.3 J	4.3 J	3.8 J	4.1 J	10 U	--	--	--	5000
Aluminum	mg/L	0.0598	0.0513	0.0698	0.0775	0.0728	0.0561	0.0563	0.0535	0.0503	0.0512	0.0453	0.038	0.0319 J	0.0362	0.0417	0.0286 J	--	--	--	0.05 to 0.2
Calcium	mg/L	33.5	28.9	34.4	33	31.9	31.3	34.1	33.2	32.9	33.6	34.2	31.2	32	31.8	31.4	32 J	--	--	--	--
Iron	mg/L	0.0479 J	0.1 U	0.1 U	0.017 J	0.0162 J	0.1 U	0.0206 J	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	11.1	9.35	10.9	10.3	10.0	9.95	10.7	10.6	10.5	10.6	10.8	9.94	10.2	10.1	10.1	10.2 J	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															17 J-	--	--	--	250
Fluoride	mg/L	Not Sampled															0.19 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															28 J-	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															1 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3016 -- Bar Sink Faucet,
10/18/2016 (Preliminary) and 12/1/2016

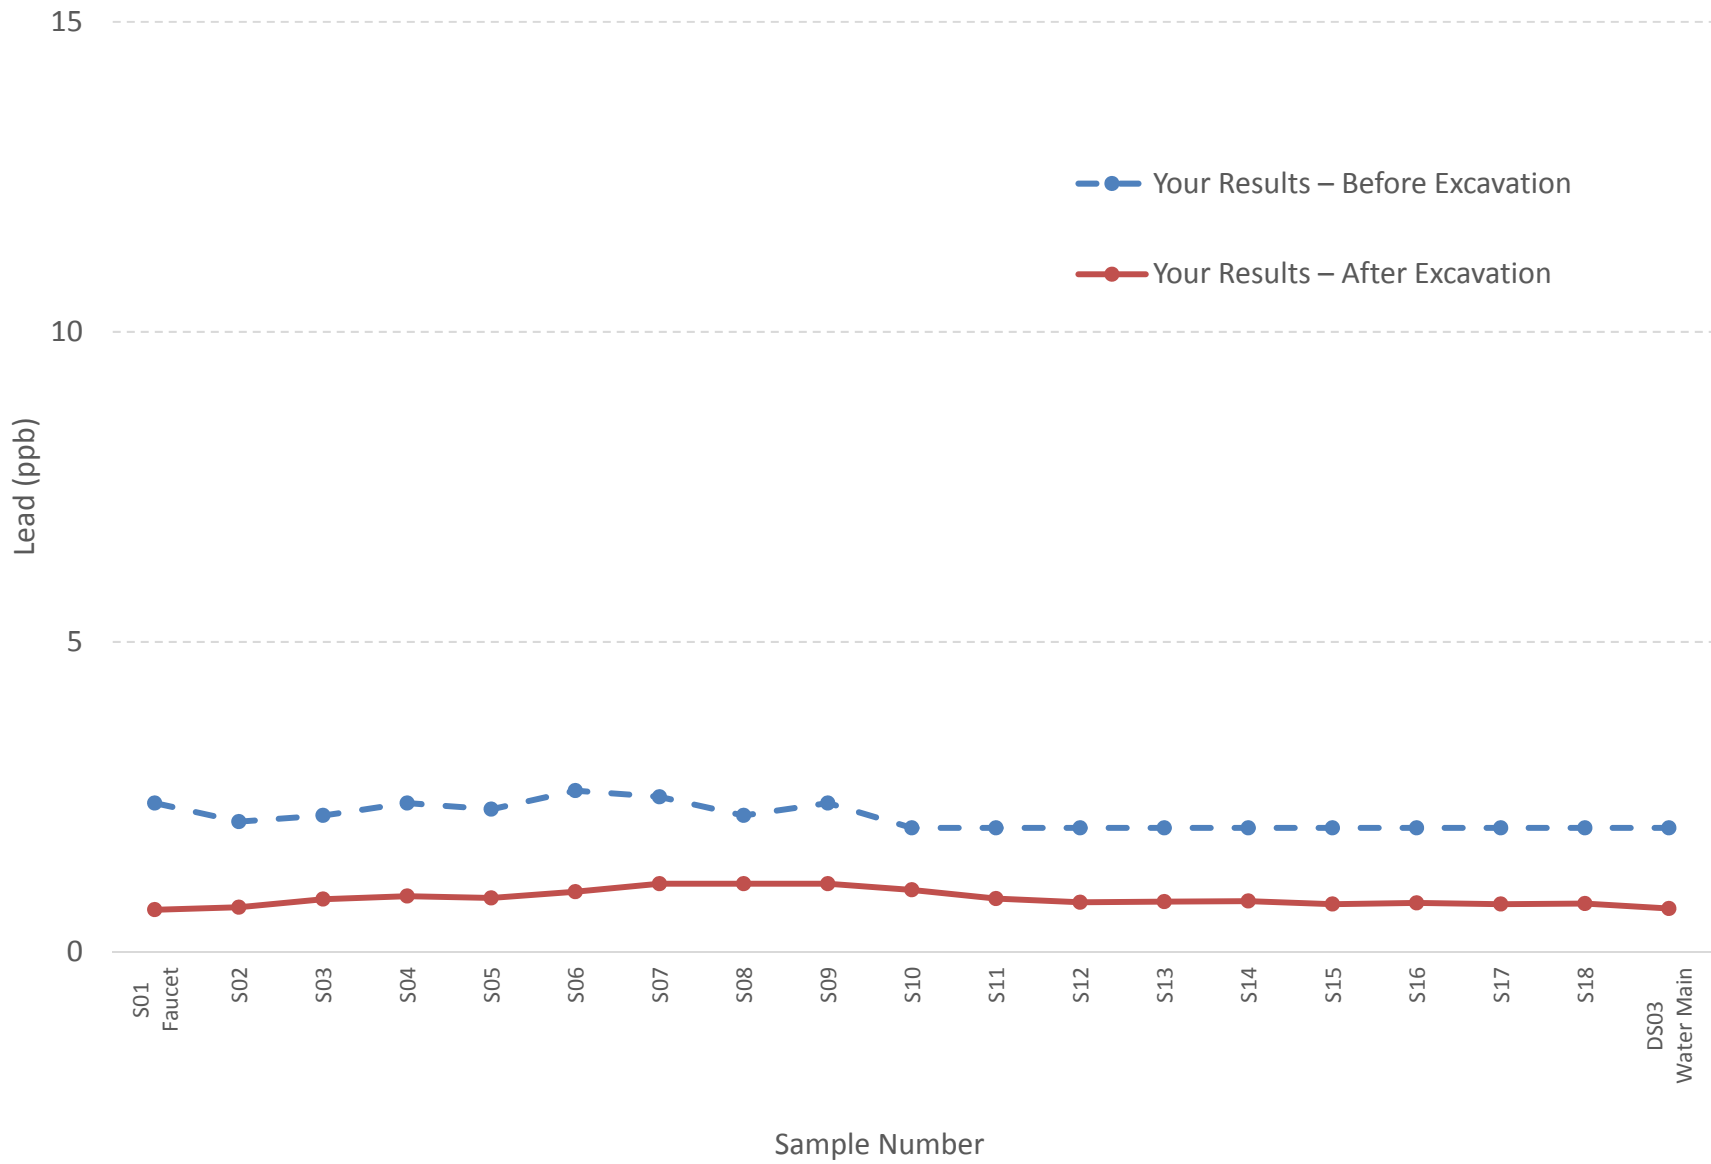

Site 3016 -- Bar Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/18/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.4	2.1	2.2	2.4	2.3	2.6	2.5	2.2	2.4	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	82	49	61	26	26	22	20 U	20 U	22	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.088	0.083	0.081	0.090	0.088	0.091	0.091	0.086	0.090	0.095	0.092	0.087	0.087	0.088	0.084	0.089	0.092	0.095	0.090	--	--	--	0.05 to 0.2
Calcium	mg/L	37	36	36	38	37	37	38	37	37	39	38	37	37	37	35	37	37	41	38	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	13	13	13	13	13	13	13	13	13	14	13	13	13	13	12	13	13	14	13	--	--	--	--
Potassium	mg/L	1.6	1.6	1.6	1.7	1.6	1.6	1.7	1.6	1.6	1.7	1.7	1.6	1.6	1.6	1.5	1.6	1.6	1.8	1.6	--	--	--	--
Sodium	mg/L	12	11	11	12	12	12	12	12	12	12	12	11	12	12	11	11	11	13	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3016 -- Bar Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/1/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
		1st sample (125 mL)	2nd sample (125 mL)																	Distribution System				
Cadmium	µg/L	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	5	--	5	--
Chromium	µg/L	0.52 U	0.57 U	0.50 U	0.47 U	0.52 U	0.48 U	0.51 U	0.48 U	0.57 U	0.52 U	0.46 U	0.48 U	0.48 U	0.56 U	0.49 U	0.53 U	0.53 U	0.52 U	0.56 U	100	--	100	--
Copper	µg/L	1.1	0.9 J	1.0	1.1	1.1	1.7	1.0	0.92 J	1.1	0.98 J	0.90 J	0.83 J	0.93 J	0.89 J	0.84 J	1.0	0.84 J	0.86 J	0.76 J	--	1300	1300	1000
Lead	µg/L	0.68 J	0.72 J	0.85 J	0.9 J	0.87 J	0.97 J	1.1	1.1	1.1	1.0	0.86 J	0.80 J	0.81 J	0.82 J	0.77 J	0.79 J	0.77 J	0.78 J	0.70 J	--	15	0	--
Manganese	µg/L	0.66 U	0.68 U	0.80 U	0.68 U	0.66 U	0.63 U	0.64 U	0.62 U	0.66 U	0.75 U	0.68 U	0.72 U	0.66 U	0.70 U	0.65 U	0.71 U	0.64 U	0.67 U	0.70 U	--	--	--	50
Nickel	µg/L	0.83	0.56	0.63	0.51	0.52	0.50	0.53	0.52	0.55	0.49 J	0.55	0.54	0.62	0.50 J	0.49 J	0.72	0.50 J	0.56	0.53	--	--	--	--
Tin	µg/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	--	--	--	--
Zinc	µg/L	40.7	32.0	44.2	20.6	18.8	20.6	15.5	14.2	16.8	13.5	12.9	12.2	13.6	12.2	11.7	12.5	11.1	11.4	7.5	--	--	--	5000
Aluminum	mg/L	0.0373	0.0388	0.0382	0.0377	0.0380	0.0388	0.0393	0.0392	0.0394	0.0387	0.0387	0.0383	0.0397	0.0399	0.0382	0.0405	0.0391	0.0389	0.0397	--	--	--	0.05 to 0.2
Calcium	mg/L	34.5 J	34.4 J	35.8 J	35.5 J	34.8 J	34.4 J	35.4 J	34.9 J	35.0 J	34.4 J	35.2 J	34.8 J	34.5 J	35.2 J	34.3 J	34.7 J	35.2 J	35.1 J	34.2 J	--	--	--	--
Iron	mg/L	0.0192 J	0.100 U	0.042 J	0.0253 J	0.0153 J	0.166	0.100 U	0.100 U	0.0146 J	0.0195 J	0.100 U	0.0166 J	0.0178 J	0.0277 J	0.0297 J	0.0243 J	0.0138 J	0.0331 J	0.0204 J	--	--	--	0.3
Magnesium	mg/L	11.8	11.8	12.3	12.2	11.9	11.8	12.2	12.0	11.9	11.8	12.0	11.9	11.8	12.0	11.7	11.8	11.9	11.9	11.6	--	--	--	--
Potassium	mg/L	1.58	1.57	1.57	1.64	1.63	1.57	1.61	1.60	1.58	1.57	1.60	1.57	1.55	1.57	1.57	1.56	1.58	1.57	1.57	--	--	--	--
Sodium	mg/L	10.5 J	10.4 J	10.9 J	10.9 J	10.7 J	10.6 J	10.9 J	10.7 J	10.8 J	10.5 J	10.7 J	10.6 J	10.5 J	10.8 J	10.5 J	10.5 J	10.7 J	10.7 J	10.4 J	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		103	--	--	--	--
Chloride	mg/L	Not Sampled																		16.6	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.111	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		27.0	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.232	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3037, Kitchen Faucet, 11/2/2016 and 12/19/2016

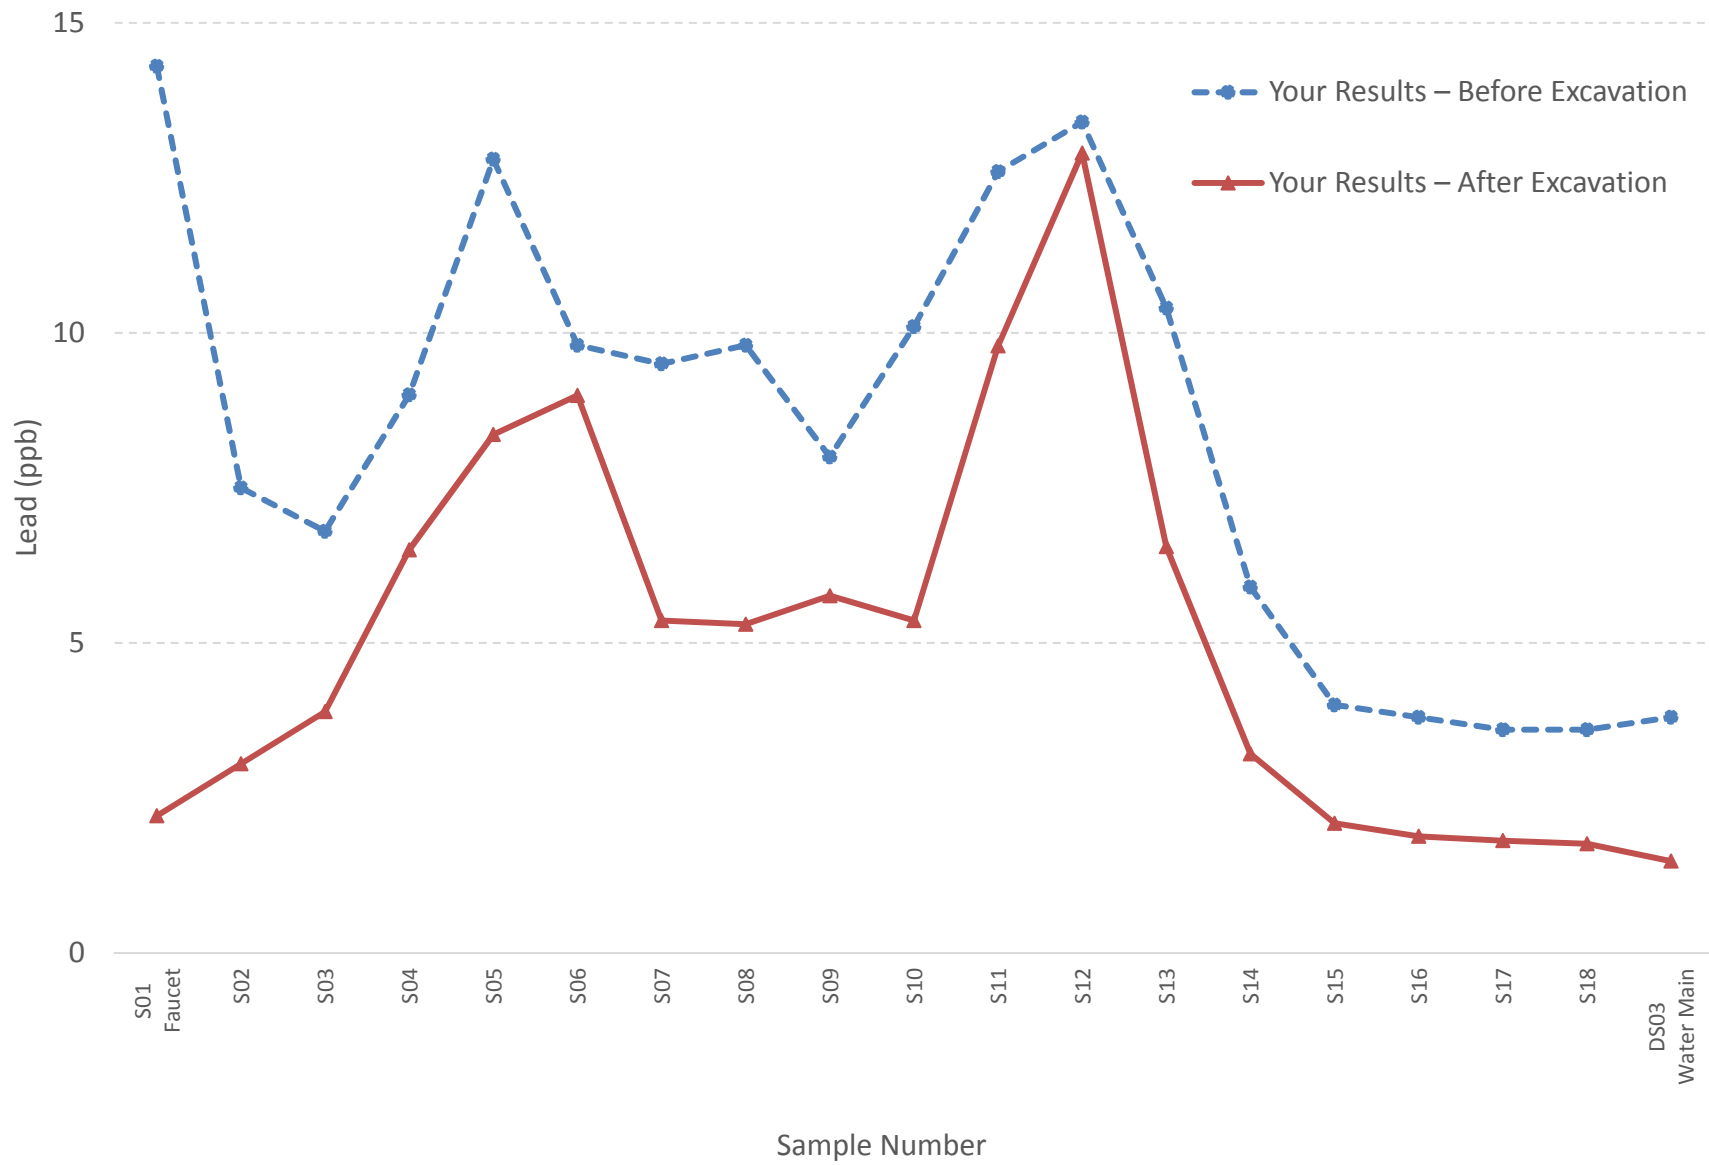

Site 3037 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 11/2/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.31	0.37	0.22	0.08 J	0.07 J	0.05 J	0.05 J	0.05 J	0.04 J	0.03 J	0.04 J	0.03 J	0.03 J	0.05 J	0.03 J	0.03 J	0.03 J	0.03 J	0.03 J	5	--	5	--
Chromium	µg/L	0.52 J	0.53 J	0.51 J	0.52 J	0.42 U	0.53 J	0.54 J	0.55 J	0.57 J	0.57 J	0.59 J	0.60 J	0.59 J	0.64 J	0.60 J	0.62 J	0.60 J	0.63 J	0.63 J	100	--	100	--
Copper	µg/L	1.3	1.0 J	1.0	1.1	1.3	1.7	1.3	0.96 J	1.1	1.5	1.2	1.1	1.0	0.92 J	0.86 J	0.80 J	0.80 J	0.85 J	0.93 J	--	1300	1300	1000
Lead	µg/L	14.3	7.5	6.8	9.0	12.8	9.8	9.5	9.8	8.0	10.1	12.6	13.4	10.4	5.9	4.0	3.8	3.6	3.6	3.8	--	15	0	--
Manganese	µg/L	7.5	3.9	2.0	1.6	2.1	2.1	2.2	2.1	1.6	1.1	0.84 J	0.84 J	0.94 J	1.1	1.0 J	1.1	1.1	1.0	1.2	--	--	--	50
Nickel	µg/L	1.2	0.61	0.79	0.65	0.69	0.74	0.72	0.69	0.67	0.74	0.71	0.82	0.80	0.84	0.76	0.64	0.66	0.72	0.70	--	--	--	--
Tin	µg/L	0.08 J	1 U	1 U	0.1 J	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	--	--	--	--
Zinc	µg/L	200	196	119	46.1	46.3	50.5	48.7	41.8	36.1	30.1	25.0	26.3	20.9	22.3	20.1	20.4	19.3	18.7	19.6	--	--	--	5000
Aluminum	mg/L	0.0963	0.129	0.106	0.0869	0.0858	0.0825	0.0778	0.0796	0.0763	0.0775	0.0764	0.0760	0.0744	0.0754	0.0737	0.0746	0.0731	0.0766	0.0737	--	--	--	0.05 to 0.2
Calcium	mg/L	33.8	34.0	34.9	34.6	35.1	34.3	34.4	33.8	34.5	34.5	34.5	33.8	33.4	34.0	34.0	33.6	34.6	34.6	34.6	--	--	--	--
Iron	mg/L	0.494	0.636	0.350	0.117	0.162	0.124	0.112	0.114	0.0537 J	0.0594 J	0.0255 J	0.0579 J	0.0394 J	0.0156 U	0.0321 J	0.0302 J	0.0349 J	0.0296 J	0.0432 J	--	--	--	0.3
Magnesium	mg/L	12.2	12.1	12.3	12.1	12.3	12.2	12.3	12.0	12.3	12.4	12.3	12.0	11.9	12.1	12.2	12.0	12.4	12.3	12.3	--	--	--	--
Potassium	mg/L	1.76	1.73	1.82	1.81	1.81	1.82	1.78	1.76	1.84	1.81	1.83	1.79	1.72	1.73	1.84	1.73	1.81	1.79	1.81	--	--	--	--
Sodium	mg/L	11.9	11.8	12.2	12.0	12.2	11.9	12.1	11.8	12.1	12.1	12.1	11.9	11.7	11.6	12.0	11.7	12.1	12.1	12.0	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		105	--	--	--	--
Chloride	mg/L	Not Sampled																		17.5	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.137	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		27.3	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.130	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3037 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/19/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	Not available - results will be provided when available																			5	--	5	--
Chromium	µg/L	Not available - results will be provided when available																			100	--	100	--
Copper	µg/L	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.73	1.27 K	1.00 U	1.04 K	1.00 U	1.00 K	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	--	1300	1300	1000
Lead	µg/L	2.21	3.05	3.89	6.50	8.36	8.99	5.36	5.30	5.76	5.36	9.79	12.9	6.55	3.21	2.09	1.88	1.81	1.76	1.48	--	15	0	--
Zinc	µg/L	149	144	73.3	34.4	28.6	34.3	36.7	32.3	33.7	30.8	24.0	16.8	15.1 K	20.8	14.7 K	13.6 K	13.4 K	13.0 K	10.0 U	--	--	--	5000
Manganese	µg/L	Not available - results will be provided when available																			--	--	--	50
Nickel	µg/L																				--	--	--	--
Aluminum	mg/L																				--	--	--	0.05 to 0.2
Calcium	mg/L																				--	--	--	--
Iron	mg/L																				--	--	--	0.3
Magnesium	mg/L																				--	--	--	--
Potassium	mg/L																				--	--	--	--
Sodium	mg/L																				--	--	--	--
Tin	mg/L																				--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		100	--	--	--	--
Chloride	mg/L	Not Sampled																		17.3	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.09	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		29.8	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.15 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
K = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
L = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3066, Bathroom Sink Faucet,
10/10/2016 and 12/13/2016

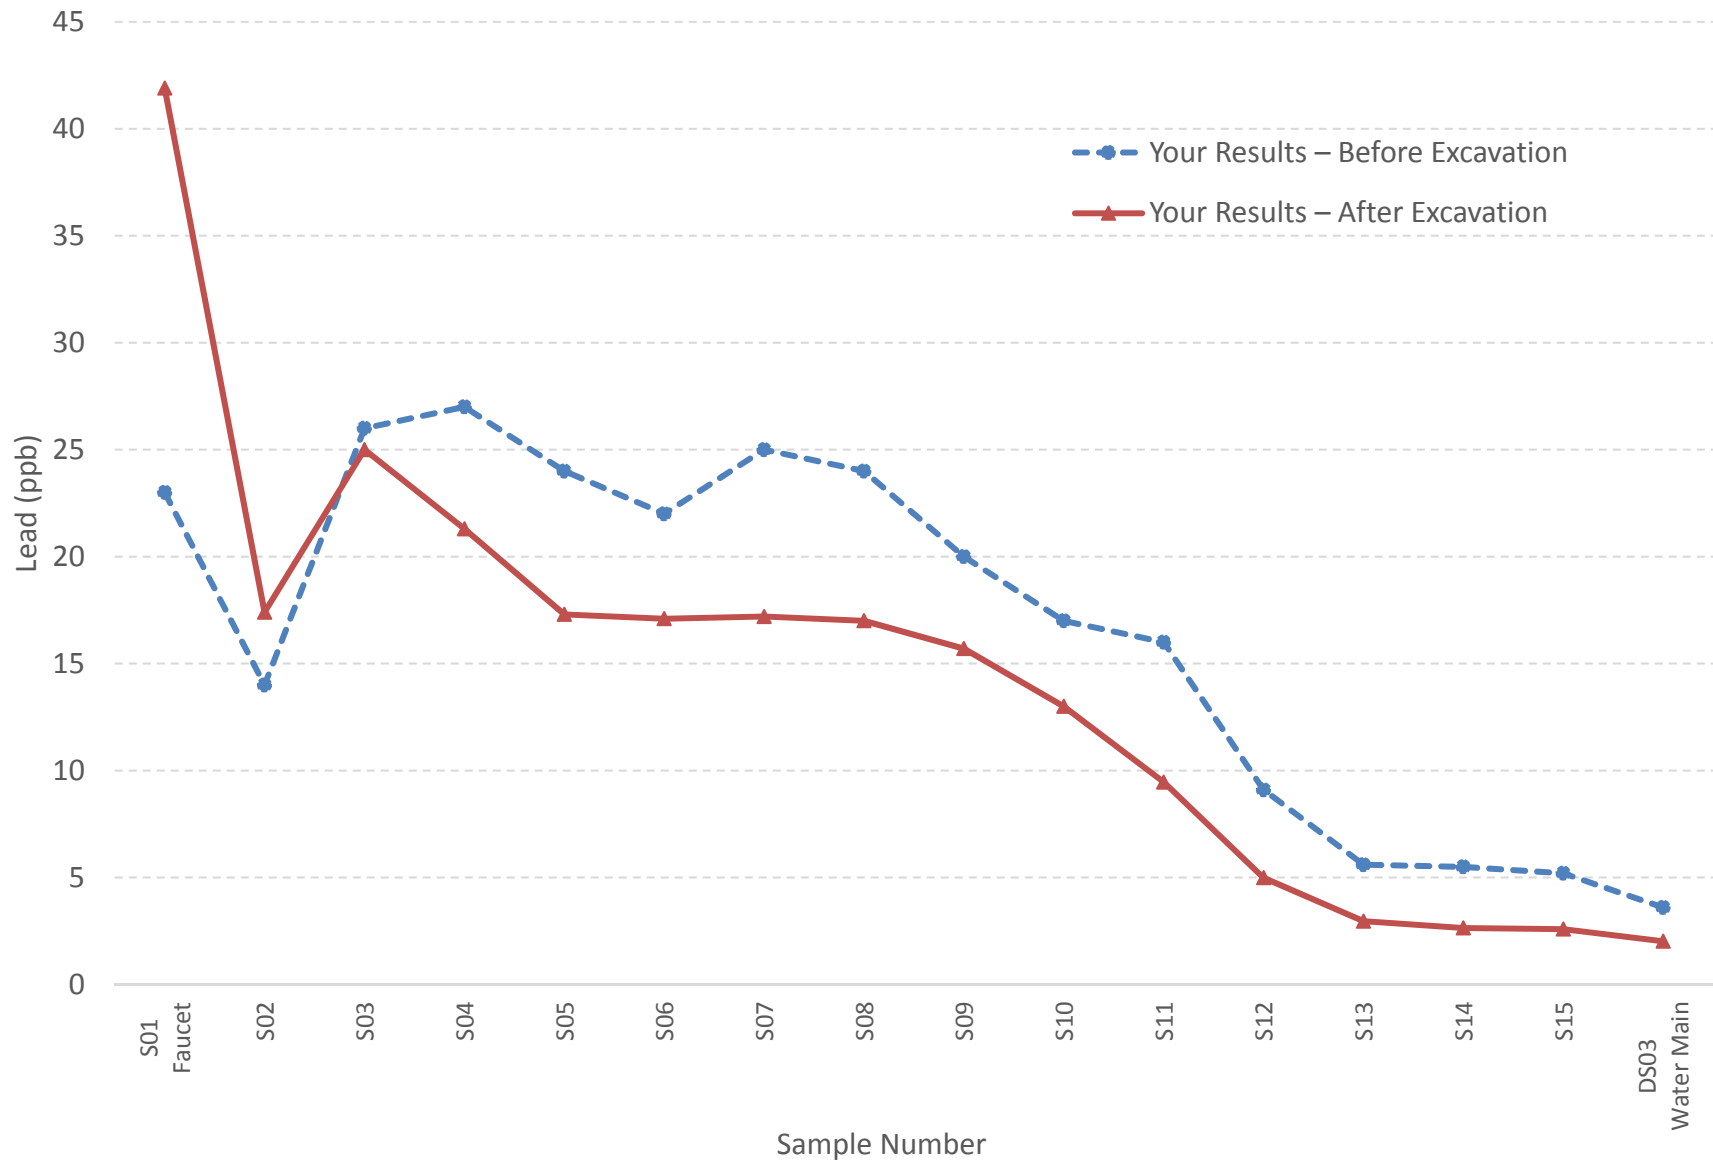

Site 3066 -- Bathroom Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/10/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--	
Chromium	µg/L	2.6 U	2.9 U	2.6 U	3.1 U	2.5 U	2.9 U	2.7 U	2.7 U	2.6 U	2.6 U	2.8 U	2.4 U	2.6 U	2.8 U	2.8 U	2.8 U	100	--	100	--	
Copper	µg/L	11	2.5 J	5.6 J	4.2 J	3.6 J	3.2 J	2.8 J	2.8 J	2.2 J	3.7 J	1.9 J	3.1 J	2.6 J	1.9 J	3.1 J	4.4 J	--	1300	1300	1000	
Lead	µg/L	23	14	26	27	24	22	25	24	20	17	16	9.1	5.6	5.5	5.2	3.6	--	15	0	--	
Manganese	µg/L	3.0 J	3.4 J	4.3	4.8	4.2	3.6 J	3.8 J	3.4 J	3.4 J	3.8 J	3.9 J	3.6 J	3.3 J	3.4 J	3.6 J	3.9 J	--	--	--	50	
Nickel	µg/L	2.2 J	1.9 J	4.0 J	2.6 J	3.7 J	1.9 J	2.1 J	1.6 J	1.7 J	2.1 J	1.9 J	2.6 J	3.8 J	1.8 J	2.0 J	2.2 J	--	--	--	--	
Zinc	µg/L	290	110	84	67	28	21	19 J	64	15 J	18 J	13 J	22	13 J	11 J	12 J	16 J	--	--	--	5000	
Aluminum	mg/L	0.078 J-	0.11 J-	0.13 J-	0.14 J-	0.14 J-	0.15 J-	0.14 J-	0.14 J-	0.14 J-	0.13 J-	0.14 J-	0.13 J-	0.14 J-	0.13 J-	0.14 J-	0.13 J-	--	--	--	0.05 to 0.2	
Calcium	mg/L	35 J+	35 J+	35 J+	36 J+	36 J+	34 J+	36 J+	36 J+	35 J+	33 J+	36 J+	35 J+	37 J+	35 J+	35 J+	35 J+	--	--	--	--	
Iron	mg/L	0.11	0.16	0.25	0.30	0.26	0.22	0.24	0.21	0.20	0.19	0.2	0.20	0.18	0.17	0.17	0.18	--	--	--	0.3	
Magnesium	mg/L	13 J+	12 J+	12 J+	13 J+	13 J+	12 J+	13 J+	13 J+	13 J+	12 J+	13 J+	12 J+	13 J+	13 J+	13 J+	12 J+	--	--	--	--	
Potassium	mg/L	1.6	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.7	1.6	1.6	1.6	--	--	--	--	
Sodium	mg/L	11	11	11	11	12	11	12	12	11	11	12	11	12	11	11	11	--	--	--	--	
Tin	mg/L	0.0025 U	0.0023 U	0.020 U	0.0017 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.0021 U	0.020 U	0.020 U	0.0017 U	0.0018 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--	
Chloride	mg/L	Not Sampled															5.0	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.17 J	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															23.9 J	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3066 -- Bathroom Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/13/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	Not available - results will be provided when available																5	--	5	--	
Chromium	µg/L																	100	--	100	--	
Copper	µg/L	32.2	2.44	6.19	2.25	1.94	2.30	1.85	1.57	1.27	1.45	1.26	1.14	1.00 U	1.00	1.12	1.00 U	--	1300	1300	1000	
Lead	µg/L	41.9	17.4	25.0	21.3	17.3	17.1	17.2	17.0	15.7	13.0	9.46	4.99	2.96	2.64	2.59	2.02	--	15	0	--	
Zinc	µg/L	1000	250	66.8	47.9	24.5	17.8	14.8	17.2	12.6	11.0	10.4	10.0 U	10.3	10.0 U	10.0 U	10.0 U	--	--	--	5000	
Manganese	µg/L	Not available - results will be provided when available																--	--	--	50	
Nickel	µg/L																	--	--	--	--	
Aluminum	mg/L																	--	--	--	0.05 to 0.2	
Calcium	mg/L																	--	--	--	--	
Iron	mg/L																	--	--	--	0.3	
Magnesium	mg/L																	--	--	--	--	
Potassium	mg/L																	--	--	--	--	
Sodium	mg/L																	--	--	--	--	
Tin	mg/L																	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															110 J	--	--	--	--	
Chloride	mg/L	Not Sampled															18.1	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.09	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															29.7 L	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															0.17	--	--	--	--	

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

K = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

L = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3070, Kitchen Faucet, 10/11/2016 (Preliminary) and 11/8/2016

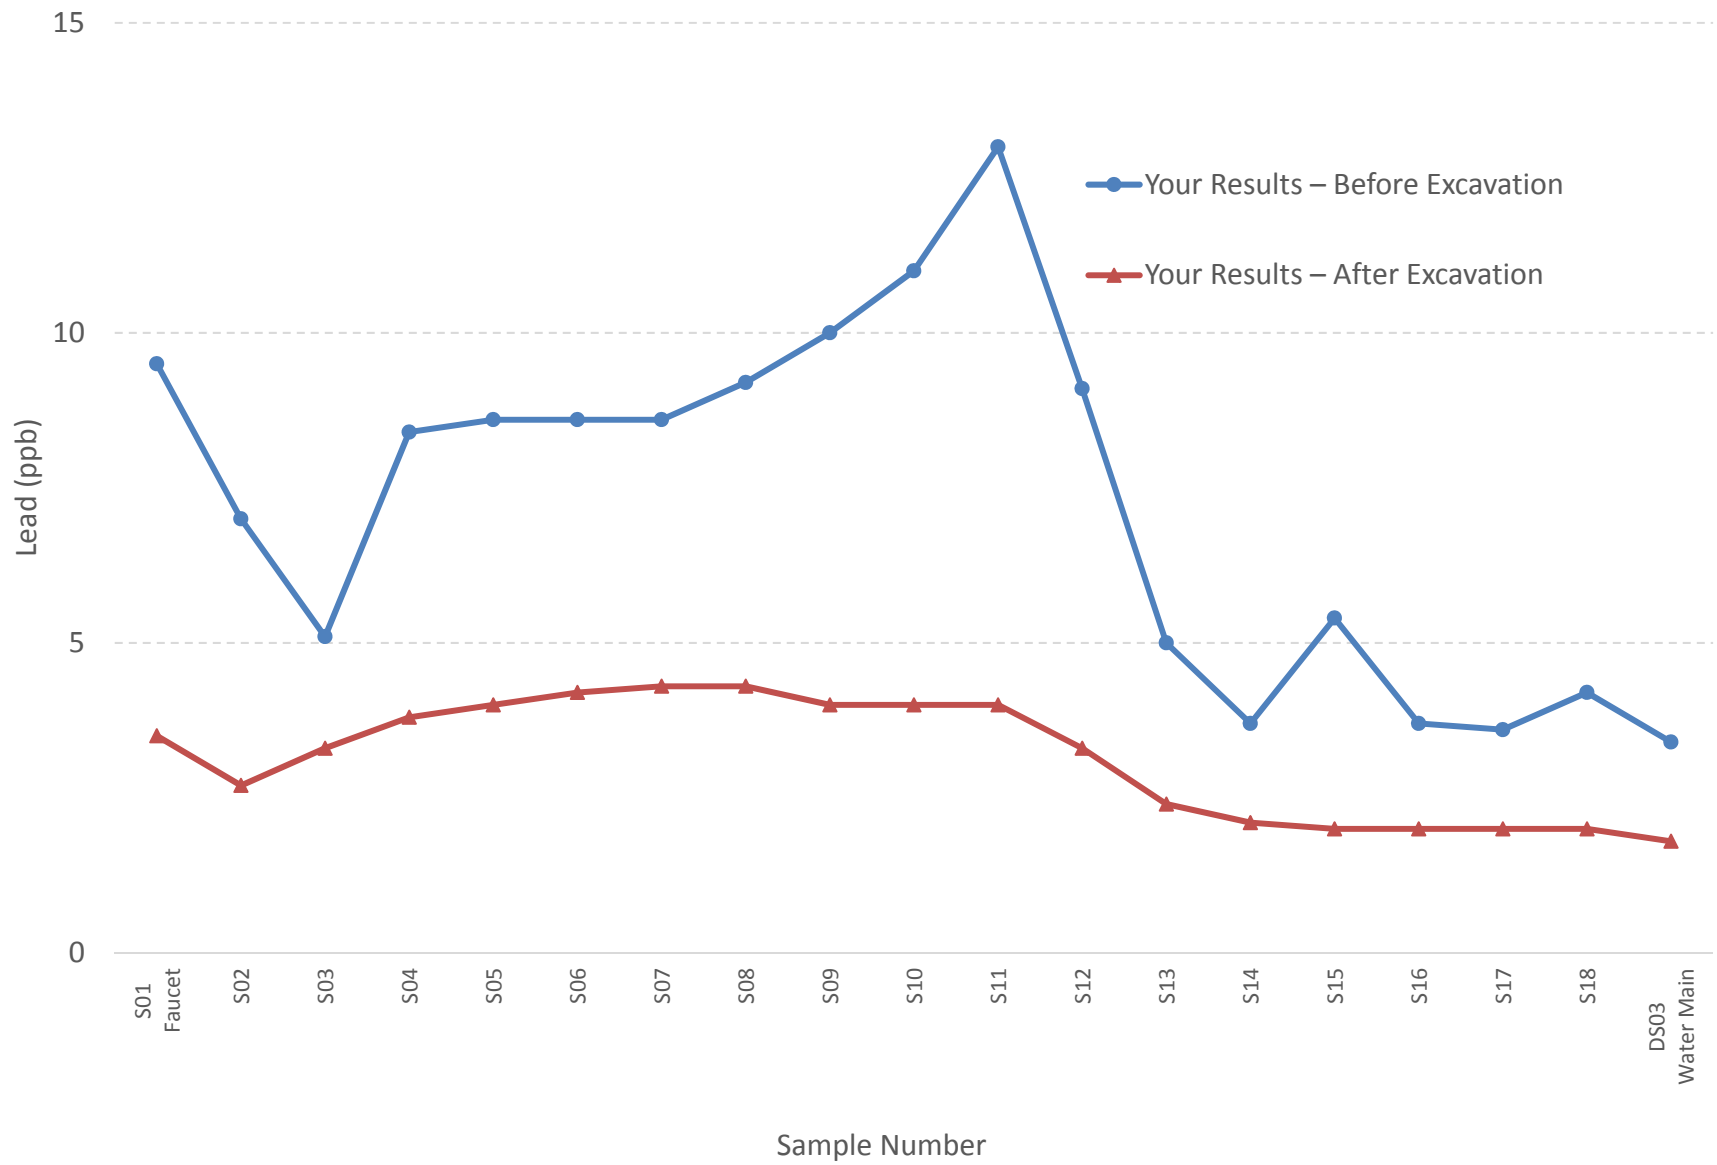

Site 3070 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/11/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.9	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	12	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	9.5	7.0	5.1	8.4	8.6	8.6	8.6	9.2	10	11	13	9.1	5.0	3.7	5.4	3.7	3.6	4.2	3.4	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.9	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	270	140	71	32	26	28	32	23	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	21	--	--	--	5000
Aluminum	mg/L	0.068	0.072	0.081	0.087	0.084	0.085	0.086	0.087	0.087	0.081	0.084	0.084	0.084	0.081	0.098	0.097	0.096	0.097	0.085	--	--	--	0.05 to 0.2
Calcium	mg/L	37	36	39	39	37	38	38	39	39	37	37	37	37	38	36	37	36	36	38	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	13	13	14	14	13	14	14	14	14	13	13	13	13	13	13	13	13	13	13	--	--	--	--
Potassium	mg/L	1.6	1.6	1.8	1.7	1.6	1.7	1.7	1.7	1.7	1.6	1.7	1.6	1.7	1.6	1.6	1.6	1.6	1.6	1.7	--	--	--	--
Sodium	mg/L	12	12	13	13	12	13	13	13	13	12	13	12	13	12	12	12	12	12	13	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3070 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results


Parameter	Units	Your Results - After Excavation on 11/8/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.13 J	0.06 J	0.03 J	0.03 J	0.02 J	0.02 J	0.02 J	0.20 U	0.20 U	0.20 U	0.03 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U				
Chromium	µg/L	0.53 J	0.52 J	0.55 J	0.51 U	0.58 J	0.55 J	0.54 J	0.61 J	0.63 J	0.56 J	0.54 J	0.57 J	0.57 J	0.58 J	0.56 J	0.55 J	0.59 J	0.60 J	0.62 J	100	--	100	--
Copper	µg/L	27.7	3.1	1.8	1.5	1.4	1.4	1.3	1.3	1.3	1.1	1.1	1.0	1.0	1.0	0.97 J	0.94 J	1 J	0.97 J	0.92 J	--	1300	1300	1000
Lead	µg/L	3.5	2.7	3.3	3.8	4.0	4.2	4.3	4.3	4.0	4.0	4.0	3.3	2.4	2.1	2.0	2.0	2.0	2.0	1.8	--	15	0	--
Manganese	µg/L	1.5	1.1	1.2	1.2	1.3	1.4	1.3	1.3	1.3	1.2	1.0	1.0	1.1	1.1	1.0	1.0	1.1	1.1	1.1	--	--	--	50
Nickel	µg/L	8.6	1.5	0.66 U	0.59 U	0.60 U	0.81	1.0	0.91	0.84	0.68 U	0.63 U	0.62 U	1.4	0.66 U	0.53 U	0.54 U	0.70 U	0.56 U	0.69 U	--	--	--	--
Tin	µg/L	0.19 J	0.07 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.08 J	1.0 U	1.0 U	1.0 U	1.0 U	0.08 J	--	--	--	--
Zinc	µg/L	206 J+	64.6 J+	25.6 J+	15.4 J+	13.5 J+	13.9 J+	15.0 J+	12.2 J+	11.0 J+	10.2 J+	8.9 J+	9.4 J+	9.9 J+	8.7 J+	8.3 J+	8.2 J+	9.3 J+	8.3 J+	7.9 J+	--	--	--	5000
Aluminum	mg/L	0.0564	0.0660	0.0769	0.0736	0.0684	0.0743	0.0726	0.104	0.0709	0.0695	0.0696	0.0813	0.0798	0.0727	0.0740	0.0712	0.0718	0.0713	0.0735	--	--	--	0.05 to 0.2
Calcium	mg/L	33.2	32.6	33.1	33.6	33.4	32.9	33.9	32.9	33.0	33.0	33.4	33.1	32.3	32.6	32.3	33.1	32.7	32.7	33.2	--	--	--	--
Iron	mg/L	0.0390 J	0.0456 J	0.0512 J	0.0538 J	0.0418 J	0.0564 J	0.0427 J	0.0357 J	0.0509 J	0.0325 J	0.0334 J	0.0416 J	0.0247 J	0.0267 J	0.0273 J	0.0290 J	0.0219 J	0.0220 J	0.0273 J	--	--	--	0.3
Magnesium	mg/L	11.8	11.6	11.8	12.0	11.9	11.7	12.1	11.7	11.7	11.7	11.8	11.8	11.6	11.7	11.6	11.8	11.7	11.7	11.9	--	--	--	--
Potassium	mg/L	1.80	1.69	1.67	1.68	1.70	1.65	1.70	1.67	1.68	1.64	1.68	1.65	1.56	1.60	1.59	1.61	1.67	1.62	1.62	--	--	--	--
Sodium	mg/L	11.4	11.1	11.1	11.3	11.3	11.0	11.3	11.2	11.0	11.0	11.2	11.0	10.8	10.9	10.8	10.9	10.9	11.0	10.9	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		104	--	--	--	--
Chloride	mg/L	Not Sampled																		16.8	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.149	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		26.4	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.121	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.
Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3071, Kitchen Faucet,
10/15/2016 (Preliminary) and 11/18/2016

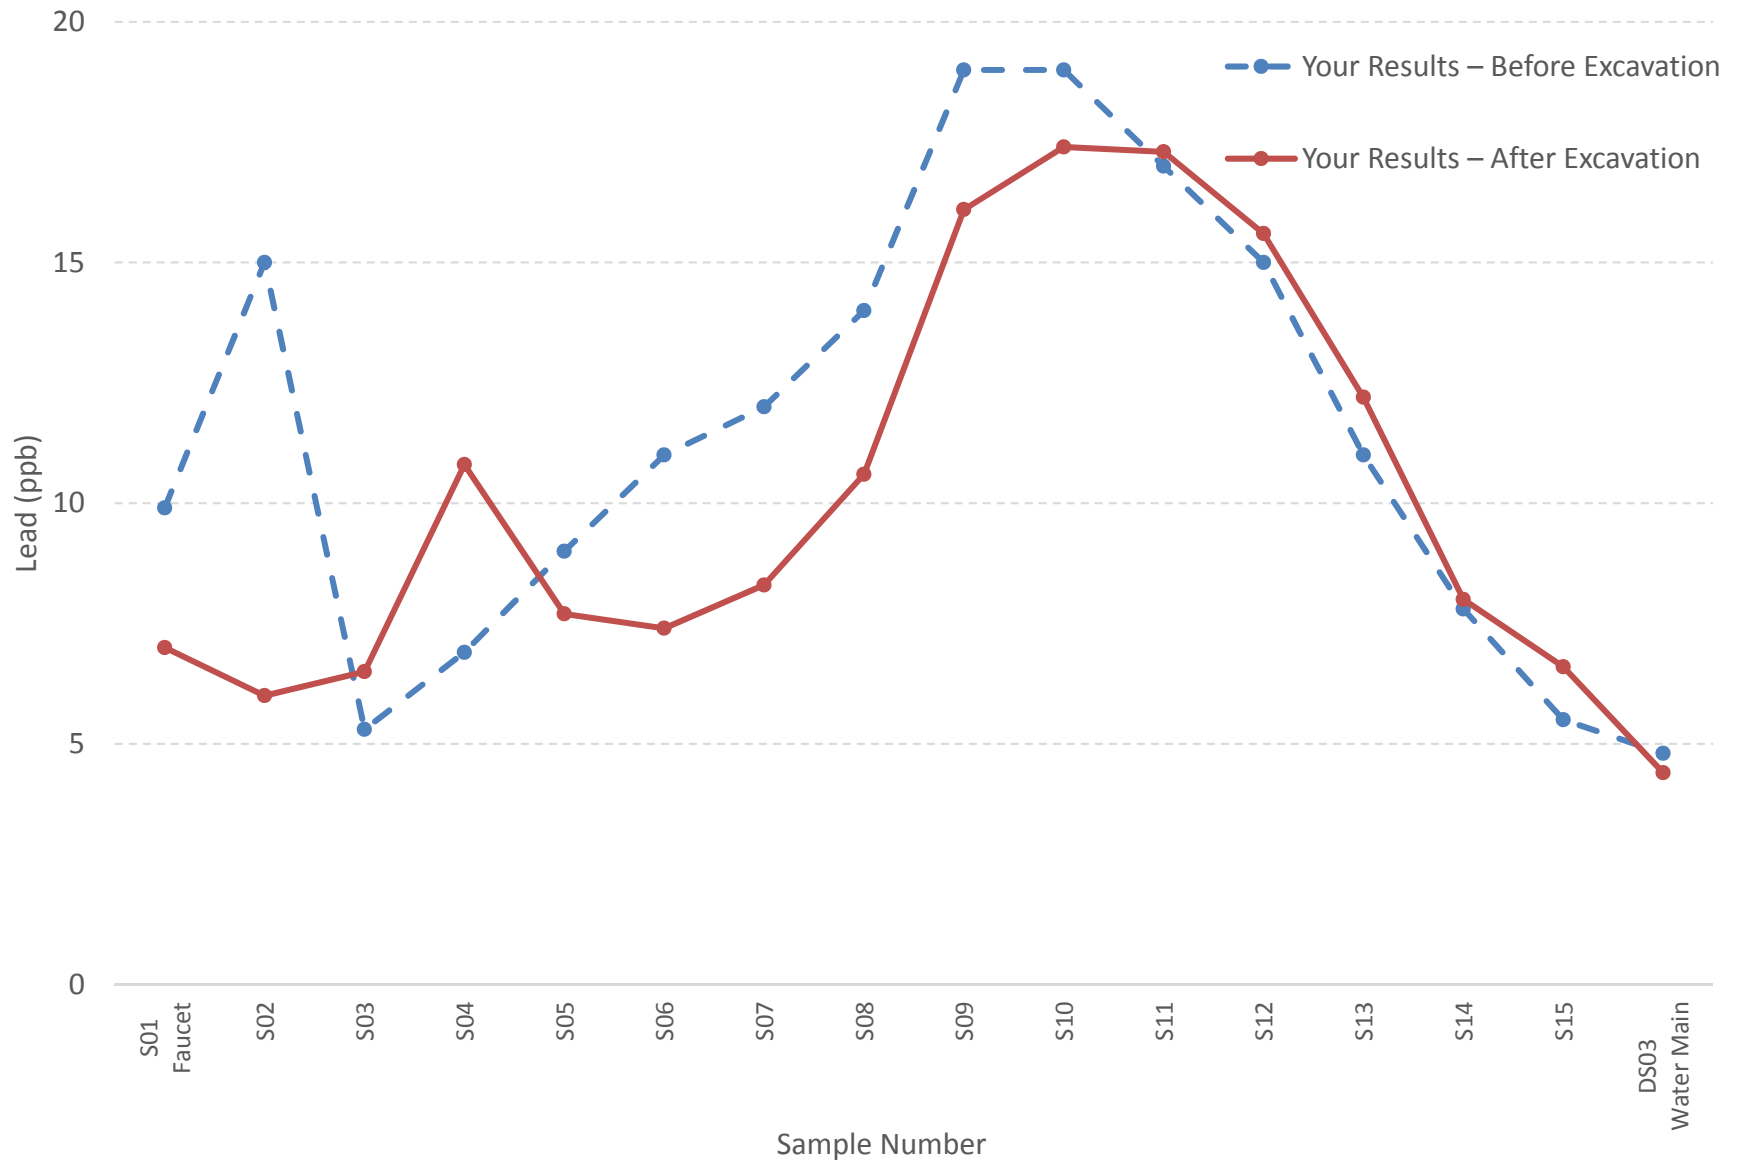

Site 3071 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/15/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--	
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--	
Copper	µg/L	58	120	20	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000	
Lead	µg/L	9.9	15	5.3	6.9	9.0	11	12	14	19	19	17	15	11	7.8	5.5	4.8	--	15	0	--	
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50	
Nickel	µg/L	5.2	20	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--	
Zinc	µg/L	320	370	160	46	38	34	29	25	23	29	22	21	22	21	20	20 U	--	--	--	5000	
Aluminum	mg/L	0.066	0.065	0.085	0.085	0.076	0.084	0.079	0.079	0.080	0.080	0.089	0.084	0.080	0.076	0.077	0.076	--	--	--	0.05 to 0.2	
Calcium	mg/L	37	35	37	37	36	37	36	37	37	36	38	37	36	36	36	36	--	--	--	--	
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3	
Magnesium	mg/L	13	12	13	13	12	12	13	13	13	12	13	13	13	13	13	13	--	--	--	--	
Potassium	mg/L	1.6	1.6	1.7	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.7	1.6	1.6	1.6	1.6	1.6	--	--	--	--	
Sodium	mg/L	11	11	11	11	11	11	11	11	11	11	12	11	11	11	11	11	--	--	--	--	
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--	
Chloride	mg/L	Not Sampled															3.0	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3071 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/18/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.03 J	0.08 J	0.08 J	0.03 J	0.20 U	0.02 J	0.20 U	0.20 U	0.20 U	0.20 U	0.02 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U				
Chromium	µg/L	0.84 U	0.88 U	0.88 U	0.79 U	0.78 U	0.83 U	0.80 U	0.79 U	0.86 U	0.85 U	0.87 U	0.83 U	0.82 U	0.94 U	0.86 U	0.86 U	100	--	100	--
Copper	µg/L	31	34.5	16.3	11.7	4.4	4.2	4.2	4.5	3.8	3.4	3.5	3.4	3.8	3.6	3.3	2.7	--	1300	1300	1000
Lead	µg/L	7.0	6.0	6.5	10.8	7.7	7.4	8.3	10.6	16.1	17.4	17.3	15.6	12.2	8.0	6.6	4.4	--	15	0	--
Manganese	µg/L	3.3	1.4	2.8	2.0	1.2	0.82 J	0.83 J	0.68 J	0.63 J	0.67 J	0.73 J	0.70 J	0.74 J	0.84 J	0.89 J	0.64 J	--	--	--	50
Nickel	µg/L	2.4	4.9	1.1	1.0	0.71	0.69	0.71	0.71	0.72	0.68	0.70	0.68	0.69	0.70	0.71	0.68	--	--	--	--
Tin	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.08 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	135	235	132	54.8	40.2	38.9	33.6	27.4	24.0	22.0	22.0	20.5	20.3	23.1	20.4	12.6	--	--	--	5000
Aluminum	mg/L	0.0630	0.0496	0.0706	0.0761	0.0538	0.0522	0.0511	0.0509	0.0500	0.0495	0.0492	0.0483	0.0463	0.046	0.0451	0.0407	--	--	--	0.05 to 0.2
Calcium	mg/L	35.8	36.7	37.2	36.9	38.3	37.5	38.5	37.3	37.9	37.1	38.2	37.2	37.6	37.2	37.5	37.2	--	--	--	--
Iron	mg/L	0.0673 U	0.0198 U	0.0352 U	0.101	0.073 U	0.0284 U	0.0288 U	0.0264 U	0.0211 U	0.100 U	0.0202 U	0.0200 U	0.0223 U	0.0214 U	0.100 U	0.100 U	--	--	--	0.3
Magnesium	mg/L	12.3	12.1	12.4	12.2	12.4	12.1	12.4	12.1	12.4	12.1	12.4	12.1	12.3	12.1	12.2	12.2	--	--	--	--
Potassium	mg/L	1.59	1.65	1.70	1.65	1.65	1.66	1.70	1.61	1.72	1.63	1.66	1.65	1.74	1.64	1.66	1.67	--	--	--	--
Sodium	mg/L	11.1	11.4	11.4	11.3	11.5	11.4	11.6	11.3	11.6	11.3	11.6	11.3	11.4	11.3	11.6	11.5	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															104	--	--	--	--
Chloride	mg/L	Not Sampled															17.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.130	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															30.0	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.177	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3072, Kitchen Faucet, 10/5/2016 (Preliminary) and 11/17/2016

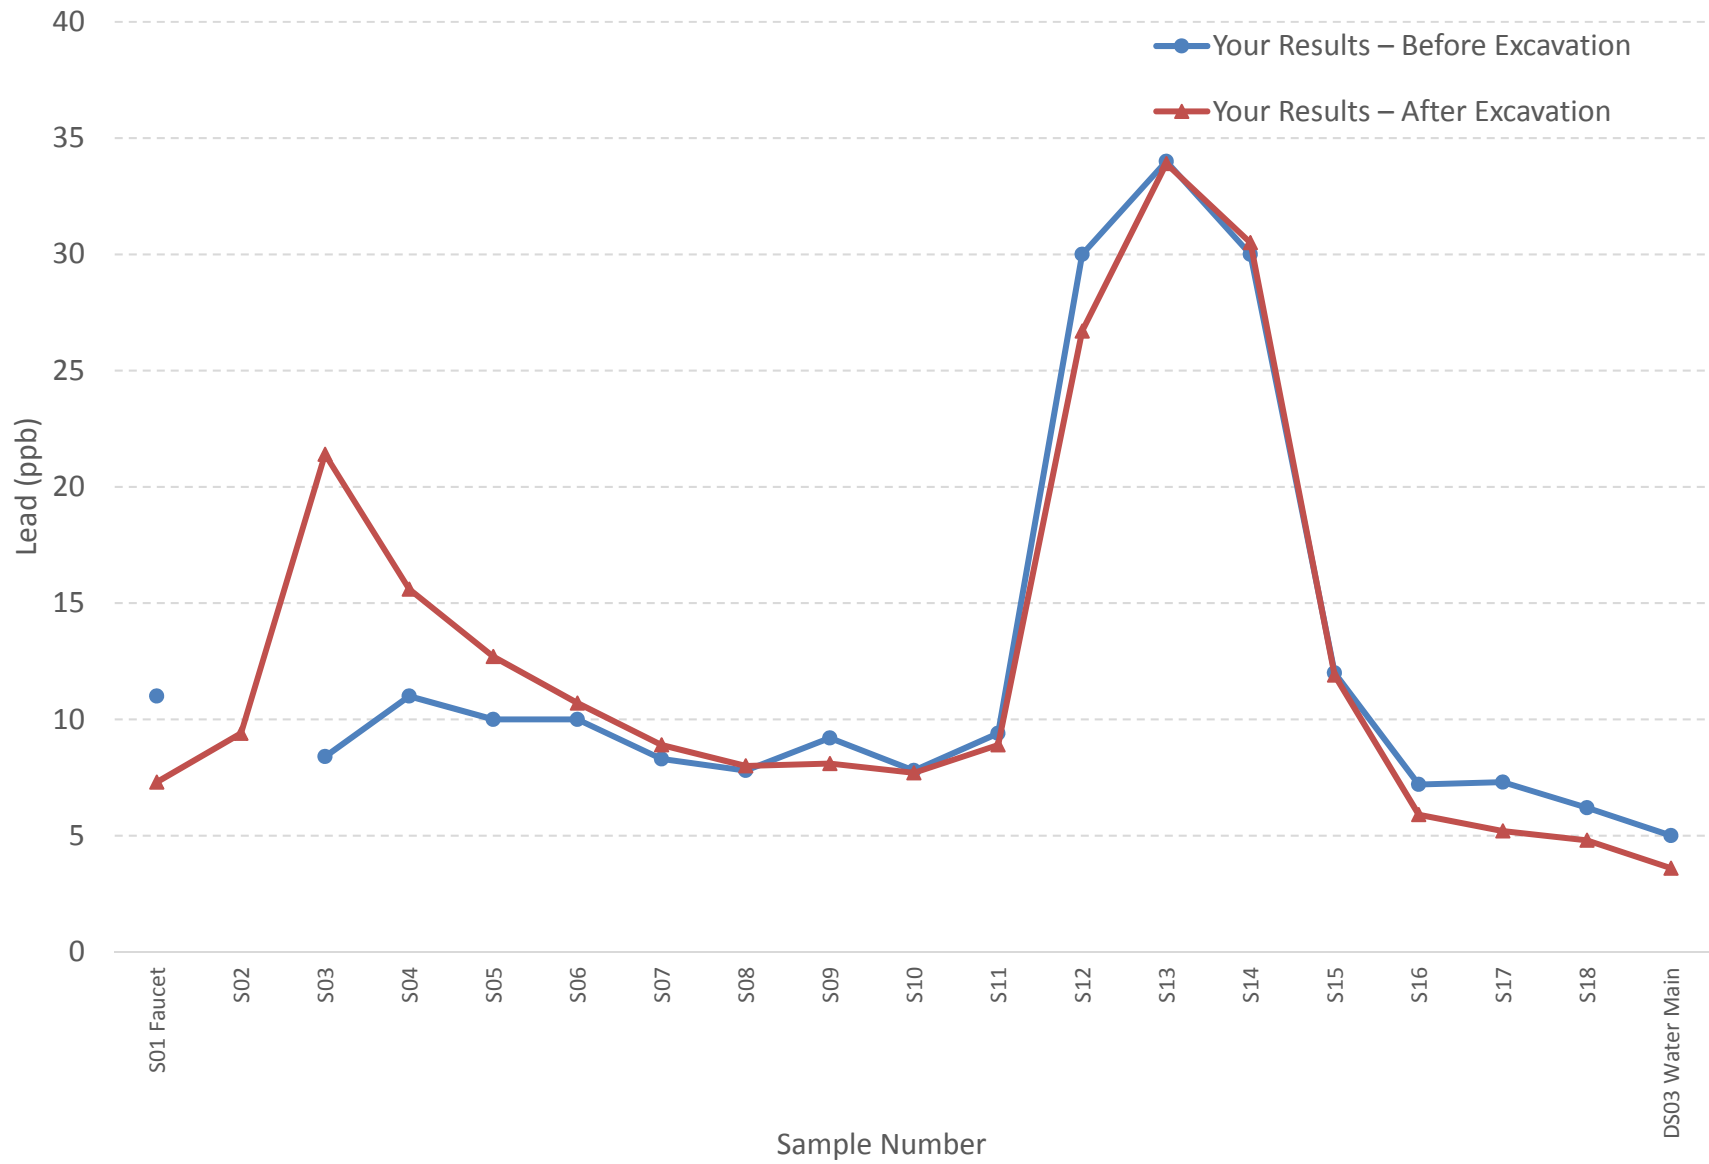

Site 3072 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/5/2016																		Comparison Standards			
		S01 / S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet and Under Sink																	Distribution System				
		1st sample (250 mL)	2nd sample (1 liter)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	11	8.4	11	10	10	8.3	7.8	9.2	7.8	9.4	30	34	30	12	7.2	7.3	6.2	5.0	--	15	0	--
Manganese	µg/L	4.5	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	200	63	33	35	28	27	29	27	25	22	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.12	0.11	0.12	0.13	0.12	0.12	0.12	0.13	0.12	0.11	0.12	0.12	0.12	0.12	0.11	0.11	0.10	0.10	--	--	--	0.05 to 0.2
Calcium	mg/L	36	34	34	36	36	34	34	36	34	31	35	34	36	36	34	36	33	33	--	--	--	--
Iron	mg/L	0.14	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	13	12	12	13	13	13	13	12	12	12	13	12	13	13	13	13	12	12	--	--	--	--
Potassium	mg/L	1.8	1.7	1.7	1.7	1.8	1.7	1.7	1.9	1.7	1.5	1.7	1.7	1.8	1.8	1.7	1.8	1.6	1.6	--	--	--	--
Sodium	mg/L	11	11	11	11	11	11	11	11	11	10	11	11	11	11	11	11	10	11	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																	120	--	--	--	--
Chloride	mg/L	Not Sampled																	3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																	0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																	50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																	0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3072 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results


Parameter	Units	Your Results - After Excavation on 11/17/2016																			Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																						
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)						Distribution System
Cadmium	µg/L	0.07 J	0.15 J	0.09 J	0.04 J	0.03 J	0.03 J	0.03 J	0.20 U	0.02 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U					5
Chromium	µg/L	0.80 U	0.78 U	0.84 U	0.76 U	0.85 U	0.78 U	0.83 U	0.87 U	0.82 U	0.78 U	0.79 U	0.81 U	0.86 U	0.83 U	0.86 U	0.85 U	0.85 U	0.87 U	0.88 U	100	--	100	--	
Copper	µg/L	17.6 J	1.4 J	11.1 J	5.5 J	3.7 J	3.6 J	2.3 J	2.0 J	1.7 J	1.4 J	1.4 J	1.5 J	1.6 J	1.3 J	1.3 J	1.1 J	1.1 J	1.0 J	0.65 U	--	1300	1300	1000	
Lead	µg/L	7.3	9.4	21.4	15.6	12.7	10.7	8.9	8.0	8.1	7.7	8.9	26.7	33.9	30.5	11.9	5.9	5.2	4.8	3.6	--	15	0	--	
Manganese	µg/L	3.2	2.4	3.6	2.1	1.7	1.5	1.6	1.7	1.5	1.5	1.4	1.4	1.2	1.4	2.2	2.6	2.8	2.6	2.3	--	--	--	50	
Nickel	µg/L	12.3	1.1	0.81	0.79	0.73	1.10	0.63	0.82	0.75	0.62	0.61	0.58	0.75	0.58	0.63	0.80	0.64	0.67	0.68	--	--	--	--	
Tin	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.23 U	1.0 U	1.0 U	0.14 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--	
Zinc	µg/L	365 J	176 J	161 J	41.9 J	37.7 J	28.2 J	28.7 J	29.8 J	27.9 J	24.2 J	22.0 J	16.4 J	13.4 J	14.8 J	13.6 J	13.7 J	14.0 J	12.2 J	8.7 J	--	--	--	5000	
Aluminum	mg/L	0.0595 J	0.0776 J	0.0921 J	0.0906 J	0.0851 J	0.0774 J	0.0825 J	0.0791 J	0.0831 J	0.0779 J	0.0763 J	0.0782 J	0.0752 J	0.0780 J	0.0728 J	0.0698 J	0.0700 J	0.0671 J	0.0621 J	--	--	--	0.05 to 0.2	
Calcium	mg/L	34.7	34.0	34.7	35.0	34.5	34.3	34.6	34.2	34.4	34.6	34.8	34.4	34.6	34.6	34.7	34.9	35.1	35.7	35.3	--	--	--	--	
Iron	mg/L	0.108	0.0899 J	0.286	0.150	0.111	0.116	0.0926 J	0.105	0.0969 J	0.0725 J	0.0777 J	0.0744 J	0.0746 J	0.0724 J	0.0889 J	0.0912 J	0.0912 J	0.0882 J	0.0956 J	--	--	--	0.3	
Magnesium	mg/L	12.2	11.8	11.9	11.9	11.9	12.0	12.1	11.9	12.0	12.1	12.2	12.0	12.1	12.0	12.1	12.2	12.2	12.4	12.3	--	--	--	--	
Potassium	mg/L	1.59	1.56	1.54	1.52	1.50	1.53	1.48	1.47	1.56	1.49	1.53	1.46	1.52	1.51	1.49	1.52	1.51	1.51	1.5	--	--	--	--	
Sodium	mg/L	11.1	10.9	10.6	10.7	10.6	10.6	10.6	10.6	10.7	10.6	10.8	10.6	10.6	10.6	10.6	10.8	10.8	10.8	10.8	10.7	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		101	--	--	--	--	
Chloride	mg/L	Not Sampled																		17.5	--	--	--	250	
Fluoride	mg/L	Not Sampled																		0.120	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled																		28.5	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled																		0.131	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.
Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3074, Kitchen Faucet,
10/15/2016 (Preliminary) and 12/20/2016

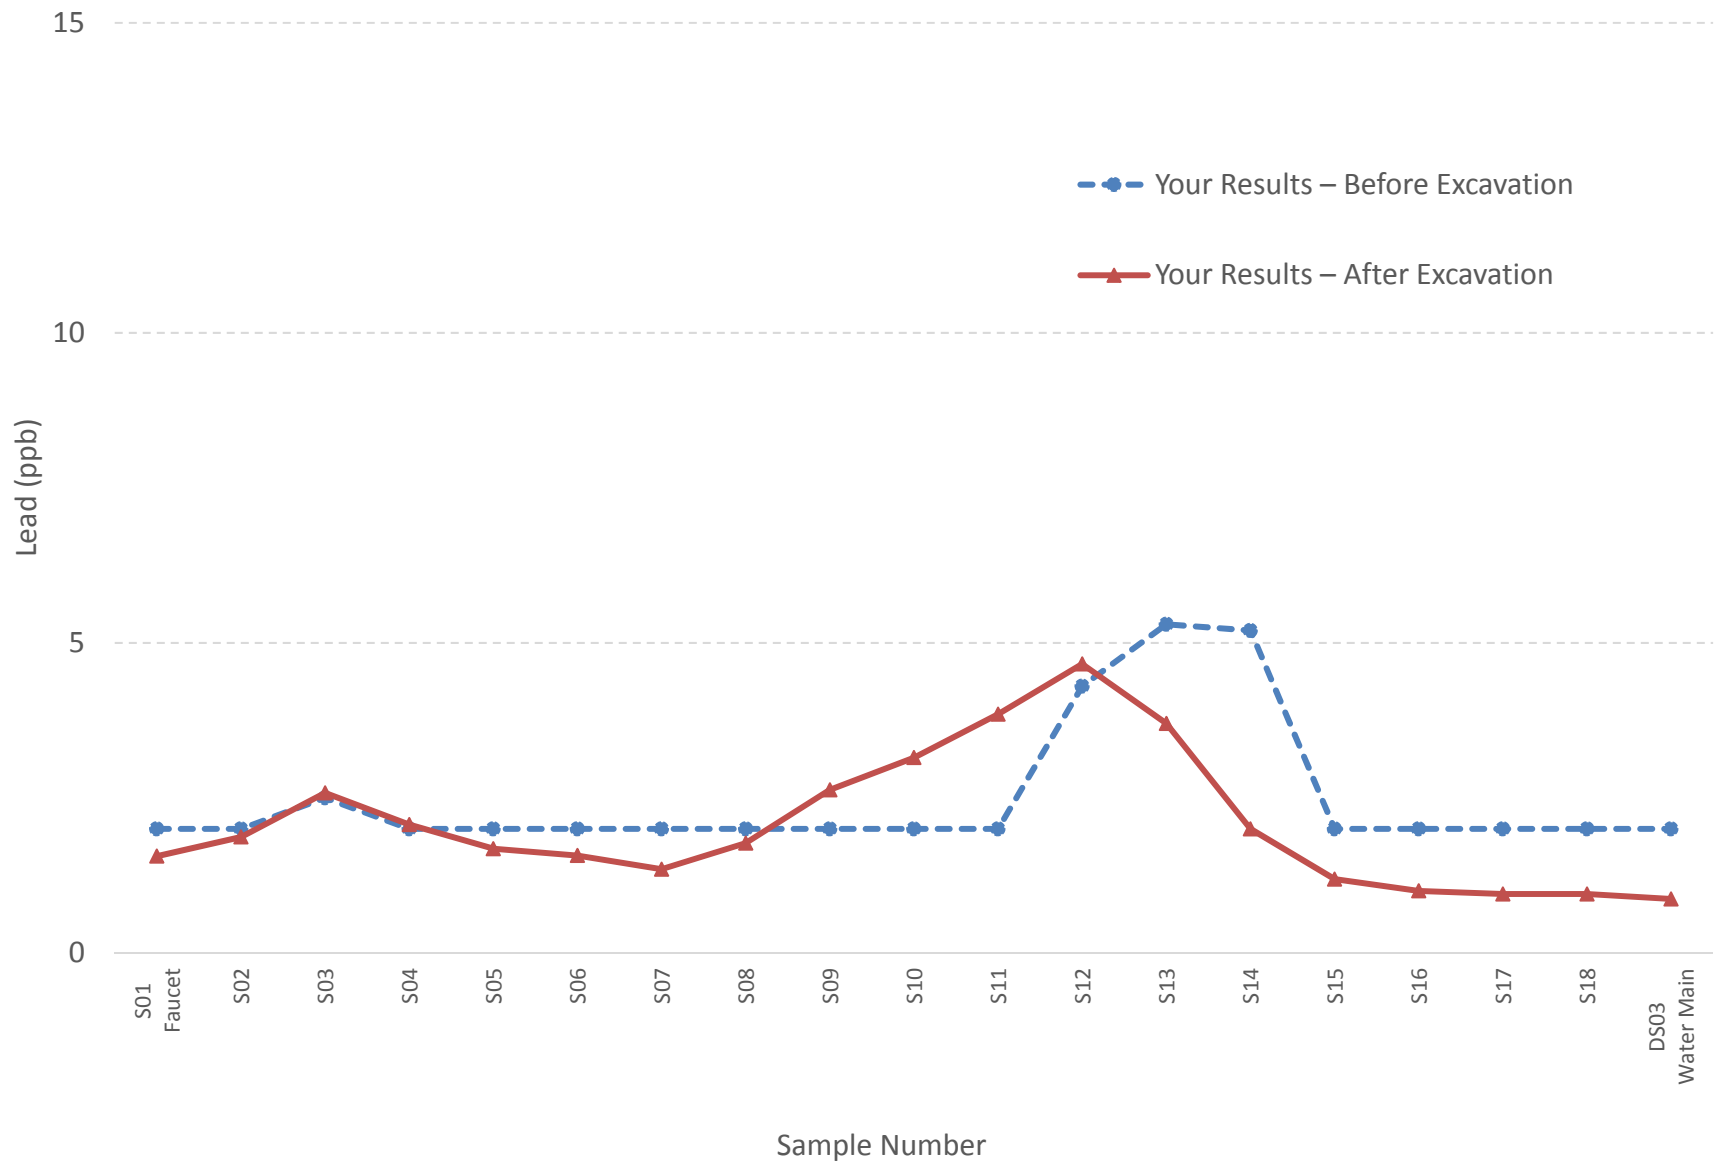

Site 3074 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/15/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	42	29	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.0 U	2.0 U	2.5	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	4.3	5.3	5.2	2.0 U	2.0 U	2.0	2.0 U	2.0 U	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.5	5.4	7.9	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	280	72	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.080	0.090	0.094	0.095	0.093	0.10	0.092	0.10	0.096	0.093	0.097	0.10	0.10	0.12	0.086	0.092	0.20 U	0.092	0.090	--	--	--	0.05 to 0.2
Calcium	mg/L	38	36	37	37	37	38	37	40	38	36	35	38	37	38	34	35	34	36	36	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.14	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.11	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	13	13	13	13	13	13	13	14	13	13	12	14	13	13	12	13	12	13	13	--	--	--	--
Potassium	mg/L	1.6	1.6	1.6	1.7	1.6	1.7	1.7	1.8	1.7	1.6	1.6	1.7	1.6	1.7	1.5	1.5	1.5	1.6	1.6	--	--	--	--
Sodium	mg/L	12	12	12	12	12	12	12	13	12	12	11	12	12	12	11	12	11	12	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3074 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/20/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	Not available - results will be provided when available																			5	--	5	--
Chromium	µg/L	Not available - results will be provided when available																			100	--	100	--
Copper	µg/L	74.7	72.7	31.1	8.98	7.84	5.92	4.24	3.97	3.57	3.66	3.32	3.51	3.02	3.05	2.91	2.85	2.97	2.84	3.01	--	1300	1300	1000
Lead	µg/L	1.56	1.87	2.58	2.07	1.68	1.57	1.35	1.77	2.63	3.15	3.85	4.66	3.70	2.00	1.19	1.00	0.95	0.95	0.87	--	15	0	--
Zinc	µg/L	331	70.6	29.8	21.3	21.1	26.8	15.0	13.4	11.9	12.2	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	--	--	--	5000
Manganese	µg/L	Not available - results will be provided when available																			--	--	--	50
Nickel	µg/L																				--	--	--	--
Aluminum	mg/L																				--	--	--	0.05 to 0.2
Calcium	mg/L																				--	--	--	--
Iron	mg/L																				--	--	--	0.3
Magnesium	mg/L																				--	--	--	--
Potassium	mg/L																				--	--	--	--
Sodium	mg/L																				--	--	--	--
Tin	mg/L																				--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110	--	--	--	--
Chloride	mg/L	Not Sampled																		17.7	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.09	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		30.7	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.15	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3075 -- Bathroom Sink Faucet,
10/13/2016 (Preliminary) and 12/9/2016

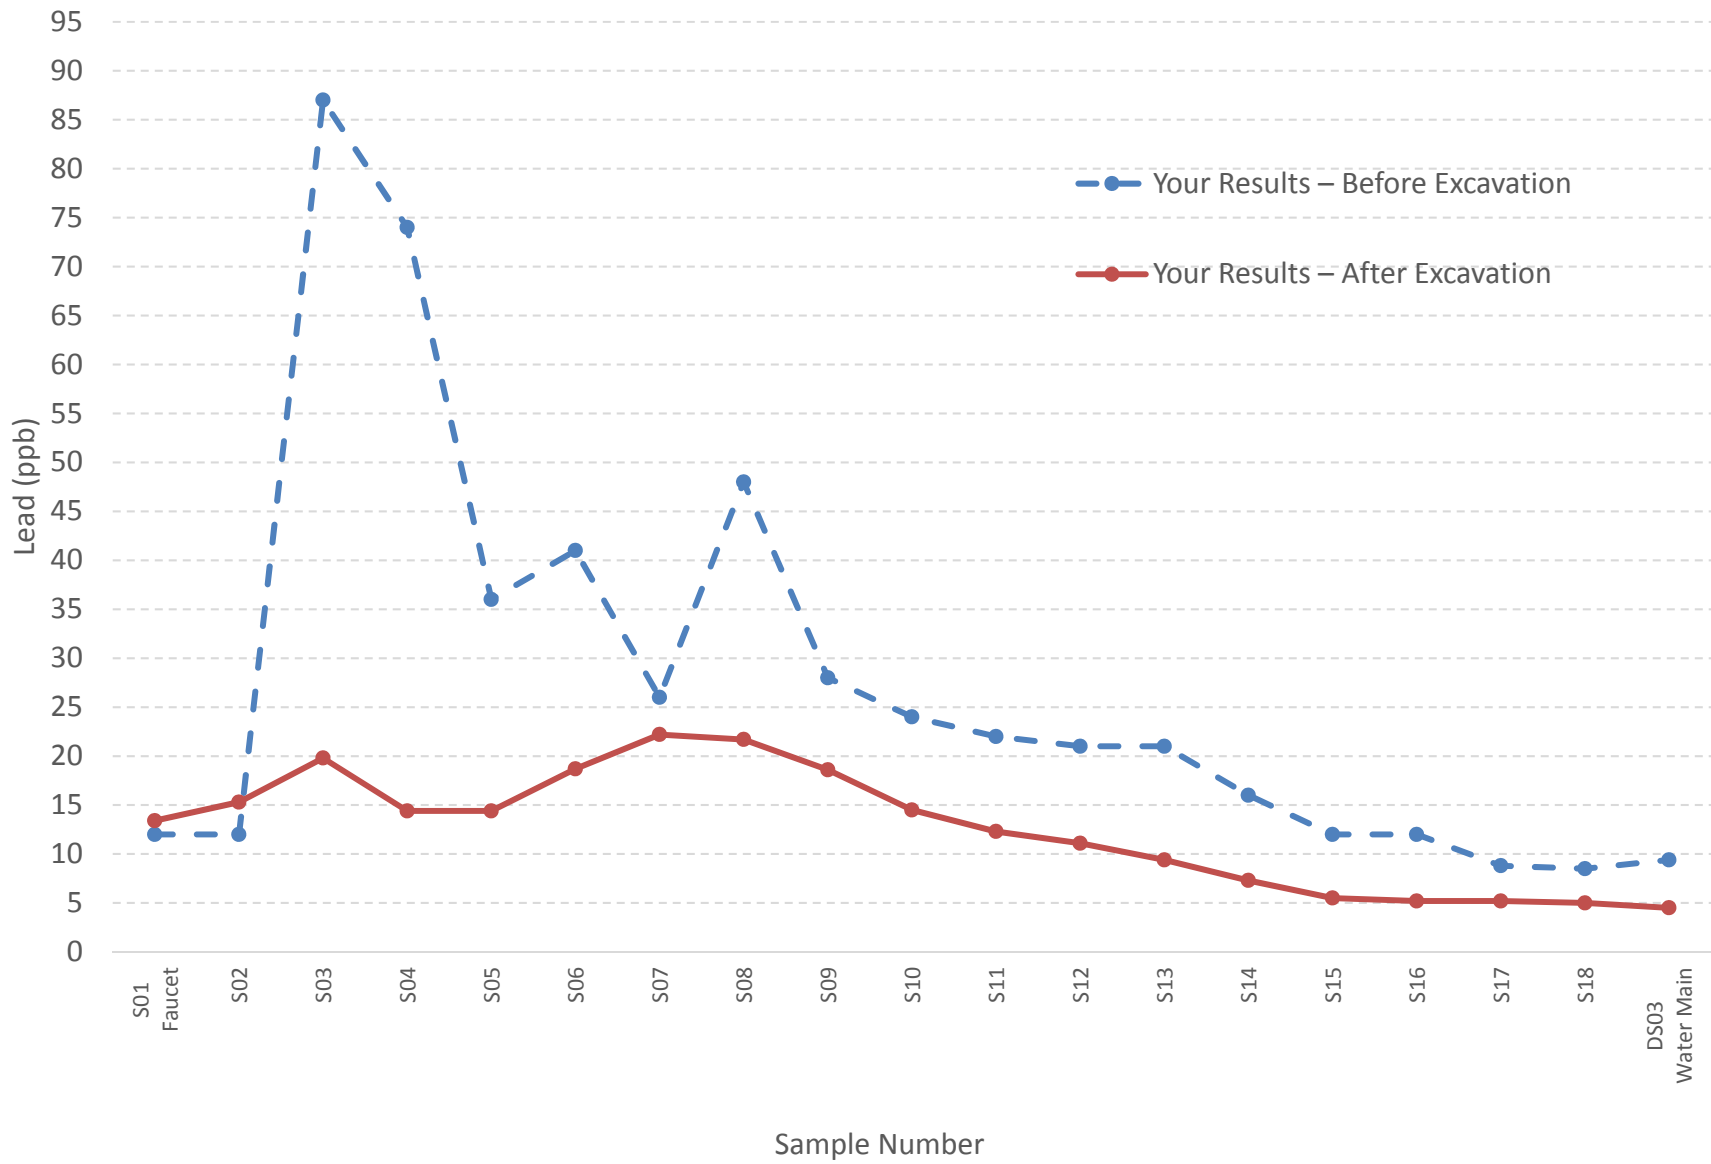

Site 3075 -- Bathroom Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/13/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	1.0 U	2.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	2.0 U	4.0 U	2.1	2.1	2.1	2.2	2.5	2.3	2.6	3.1	2.0 U	2.0	4.0 U	100	--	100	--
Copper	µg/L	10 U	10 U	13	10 U	10 U	10 U	5.0 U	10 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	10 U	--	1300	1300	1000
Lead	µg/L	12	12	87	74	36	41	26	48	28	24	22	21	21	16	12	12	8.8	8.5	9.4	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	15	12	4.2	4.0 U	2.0 U	4.9	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0	2.0 U	2.0 U	4.0 U	--	--	--	50
Nickel	µg/L	7.9	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	2.9	4.3	2.0 U	2.1	16	2.0 U	2.0 U	2.0 U	2.0 U	2.1	2.0 U	2.0 U	4.0 U	--	--	--	--
Zinc	µg/L	380	210	240	190	69	43	21	40	25	18	58	14	16	17	14	14	10	10	20 U	--	--	--	5000
Aluminum	mg/L	0.069	0.080	0.20	0.17	0.12	0.11	0.11	0.11	0.12	0.11	0.11	0.11	0.12	0.12	0.11	0.10	0.10	0.10	0.15	--	--	--	0.05 to 0.2
Calcium	mg/L	35	35	35	34	35	35	34	35	38	34	35	36	38	37	38	35	35	35	36	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.80	0.59	0.30	0.12	0.12	0.14	0.20	0.12	0.10	0.11	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	12	12	12	12	12	12	12	12	13	12	12	12	13	13	13	12	12	12	12	--	--	--	--
Potassium	mg/L	1.6	1.5	1.5	1.5	1.5	1.6	1.5	1.6	1.7	1.5	1.6	1.6	1.6	1.6	1.6	1.5	1.5	1.6	1.7	--	--	--	--
Sodium	mg/L	11	11	11	11	11	11	11	11	12	11	11	11	12	12	12	11	11	11	11	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110	--	--	--	--
Chloride	mg/L	Not Sampled																		1.0 U	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3075 -- Bathroom Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results


Parameter	Units	Your Results - After Excavation on 12/9/2016																		Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.09 J	0.11 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U				
Chromium	µg/L	0.32 U	0.29 U	0.31 U	0.32 U	0.31 U	0.34 U	0.32 U	0.33 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	0.37 U	0.34 U	0.36 U	0.38 U	0.33 U	0.30 U	100	--	100	--
Copper	µg/L	8.8	1.7	4.7	2.2	2.1	2.1	1.5	1.5	1.3	1.3	1.1	1.1	0.96 U	7.5	0.9 U	0.88 U	0.91 U	0.87 U	0.81 U	--	1300	1300	1000
Lead	µg/L	13.4	15.3	19.8	14.4	14.4	18.7	22.2	21.7	18.6	14.5	12.3	11.1	9.4	7.3	5.5	5.2	5.2	5.0	4.5	--	15	0	--
Manganese	µg/L	4.7	2.4	1.1	0.53 J	0.42 J	0.46 J	0.48 J	0.64 J	0.61 J	0.66 J	0.79 J	0.78 J	0.88 J	1.0 J	1.0	1.0	1.1	0.99 J	1.0	--	--	--	50
Nickel	µg/L	24.9	2.0	13.0	3.2	2.2	2.0	2.2	3.3	1.2	1.1	0.93	1.1	1.0	1.1	0.89	1.0	0.84	0.78	0.68	--	--	--	--
Tin	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.14 J	1.0 U	1.0 U	1.0 U	1.0 U	1.2	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	633 J+	294 J+	87.8 J+	34.4 J+	25.8 J+	21.3 J+	17.2 J+	17.2 J+	14.0 J+	12.4 J+	11.7 J+	11.5 J+	11.2 J+	11.3 J+	10.7 J+	10.7 J+	10.8 J+	9.5 J+	7.0 J+	--	--	--	5000
Aluminum	mg/L	0.0452	0.0589	0.0708	0.0604	0.0599	0.0547	0.0485	0.0486	0.0419	0.0377	0.0392	0.0390	0.0404	0.0441	0.0490	0.0469	0.0460	0.0476	0.0446	--	--	--	0.05 to 0.2
Calcium	mg/L	34.8	34.3	34.7	35.4	34.8	35.6	35.1	35.6	35.7	35.3	35.5	35.1	35.3	34.7	35.3	35.1	35.5	35.3	35.6	--	--	--	--
Iron	mg/L	0.0354 J	0.141	0.112	0.0269 J	0.0252 J	0.0142 J	0.0155 J	0.0264 J	0.0317 J	0.100 U	0.0217 J	0.0298 J	0.0293 J	0.0220 J	0.0153 J	0.0385 J	0.0458 J	0.0155 J	0.0252 J	--	--	--	0.3
Magnesium	mg/L	12.0	11.8	11.9	12.1	12.0	12.2	12.0	12.2	12.3	12.1	12.2	12.0	12.2	12.1	12.3	12.2	12.3	12.3	12.4	--	--	--	--
Potassium	mg/L	1.59	1.59	1.61	1.64	1.60	1.61	1.61	1.60	1.61	1.64	1.59	1.60	1.63	1.63	1.62	1.62	1.60	1.66	1.64	--	--	--	--
Sodium	mg/L	11.0	10.9	11.1	11.2	11.1	11.3	11.1	11.3	11.3	11.2	11.2	11.1	11.3	11.2	11.2	11.2	11.4	11.3	11.5	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		106	--	--	--	--
Chloride	mg/L	Not Sampled																		17.3	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.102	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		26.4	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.202	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.
Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3088, Kitchen Faucet,
10/17/2016 (Preliminary) and 12/8/2016

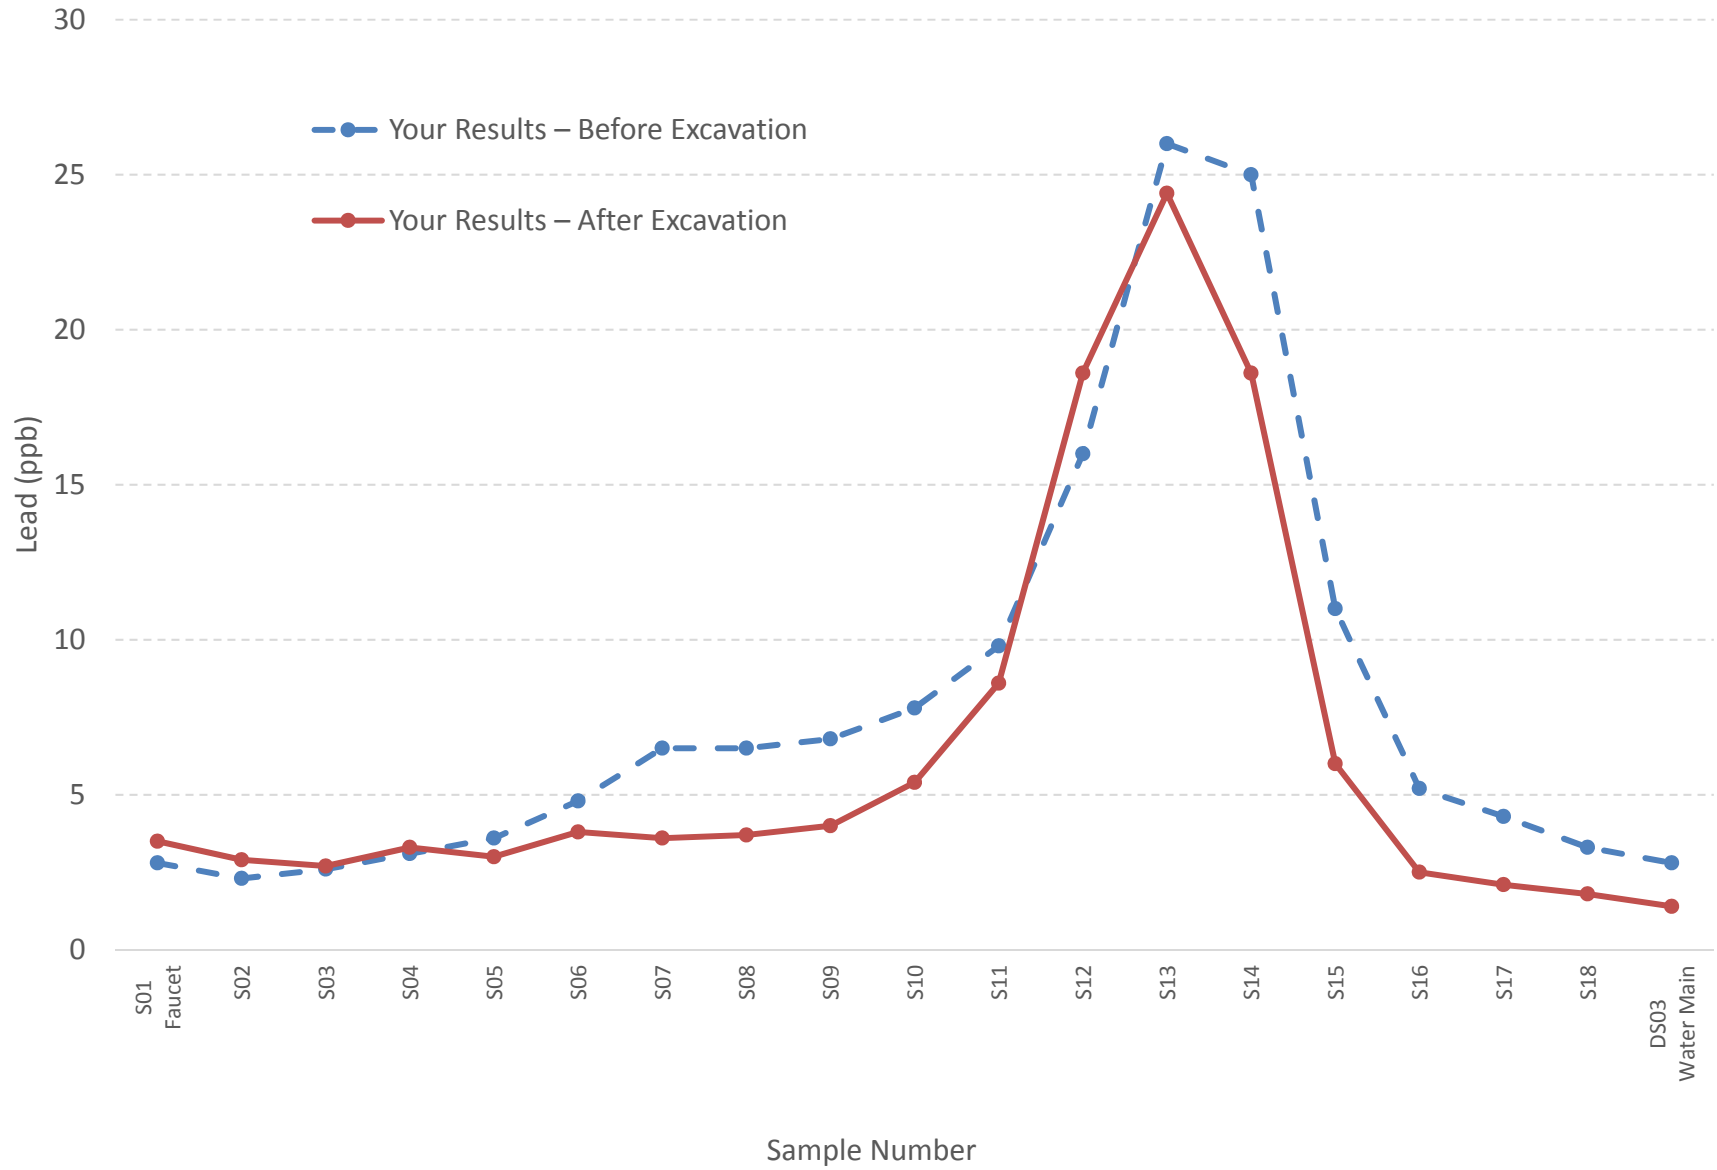

Site 3088 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/17/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.2	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	100	220	270	81	43	22	11	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.8	2.3	2.6	3.1	3.6	4.8	6.5	6.5	6.8	7.8	9.8	16	26	25	11	5.2	4.3	3.3	2.8	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	150	33	27	27	43	30	53	43	34	44	41	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.059	0.066	0.054	0.086	0.094	0.091	0.089	0.083	0.083	0.085	0.088	0.080	0.095	0.088	0.085	0.082	0.082	0.086	0.092	--	--	--	0.05 to 0.2
Calcium	mg/L	35	35	35	39	38	37	37	36	36	38	38	35	39	36	35	36	36	36	39	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	12	12	13	13	13	12	13	12	12	13	13	12	13	12	12	12	12	12	13	--	--	--	--
Potassium	mg/L	1.6	1.7	1.6	1.8	1.7	1.7	1.7	1.6	1.6	1.7	1.7	1.5	1.8	1.6	1.6	1.6	1.6	1.6	1.8	--	--	--	--
Sodium	mg/L	11	11	11	12	12	11	12	11	11	12	12	11	12	11	11	11	11	11	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3088 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/8/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
		1st sample (125 mL)	2nd sample (125 mL)																	Distribution System				
Cadmium	µg/L	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	5	--	5	--
Chromium	µg/L	0.46 U	0.46 U	0.40 U	0.36 U	0.43 U	0.46 U	0.37 U	0.44 U	0.43 U	0.42 U	0.44 U	0.48 U	0.38 U	0.36 U	0.38 U	0.42 U	0.38 U	0.34 U	0.38 U	100	--	100	--
Copper	µg/L	44.4	54.8	27.9	15.5	13.9	20.8	7.1	6.0	6.6	3.9	6.1	6.3	3.7	4.2	3.4	3.6	3.3	3.0	2.6	--	1300	1300	1000
Lead	µg/L	3.5	2.9	2.7	3.3	3.0	3.8	3.6	3.7	4.0	5.4	8.6	18.6	24.4	18.6	6.0	2.5	2.1	1.8	1.4	--	15	0	--
Manganese	µg/L	0.89 U	0.24 U	0.22 U	0.41 U	0.41 U	0.62 U	0.40 U	0.43 U	0.72 U	0.98 U	6.1	0.60 U	0.40 U	0.55 U	0.93 U	1.1	1.1	0.95 U	0.88 U	--	--	--	50
Nickel	µg/L	2.5	0.78	1.1	0.78	0.68	0.74	0.56	0.58	0.58	0.57	0.58	0.58	0.60	0.65	0.65	0.7	0.64	2.0	0.53	--	--	--	--
Tin	µg/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	--	--	--	--
Zinc	µg/L	205 J+	36.4 J+	29.1 J+	28.5 J+	19.8 J+	32.9 J+	70.2 J+	53.6 J+	52.8 J+	57.2 J+	36.5 J+	14.2 J+	11.1 J+	12.2 J+	10.1 J+	10.8 J+	9.9 J+	10.1 J+	6.6 J+	--	--	--	5000
Aluminum	mg/L	0.0548	0.0565	0.0648	0.0649	0.0539	0.0549	0.0526	0.0485	0.0466	0.0443	0.0459	0.0468	0.0454	0.0505	0.0495	0.0483	0.0447	0.0450	0.0406	--	--	--	0.05 to 0.2
Calcium	mg/L	36.2	36.5	37.2	36.9	36.2	36.2	36.4	36.2	35.6	36.2	36.6	36.3	35.7	36.4	35.8	36.9	36.9	36.9	35.5	--	--	--	--
Iron	mg/L	0.100 U	0.121	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.0673 J	0.127	0.0398 J	0.100 U	0.0383 J	0.0260 J	0.0186 J	0.100 U	0.100 U	0.0180 J	--	--	--	0.3
Magnesium	mg/L	12.4	12.4	12.5	12.5	12.4	12.4	12.6	12.6	12.3	12.5	12.6	12.5	12.3	12.5	12.4	12.7	12.7	12.7	12.2	--	--	--	--
Potassium	mg/L	1.73	1.78	1.83	1.80	1.76	1.73	1.75	1.74	1.72	1.72	1.76	1.74	1.73	1.75	1.74	1.79	1.80	1.78	1.72	--	--	--	--
Sodium	mg/L	11.8	11.8	12.0	12.1	11.9	11.8	11.9	11.8	11.7	11.8	11.9	11.8	11.6	11.8	11.7	12.0	12.0	12.0	11.5	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		104	--	--	--	--
Chloride	mg/L	Not Sampled																		16.5	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.118	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		26.0	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.200	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3091, Kitchen Faucet, 10/4/2016 (Preliminary) and 11/11/2016

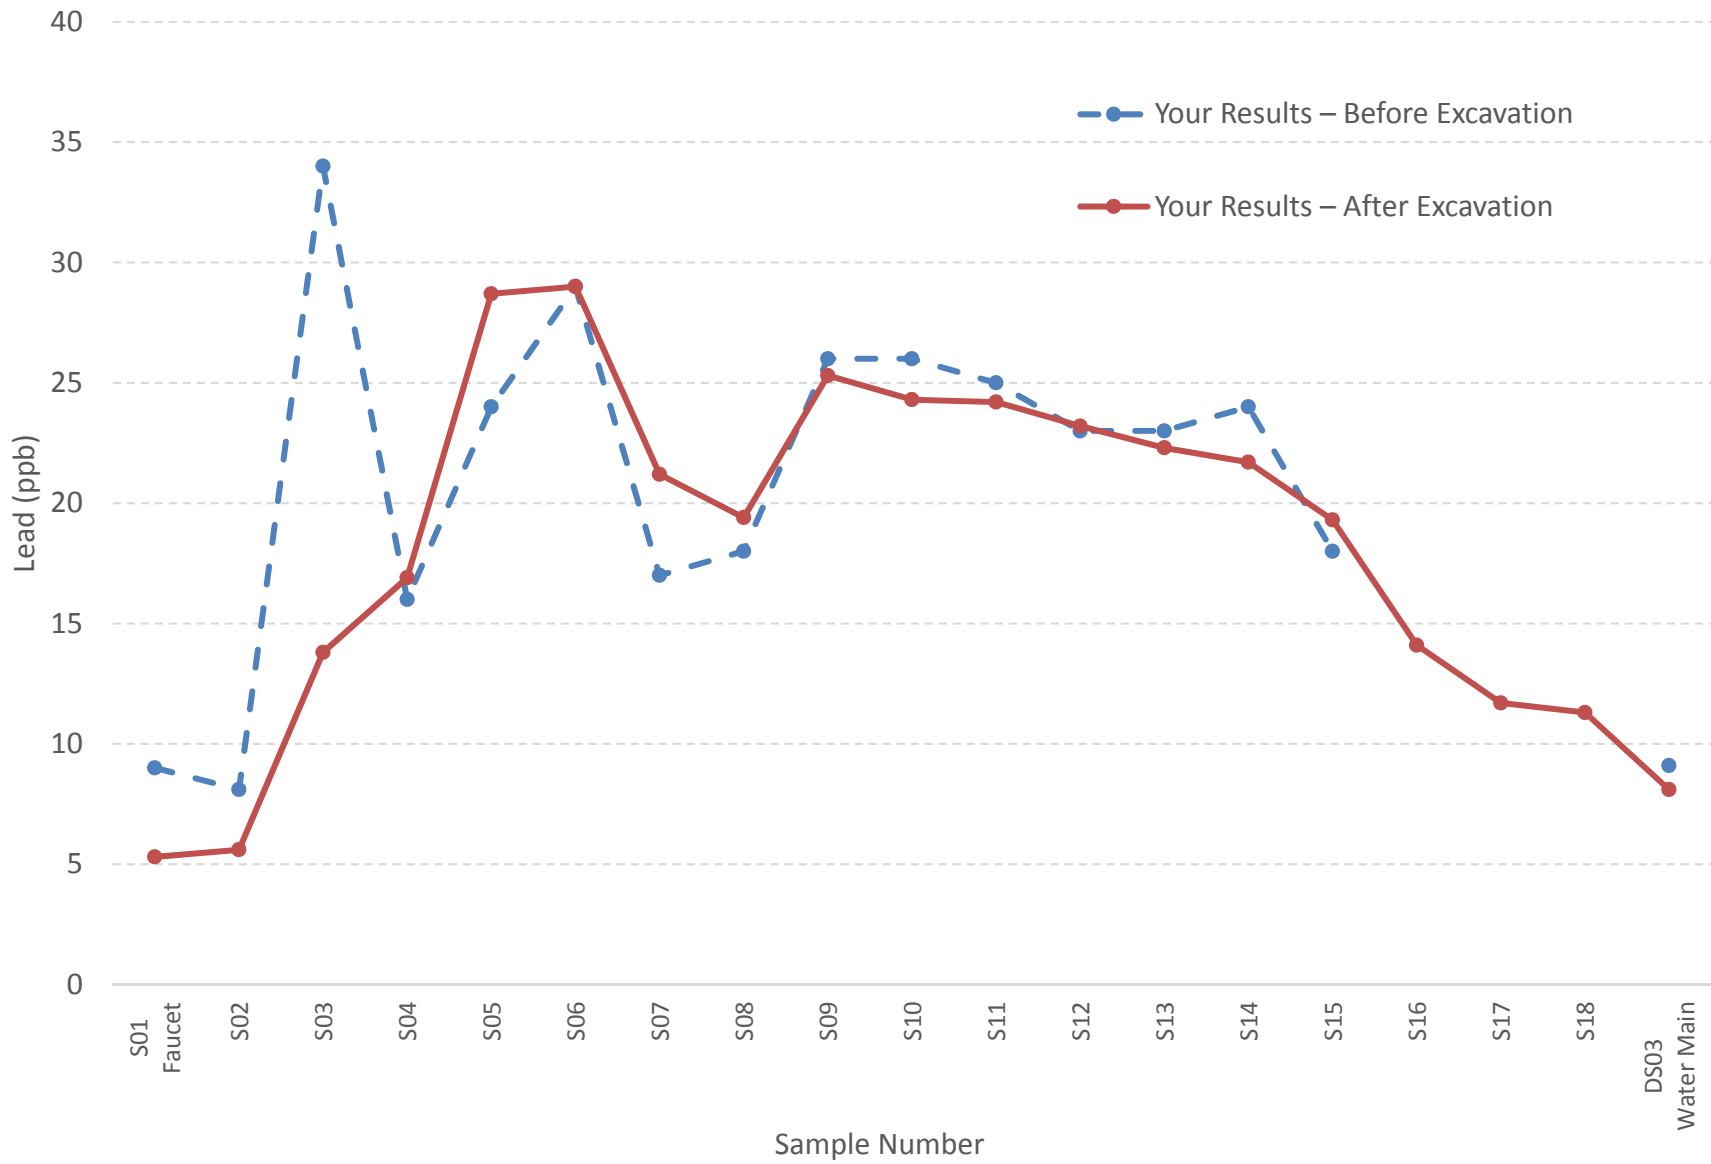

Site 3091 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/4/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	91	18	100	10 U	10 U	10 U	10 U	10 U	10 U	440	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	9.0	8.1	34	16	24	29	17	18	26	26	25	23	23	24	18	9.1	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	6.5	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	5.3	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	290	120	160	65	34	32	31	25	20	22	26	20 U	25	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.077	0.10	0.13	0.13	0.12	0.12	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.10	0.097	--	--	--	0.05 to 0.2
Calcium	mg/L	34	35	36	39	35	37	36	35	35	36	34	35	35	36	36	36	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.29	0.12	0.11	0.13	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.28	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	12	12	13	14	12	13	13	13	12	13	13	13	13	13	13	13	--	--	--	--
Potassium	mg/L	1.6	1.7	1.8	1.9	1.7	1.8	1.8	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.8	--	--	--	--
Sodium	mg/L	10	11	11	12	11	11	11	11	11	11	11	11	11	11	11	11	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.086	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															5.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3091 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/11/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	0.08 J	0.07 J	0.05 J	0.06 J	0.18 J	0.04 J	0.03 J	0.05 J	0.06 J	0.07 J	0.02 J	0.03 J	0.03 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	5				
Chromium	µg/L	0.65 U	0.59 U	0.62 U	0.62 U	0.62 U	0.64 U	0.62 U	0.63 U	0.70 U	0.69 U	0.66 U	0.69 U	0.64 U	0.66 U	0.69 U	0.66 U	0.64 U	0.66 U	0.68 U	100	--	100	--
Copper	µg/L	77.1	21.2	9.8	8.3	47.0	25.1	22.8	11.7	18.3	8.6	6.4	6.7	6.7	4.8	7.3	4.7	3.8	4.3	2.4	--	1300	1300	1000
Lead	µg/L	5.3	5.6	13.8	16.9	28.7	29.0	21.2	19.4	25.3	24.3	24.2	23.2	22.3	21.7	19.3	14.1	11.7	11.3	8.1	--	15	0	--
Manganese	µg/L	2.5	3.7	2.3	2.2	3.4	3.8	2.7	2.3	2.2	1.9	1.4	1.4	1.3	1.2	1.2	1.8	1.4	1.3	1.1	--	--	--	50
Nickel	µg/L	2.2	9.8	0.69	0.72	0.67	0.68	0.74	0.72	0.72	0.72	0.71	0.74	0.81	0.63	0.89	0.78	0.58	0.61	0.67	--	--	--	--
Tin	µg/L	0.07 J	1.0 U	0.09 J	0.49 J	4.3	0.30 J	0.21 J	0.89 J	1.5	2.0	0.10 J	0.25 J	0.57 J	0.27 J	0.11 J	0.10 J	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	242 J+	210 J+	73.2 J+	61.0 J+	75.5 J+	73.1 J+	60.5 J+	46.8 J+	39.1 J+	30.6 J+	27.9 J+	26.2 J+	25.2 J+	21.7 J+	23.0 J+	24.7 J+	19.5 J+	18.1 J+	13.1 J+	--	--	--	5000
Aluminum	mg/L	0.0664	0.0828	0.104	0.108	0.111	0.1120	0.107	0.0933	0.0879	0.0875	0.0795	0.0809	0.0776	0.0755	0.0806	0.0834	0.0769	0.0766	0.0753	--	--	--	0.05 to 0.2
Calcium	mg/L	33.6	33.7	35.1	34.2	34.4	34.7	33.6	33.7	33.6	34.6	34.8	33.5	33.9	33.8	33.8	32.2	33.1	33.6	33.6	--	--	--	--
Iron	mg/L	0.0212 J	0.0513 J	0.0843 J	0.104	0.142	0.196	0.119	0.0707 J	0.0823 J	0.0547 J	0.0448 J	0.0453 J	0.0376 J	0.0337 J	0.0433 J	0.0802 J	0.0395 J	0.0683 J	0.0414 J	--	--	--	0.3
Magnesium	mg/L	12.3	11.9	12.1	11.6	11.8	11.8	11.6	11.8	11.9	12.3	12.4	11.9	11.9	12.1	12.1	12.1	11.6	11.9	12.0	--	--	--	--
Potassium	mg/L	1.79	1.77	1.86	1.80	1.78	1.78	1.73	1.73	1.74	1.79	1.80	1.76	1.72	1.81	1.76	1.70	1.63	1.60	1.66	--	--	--	--
Sodium	mg/L	12.2	12.2	12.6	12.1	12.3	12.2	12.2	12.2	12.2	12.5	12.6	12.2	12.1	12.3	12.3	11.9	11.4	11.5	11.6	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		109	--	--	--	--
Chloride	mg/L	Not Sampled																		18.6	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.138	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		28.0	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.145	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.
Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3092, Kitchen Faucet,
10/10/2016 (Preliminary) and 11/3/2016



Site 3092 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/10/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.9	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	5.8	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	58	38	35	16	20	12	10 U	10 U	10 U	10 U	10 U	37	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	3.9	2.3	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	7.6	6.2	2.0 U	2.0 U	2.0 U	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	80	6.2	4.2	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	210	73	27	32	35	23	22	22	64	120	120	72	26	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.074	0.080	0.087	0.090	0.096	0.090	0.092	0.092	0.091	0.093	0.086	0.094	0.090	0.092	0.093	0.090	--	--	--	0.05 to 0.2
Calcium	mg/L	36	36	36	37	36	35	37	37	38	38	36	36	36	37	37	37	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Potassium	mg/L	1.6	1.6	1.7	1.7	1.6	1.6	1.7	1.7	1.8	1.8	1.6	1.6	1.6	1.7	1.7	1.7	--	--	--	--
Sodium	mg/L	12	12	12	12	12	12	12	13	13	13	12	12	12	12	12	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															110	--	--	--	--
Chloride	mg/L	Not Sampled															3.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3092 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/3/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.06 J	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.02 J	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U				
Chromium	µg/L	0.97 U	1.0 U	0.58 U	0.56 U	0.60 U	0.55 U	0.59 U	0.59 U	0.59 U	0.57 U	0.62 U	0.59 U	0.57 U	0.58 U	0.63 U	0.54 U	100	--	100	--
Copper	µg/L	44.3	27.0	25.0	14.3	13.7	8.6	6.1	5.4	5.5	6.7	8.0	8.6	5.5	3.5	3.1	2.3 U	--	1300	1300	1000
Lead	µg/L	0.68 J	0.36 J	0.34 J	0.68 J	0.98 J	1.3	1.4	1.3	1.7	2.6	3.4	4.0	2.5	0.79 J	0.45 J	0.33 J	--	15	0	--
Manganese	µg/L	0.72 J	0.47 J	0.39 J	0.51 J	0.45 J	0.45 J	0.49 J	0.52 J	0.50 J	0.66 J	0.59 J	0.60 J	0.64 J	1.7	0.80 J	0.62 J	--	--	--	50
Nickel	µg/L	10.9	3.1	0.93	0.64	0.78	0.72	0.63	1.2	0.77	0.74	0.95	0.91	0.67	0.64	0.77	0.67	--	--	--	--
Tin	µg/L	0.42 J	0.16 J	0.11 J	1.0 U	0.12 J	0.07 J	1.0 U	0.08 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	153	58.1	18.1	25.1	28.8	26.3	28.7	34.2	45.9	63.7	51.1	31.5	17.2	11.3	12.8	7.3	--	--	--	5000
Aluminum	mg/L	0.153	0.0755	0.0737	0.0791	0.0864	0.0788	0.0746	0.0711	0.0712	0.0721	0.0671	0.0675	0.0684	0.0923	0.0673	0.0692	--	--	--	0.05 to 0.2
Calcium	mg/L	36.2	35.2	35.0	36.4	35.9	35.2	36.0	36.0	35.5	35.8	36.1	35.9	35.7	34.9	36.4	36.8	--	--	--	--
Iron	mg/L	0.0257 J	0.0217 J	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.0178 J	0.100 U	0.0222 J	0.100 U	0.100 U	0.0501 J	0.100 U	--	--	--	0.3
Magnesium	mg/L	12.5	12.2	12.1	12.5	12.4	12.2	12.5	12.5	12.4	12.4	12.6	12.5	12.4	12.2	12.7	12.8	--	--	--	--
Potassium	mg/L	1.70	1.67	1.67	1.76	1.70	1.72	1.73	1.71	1.71	1.70	1.72	1.72	1.68	1.72	1.75	1.75	--	--	--	--
Sodium	mg/L	11.9	11.6	11.5	11.7	11.7	11.5	11.6	11.7	11.6	11.6	11.8	11.7	11.6	11.4	11.8	11.9	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															103	--	--	--	--
Chloride	mg/L	Not Sampled															16.2	--	--	--	250
Fluoride	mg/L	Not Sampled															0.130	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															25.8	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.172	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3106 -- Utility Sink Faucet, 11/10/2016

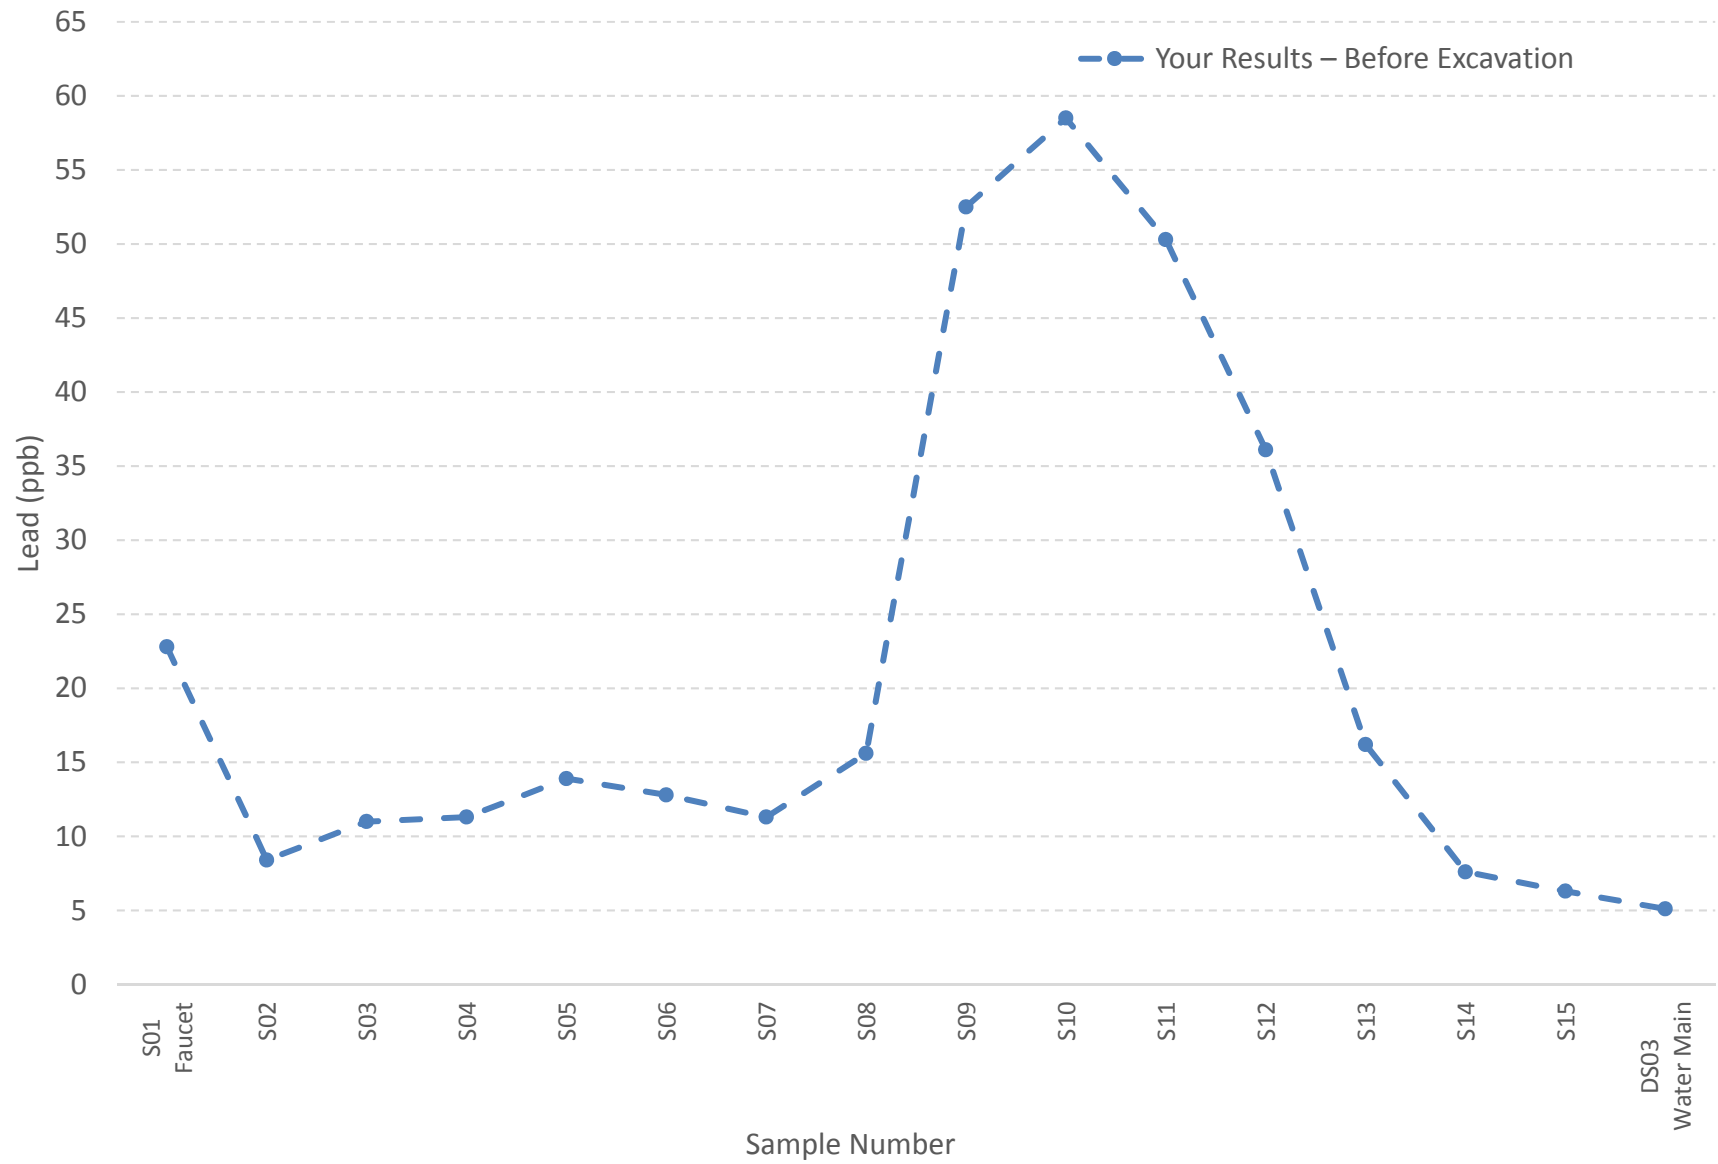

Site 3106 -- Utility Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 11/10/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	0.22	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	5	--	5	--	
Chromium	µg/L	1.1 J	0.62 J	0.55 J	0.54 J	0.62 J	0.57 J	0.61 J	0.52 J	0.58 J	0.53 J	0.49 J	0.51 J	0.48 J	0.51 J	0.60 J	0.48 J	100	--	100	--	
Copper	µg/L	1400	242	60.4	30.1	12.8	16.8	23.7	46.2	11.4	7.8	6.7	7.1	7.1	6.4	6.5	4.3	--	1300	1300	1000	
Lead	µg/L	22.8	8.4	11.0	11.3	13.9	12.8	11.3	15.6	52.5	58.5	50.3	36.1	16.2	7.6	6.3	5.1	--	15	0	--	
Manganese	µg/L	4.0	1.9	0.56 J	1.4	0.78 J	0.64 J	0.57 J	0.72 J	0.80 J	0.78 J	0.66 J	0.64 J	0.63 J	0.45 J	0.46 J	0.45 J	--	--	--	50	
Nickel	µg/L	1640	63.8	14.5	5.4	3.8	2.6	1.6	1.4	1.3	0.95	0.81	0.82	1.3	2.8	1.3	0.84	--	--	--	--	
Tin	µg/L	0.16 U	1.0 U	0.08 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--	
Zinc	µg/L	7830 J+	691 J+	94.7 J+	36.1 J+	18.1 J+	16.7 J+	15.7 J+	16.2 J+	9.9 J+	8.7 J+	7.0 J+	6.9 J+	6.4 J+	6.2 J+	6.7 J+	4.4 J+	--	--	--	5000	
Aluminum	mg/L	0.0978	0.0759	0.0783	0.0817	0.0939	0.0812	0.0838	0.0802	0.0806	0.0760	0.0739	0.0778	0.0746	0.0684	0.0718	0.0633	--	--	--	0.05 to 0.2	
Calcium	mg/L	33.8	33.3	34.2	34.1	34.5	33.5	33.7	33.6	33.6	33.2	33.9	34.2	34.5	35.8	34.6	34.1	--	--	--	--	
Iron	mg/L	0.0190 U	0.100 U	0.100 U	0.0523 J	0.0157 U	0.0379 J	0.0204 J	0.0451 J	0.0288 J	0.0402 J	0.0223 J	0.0300 J	0.0203 J	0.100 U	0.100 U	0.0154 U	--	--	--	0.3	
Magnesium	mg/L	12.2	11.9	12.2	12.2	12.3	12.0	12.1	12.0	12.0	11.9	12.1	12.2	12.4	12.8	12.4	12.2	--	--	--	--	
Potassium	mg/L	1.43	1.62	1.71	1.70	1.70	1.70	1.70	1.69	1.70	1.65	1.72	1.72	1.71	1.80	1.81	1.76	--	--	--	--	
Sodium	mg/L	10.6	11.5	12.0	11.9	12.1	11.9	12.0	11.9	12.0	11.8	12.1	12.0	12.4	12.6	12.6	12.3	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															104	--	--	--	--	
Chloride	mg/L	Not Sampled															19.5	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.136	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															29.2	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															0.156	--	--	--	--	

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3113, Kitchen Faucet,
10/14/2016 (Preliminary)

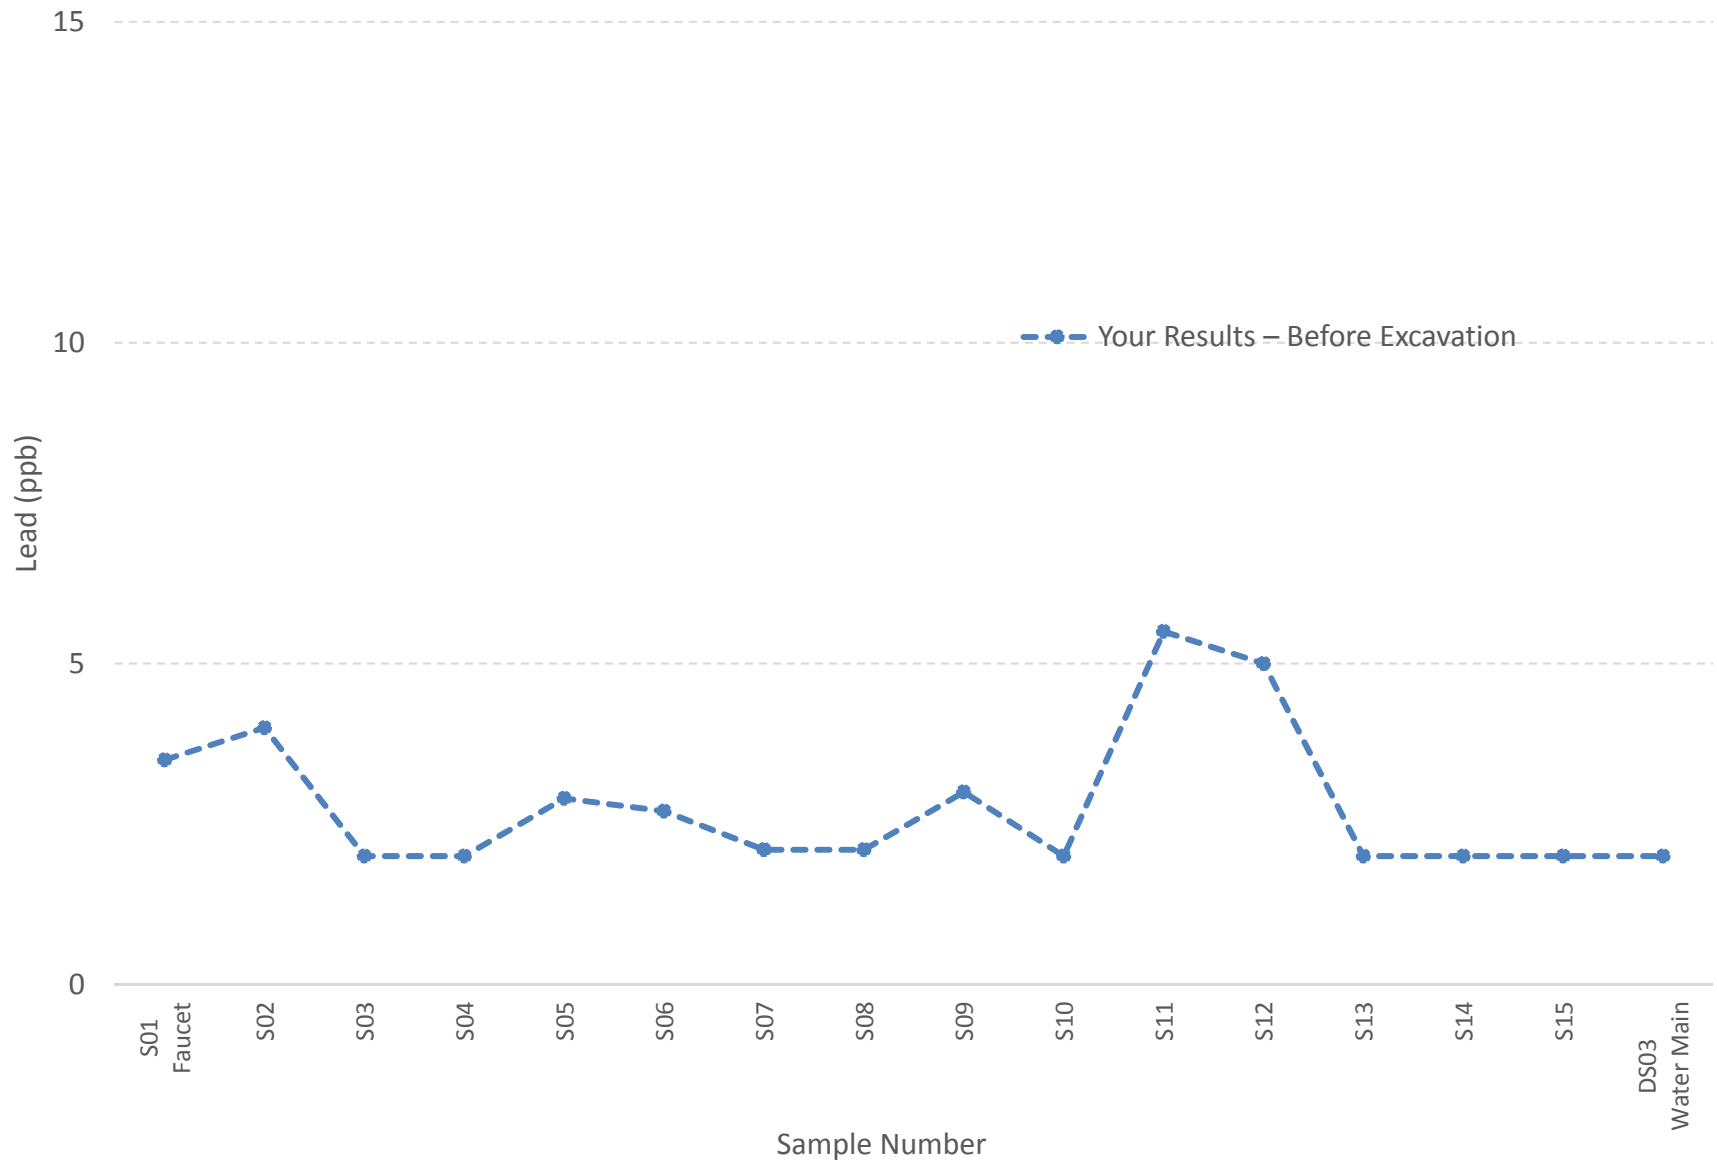

**Site 3113 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results**

Parameter	Units	Your Results - Before Excavation on 10/14/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink														Distribution System					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--	
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--	
Copper	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000	
Lead	µg/L	3.5	4.0	2.0 U	2.0 U	2.9	2.7	2.1	2.1	3.0	2.0	5.5	5.0	2.0 U	2.0 U	2.0 U	2.0 U	--	15	0	--	
Manganese	µg/L	4.0 U	5.7	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50	
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	22	4.0 U	4.0 U	4.0 U	--	--	--	--	
Zinc	µg/L	190	220	150	42	32	28	28	30	29	26	22	20	110	20 U	20 U	20 U	--	--	--	5000	
Aluminum	mg/L	0.10	0.083	0.098	0.13	0.15	0.11	0.11	0.11	0.11	0.10	0.10	0.10	0.095	0.098	0.098	0.092	--	--	--	0.05 to 0.2	
Calcium	mg/L	35	36	38	36	37	36	37	39	37	35	35	38	36	36	38	35	--	--	--	--	
Iron	mg/L	0.11	0.29	0.10	0.10	0.21	0.11	0.10	0.12	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3	
Magnesium	mg/L	13	12	13	13	13	13	13	13	13	12	12	13	13	13	13	12	--	--	--	--	
Potassium	mg/L	1.6	1.6	1.7	1.6	1.6	1.6	1.6	1.8	1.8	1.5	1.6	1.7	1.6	1.6	1.7	1.6	--	--	--	--	
Sodium	mg/L	11	11	12	11	11	11	12	12	12	11	11	12	11	12	12	11	--	--	--	--	
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled																120	--	--	--	--
Chloride	mg/L	Not Sampled																1.0 U	--	--	--	250
Fluoride	mg/L	Not Sampled																0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																0.050 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.


Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a "J" qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3206, Kitchen Faucet,
10/6/2016 and 10/18/2016 (Preliminary)

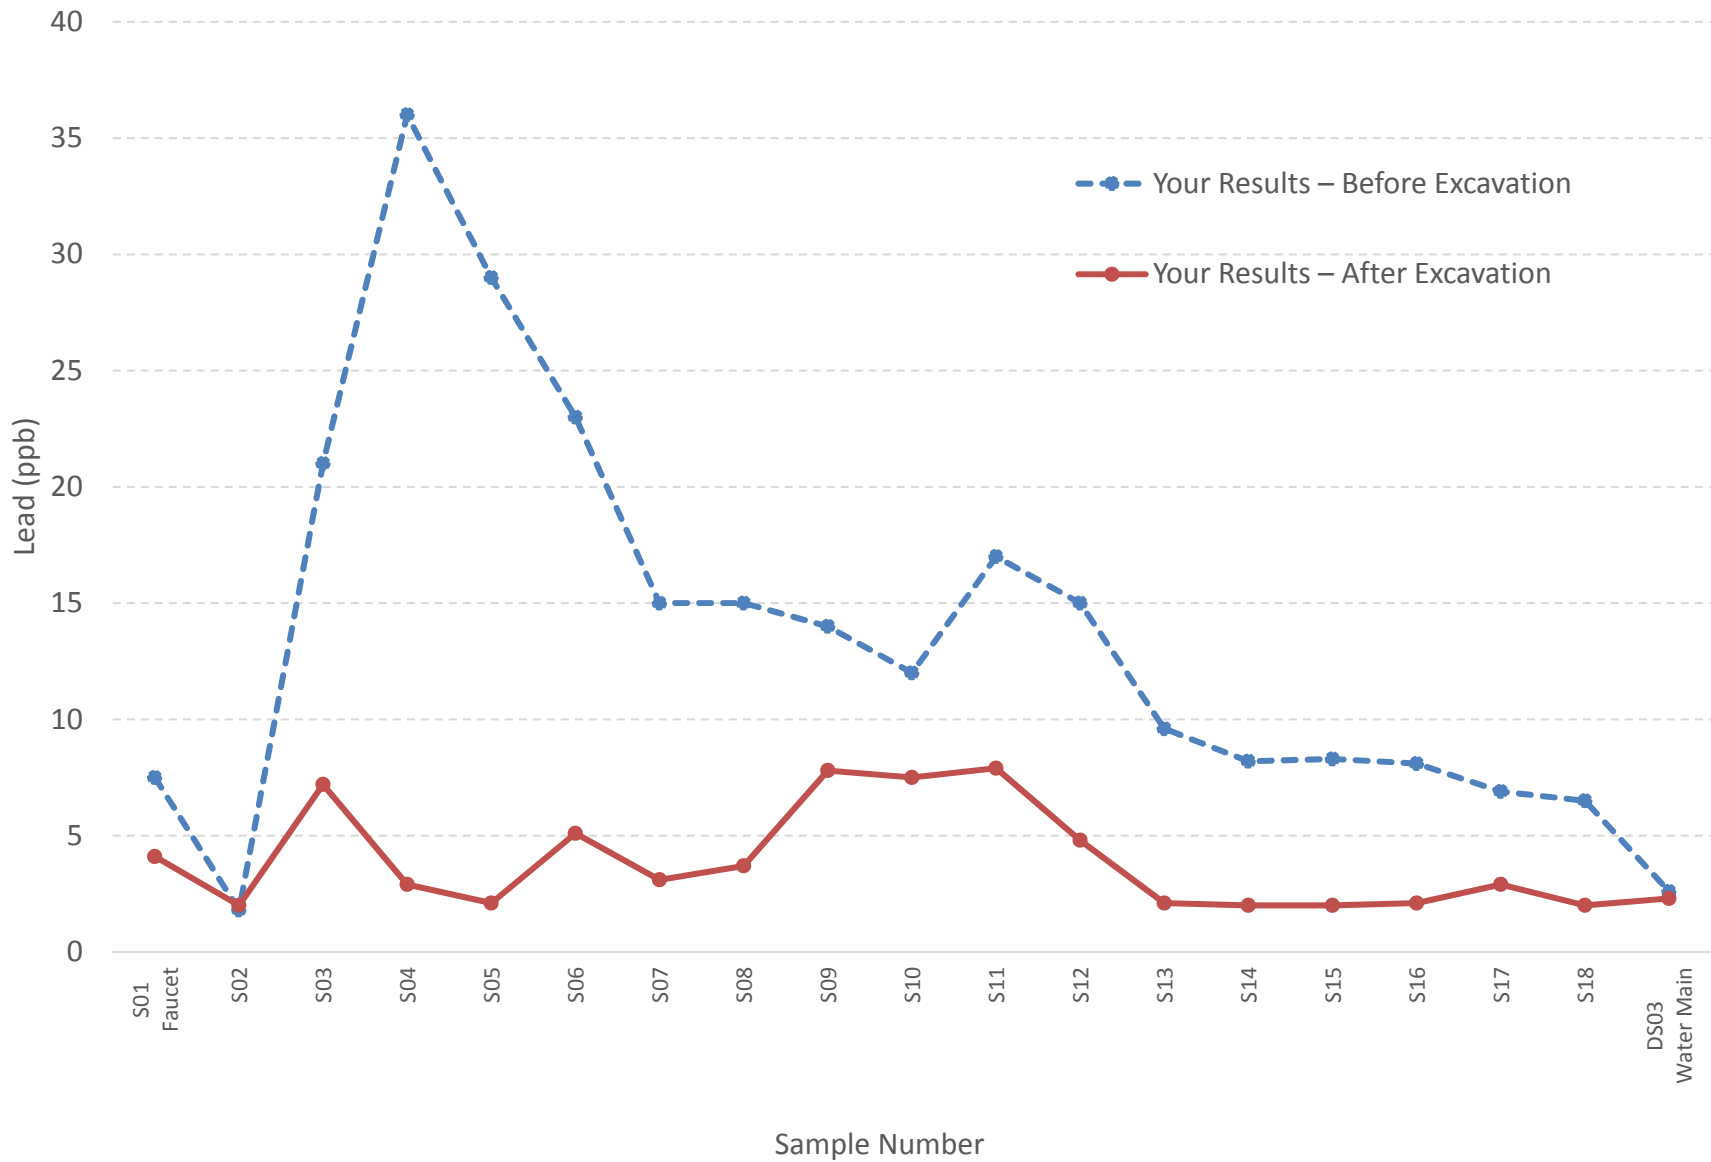

Site 3206 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/6/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	0.58 J	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	3.1 U	3.2 U	3.4 U	3.3 U	3.3 U	3.3 U	3.2 U	3.1 U	3.1 U	3.2 U	3.2 U	3.1 U	3.1 U	3.1 U	3.3 U	3.3 U	3.3 U	3.3 U	2.2 U	100	--	100	--
Copper	µg/L	40	5.8 U	7.7 U	8.2 U	6.6 U	18	7.7 U	4.3 U	4.9 U	4.0 U	3.8 U	3.4 U	3.3 U	3.4 J	3.3 U	3.2 U	3.1 J	3.1 U	1.5 U	--	1300	1300	1000
Lead	µg/L	7.5	1.8 J	21	36	29	23	15	15	14	12	17	15	9.6	8.2	8.3	8.1	6.9	6.5	2.6	--	15	0	--
Manganese	µg/L	7.3	4.5	14	26	19	13	8.8	10	9.5	7.6	6.6	6.7	5.9	5.3	6.8	5.2	4.5	4.1	1.6 J	--	--	--	50
Nickel	µg/L	2.8 U	2.0 U	2.0 U	2.0 U	1.8 U	1.8 U	1.7 U	1.7 U	1.8 U	1.7 U	1.8 U	1.7 U	1.7 U	1.7 U	1.8 U	1.8 U	1.8 U	1.7 U	0.94 U	--	--	--	--
Zinc	µg/L	550 B	220 B	150 B	120 B	140 B	68 B	46 B	65 B	65 B	36 B	36 B	50 B	42 B	29 B	48 B	72 B	57 B	45 B	11 U	--	--	--	5000
Aluminum	mg/L	0.11	0.087	0.18	0.19	0.17	0.14	0.12	0.14	0.15	0.12	0.12	0.12	0.14	0.13	0.13	0.13	0.13	0.12	0.12	--	--	--	0.05 to 0.2
Calcium	mg/L	36 J	36 J	37 J	37 J	36 J	35 J	34 J	37 J	38 J	36 J	38 J	38 J	36 J	37 J	37 J	37 J	37 J	35 J	36 J	--	--	--	--
Iron	mg/L	0.15 J+	0.24 J+	0.36 J+	0.37 J+	0.26 J+	0.27 J+	0.15 J+	0.18 J+	0.16 J+	0.11 J+	0.099 U	0.089 U	0.083 U	0.018 U	0.11 J+	0.062 U	0.057 U	0.048 U	0.032 U	--	--	--	0.3
Magnesium	mg/L	13 J	12 J	13 J	13 J	12 J	12 J	12 J	13 J	13	12 J	13 J	13 J	13 J	13 J	13 J	13 J	13 J	12 J	12 J	--	--	--	--
Potassium	mg/L	1.7	1.6	1.7	1.7	1.7	1.6	1.5	1.7	1.7	1.6	1.8	1.7	1.7	1.7	1.7	1.7	1.7	1.6	1.6	--	--	--	--
Sodium	mg/L	11 J+	11 J+	12 J+	12 J+	11 J+	11 J+	11 J+	12 J	12 J	11 J	12 J	12 J	12 J	12 J	12 J	12 J	12 J	11 J	11 J	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.0037 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110	--	--	--	--
Chloride	mg/L	Not Sampled																		1.0 J	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		23.9 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.0077 J	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
(B) = Low levels were also present in the laboratory blank samples, indicating a potential high bias (the actual value may be lower than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3206 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - After Excavation on 10/18/2016																			Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																	Distribution System					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)						
Cadmium	µg/L	2.5	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--	
Chromium	µg/L	5.0	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.7	4.0 U	4.0 U	100	--	100	--	
Copper	µg/L	33	69	18	10 U	10 U	10 U	10 U	10 U	10 U	14	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	35	--	1300	1300	1000	
Lead	µg/L	4.1	2.0 U	7.2	2.9	2.1	5.1	3.1	3.7	7.8	7.5	7.9	4.8	2.1	2.0 U	2.0 U	2.1	2.9	2.0 U	2.3	--	15	0	--	
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50	
Nickel	µg/L	6.9	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--	
Zinc	µg/L	80	31	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	24	--	--	--	5000	
Aluminum	mg/L	0.11	0.17	0.13	0.15	0.13	0.17	0.13	0.15	0.14	0.13	0.14	0.13	0.12	0.10	0.11	0.11	0.14	0.13	0.11	--	--	--	0.05 to 0.2	
Calcium	mg/L	40	49	35	43	38	47	43	49	46.0	42	44	44	42	39	41	41	52	44	40	--	--	--	--	
Iron	mg/L	0.10 U	0.10 U	0.12	0.10 U	0.10 U	0.15	0.10 U	0.10 U	0.17	0.10	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3	
Magnesium	mg/L	13	16	11	14	12	15	14	16	16	14	15	15	14	13	14	14	17	15	14	--	--	--	--	
Potassium	mg/L	1.7	2.1	1.6	1.9	1.7	2.1	1.9	2.1	2.0	1.8	1.9	1.9	1.8	1.7	1.8	1.8	2.2	1.9	1.7	--	--	--	--	
Sodium	mg/L	12	15	10	12	11	14	13	15	14	13	13	13	12	11	12	12	15	13	12	--	--	--	--	
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled																			130	--	--	--	--
Chloride	mg/L	Not Sampled																			3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																			0.15 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																			32.3 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																			0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
U = Not detected above the listed reporting limit
J = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.


Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3224, Kitchen Faucet, 9/28/2016 (Preliminary) and 10/10/2016

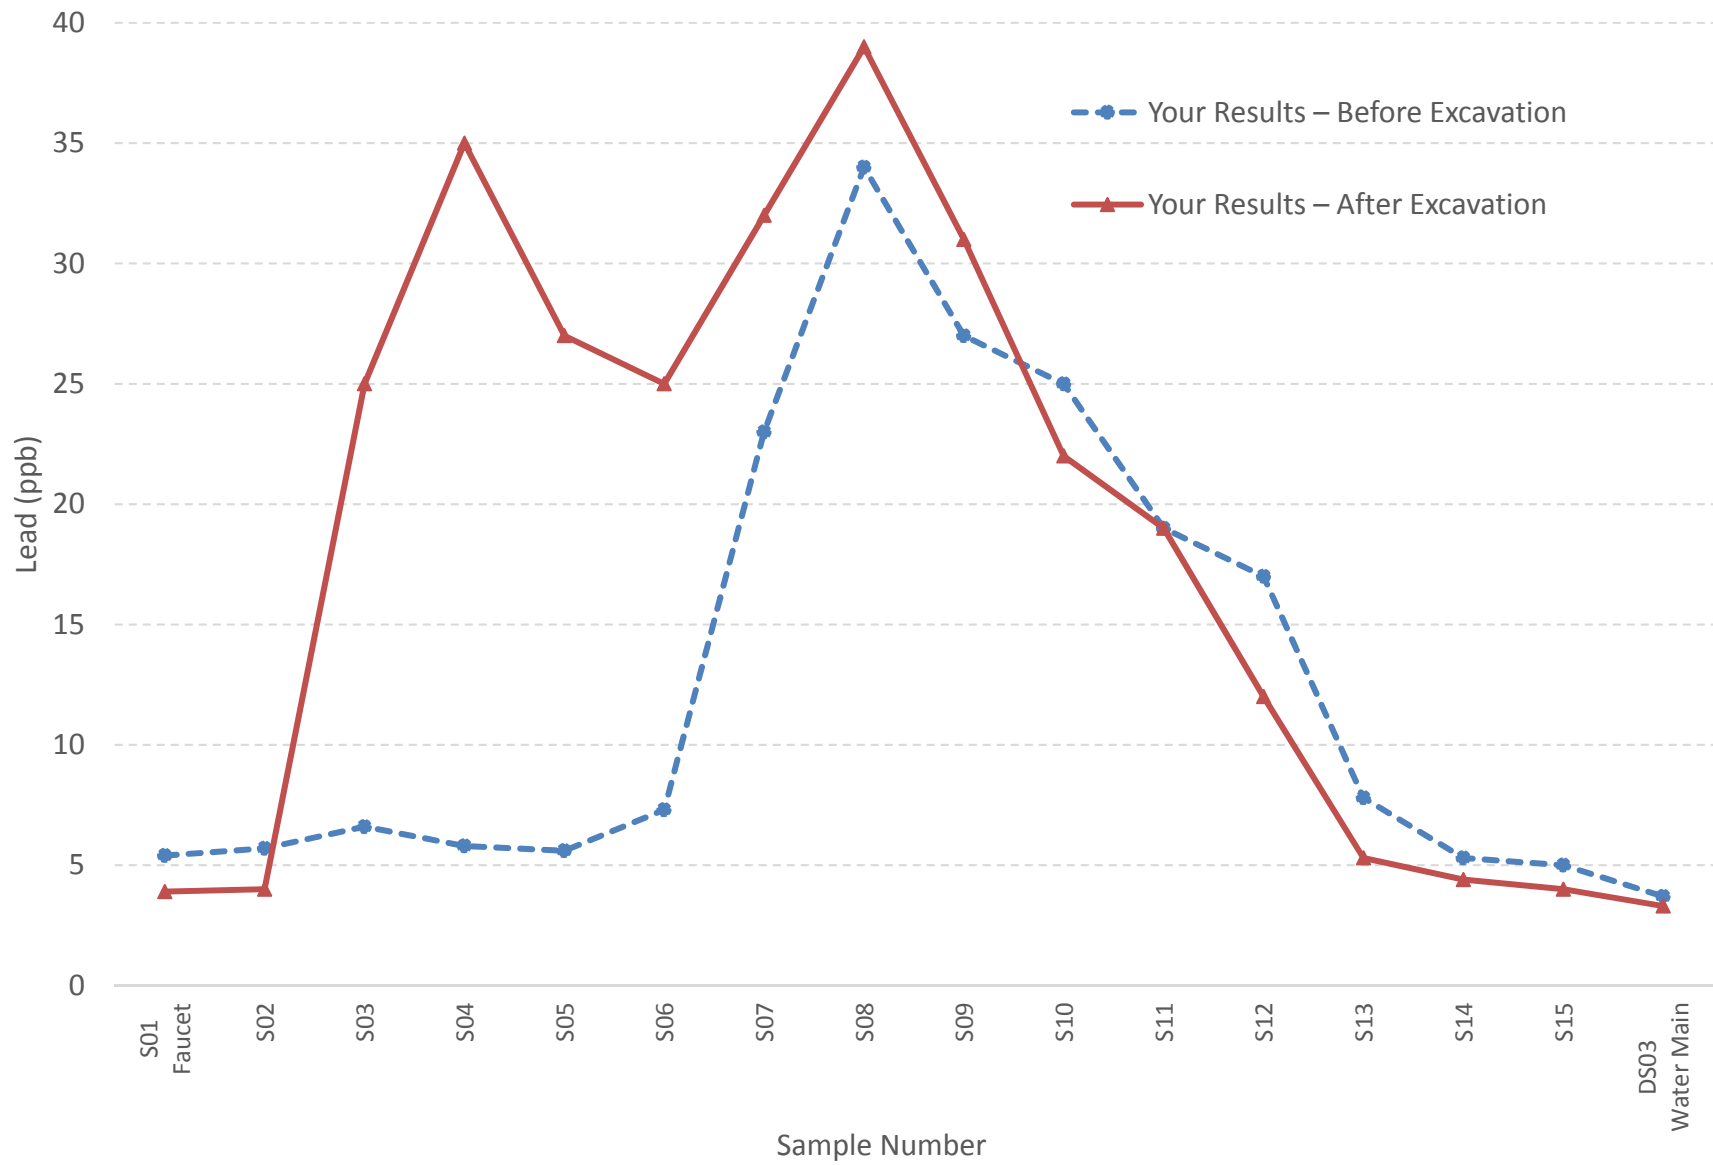

Site 3224 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 9/28/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	10	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	5.4	5.7	6.6	5.8	5.6	7.3	23	34	27	25	19	17	7.8	5.3	5.0	3.7	--	15	0	--
Manganese	µg/L	4.5	5.3	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	5.6	4.0 U	4.8	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	160	120	37	25	27	120	94	29	21	22	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.070	0.095	0.087	0.089	0.088	0.088	0.085	0.088	0.086	0.089	0.088	0.090	0.075	0.071	0.069	0.064	--	--	--	0.05 to 0.2
Calcium	mg/L	35	35	35	36	35	35	35	35	34	35	35	36	34	35	35	35	--	--	--	--
Iron	mg/L	0.24	0.26	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	14	14	14	14	14	14	13	14	13	14	14	14	13	14	14	14	--	--	--	--
Potassium	mg/L	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.4	1.5	1.5	1.5	1.4	1.5	1.5	1.5	--	--	--	--
Sodium	mg/L	12	12	12	12	12	12	12	12	11	12	12	12	11	12	12	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															3.0	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
U = **Not detected above the listed reporting limit**

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3224 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 10/10/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.1 U	3.2 U	7.7 U	3.5 U	4.2 U	3.1 U	4.7 U	3.6 U	3.6 U	5.3 U	3.9 U	3.5 U	3.4 U	3.6 U	4.9 U	3.7 U	100	--	100	--
Copper	µg/L	2.0 J	10 U	4.3 J	3.1 J	2.4 J	2.4 J	1.8 J	1.5 J	10 U	1.9 J	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	3.9	4.0	25	35	27	25	32	39	31	22	19	12	5.3	4.4	4.0	3.3	--	15	0	--
Manganese	µg/L	5.7	2.3 J	4.1	4.4	3.5 J	2.7 J	2.1 J	1.7 J	1.5 J	1.5 J	1.9 J	1.2 J	1.1	1.2 J	2.0 J	1.2 J	--	--	--	50
Nickel	µg/L	2.2 U	1.7 U	3.4 U	2.0 U	2.2 U	1.8 U	2.7 U	2.1 U	2.0 U	2.7 U	2.3 U	2.0 U	2.0 U	2.1 U	2.6 U	2.4 U	--	--	--	--
Zinc	µg/L	140 J+	67 J+	110 J+	130 J+	90 J+	140 J+	100 J+	42 J+	34 J+	33 J+	23 J+	21 J+	21 J+	19 U	27 J+	14 U	--	--	--	5000
Aluminum	mg/L	0.078 J	0.079 J-	0.11 J-	0.13 J-	0.11 J-	0.11 J-	0.094 J-	0.098 J-	0.10 J-	0.092 J-	0.095 J-	0.092 J-	0.092 J-	0.092 J-	0.092 J-	0.091 J	--	--	--	0.05 to 0.2
Calcium	mg/L	34 J	34 J	35 J	35 J	35 J	36	33 J	36 J	35 J	34 J	36 J	34 J	36 J	35 J	34 J	33 J	--	--	--	--
Iron	mg/L	0.68 J-	0.13 J	0.38 J	0.50 J-	0.38 J-	0.30 J	0.14 J-	0.13 J-	0.094 U	0.055 U	0.12 J-	0.036 U	0.026 U	0.026 U	0.085 U	0.029 J	--	--	--	0.3
Magnesium	mg/L	12 J	12 J	12 J	12 J	12 J	13 J	12 J	12 J	12 J	12 J	12 J	12 J	13 J	12 J	12 J	12 J	--	--	--	--
Potassium	mg/L	1.6	1.5	1.6	1.6	1.6	1.7	1.5	1.60	1.6	1.8	1.7	1.6	1.6	1.6	1.5	1.5	--	--	--	--
Sodium	mg/L	11 J+	11 J+	12 J+	11 J+	11 J+	12 J+	11 J+	12 J+	12 J+	11 J+	12 J+	11 J+	12 J+	11 J+	11 J+	11 J+	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															3.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.17 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															40.5 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

U = Not detected above the listed reporting limit

J = Estimated

J+ = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

J- = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3226, Kitchen Faucet,
10/17/2016 (Preliminary) and 12/17/2016



Site 3226 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/17/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	13	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	6.7	4.2	3.8	4.5	4.3	5.3	5.7	5.6	5.3	5.1	5.3	5.6	4.4	4.6	3.7	2.6	--	15	0	--
Manganese	µg/L	5.2	5.4	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	6.0	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	110	62	37	25	46	76	48	28	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.088	0.082	0.078	0.12	0.074	0.080	0.076	0.077	0.079	0.091	0.092	0.095	0.088	0.093	0.090	0.089	--	--	--	0.05 to 0.2
Calcium	mg/L	38	35	36	36	34	36	36	37	36	37	37	38	34	37	36	37	--	--	--	--
Iron	mg/L	0.31	0.41	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	13	12	12	12	12	12	12	13	13	12	12	13	12	13	12	13	--	--	--	--
Potassium	mg/L	1.7	1.6	1.6	1.6	1.5	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.5	1.6	1.6	1.6	--	--	--	--
Sodium	mg/L	12	11	11	11	10	11	11	11	11	11	11	12	11	11	11	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															3.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3226 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/17/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	Not available - results will be provided when available																5	--	5	--
Chromium	µg/L																	100	--	100	--
Copper	µg/L	29.2	10.7	5.25	1.04	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	--	1300	1300	1000
Lead	µg/L	4.33	3.23	2.12	1.42	1.43	1.68	1.56	1.72	1.77	1.70	1.79	1.60	1.64	1.57	1.44	1.10	--	15	0	--
Zinc	µg/L	246	83.8	37.4	15.1	14.2	18.9	21.9	15.1	12.1	11.5	11.0	10.0 U	10.0 U	11.1	10.0 U	10.0 U	--	--	--	5000
Manganese	µg/L	Not available - results will be provided when available																--	--	--	50
Nickel	µg/L																	--	--	--	--
Aluminum	mg/L																	--	--	--	0.05 to 0.2
Calcium	mg/L																	--	--	--	--
Iron	mg/L																	--	--	--	0.3
Magnesium	mg/L																	--	--	--	--
Potassium	mg/L																	--	--	--	--
Sodium	mg/L																	--	--	--	--
Tin	mg/L																	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															110	--	--	--	--
Chloride	mg/L	Not Sampled															16.5	--	--	--	250
Fluoride	mg/L	Not Sampled															0.09	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															24.4	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.34	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3282, Kitchen Faucet, 10/15/2016 (Preliminary) and 11/29/2016



Site 3282 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/15/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	32	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	3.0	2.0 U	10	9.4	5.3	5.8	9.2	8.5	8.6	6.7	4.2	2.6	2.0 U	2.0 U	2.0 U	2.0 U	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	8.0	7.6	4.0 U	4.0 U	6.9	6.5	6.0	4.3	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	12	4.0 U	4.6	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	590	300	130	37	20	30	34	88	36	170	41	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.081	0.083	0.14	0.12	0.097	0.11	0.12	0.11	0.12	0.11	0.096	0.093	0.096	0.093	0.090	0.090	--	--	--	0.05 to 0.2
Calcium	mg/L	35	36	36	37	34	37	37	35	36	36	35	36	37	36	35	35	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	12	12	12	13	12	13	13	12	13	12	12	12	13	12	12	12	--	--	--	--
Potassium	mg/L	1.6	1.6	1.6	1.6	1.5	1.6	1.6	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.5	1.6	--	--	--	--
Sodium	mg/L	11	11	11	11	11	12	12	11	12	11	11	11	12	11	11	11	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															3.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3282 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/29/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U				
Chromium	µg/L	0.43 J	0.39 J	0.39 J	0.38 J	0.36 J	0.39 J	0.39 J	0.41 J	0.37 J	0.39 J	0.38 J	0.43 J	0.38 J	0.39 J	0.42 J	0.38 J	100	--	100	--
Copper	µg/L	12.9	2.8	2.0	1.7	1.4	1.5	1.5	1.2	1.2	1.1	1.1	1.0	1.1	1.0	0.97 J	0.88 J	--	1300	1300	1000
Lead	µg/L	2.3	2.4	2.6	2.7	2.7	3.6	3.5	3.4	3.4	3.2	2.6	1.9	1.3	1.2	1.1	0.90 J	--	15	0	--
Manganese	µg/L	0.82 U	0.60 U	0.66 U	0.37 U	0.54 U	0.68 U	0.47 U	0.49 U	0.63 U	0.81 U	0.90 U	1.3	0.93 J	2.2	0.78 U	0.67 U	--	--	--	50
Nickel	µg/L	1.2	0.58	0.51	0.69	0.50 J	0.50 J	0.50 J	0.48 J	0.51	0.52	0.49 J	0.54	0.51	0.51	0.49 J	0.49 J	--	--	--	--
Tin	µg/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	0.52 J	--	--	--	--
Zinc	µg/L	243	334	29.1	13.9	13.1	10.6	8.7	8.1	7.9	7.4	7.0	7.3	6.6	6.5	6.1	5.2	--	--	--	5000
Aluminum	mg/L	0.0460	0.0509	0.0581	0.0566	0.0561	0.0530	0.0475	0.0458	0.0469	0.0451	0.0443	0.0434	0.0409	0.0408	0.0412	0.0392	--	--	--	0.05 to 0.2
Calcium	mg/L	33.3	33.6	33.3	33.7	33.3	31.8	33.8	33.3	32.9	33.3	33.0	33.1	33.3	32.8	33.7	33.3	--	--	--	--
Iron	mg/L	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	--	--	--	0.3
Magnesium	mg/L	11.9	11.8	11.8	11.9	11.8	11.3	12.0	11.9	11.7	11.9	11.8	11.8	11.9	11.7	12.0	11.9	--	--	--	--
Potassium	mg/L	1.57	1.54	1.55	1.56	1.53	1.48	1.43	1.54	1.47	1.55	1.52	1.53	1.53	1.56	1.49	1.54	--	--	--	--
Sodium	mg/L	11.3	11.2	11.0	11.0	10.9	10.6	10.4	10.9	10.8	11.0	10.8	10.9	10.9	10.8	11.1	11.0	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															104	--	--	--	--
Chloride	mg/L	Not Sampled															16.4	--	--	--	250
Fluoride	mg/L	Not Sampled															0.098 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															26.9	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.247	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3300, Kitchen Faucet,
10/8/2016 (Preliminary) and 10/22/2016 (Preliminary)

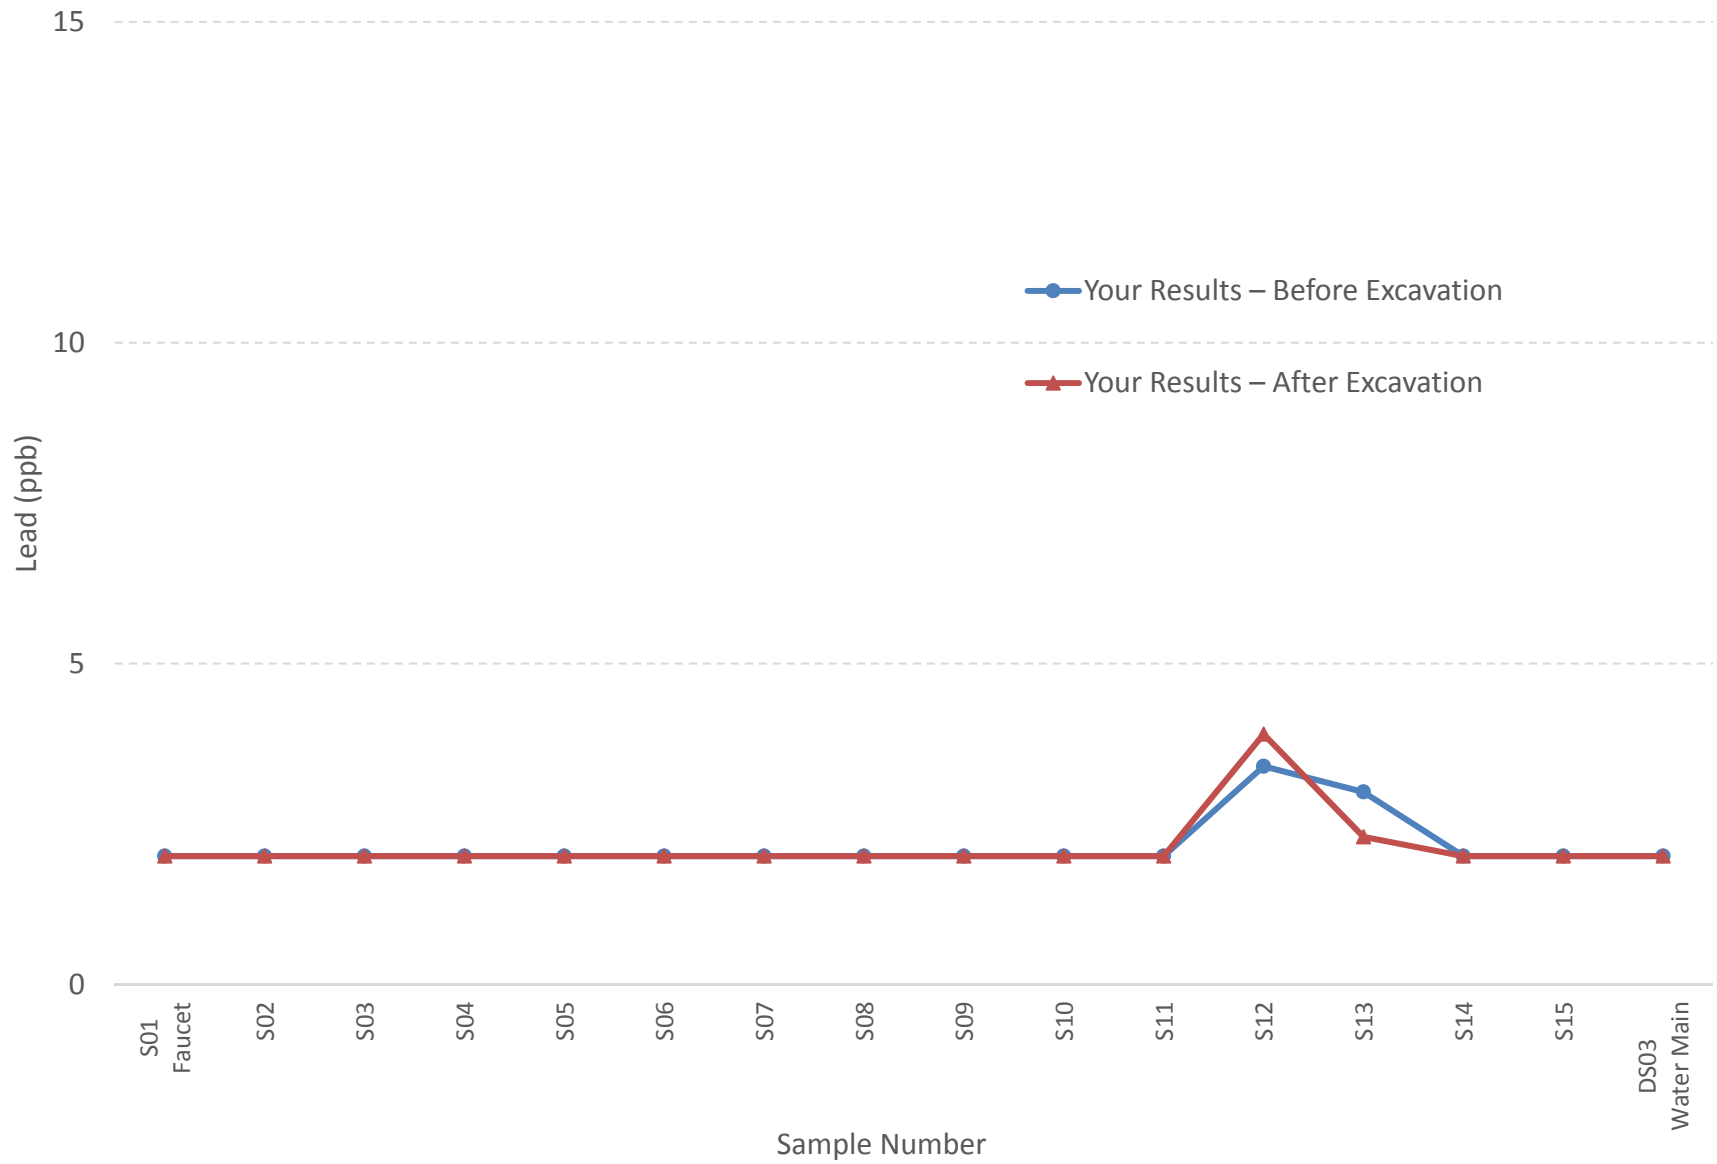

Site 3300 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/8/2016																Comparison Standards					
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL		
		Faucet	Under Sink																			Distribution System	
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)							
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--		
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.3	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--		
Copper	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000		
Lead	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	3.4	3.0	2.0 U	2.0 U	2.0 U	--	15	0	--		
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	11	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50		
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--		
Zinc	µg/L	59	100	55	62	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000		
Aluminum	mg/L	0.095	0.092	0.092	0.094	0.10	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.14	--	--	--	0.05 to 0.2		
Calcium	mg/L	36	37	36	37	36	36	38	36	37	37	36	37	36	36	36	36	--	--	--	--		
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.12	0.10 U	0.10 U	0.10 U	0.10 U	0.77	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3		
Magnesium	mg/L	13	13	13	13	12	13	13	12	13	13	13	13	13	13	13	12	--	--	--	--		
Potassium	mg/L	1.6	1.6	1.6	1.6	1.6	1.6	1.7	1.6	1.7	1.6	1.6	1.6	1.6	1.6	1.6	1.6	--	--	--	--		
Sodium	mg/L	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	11	--	--	--	--		
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--		
Total Alkalinity	mg CaCO3/L	Not Sampled															100	--	--	--	--		
Chloride	mg/L	Not Sampled															3.0	--	--	--	250		
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2		
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250		
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--		

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3300 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - After Excavation on 10/22/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						Distribution System
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U					5
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	7.9	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--	
Copper	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000	
Lead	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	3.9	2.3	2.0 U	2.0 U	2.0 U	--	15	0	--	
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50	
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--	
Zinc	µg/L	56	100	53	21	22	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000	
Aluminum	mg/L	0.086	0.088	0.096	0.10	0.12	0.089	0.093	0.089	0.091	0.087	0.089	0.091	0.087	0.083	0.084	0.090	--	--	--	0.05 to 0.2	
Calcium	mg/L	38	38	39	40	43	36	38	38	39	37	38	37	37	36	36	36	--	--	--	--	
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3	
Magnesium	mg/L	13	13	13	13	14	12	13	13	13	13	13	13	13	12	12	12	--	--	--	--	
Potassium	mg/L	1.7	1.8	1.9	1.9	2.1	1.7	1.8	1.8	1.8	1.7	1.8	1.7	1.7	1.7	1.7	1.7	--	--	--	--	
Sodium	mg/L	12	12	13	13	14	12	12	12	13	12	12	12	12	12	12	11	--	--	--	--	
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--	
Chloride	mg/L	Not Sampled															3.0	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.


Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3301, Kitchen Faucet, 10/19/2016 (Preliminary) and 11/15/2016

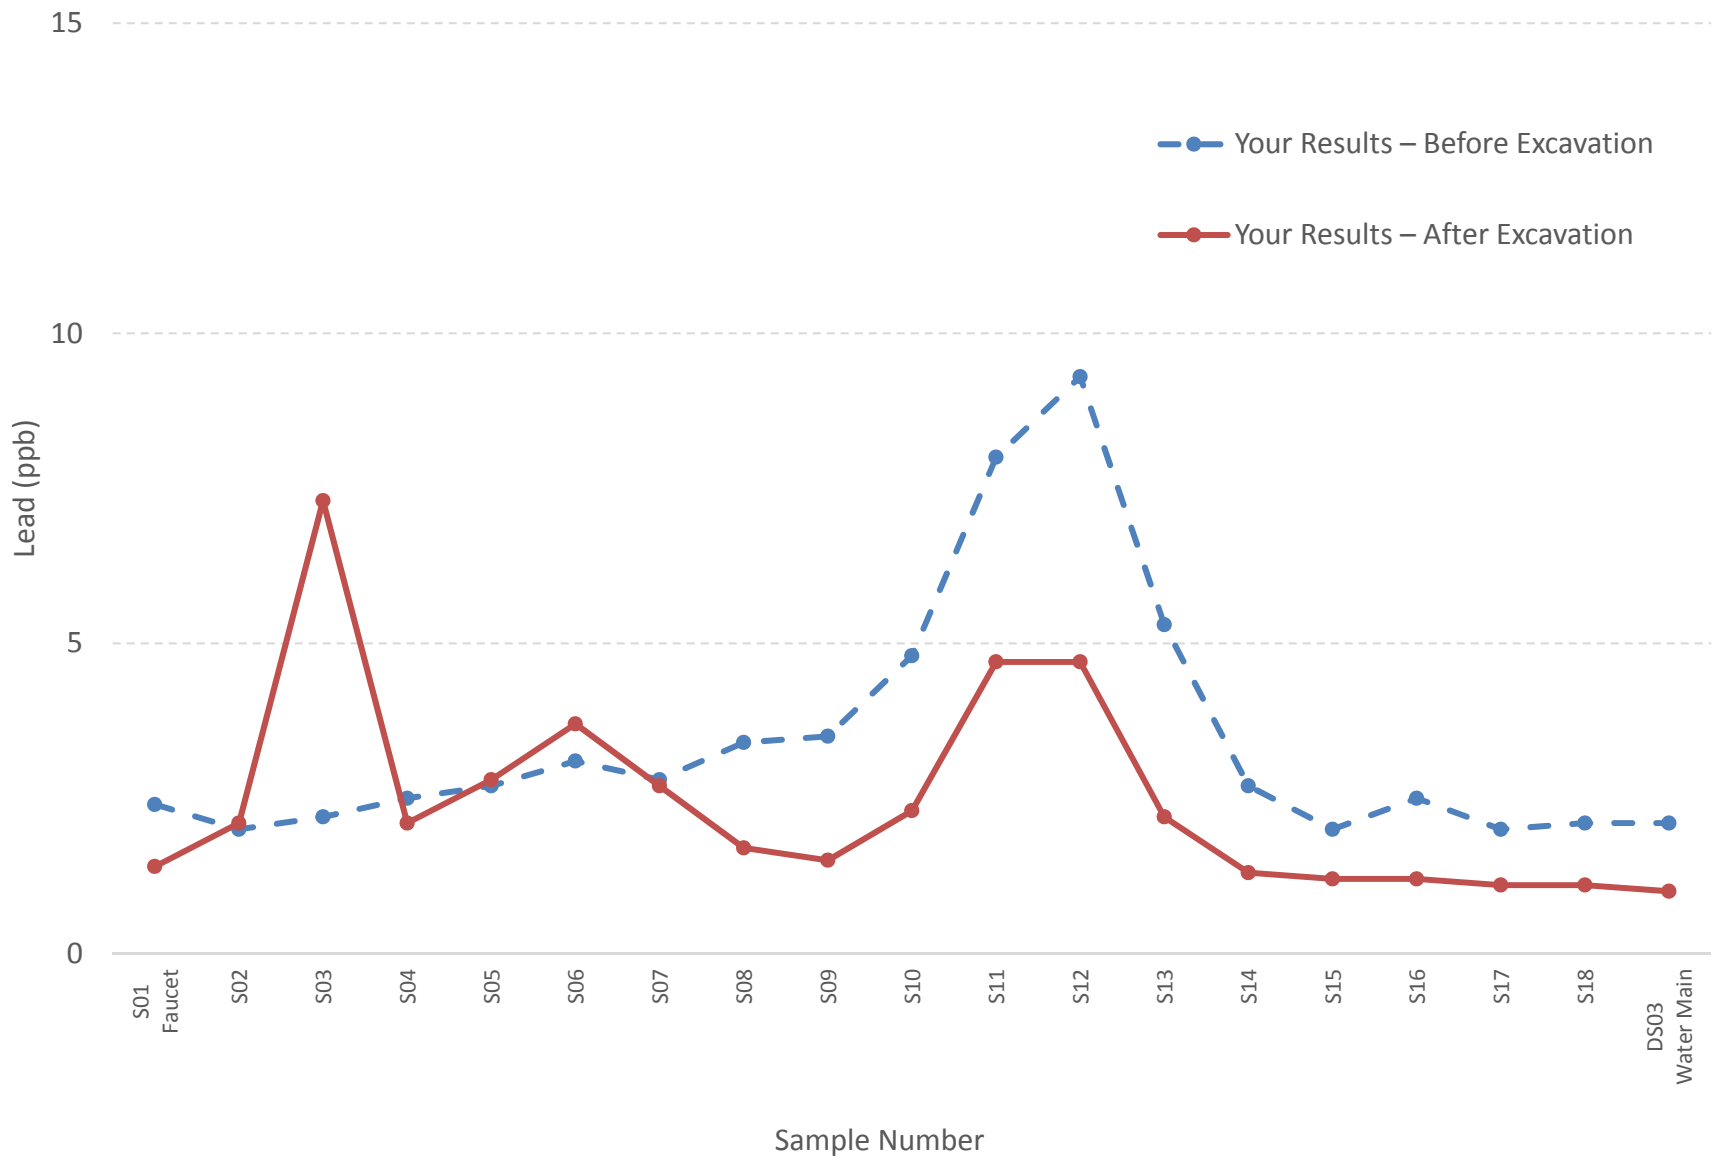

Site 3301 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/19/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	72	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.4	2.0 U	2.2	2.5	2.7	3.1	2.8	3.4	3.5	4.8	8.0	9.3	5.3	2.7	2.0 U	2.5	2.0 U	2.1	2.1	--	15	0	--
Manganese	µg/L	5.1	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	140	110	45	30	30	26	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.078	0.089	0.098	0.090	0.096	0.097	0.084	0.093	0.098	0.090	0.083	0.098	0.088	0.082	0.083	0.081	0.080	0.087	0.077	--	--	--	0.05 to 0.2
Calcium	mg/L	38	36	36	33	36	36	32	36	37	35	33	37	36	36	37	36	35	38	36	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	13	12	12	11	12	12	11	12	13	12	11	13	12	13	13	12	12	13	12	--	--	--	--
Potassium	mg/L	1.6	1.5	1.5	1.5	1.5	1.5	1.4	1.5	1.6	1.5	1.4	1.6	1.5	1.5	1.6	1.5	1.5	1.6	1.5	--	--	--	--
Sodium	mg/L	11	11	11	10	11	11	9.8	11	11	11	10	11	11	11	11	11	11	11	11	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		130	--	--	--	--
Chloride	mg/L	Not Sampled																		1.0 U	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3301 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/15/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
		1st sample (125 mL)	2nd sample (125 mL)																	Distribution System				
Cadmium	µg/L	0.27	0.61	0.31	0.11 J	0.12 J	0.08 J	0.07 J	0.06 J	0.06 J	0.05 J	0.04 J	0.05 J	0.04 J	0.04 J	0.03 J	0.04 J	0.03 J	0.03 J	0.03 J	5	--	5	--
Chromium	µg/L	0.46 U	0.51 U	0.62 U	0.55 U	0.55 U	0.57 U	0.56 U	0.58 U	0.62 U	0.58 U	0.59 U	0.58 U	0.56 U	0.58 U	0.58 U	0.58 U	0.59 U	0.57 U	0.62 U	100	--	100	--
Copper	µg/L	61.5	3.9	3.8	3.0	5.1	18.3	6.5	3.0	3.2	2.7	2.4	2.3	2.1	2.1	1.9	2.0	1.8	1.8	1.5	--	1300	1300	1000
Lead	µg/L	1.4	2.1	7.3	2.1	2.8	3.7	2.7	1.7	1.5	2.3	4.7	4.7	2.2	1.3	1.2	1.2	1.1	1.1	1.0	--	15	0	--
Manganese	µg/L	2.1	1.4	2.1	0.55 J	0.79 J	0.73 J	0.47 J	0.39 J	0.51 J	0.66 J	0.41 J	0.45 J	0.47 J	0.53 J	0.56 J	0.48 J	0.49 J	0.43 J	0.61 J	--	--	--	50
Nickel	µg/L	4.3	0.78	0.72	0.66	0.70	0.84	0.68	0.62	0.65	0.68	0.61	0.73	0.60	0.96	0.66	0.85	0.62	0.60	0.62	--	--	--	--
Tin	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	0.09 J	0.18 J	0.08 J	0.08 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	127	137	150	25.8	25.6	23.4	16.6	13.3	15.1	13.8	10.8	9.3	8.9	8.9	8.8	8.5	8.0	8.0	6.9	--	--	--	5000
Aluminum	mg/L	0.0424	0.0578	0.121	0.0619	0.0584	0.0617	0.0582	0.0543	0.0551	0.0551	0.0528	0.0500	0.0478	0.0455	0.0454	0.0446	0.0425	0.0425	0.0431	--	--	--	0.05 to 0.2
Calcium	mg/L	33.7	33.7	34.0	33.5	33.5	33.7	33.7	34.3	34.2	34.7	33.3	33.7	33.9	33.3	33.8	33.9	33.6	33.3	33.1	--	--	--	--
Iron	mg/L	0.0245 J	0.0250 J	0.103	0.0242 J	0.0348 J	0.0138 J	0.0220 J	0.0274 J	0.0145 J	0.0213 J	0.0213 J	0.100 U	0.100 U	0.0142 J	0.100 U	0.100 U	0.0196 J	0.0156 J	0.100 U	--	--	--	0.3
Magnesium	mg/L	12.0	12.0	12.0	11.9	11.9	12.0	12.0	12.2	12.2	12.4	11.9	11.9	12.1	11.9	12.1	12.1	12.1	11.9	11.9	--	--	--	--
Potassium	mg/L	1.50	1.55	1.50	1.47	1.49	1.55	1.53	1.52	1.59	1.55	1.52	1.48	1.54	1.51	1.58	1.55	1.51	1.52	1.51	--	--	--	--
Sodium	mg/L	10.5	10.5	10.5	10.3	10.3	10.5	10.5	10.5	10.5	10.8	10.3	10.4	10.6	10.4	10.6	10.5	10.5	10.4	10.4	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		102	--	--	--	--
Chloride	mg/L	Not Sampled																		16.8	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.117	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		28.5	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.187	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3319, Kitchen Faucet, 10/7/2016 (Preliminary) and 10/20/2016 (Preliminary)

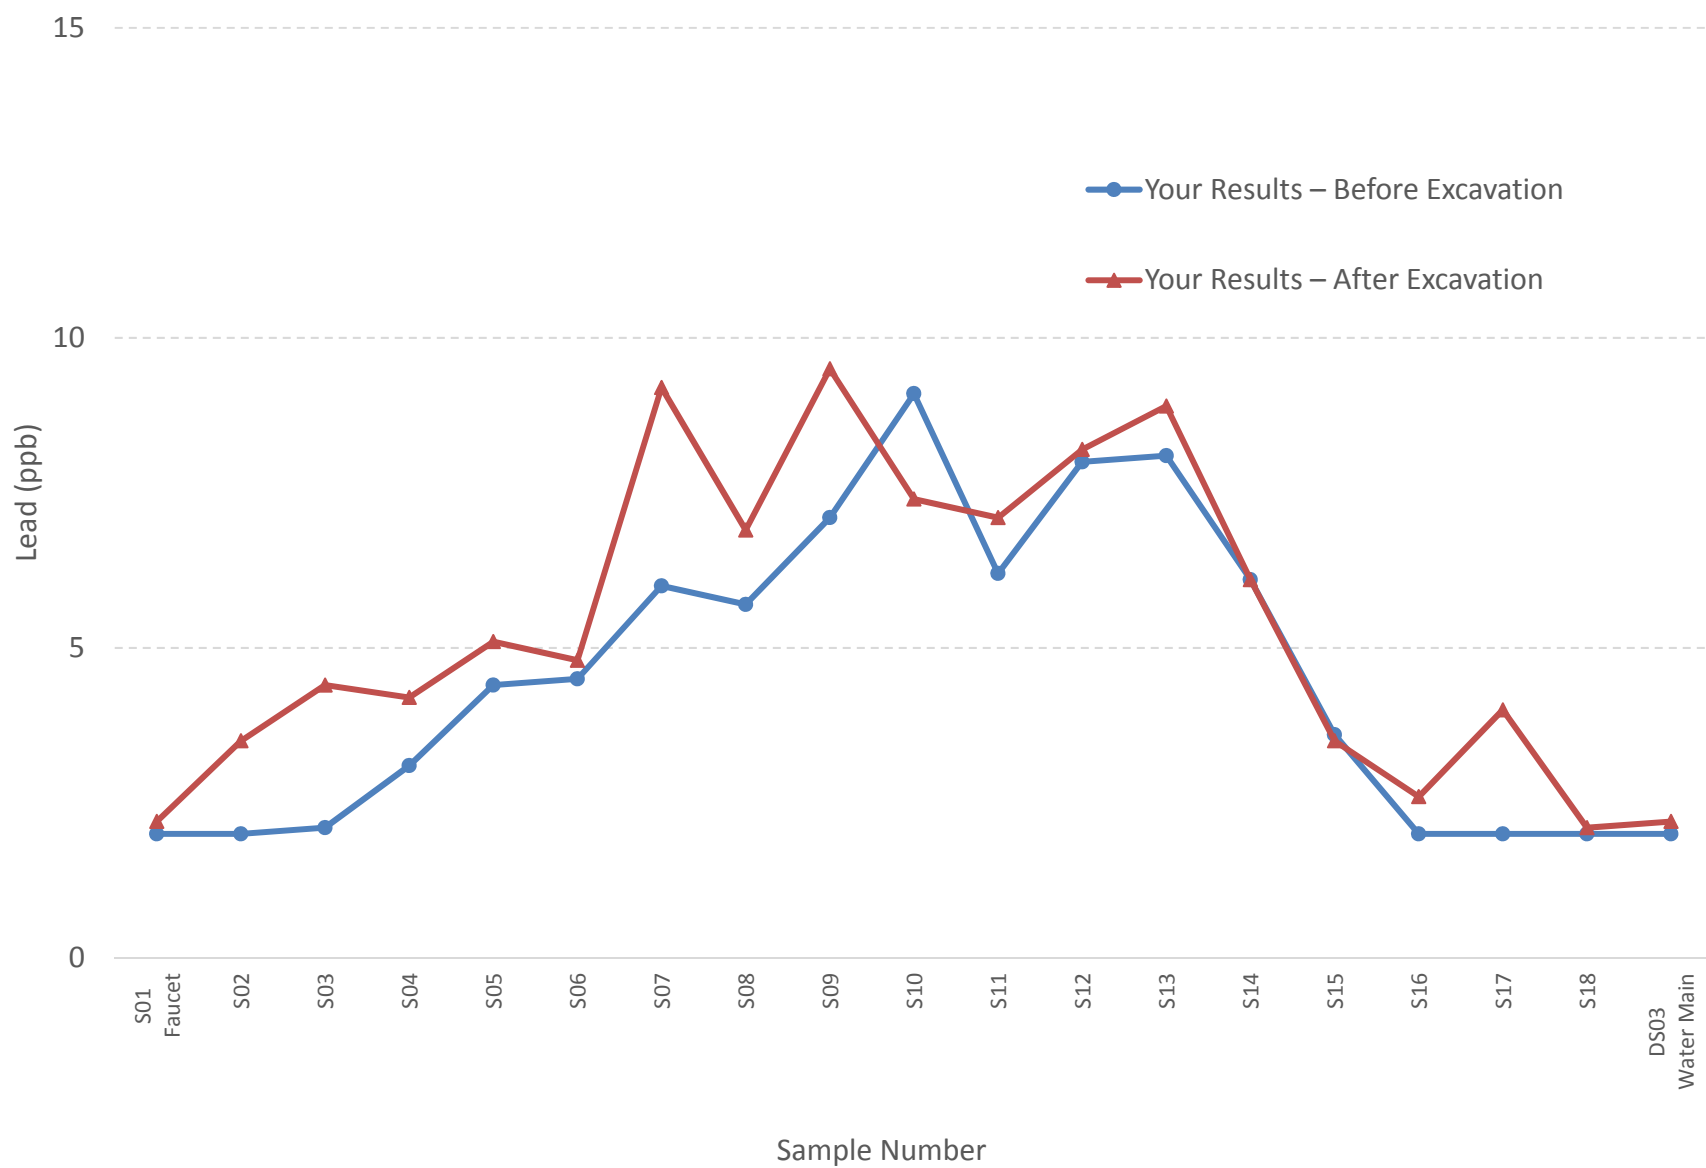

Site 3319 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/7/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	8.0 U	100	--	100	--
Copper	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.0 U	2.0 U	2.1	3.1	4.4	4.5	6.0	5.7	7.1	9.1	6.2	8.0	8.1	6.1	3.6	2.0	2.0 U	2.0 U	2.0 U	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.1	4.5	5.9	4.0	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	140	46	26	22	20 U	20	32	30	29	31	20	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.097	0.098	0.086	0.094	0.11	0.097	0.099	0.10	0.11	0.11	0.12	0.12	0.11	0.12	0.10	0.12	0.12	0.11	0.11	--	--	--	0.05 to 0.2
Calcium	mg/L	35	36	34	37	44	39	39	39	43	40	46	45	40	43	36	40	40	37	38	--	--	--	--
Iron	mg/L	0.10 U	0.24	0.10 U	0.10 U	0.10 U	0.10 U	0.13	0.16	0.18	0.19	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	12	12	12	13	15	14	14	14	15	14	16	16	14	15	12	14	14	13	13	--	--	--	--
Potassium	mg/L	1.6	1.6	1.5	1.6	1.9	1.7	1.7	1.7	1.9	1.7	2.0	2.0	1.7	1.9	1.5	1.7	1.7	1.6	1.7	--	--	--	--
Sodium	mg/L	11	11	11	12	14	13	13	13	14	13	15	15	13	14	11	12	13	12	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3319 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - After Excavation on 10/20/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.2	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U				
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	5.8	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.2	3.5	4.4	4.2	5.1	4.8	9.2	6.9	9.5	7.4	7.1	8.2	8.9	6.1	3.5	2.6	4.0	2.1	2.2	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	6.3	4.0 U	4.5	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	160	58	27	20 U	20 U	21	34	30	26	21	20 U	20 U	20 U	20 U	20 U	20 U	20 U	26	20 U	--	--	--	5000
Aluminum	mg/L	0.081	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.10	0.094	0.095	0.091	0.094	--	--	--	0.05 to 0.2
Calcium	mg/L	37	36	37	38	36	38	36	38	38	38	37	37	38	38	38	37	39	37	38	--	--	--	--
Iron	mg/L	0.10 U	0.12	0.12	0.10 U	0.10 U	0.10 U	0.26	0.17	0.23	0.13	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	13	13	13	13	13	14	13	14	13	13	13	13	13	13	14	13	14	13	13	--	--	--	--
Potassium	mg/L	1.6	1.6	1.6	1.6	1.6	1.7	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.7	--	--	--	--
Sodium	mg/L	11	11	11	11	11	12	11	12	12	12	11	11	12	12	12	12	12	11	11	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--


Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.
Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3332, Kitchen Faucet, 10/10/2016 and 12/3/2016

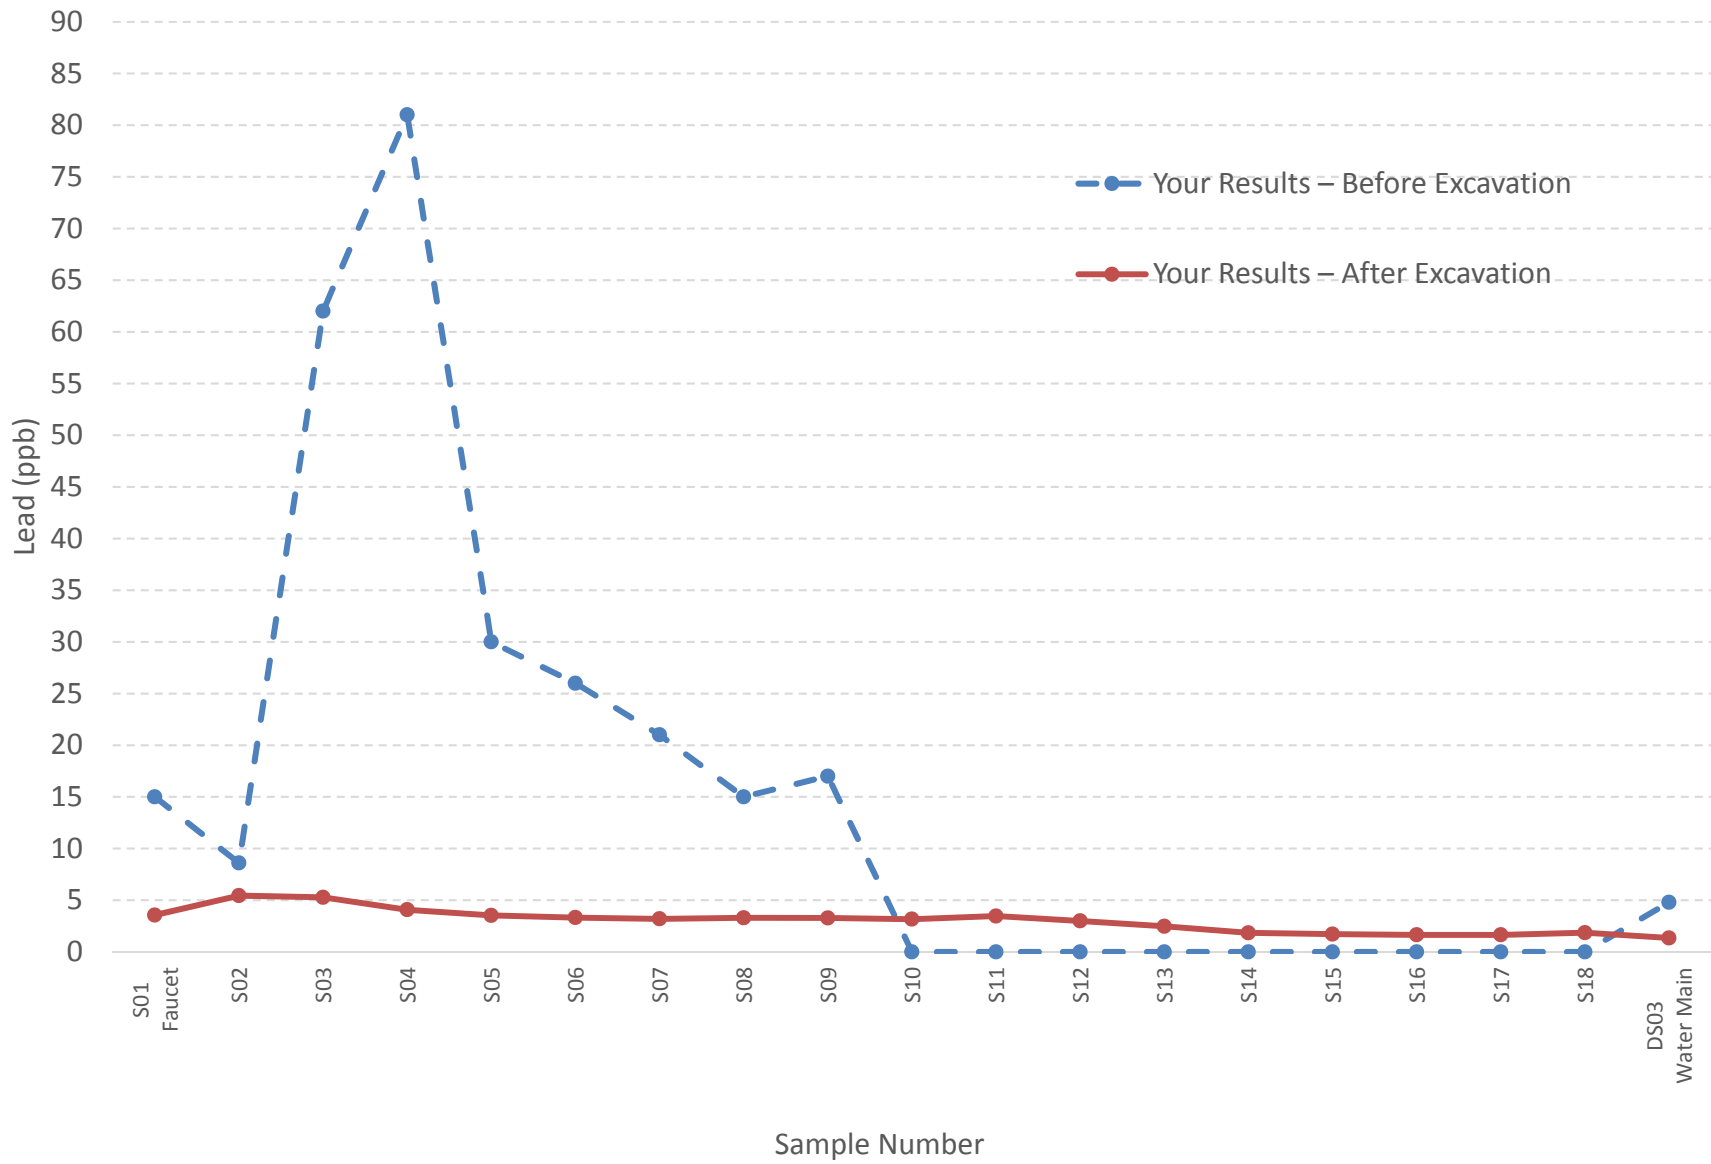

**Site 3332 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results**

Parameter	Units	Your Results - Before Excavation on 10/10/2016																		DS01, DS02, DS03	Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18		Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	0.82 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	0.57 U	1.5 U	5	--	5	--
Chromium	µg/L	3.7 U	3.3 U	4.3 U	3.7 U	3.3 U	3.3 U	2.8 U	3.2 U	3.5 U	3.2 U	3.3 U	4.0 U	3.3 U	4.6 U	3.5 U	6.1 U	3.5 U	5.5 U	5.1 U	100	--	100	--
Copper	µg/L	9.1 J	1.5 J	10	4.5 J	2.5 J	2.8 J	2.6 J	1.7 J	2.0 J	1.6 J	1.7 J	1.6 J	1.4 J	6.3 J	4.7 J	5.7 J	3.1 J	3.7 J	2.6 J	--	1300	1300	1000
Lead	µg/L	15	8.6	62	81	30	26	21	15	17	13 J-	13 J-	11 J-	9.2 J	8.1 J-	7.8 J-	7.9 J-	7.2 J-	7.2 J-	4.8	--	15	0	--
Manganese	µg/L	3.3 J	2.5 J	18	26	8.5	7.7	6.9	4.4	4.8	4.0	3.7 J	3.5 J	3.3 J	3.2 J	3.0 J	3.4 J	5.2	3.2 J	3.7 J	--	--	--	50
Nickel	µg/L	4.1	1.8 U	2.6 U	2.1 U	1.9 U	2.0 U	1.9 U	1.8 U	2.0 U	2.0 U	1.9 U	2.2 U	1.9 U	3.7 U	2.8 U	4.8	2.6 U	3.3 U	3.5 U	--	--	--	--
Zinc	µg/L	530 J+	330 J+	350 J+	190 J+	84 J+	160 J+	64 J+	61 J+	93 J+	45 J+	47 J+	46 J+	47 J+	48 J+	42 J+	44 J+	34 J+	47 J+	39 J+	--	--	--	5000
Aluminum	mg/L	0.085 J-	0.082 J-	0.23 J-	0.19 J-	0.12 J-	0.13 J-	0.10 J-	0.10 J-	0.11 J-	0.099 J-	0.10 J-	0.10 J-	0.10 J-	0.10 J-	0.094 J-	0.095 J-	0.096 J-	0.094 J-	0.094 J-	--	--	--	0.05 to 0.2
Calcium	mg/L	37 J	38 J-	37 J	37 J	35 J	35 J	34 J	34 J	35 J	35 J	36 J	36 J	37 J	37 J	35 J	35 J	35 J	35 J	36 J	--	--	--	--
Iron	mg/L	0.13 J-	0.038 U	0.31 J-	0.33 J-	0.11 J-	0.13 J	0.080 U	0.069 U	0.081 U	0.061 U	0.061 U	0.058 U	0.050 U	0.050 U	0.040 U	0.056 U	0.48 J	0.045 U	0.044 U	--	--	--	0.3
Magnesium	mg/L	13 J	13 J	13 J	13 J	12 J	12 J	12 J	12 J	12 J	12 J	13 J	13 J	13 J	13 J	12 J	12 J	12 J	12 J	13 J	--	--	--	--
Potassium	mg/L	1.8	1.8	1.7	1.7	1.6	1.6	1.5	1.5	1.6	1.6	1.7	1.70	1.7	1.7	1.6	1.6	1.6	1.6	1.6	--	--	--	--
Sodium	mg/L	12 J+	12 J+	12 J	12 J+	11 J+	11 J+	11 J+	11 J+	11 J+	11 J+	12 J+	12 J+	12 J+	12 J+	11 J+	12 J+	11 J+	11 J+	12 J+	--	--	--	--
Tin	mg/L	0.0025 U	0.020 U	0.0023 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.16 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		23.9 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
 U = Not detected above the listed reporting limit
 J = Estimated
 J+ = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).
 J- = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.
Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.
Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.
Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a "J" qualifier after the number.

Site 3332 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/13/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	Not available - results will be provided when available																			5	--	5	--
Chromium	µg/L	Not available - results will be provided when available																			100	--	100	--
Copper	µg/L	7.58	1.00 U	3.82	1.90	1.15	1.09	1.00 U	1.91	2.19	1.26	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	1.00 U	--	1300	1300	1000
Lead	µg/L	3.56	5.45	5.28	4.08	3.53	3.32	3.20	3.30	3.28	3.17	3.47	3.00	2.48	1.84	1.72	1.65	1.65	1.86	1.35	--	15	0	--
Zinc	µg/L	359	381	147	39.8	39.3	28.3	23.9	28.1	27.8	22.6	21.3	18.8	18.8	18.5	18.0	17.3	17.8	29.7	11.8	--	--	--	5000
Manganese	µg/L	Not available - results will be provided when available																			--	--	--	50
Nickel	µg/L																				--	--	--	--
Aluminum	mg/L																				--	--	--	0.05 to 0.2
Calcium	mg/L																				--	--	--	--
Iron	mg/L																				--	--	--	0.3
Magnesium	mg/L																				--	--	--	--
Potassium	mg/L																				--	--	--	--
Sodium	mg/L																				--	--	--	--
Tin	mg/L																				--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110 J	--	--	--	--
Chloride	mg/L	Not Sampled																		17.5	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.09	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		29.2	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.17	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3343, Kitchen Faucet,
10/13/2016 (Preliminary) and 12/1/2016



Site 3343 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/13/2016																Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink																			Distribution System
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)						
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--	
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--	
Copper	µg/L	41	19	11	12	12	10	10 U	10	10	11	11	11	10 U	10 U	10 U	10 U	--	1300	1300	1000	
Lead	µg/L	2.0 U	2.2	2.7	4.7	6.2	6.3	6.2	6.5	6.5	6.8	6.9	5.9	4.7	4.2	3.9	2.9	--	15	0	--	
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50	
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--	
Zinc	µg/L	85	61	110	120	75	62	51	48	47	49	43	40	38	36	34	23	--	--	--	5000	
Aluminum	mg/L	0.077	0.087	0.095	0.10	0.13	0.12	0.12	0.11	0.12	0.14	0.13	0.12	0.12	0.11	0.19	0.12	--	--	--	0.05 to 0.2	
Calcium	mg/L	36	35	36	37	37	37	37	35	36	38	39	37	37	37	36	38	--	--	--	--	
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.16	0.41	0.30	0.17	0.16	0.16	0.19	0.18	0.15	0.16	0.13	0.14	0.13	--	--	--	0.3	
Magnesium	mg/L	13	12	13	13	13	13	13	12	13	13	13	13	13	13	13	13	--	--	--	--	
Potassium	mg/L	1.6	1.6	1.6	1.6	1.6	1.7	1.7	1.5	1.6	1.7	1.7	1.6	1.6	1.6	1.6	1.6	--	--	--	--	
Sodium	mg/L	11	11	11	11	11	12	12	11	11	12	12	11	11	11	11	12	--	--	--	--	
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--	
Chloride	mg/L	Not Sampled															3.0	--	--	--	250	
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--	

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3343 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/1/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.21	0.35	0.76	0.87	0.24	0.23	0.19 J	0.20	0.16 J	0.14 J	0.14 J	0.14 J	0.13 J	0.11 J	0.11 J	0.08 J	5	--	5	--
Chromium	µg/L	0.76 U	0.63 U	0.56 U	0.53 U	0.5 U	0.56 U	0.57 U	0.61 U	0.59 U	0.54 U	0.53 U	0.55 U	0.59 U	0.58 U	0.52 U	0.52 U	100	--	100	--
Copper	µg/L	42.1	17.4	7.0	4.7	5.2	5.3	4.7	4.4	4.5	4.3	4.3	4.4	4.5	4.6	4.6	3.9	--	1300	1300	1000
Lead	µg/L	1.1	1.5	1.2	1.0	1.1	1.2	1.4	1.6	1.6	1.5	1.5	1.3	0.80 J	0.64 J	0.62 J	0.58 J	--	15	0	--
Manganese	µg/L	0.50 U	0.68 U	0.99 U	0.78 U	0.56 U	0.60 U	0.63 U	0.66 U	0.66 U	0.66 U	0.64 U	0.68 U	0.67 U	0.73 U	0.66 U	0.65 U	--	--	--	50
Nickel	µg/L	0.88	0.52	0.84	0.60	0.59	0.56	0.52	0.56	0.59	0.54	0.55	0.59	0.52	0.54	0.54	0.53	--	--	--	--
Tin	µg/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	--	--	--	--
Zinc	µg/L	95.5	59.6	109	91.0	31.4	28.7	26.2	25.4	23.7	20.9	19.2	18.2	17.2	16.9	16.4	11.9	--	--	--	5000
Aluminum	mg/L	0.0372	0.0531	0.110	0.0576	0.0507	0.0535	0.0477	0.0452	0.0443	0.0436	0.0438	0.0428	0.0422	0.0438	0.0460	0.0478	--	--	--	0.05 to 0.2
Calcium	mg/L	34.3	35.6	34.2	34.9	34.7	34.7	34.7	34.8	33.9	35.0	34.2	34.5	33.8	34.3	34.3	33.8	--	--	--	--
Iron	mg/L	0.0218 J	0.0407 J	0.0519 J	0.0283 J	1.96	0.0269 J	0.0274 J	0.0174 J	0.0303 J	0.0218 J	0.0376 J	0.0279 J	0.0261 J	0.0727 J	0.0206 J	0.100 U	--	--	--	0.3
Magnesium	mg/L	12.0	12.3	11.7	11.8	11.9	12.0	12.0	12.0	11.8	12.1	11.8	11.9	11.7	11.8	11.9	11.7	--	--	--	--
Potassium	mg/L	1.59	1.41	1.60	1.52	1.56	1.60	1.59	1.55	1.49	1.58	1.55	1.56	1.52	1.55	1.56	1.55	--	--	--	--
Sodium	mg/L	10.5	9.49	10.5	10.6	10.6	10.7	10.7	10.6	10.5	10.7	10.5	10.7	10.5	10.6	10.5	10.6	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															104	--	--	--	--
Chloride	mg/L	Not Sampled															16.9	--	--	--	250
Fluoride	mg/L	Not Sampled															0.110	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															27.8	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.216	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3368, Kitchen Faucet, 10/13/2016 (Preliminary) and 12/7/2016



Site 3368 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/13/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	67	31	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	11	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.1	3.9	3.5	2.2	2.0 U	2.0 U	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	120	64	70	31	35	33	29	25	28	30	27	21	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.085	0.10	0.10	0.099	0.11	0.31	0.10	0.10	0.10	0.10	0.11	0.10	0.10	0.10	0.10	0.11	--	--	--	0.05 to 0.2
Calcium	mg/L	37	38	37	37	39	37	37	36	37	38	38	38	37	38	38	39	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	13	13	13	13	14	13	13	12	13	13	14	13	13	13	14	14	--	--	--	--
Potassium	mg/L	1.7	1.7	1.8	1.7	1.8	1.7	1.7	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	--	--	--	--
Sodium	mg/L	11	12	12	11	12	11	12	11	12	12	12	12	12	12	12	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															5.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3368 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/7/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.29	0.34	0.43	0.13 J	0.15 J	0.13 J	0.12 J	0.09 J	0.13 J	0.14 J	0.2 J	0.12 J	0.24	0.14 J	0.13 J	0.11 J				
Chromium	µg/L	0.78 U	0.59 U	0.50 U	0.46 U	0.51 U	0.50 U	0.52 U	0.47 U	0.51 U	0.48 U	0.50 U	0.50 U	0.50 U	0.56 U	0.56 U	0.52 U	100	--	100	--
Copper	µg/L	55.3	22.6	6.3	3.2	2.9	2.9	3.1	3.8	3.3	3.1	4.1	9.0	7.9	4.4	3.2	2.2	--	1300	1300	1000
Lead	µg/L	1.0	0.78 J	0.78 J	1.1	0.77 J	0.86 J	1.0	1.2	1.1	1.2	1.4	3.1	3.9	2.0	1.0	0.53 J	--	15	0	--
Manganese	µg/L	1.2	1.1	0.68 U	0.99 U	0.72 U	0.54 U	0.69 U	0.90 U	0.65 U	0.60 U	0.66 U	0.61 U	1.1	0.64 U	0.66 U	0.58 U	--	--	--	50
Nickel	µg/L	11.7	3.3	0.90	0.66	0.62	0.65	0.65	0.68	0.68	0.63	0.57	0.54	0.58	0.69	0.62	0.59	--	--	--	--
Tin	µg/L	1.7	0.38 U	1.0 U	1.0 U	0.48 U	0.16 U	0.14 U	0.13 U	0.32 U	0.38 U	2.2	0.66 U	5.3	2.1	1.8	1.6	--	--	--	--
Zinc	µg/L	96.9 J+	64.1 J+	70.5 J+	29.9 J+	32.8 J+	34.1 J+	27.9 J+	23.2 J+	25.3 J+	30.0 J+	27.3 J+	20.1 J+	16.5 J+	15.0 J+	15.0 J+	11.6 J+	--	--	--	5000
Aluminum	mg/L	0.0458	0.0442	0.0482	0.0463	0.0455	0.0451	0.0454	0.0466	0.0486	0.0502	0.0516	0.0519	0.0495	0.0476	0.0451	0.0422	--	--	--	0.05 to 0.2
Calcium	mg/L	34.3	33.6	34.8	35.0	34.7	34.7	34.2	34.8	34.6	35.0	34.3	34.8	34.6	34.1	34.2	34.1	--	--	--	--
Iron	mg/L	0.0300 U	0.0689 U	0.0418 U	0.0563 U	0.100 U	0.0274 U	0.0332 U	0.0330 U	0.100 U	0.0174 U	0.100 U	0.0260 U	0.0183 U	0.100 U	0.100 U	0.100 U	--	--	--	0.3
Magnesium	mg/L	12.2	12.0	12.4	12.4	12.3	12.3	12.2	12.3	12.2	12.3	12.0	12.2	12.1	12.0	12.0	12.0	--	--	--	--
Potassium	mg/L	1.67	1.64	1.69	1.66	1.69	1.62	1.62	1.64	1.71	1.66	1.67	1.66	1.66	1.61	1.64	1.63	--	--	--	--
Sodium	mg/L	11.3	11.1	11.4	11.4	11.5	11.5	11.3	11.6	11.5	11.7	11.4	11.5	11.4	11.2	11.2	11.1	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															105	--	--	--	--
Chloride	mg/L	Not Sampled															16.5	--	--	--	250
Fluoride	mg/L	Not Sampled															0.120	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															27.1	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.187	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3383, Kitchen Faucet, 10/17/2016 (Preliminary) and 12/6/2016

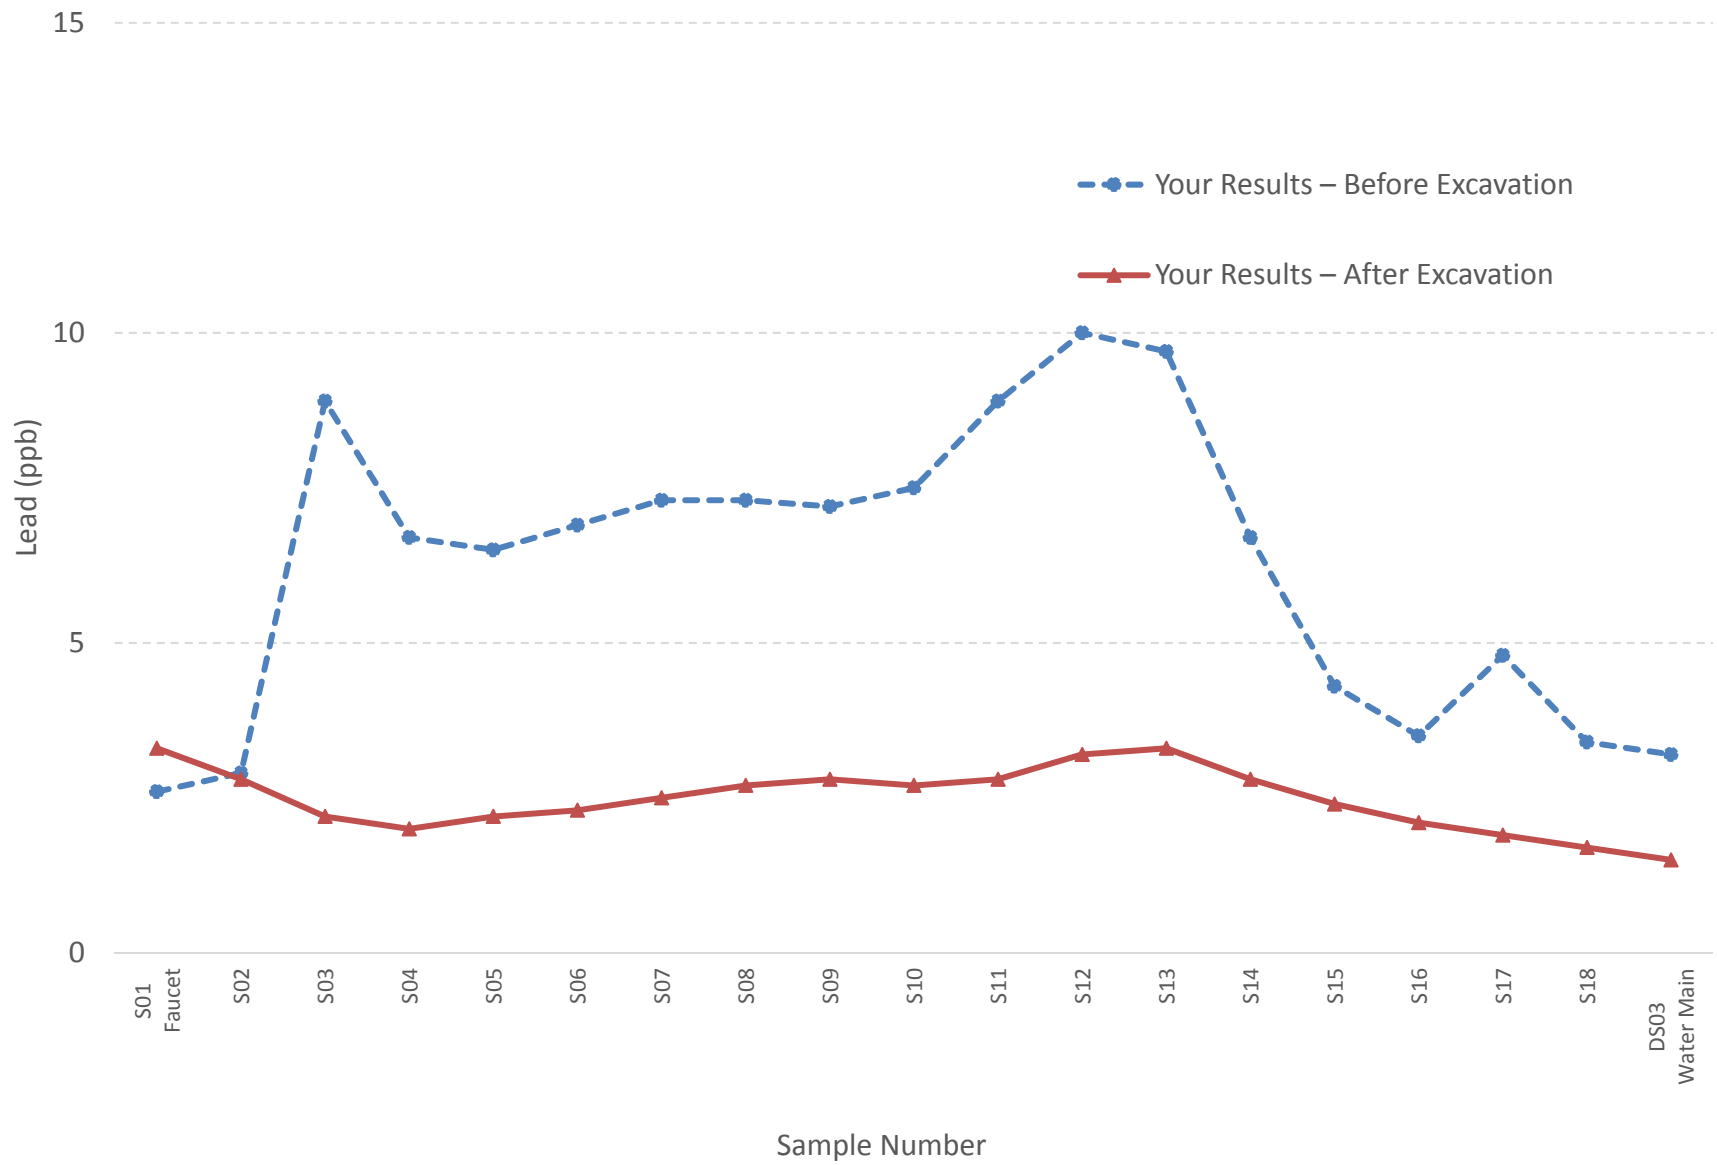

Site 3383 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/17/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.5	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	8.2	6.0	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.1	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.6	2.9	8.9	6.7	6.5	6.9	7.3	7.3	7.2	7.5	8.9	10	9.7	6.7	4.3	3.5	4.8	3.4	3.2	--	15	0	--
Manganese	µg/L	4.3	6.2	5.3	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.7	4.6	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	200	85	69	58	54	35	30	33	30	26	22	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.088	0.10	0.11	0.10	0.11	0.11	0.11	0.10	0.11	0.10	0.11	0.10	0.10	0.10	0.097	0.095	0.099	0.10	0.093	--	--	--	0.05 to 0.2
Calcium	mg/L	36	36	37	37	37.0	36	37	37	37	38	37	36	37	37	37	36	38	38	37	--	--	--	--
Iron	mg/L	0.13	0.48	0.14	0.11	0.21	0.10 U	0.10 U	0.12	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	12	12	13	12	12	13	13	13	13	13	13	13	13	13	13	13	13	13	13	--	--	--	--
Potassium	mg/L	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.6	1.7	1.6	1.7	1.6	1.7	1.7	1.6	--	--	--	--
Sodium	mg/L	11	11	11	11	11	11	12	12	12	12	11	12	11	11	11	11	12	12	11	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		110	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.15 J	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		23.9 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
U = Not detected above the listed reporting limit
J = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3383 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/6/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
		1st sample (125 mL)	2nd sample (125 mL)																	Distribution System				
Cadmium	µg/L	0.20	0.09 J	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	0.20 U	5	--	5	--
Chromium	µg/L	0.42 J	0.38 J	0.40 J	0.40 J	0.42 J	0.38 J	0.39 J	0.41 J	0.45 J	0.49 J	0.49 J	0.46 J	0.46 J	0.43 J	0.43 J	0.46 J	0.45 J	0.74 J	0.43 J	100	--	100	--
Copper	µg/L	14.7	2.1	1.7	1.1	1.1	1.0	1.2	1.0	1.1	1.0 J	1.2	1.0	0.88 U	0.87 U	0.95 J	0.86 U	0.81 U	0.85 U	0.75 U	--	1300	1300	1000
Lead	µg/L	3.3	2.8	2.2	2.0	2.2	2.3	2.5	2.7	2.8	2.7	2.8	3.2	3.3	2.8	2.4	2.1	1.9	1.7	1.5	--	15	0	--
Manganese	µg/L	2.9	4.8	1.0	0.72 J	0.74 J	0.86 J	0.67 J	0.66 J	0.69 J	0.64 J	1.2	0.74 J	0.83 J	1.1	2.0	1.6	0.98 J	0.78 J	0.51 J	--	--	--	50
Nickel	µg/L	36.9	2.5	2.2	1.1	1.2	0.69	0.86	0.65	0.92	0.66	0.66	0.82	0.63	0.72	0.60	0.62	0.73	0.81	0.56	--	--	--	--
Tin	µg/L	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.18 J	1.0 U	1.0 U	1.0 U	1.0 U	0.55 J	1.0 U	1.0 U	1.0 U	0.22 J	1.0 U	1.0 U	0.17 J	1.0 U	--	--	--	--
Zinc	µg/L	232	66.3	32.3	25.5	23.8	20.0	18.8	16.9	16.7	15.5	14.7	13.2	12.7	11.6	11.9	14.5	11.5	13.2	8.5	--	--	--	5000
Aluminum	mg/L	0.0758	0.0860	0.0480	0.0448	0.0442	0.0448	0.0467	0.0433	0.0469	0.0460	0.0455	0.0447	0.0453	0.0449	0.0463	0.0467	0.0442	0.0460	0.0438	--	--	--	0.05 to 0.2
Calcium	mg/L	34.7	35.3	36.5	36.0	36.8	36.1	35.7	35.4	35.4	36.1	36.4	35.4	35.9	35.4	35.6	35.4	35.9	35.7	35.6	--	--	--	--
Iron	mg/L	0.0926 J	0.374	0.0326 U	0.0236 U	0.100 U	0.0302 U	0.0260 U	0.100 U	0.0320 U	0.0212 U	0.100 U	0.0407 J	0.0290 U	0.0151 U	0.0152 U	0.0457 J	0.0135 U	0.0148 U	0.100 U	--	--	--	0.3
Magnesium	mg/L	11.9	12.0	12.5	12.3	12.6	12.3	12.2	12.1	12.1	12.4	12.5	12.1	12.3	12.2	12.2	12.2	12.4	12.3	12.3	--	--	--	--
Potassium	mg/L	1.70	1.74	1.76	1.69	1.79	1.73	1.71	1.68	1.70	1.73	1.74	1.71	1.70	1.70	1.70	1.69	1.72	1.72	1.73	--	--	--	--
Sodium	mg/L	11.4	11.5	11.8	11.6	11.8	11.7	11.6	11.6	11.6	11.8	11.8	11.5	11.7	11.6	11.6	11.5	11.7	11.7	11.7	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		107	--	--	--	--
Chloride	mg/L	Not Sampled																		16.7	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.116	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		26.8	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.235	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
J = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3406, Kitchen Faucet, 10/7/2016 (Preliminary) and 12/2/2016

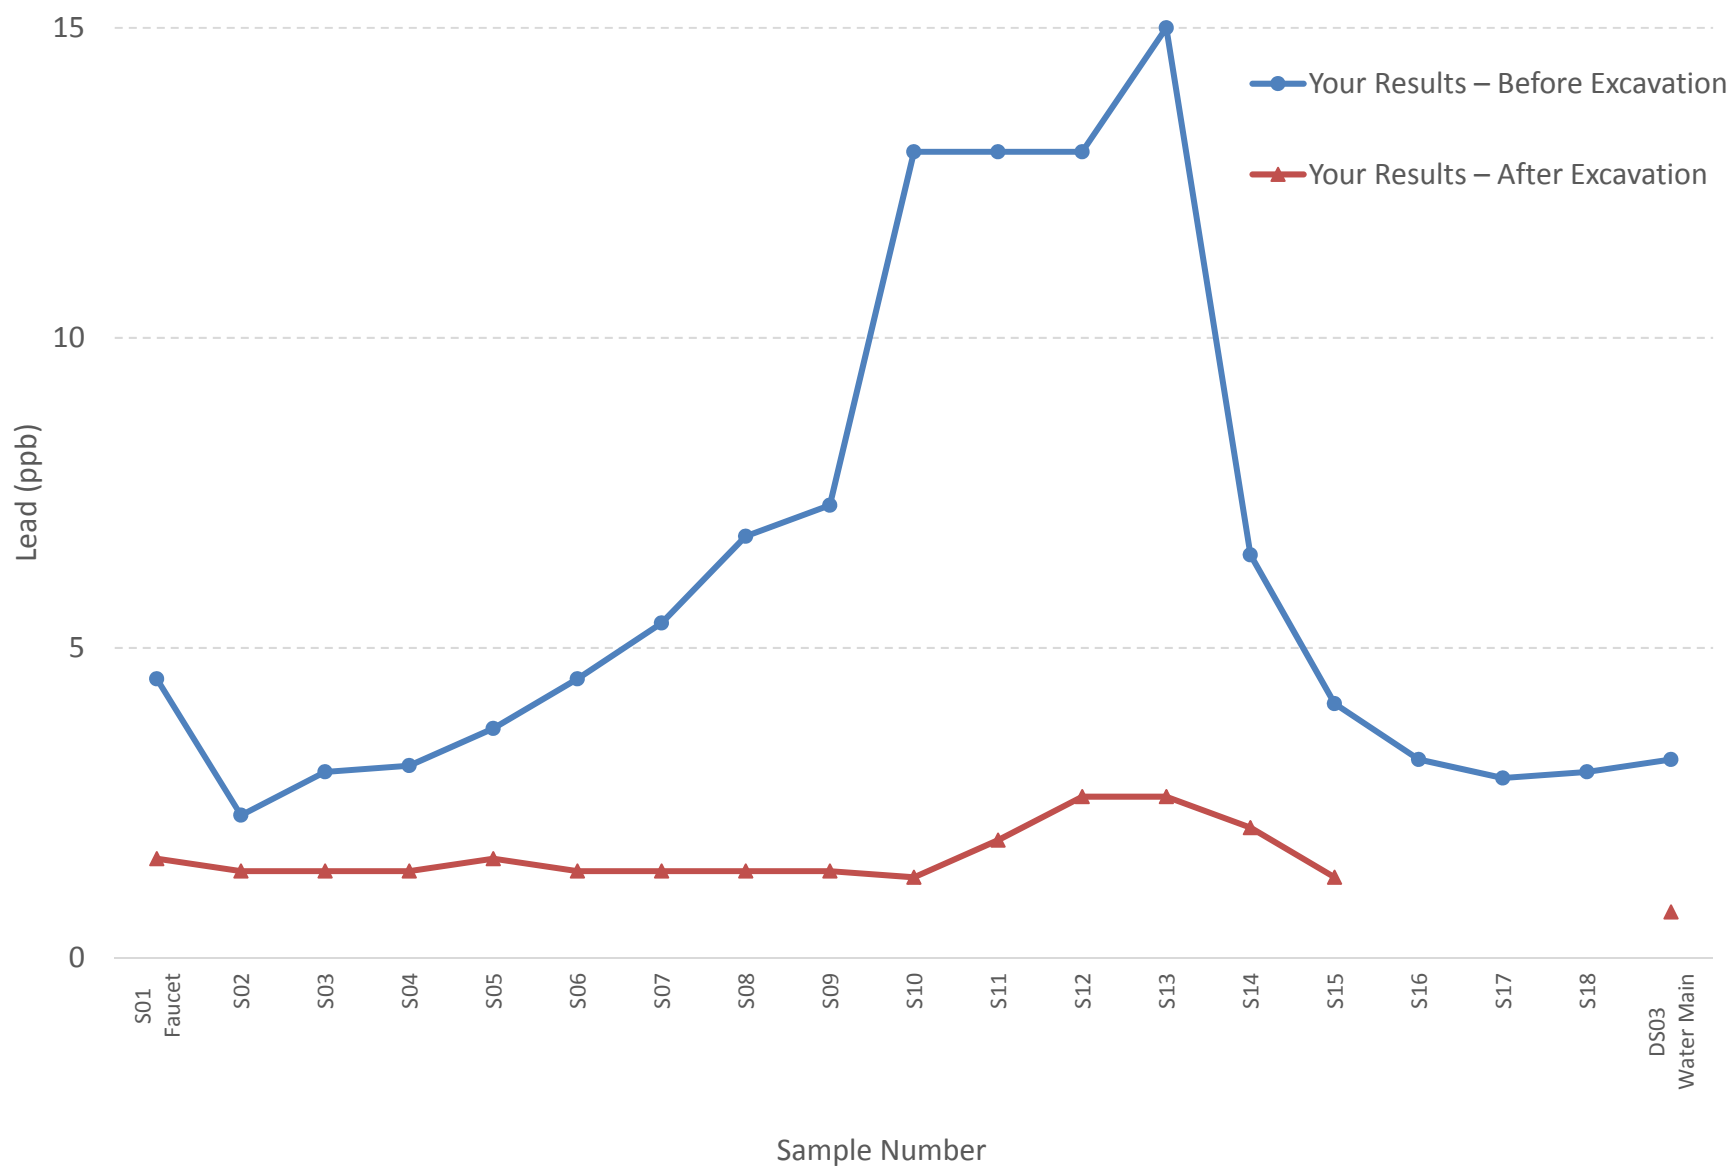

Site 3406 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/7/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	3.4	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.3	4.0 U	4.1	4.2	4.4	4.1	4.1	7.4	4.9	4.8	5.9	4.6	4.7	4.0 U	6.6	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	59	78	32	13	15	10	10 U	10 U	10 U	14	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	4.5	2.3	3.0	3.1	3.7	4.5	5.4	6.8	7.3	13	13	13	15	6.5	4.1	3.2	2.9	3.0	3.2	--	15	0	--
Manganese	µg/L	4.2	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	5.7	4.0 U	4.0 U	4.9	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	8.2	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	28	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	22	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.087	0.093	0.097	0.094	0.095	0.091	0.094	0.092	0.098	0.11	0.10	0.10	0.10	0.11	0.10	0.11	0.11	0.11	0.11	--	--	--	0.05 to 0.2
Calcium	mg/L	36	36	37	35	37	35	36	35	36	40	36	35	35	38	35	36	36	38	39	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.12	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	12	12	13	12	13	12	12	12	12	14	12	12	12	13	12	12	12	13	14	--	--	--	--
Potassium	mg/L	1.6	1.6	1.6	1.5	1.6	1.6	1.6	1.5	1.6	1.7	1.6	1.5	1.6	1.6	1.5	1.6	1.6	1.6	1.7	--	--	--	--
Sodium	mg/L	11	11	11	11	11	11	11	11	11	13	11	11	11	12	11	11	11	12	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		1.0 U	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3406 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 12/2/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	5	--	5	--
Chromium	µg/L	0.52 U	0.53 U	0.53 U	0.42 U	0.52 U	0.55 U	0.51 U	0.53 U	0.55 U	0.48 U	0.51 U	0.53 U	0.58 U	0.54 U	0.53 U	0.58 U	100	--	100	--
Copper	µg/L	20.2 J+	23.3 J+	13.3 J+	6.3 J+	6.2 J+	5.8 J+	3.5 J+	3.2 J+	3.8 J+	3 J+	3.1 J+	3.1 J+	2.9 J+	2.7 J+	2.8 J+	2.8 J+	--	1300	1300	1000
Lead	µg/L	1.6	1.4	1.4	1.4	1.6	1.4	1.4	1.4	1.4	1.3	1.9	2.6	2.6	2.1	1.3	0.74 J	--	15	0	--
Manganese	µg/L	0.99 J	0.91 J	1.1	0.93 J	0.92 J	1.2	0.96 J	0.91 J	1 J	0.97 J	0.99 J	0.98 J	0.97 J	1.0	1.1	1.3	--	--	--	50
Nickel	µg/L	1.3	0.60	0.60	0.58	0.92	0.75	0.54	0.55	0.80	0.54	0.54	0.58	0.54	0.57	0.53	0.55	--	--	--	--
Tin	µg/L	0.19 J	0.22 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	12.5	4.3	5.6	6.2	6.9	7.5	11.5	5.3	23.9	6.2	5.3	3.2	3.1	4.2	2.5 U	2.8 U	--	--	--	5000
Aluminum	mg/L	0.0420	0.0447	0.0455	0.0458	0.0463	0.0463	0.0466	0.0453	0.0455	0.0453	0.0462	0.0445	0.0438	0.0442	0.0452	0.0431	--	--	--	0.05 to 0.2
Calcium	mg/L	34.2	34.0	34.2	34.5	34.4	35.0	34.8	34.4	34.6	35.1	34.4	34.2	34.8	34.7	34.1	34.6	--	--	--	--
Iron	mg/L	0.0248 U	0.0145 U	0.0156 U	0.100 U	0.0181 U	0.100 U	0.0141 U	0.0154 U	0.0278 U	0.0166 U	0.0199 U	0.0372 U	0.100 U	0.100 U	0.100 U	0.0231 U	--	--	--	0.3
Magnesium	mg/L	11.7	11.5	11.6	11.8	11.7	11.9	11.9	11.8	11.8	11.9	11.7	11.6	11.8	11.8	11.6	11.8	--	--	--	--
Potassium	mg/L	1.54	1.53	1.56	1.60	1.55	1.58	1.59	1.54	1.62	1.54	1.58	1.53	1.56	1.53	1.48	1.54	--	--	--	--
Sodium	mg/L	10.8	10.7	10.6	10.9	10.8	10.8	10.9	10.8	10.9	11.0	10.8	10.7	10.8	10.8	10.6	10.7	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															106	--	--	--	--
Chloride	mg/L	Not Sampled															17.1	--	--	--	250
Fluoride	mg/L	Not Sampled															0.126	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															26.3	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.22	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3437, Kitchen Faucet,
10/14/2016 (Preliminary) and 11/3/2016



Site 3437 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/14/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink														Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	47	76	53	31	28	11	11	10 U	11	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	2.0 U	2.6	3.4	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	3.4	5.4	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	220	32	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.090	0.099	0.11	0.099	0.11	0.16	0.11	0.11	0.10	0.099	0.092	0.085	0.095	0.090	0.089	0.091	--	--	--	0.05 to 0.2
Calcium	mg/L	35	36	36	32	36	34	37	37	35	35	34	32	36	34	35	35	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.10 U	0.12	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	12	13	13	11	12	12	13	13	12	12	12	11	13	12	12	12	--	--	--	--
Potassium	mg/L	1.6	1.6	1.6	1.4	1.5	1.5	1.7	1.7	1.6	1.6	1.5	1.4	1.6	1.5	1.5	1.5	--	--	--	--
Sodium	mg/L	11	11	11	10	11	11	11	12	11	11	11	10	11	11	11	11	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															120	--	--	--	--
Chloride	mg/L	Not Sampled															3.0	--	--	--	250
Fluoride	mg/L	Not Sampled															0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3437 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/3/2016																Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																		
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	Distribution System				
Cadmium	µg/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U				
Chromium	µg/L	0.59 U	0.49 U	0.41 U	0.43 U	0.45 U	0.44 U	2.0 U	0.44 U	0.51 U	0.43 U	0.46 U	0.36 U	0.36 U	0.44 U	0.44 U	0.42 U	100	--	100	--
Copper	µg/L	81.5	54.8	16.0	10.7	10.2	6.2	5.2	5.6	6.0	5.0	5.0 J	4.7	4.7 J	4.6 J	4.5 J	3.8	--	1300	1300	1000
Lead	µg/L	2.3	3.0	2.7	0.97 J	0.93 J	0.88 J	0.83 J	0.93 J	2.3	1.6	0.88 J	0.80 J	0.79 J	0.77 J	0.75 J	0.64 J	--	15	0	--
Manganese	µg/L	1.9	0.47 J	0.52 J	0.56 J	0.54 J	0.53 J	0.46 J	0.55 J	0.60 J	0.56 J	0.76 J	0.58 J	0.64 J	0.64 J	0.58 J	0.63 J	--	--	--	50
Nickel	µg/L	9.6	1.8	0.75	1.2	0.79	0.64	0.61	0.69	0.65	0.64	0.64	0.57	0.65	0.59	0.57	0.70	--	--	--	--
Tin	µg/L	0.27 J	0.71 J	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	287 J	25.7 J	11.0 J	6.8 J	6.7 J	7.0 J	5.1 J	5.3 J	4.8 J	4.1 J	4.5 J	4.7 J	5.0 J	3.5 U	3.5 U	2.7 U	--	--	--	5000
Aluminum	mg/L	0.0714	0.0749	0.0686	0.0698	0.0662	0.0698	0.0697	0.0694	0.0703	0.0685	0.0669	0.0661	0.0675	0.0714	0.0687	0.0667	--	--	--	0.05 to 0.2
Calcium	mg/L	35.9	35.5	36.6	35.4	34.6	34.6	34.8	34.5	34.4	34.5	34.9	34.5	34.1	34.8	34.5	34.7	--	--	--	--
Iron	mg/L	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.100 U	0.053 J	0.0155 J	0.0161 J	0.100 U	0.0193 J	--	--	--	0.3
Magnesium	mg/L	12.2	12.0	12.4	12.0	11.7	11.7	11.8	11.7	11.7	11.7	11.8	11.6	11.5	11.7	11.6	11.7	--	--	--	--
Potassium	mg/L	1.80	1.75	1.74	1.81	1.76	1.74	1.74	1.73	1.78	1.75	1.78	1.79	1.73	1.70	1.79	1.82	--	--	--	--
Sodium	mg/L	12.0	11.6	11.7	12.0	11.8	11.6	11.8	11.7	11.8	11.7	11.9	11.8	11.6	11.8	11.8	11.9	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled															105	--	--	--	--
Chloride	mg/L	Not Sampled															17.2	--	--	--	250
Fluoride	mg/L	Not Sampled															0.132	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled															27.3	--	--	--	250
Total Phosphorus	mg/L	Not Sampled															0.151	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.


Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3434, Kitchen Faucet, 10/6/2016 and 10/18/2016 (Preliminary)

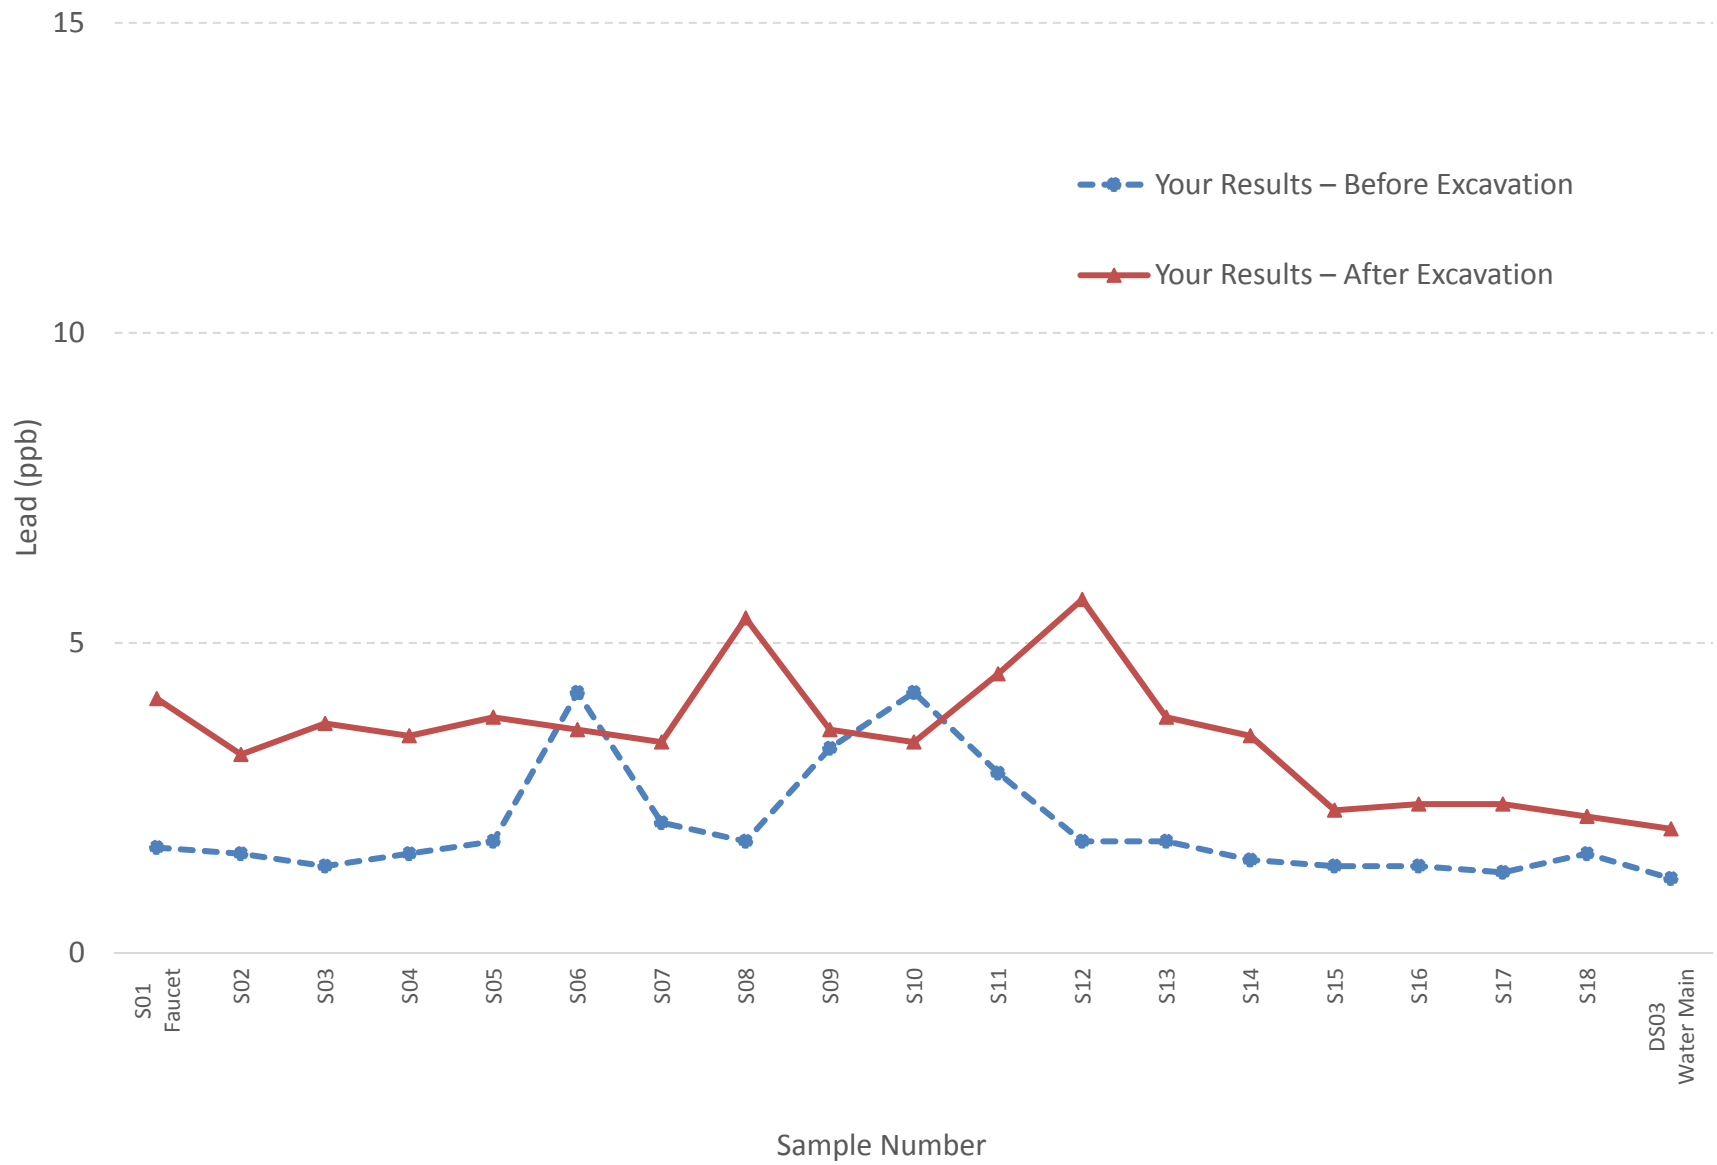

Site 3434 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/6/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.4	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	3.3 U	3.9 U	3.4 U	3.5 U	19	5.9	4.9	3.5 U	3.8 U	3.6 U	3.4 U	3.2 U	5.2	4.0 U	3.5 U	3.1 U	11	3.2 U	3.4 U	100	--	100	--
Copper	µg/L	31	76	16	4.0 U	4.1 U	6.2 U	4.1 U	5.8 J	5.2 U	3.7 U	6.0 U	3.3 U	3.1 U	3.9 U	3.1 U	3.0 U	3.1 U	4.1 U	2.5 U	--	1300	1300	1000
Lead	µg/L	1.7 J	1.6 J	1.4 J	1.6 J	1.8 J	4.2	2.1 J	1.8 J	3.3 J	4.2	2.9 J	1.8 J	1.5 J	1.4 J	1.4 J	1.3 J	1.6 J	1.2 J-	1.2 J-	--	15	0	--
Manganese	µg/L	1.0 J	0.95 J	0.97 J	1.1 J	3.0 J	3.5 J	1.6 J	1.5 J	1.3 J	1.1 J	1.4 J	1.1 J	2.0 J	1.2 J	1.5 J	1.2 J	2.9 J	1.2 J	1.0 J	--	--	--	50
Nickel	µg/L	4.8	2.9 U	2.0 U	2.0 U	10	4.4	2.9 U	2.1 U	2.3 U	2.0 U	1.9 U	2.0 U	3.1 U	2.4 U	1.8 U	1.8 U	6.0	2.4 U	1.7 U	--	--	--	--
Zinc	µg/L	85	46	11 J	17 U	18 U	17 U	17 U	17 U	14 U	13 U	9.6 U	8.3 U	13 U	9.8 U	8.3 U	9.6 U	9.7 U	15 U	6.0 U	--	--	--	5000
Aluminum	mg/L	0.084	0.086	0.10	0.11	0.11	0.10	0.11	0.098	0.10	0.11	0.12	0.11	0.12	0.11	0.12	0.11	0.11	0.10	0.11 J+	--	--	--	0.05 to 0.2
Calcium	mg/L	35 J	36 J	38 J	37 J	39 J	35 J	39 J	34 J	36 J	38 J	37 J	38 J	36 J	37 J	35 J	36 J	33 J	35 J	35 J	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	0.054 U	0.034 U	0.086 U	0.024 U	0.029 U	0.048 U	0.026 U	0.019 U	0.022 U	0.11 J+	0.019 U	0.031 U	0.028 U	0.023 U	0.026 U	0.037 U	0.11 J+	--	--	--	0.3
Magnesium	mg/L	13 J	13 J	13 J	13 J	13 J	12 J	13 J	12 J	12 J	13 J	13 J	13 J	13 J	13 J	13 J	12 J	13 J	12 J	12 J	--	--	--	--
Potassium	mg/L	1.5	1.6	2.2	1.9	1.9	1.7	1.8	1.6	1.7	1.8	1.8	1.8	1.8	1.7	1.7	1.6	1.7	1.4	1.6	--	--	--	--
Sodium	mg/L	11 J	11 J	11 J	11 J	12 J	11 J	12 J	11 J	11 J	12 J	12 J	12 J	12 J	12 J	12 J	11 J	12 J	11 J	11 J+	--	--	--	--
Tin	mg/L	0.0018 U	0.020 U	0.020 U	0.020 U	0.020 U	0.0068 U	0.020 U	0.0027 U	0.020 U	0.020 U	0.0020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		15.5 J	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

(U) = Not detected above the listed reporting limit

(J) = Estimated

(J+) = Potential high bias (based on laboratory quality checks, the actual value may be slightly lower than what is reported here).

(J-) = Potential low bias (based on laboratory quality checks, the actual value may be slightly higher than what is reported here).

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

Site 3434 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - After Excavation on 10/18/2016																		Comparison Standards					
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL	
		Faucet	Under Sink	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)	Distribution System					
		1st sample (125 mL)	2nd sample (125 mL)																						
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--	
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	5.5	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--	
Copper	µg/L	39	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000	
Lead	µg/L	4.1	3.2	3.7	3.5	3.8	3.6	3.4	5.4	3.6	3.4	4.5	5.7	3.8	3.5	2.3	2.4	2.4	2.2	2.0 U	--	15	0	--	
Manganese	µg/L	4.0 U	5.9	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	470	250	94	29	37	26.0	20 U	20 U	24	20 U	20 U	20 U	20 U	57	20 U	20 U	20 U	20 U	20 U	--	--	--	5000	
Aluminum	mg/L	0.098	0.11	0.12	0.11	0.12	0.11	0.10	0.10	0.10	0.10	0.10	0.11	0.11	0.12	0.098	0.099	0.095	0.095	0.096	--	--	--	0.05 to 0.2	
Calcium	mg/L	38	39	38	37	39	39	38	38	37	38	37	38	38	39	38	38	37	37	38	--	--	--	--	
Iron	mg/L	0.10 U	0.26	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3	
Magnesium	mg/L	13	13	12	13	13	13	13	13	12	13	13	13	13	13	13	13	13	13	13	--	--	--	--	
Potassium	mg/L	1.7	1.7	1.7	1.6	1.7	1.7	1.7	1.6	1.6	1.7	1.6	1.6	1.6	1.7	1.6	1.6	1.6	1.6	1.6	--	--	--	--	
Sodium	mg/L	12	12	11	11	11	12	11	12	11	12	12	11	12	12	11	11	12	12	5.9	--	--	--	--	
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--	
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--	
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250	
Fluoride	mg/L	Not Sampled																		0.15 J	4	--	4	2	
Sulfate as SO4	mg/L	Not Sampled																		48.8 J	--	--	--	250	
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--	

Notes:

mg/L = milligrams per liter (also called ppm or parts per million)

µg/L = micrograms per liter (also called ppb or parts per billion)

U = Not detected above the listed reporting limit

J = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.


Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a "J" qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3443, Kitchen Faucet, 10/15/2016 (Preliminary) and 11/19/2016

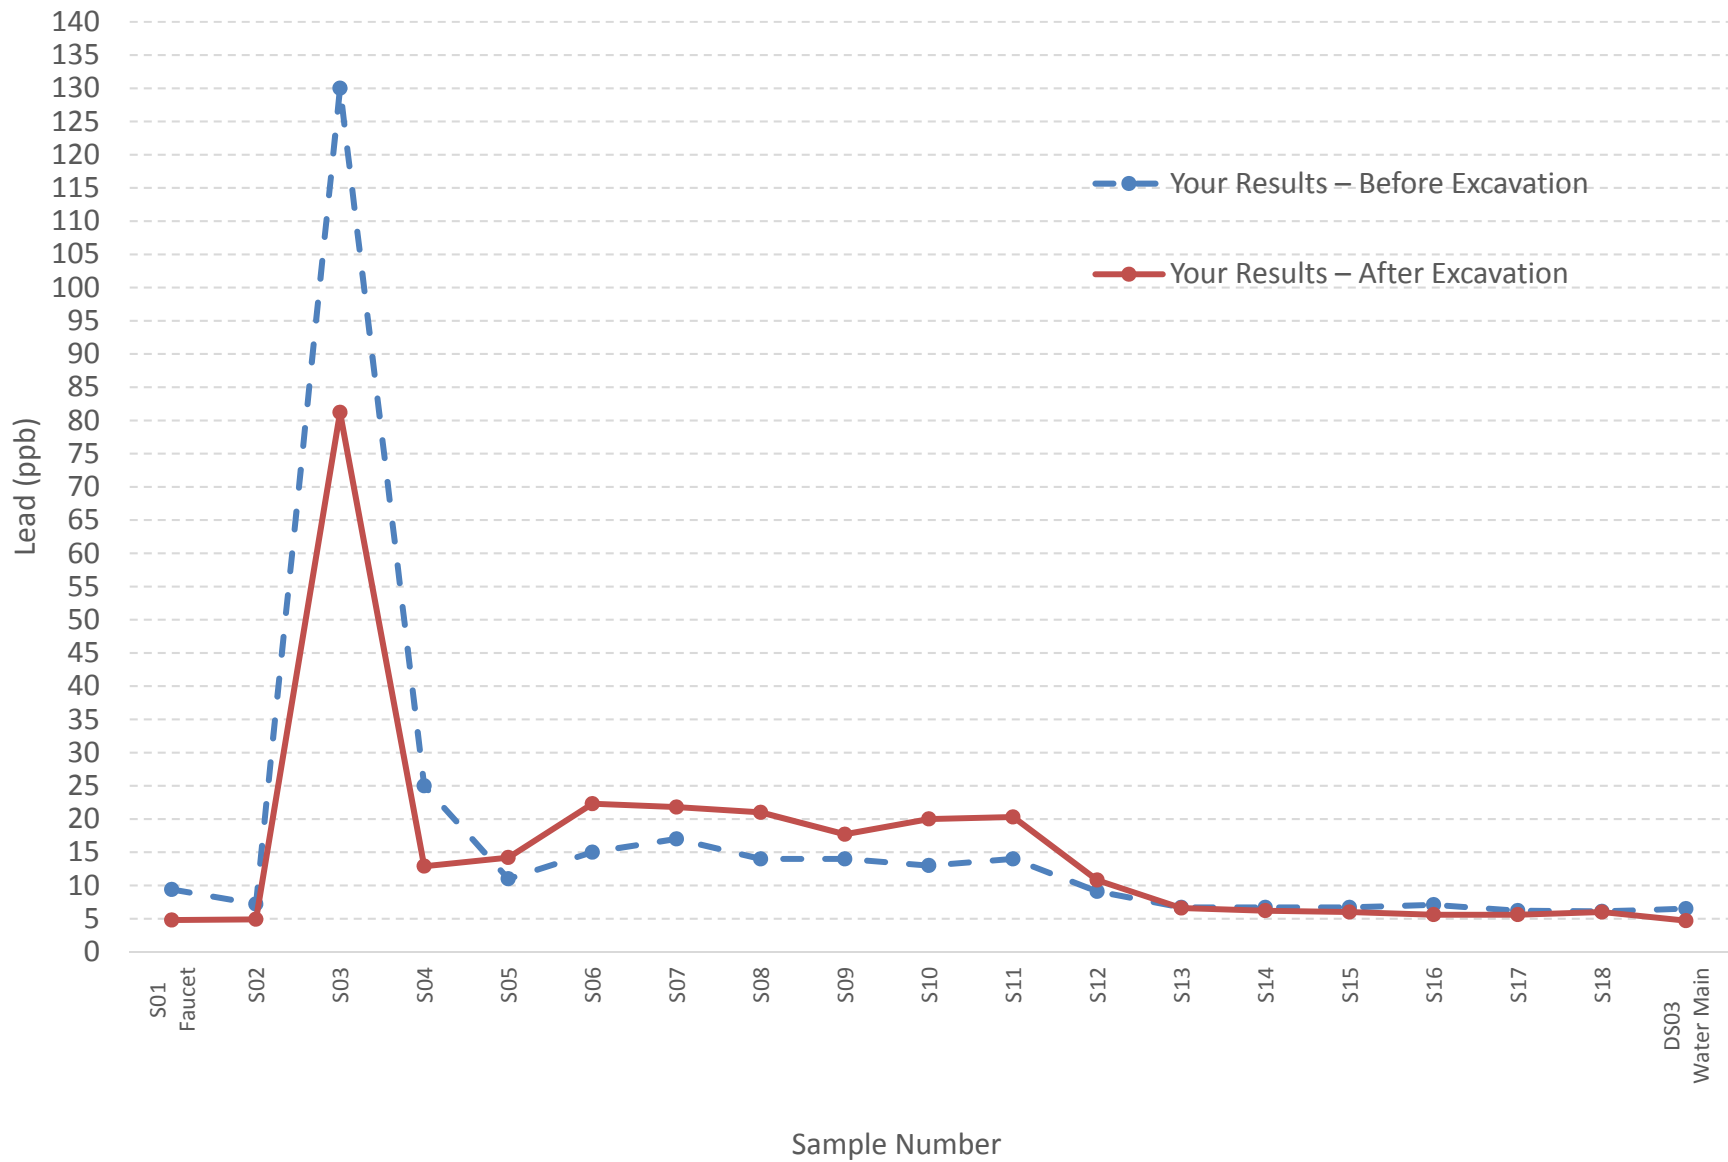

Site 3443 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
PRELIMINARY Analytical Results

Parameter	Units	Your Results - Before Excavation on 10/15/2016																			Comparison Standards			
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																	Distribution System				
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)					
Cadmium	µg/L	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	2.0 U	5	--	5	--
Chromium	µg/L	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	100	--	100	--
Copper	µg/L	76	52	130	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	--	1300	1300	1000
Lead	µg/L	9.4	7.2	130	25	11	15	17	14	14	13	14	9.1	6.7	6.7	6.7	7.1	6.2	6.1	6.5	--	15	0	--
Manganese	µg/L	4.0 U	4.0 U	29	4.1	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	50
Nickel	µg/L	5.3	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	4.0 U	--	--	--	--
Zinc	µg/L	300	46	320	29	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	--	--	--	5000
Aluminum	mg/L	0.094	0.088	0.30	0.11	0.099	0.10	0.10	0.093	0.10	0.096	0.10	0.10	0.095	0.098	0.097	0.11	0.20 U	0.20 U	0.095	--	--	--	0.05 to 0.2
Calcium	mg/L	36	34	34	35	35	35	35	34	39	36	38	37	36	37	37	43	37	35	36	--	--	--	--
Iron	mg/L	0.10 U	0.10 U	1.8	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	2.1	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	--	--	--	0.3
Magnesium	mg/L	14	12	13	13	13	13	14	13	14	13	13	13	13	13	13	15	13	12	13	--	--	--	--
Potassium	mg/L	1.8	1.6	1.6	1.6	1.7	1.7	1.8	1.6	1.7	1.7	1.7	1.7	1.6	1.6	1.6	1.9	1.6	1.6	1.6	--	--	--	--
Sodium	mg/L	13	11	11	12	12	12	13	12	12	12	12	12	12	12	12	13	12	11	12	--	--	--	--
Tin	mg/L	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	0.020 U	--	--	--	--
Total Alkalinity	mg CaCO3/L	Not Sampled																		120	--	--	--	--
Chloride	mg/L	Not Sampled																		3.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.50 U	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		50.0 U	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.050 U	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated

Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.

Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.

Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.

PRELIMINARY - Data is preliminary pending formal data review and validation as specified by laboratory and quality assurance review procedures. Therefore, the presented preliminary analytical results may be subjected to change. Unfortunately, final data is not available at this time due to delays at the contract laboratory. Residents will be notified when data has been finalized, including any changes made based on formal quality assurance review.

Site 3443 -- Kitchen Sink Faucet
Sequential Sampling by U.S. EPA
Final Analytical Results

Parameter	Units	Your Results - After Excavation on 11/19/2016																		Comparison Standards				
		S01	S02	S03	S04	S05	S06	S07	S08	S09	S10	S11	S12	S13	S14	S15	S16	S17	S18	DS01, DS02, DS03	Maximum Contaminant Level (MCL)	Action Level (AL)	Maximum Contaminant Level Goal (MCLG)	Secondary MCL
		Faucet	Under Sink																					
		1st sample (125 mL)	2nd sample (125 mL)	3rd sample (1 liter)	4th sample (1 liter)	5th sample (1 liter)	6th sample (1 liter)	7th sample (1 liter)	8th sample (1 liter)	9th sample (1 liter)	10th sample (1 liter)	11th sample (1 liter)	12th sample (1 liter)	13th sample (1 liter)	14th sample (1 liter)	15th sample (1 liter)	16th sample (1 liter)	17th sample (1 liter)	18th sample (1 liter)	Distribution System				
Cadmium	µg/L	0.20 J	0.42	1.2	0.31	0.20	0.08 J	0.07 J	0.08 J	0.07 J	0.07 J	0.06 J	0.06 J	0.07 J	0.06 J	0.05 J	0.05 J	0.05 J	0.04 J	5				
Chromium	µg/L	0.90 U	0.98 U	1.0 U	0.98 U	0.86 U	0.94 U	0.88 U	0.92 U	0.95 U	0.95 U	0.99 U	0.91 U	0.84 U	0.89 U	0.93 U	0.92 U	0.93 U	0.95 U	100	--	100	--	
Copper	µg/L	68.6	51.9	36.1	5.7	17.8	8.7	4.1	4.2	4.4	3.6	3.4	3.4	3.3	3.2	3.1	3.0	3.0	3.1	2.4	--	1300	1300	1000
Lead	µg/L	4.8	4.9	81.2	12.9	14.2	22.3	21.8	21.0	17.7	20.0	20.3	10.8	6.6	6.2	6.0	5.6	5.6	6.0	4.7	--	15	0	--
Manganese	µg/L	0.26 J	0.98 J	21.1	1.5	1.4	0.85 J	0.60 J	0.58 J	0.54 J	0.58 J	0.49 J	0.58 J	0.70 J	0.72 J	0.75 J	0.83 J	0.72 J	0.80 J	0.69 J	--	--	--	50
Nickel	µg/L	1.3	12.3	1.1	0.75	1.1	1.2	0.71	0.76	0.70	0.72	0.71	0.70	0.70	0.80	0.87	0.80	0.70	0.68	0.66	--	--	--	--
Tin	µg/L	0.10 U	1.0 U	3.4	0.12 U	0.09 U	1.0 U	0.10 U	0.07 U	0.33 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	--	--	--	--
Zinc	µg/L	194	63.5	164	31.2	28.4	12.0	10.2	11.1	11.8	9.4	8.2	7.5	8.0	7.8	7.6	8.9	6.8	7.9	4.9 U	--	--	--	5000
Aluminum	mg/L	0.0416	0.0550	0.168	0.0659	0.0604	0.0537	0.0496	0.0512	0.0486	0.0538	0.0516	0.0523	0.0476	0.0530	0.0484	0.0473	0.0459	0.0465	0.0458	--	--	--	0.05 to 0.2
Calcium	mg/L	33.6	34.1	34.2	34.7	34.0	33.1	34.3	34.5	34.2	34.0	34.1	34.4	33.7	34.5	33.7	34.0	33.7	34.3	34.2	--	--	--	--
Iron	mg/L	0.100 U	0.0458 J	0.700	0.0418 J	0.0640 J	0.0313 J	0.0264 J	0.0644 J	0.100 U	0.0144 J	0.0140 J	0.100 U	0.0153 J	0.0147 J	0.0219 J	0.0278 J	0.100 U	0.0476 J	0.100 U	--	--	--	0.3
Magnesium	mg/L	11.8	12.1	12.0	12.0	11.9	11.7	12.1	12.3	12.2	12.0	12.0	12.2	12.0	12.2	11.9	12.1	12.0	12.1	12.1	--	--	--	--
Potassium	mg/L	1.55	1.54	1.62	1.63	1.61	1.54	1.57	1.61	1.61	1.61	1.56	1.60	1.56	1.58	1.56	1.62	1.60	1.58	1.60	--	--	--	--
Sodium	mg/L	11.0	11.2	11.1	11.3	11.0	10.8	11.1	11.3	11.2	11.1	11.1	11.2	11.1	11.2	11.0	11.1	11.0	11.2	11.2	--	--	--	--
Total Alkalinity	mg/L	Not Sampled																		105	--	--	--	--
Chloride	mg/L	Not Sampled																		17.0	--	--	--	250
Fluoride	mg/L	Not Sampled																		0.124	4	--	4	2
Sulfate as SO4	mg/L	Not Sampled																		28.1	--	--	--	250
Total Phosphorus	mg/L	Not Sampled																		0.256	--	--	--	--

Notes:
mg/L = milligrams per liter (also called ppm or parts per million)
µg/L = micrograms per liter (also called ppb or parts per billion)
(U) = Not detected above the listed reporting limit
(J) = Estimated
Maximum Contaminant Level (MCL) = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology and taking cost into consideration. MCLs are enforceable standards.
Maximum Contaminant Level Goal (MCLG) = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals.
Action Level (AL) = The Action level of 15 ppb (for the 90th percentile of compliance samples) is based on technical feasibility of reducing lead in drinking water through optimizing corrosion control. It is not a health based level.

Secondary MCL = non-mandatory water quality standards established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations, such as taste, color, and odor. These contaminants are not considered to present a risk to human health at the SMCL.

Method Detection Limit (MDL) indicates the level at which the laboratory has high confidence that the analyte is PRESENT in the sample but low confidence in the numerical result. MDLs are routinely reassessed by each laboratory to ensure the accurate presentation of their data.

Reporting Limit (RL) is set by individual laboratories to ensure confidence in the precision and accuracy of the reported numerical result for the analyte. Any results reported below the RL (but above the MDL) are estimated; this is generally indicated by a “J” qualifier after the number.