



**United States Environmental Protection Agency
Region 2**

Caribbean Environmental Protection Division
City View Plaza II-Suite 7000, #48 Rd. 165 km 1.2
Guaynabo, Puerto Rico 00968-8069

FACT SHEET

**NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM
CAMUY-HATILLO WWTP
PERMIT No. PR0023744**

This Fact Sheet sets forth the principle facts and technical rationale that serve as the legal basis for the requirements of the accompanying draft permit. The draft permit has been prepared in accordance with Clean Water Act (CWA) section 402 and its implementing regulations at Title 40 of the *Code of Federal Regulations* (CFR), Parts 122 through 124, and the Water Quality Certificate (WQC) issued by the Puerto Rico Department of Natural Resources (DNER) pursuant to CWA section 401 requirements.

Pursuant to 40 CFR 124.53, the Commonwealth of Puerto Rico must either grant a certification pursuant to CWA section 401 or waive this certification before the U.S. Environmental Protection Agency (EPA) may issue a final permit. On **May 11, 2021**, DNER provided in the WQC that the allowed discharge will not cause violations to the applicable water quality standards at the receiving water body if the limitations and monitoring requirements in the WQC are met. In accordance with CWA section 401, EPA has incorporated the conditions of the WQC into the draft permit. The WQC conditions are discussed in this Fact Sheet and are no less stringent than allowed by federal requirements. Additional requirements might apply to comply with other sections of the CWA. Review and appeals of limitations and conditions attributable to the WQC were made through the applicable procedures of the Commonwealth of Puerto Rico and not through EPA procedures.

PART I. BACKGROUND

A. Permittee and Facility Description

The Puerto Rico Aqueduct and Sewer Authority (PRASA) (referred to throughout as the Permittee) has applied for **renewal of its** National Pollutant Discharge Elimination System (NPDES) permit. The Permittee is discharging pursuant to NPDES Permit No. **PR0023744**. The Permittee submitted **Application Form 1, and 2A, dated July 30, 2020**, and applied for an NPDES permit to discharge **treated** wastewater from **Camuy-Hatillo WWTP** called the facility. The facility is classified as a **major** discharger by EPA in accordance with the EPA rating criteria.

The Permittee **owns and operates wastewater treatment plant which provides secondary treatment**. Attachment A of this Fact Sheet provides a map of the area around the facility and a flow schematic of the facility.

The treatment system consists of the following:

The Camuy-Hatillo WWTP is a publicly owned treatment work (POTW) that treats sanitary wastewater through secondary treatment of the domestic sewage from Camuy, Quebradillas and Hatillo. It has a design flow rate of 3.02 MGD, and provides secondary treatment and discharge its effluent to the Atlantic Ocean.

Sanitary wastewater is processed through the following units:

- Pre-treatment process with bar screening, communitor and pumping system
- Grit removal system
- Primary clarifiers trains
- First stage biofilters trains
- Intermediate clarifiers trains
- Second stage biofilters trains

➤ Chlorination System

Sludge is dewatered and disposed in a landfill.

Summary of Permittee and Facility Information

Permittee	Puerto Rico Aqueduct and Sewer Authority (PRASA)
Facility contact, title, phone	Mrs. Irma Lopez, Executive Director Compliance and Quality Control (787) 620-2270
Permittee (mailing) address	Puerto Rico Aqueduct and Sewer Authority P.O. Box 7066 Barrio Obrero Station Santurce, Puerto Rico 00916-7066
Facility (location) address	State Road 485 Km. 3.5 Membrillo Ward Bajura Sector, Camuy, PR 00627
Type of facility	Publically-owned Treatment Works
Pretreatment program	Yes
Facility daily average flow	2.069 MGD
Facility design flow	3.02 MGD
Facility classification	Major

B. Discharge Points and Receiving Water Information

Wastewater is discharged from Outfall 001 to the Atlantic Ocean, a water of the United States.

The draft permit authorizes the discharge from the following discharge point(s):

Outfall	Effluent description	Outfall latitude	Outfall longitude	Receiving water name and classification
001	Secondary municipal wastewater.	18°, 29', 47.9" N	66°, 52', 33.4" W	Atlantic Ocean, Class SB waters

As indicated in the Puerto Rico Water Quality Standards (PRWQSR) Regulations, the designated uses for Class SB receiving waters include:

- Primary and secondary recreation; and
- Propagation and preservation of desirable species, including threatened and endangered species.

CWA section 303(d) requires the Commonwealth of Puerto Rico to develop a list of impaired waters, establish priority rankings for waters on the list, and develop TMDLs for those waters. The receiving water has not been determined to have water quality impairments for one or more of the designated uses as determined by section 303(d) of the CWA.

C. Compliance Orders/Consent Decrees

The Permittee has a Consent Decree with the Agency (civil action no 06-16-24 (sec)) in which the facility is included. This consent decree does not affect this permit action.

D. Summary of Basis for Effluent Limitations and Permit Conditions - General

The effluent limitations and permit conditions in the permit have been developed to ensure compliance with the following, as applicable:

- Clean Water Act section 401 certification requirements;
- NPDES regulations (40 CFR Part 122); and
- PRWQSR (April 2019).
- Secondary Treatment Requirements (40 CFR 133)
- Pretreatment Requirements (40 CFR Part 403)

PART II. RATIONALE FOR EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

CWA section 301(b) and 40 CFR 122.44(d) require that permits include limitations more stringent than applicable technology-based requirements where necessary to achieve applicable water quality standards. In addition, 40 CFR 122.44(d)(1)(i) requires that permits include effluent limitations for all pollutants that are or may be discharged at levels that cause, have the reasonable potential to cause, or contribute to an exceedance of a water quality criterion, including a narrative criterion. The process for determining reasonable potential and calculating water quality-based effluent limits (WQBELs) is intended to protect the designated uses of the receiving water, and achieve applicable water quality criteria. Where reasonable potential has been established for a pollutant, but there is no numeric criterion for the pollutant, WQBELs must be established using (1) EPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state's narrative criterion, supplemented with other relevant information, as provided in 40 CFR 122.44(d)(1)(vi).

The effluent limitations and permit conditions in the permit have been developed to ensure compliance with all federal and state regulations, including PRWQSR. The basis for each limitation or condition is discussed below.

A. Effluent Limitations

The permit establishes **both Technology-based Effluent Limitations (TBELs) and WQBELs** for several pollutants and the basis for these limitations are discussed below.

1. **Flow:** An effluent limitation for flow has been established in the permit for 3.02 MGD as a Daily Maximum. Monitoring conditions are applied pursuant to 40 CFR 122.21(j)(4)(ii) and IWQC.
The frequency monitoring for flow shall be continuous with a flow meter.
2. **5-Day Biochemical Oxygen Demand (BOD₅):** The effluent concentration and percent removal limitations are based on technology-based secondary treatment standards for publicly owned treatment works (POTWs) specified in 40 CFR 133.102(a). The permit also requires influent monitoring and reporting in accordance with 40 CFR 122.44(i) to meet the requirement of the percent removal limitation (see section C.1.—Monitoring Requirements— of this Part).
3. **Total Suspended Solids (TSS):** The effluent concentration and percent removal limitations are based on technology-based secondary treatment standards for POTWs specified in 40 CFR 133.102(b). The permit also requires influent monitoring and reporting in accordance with 40 CFR 122.44(i) to meet the requirement of the percent removal limitation (see section C.1.—Monitoring Requirements— of this Fact Sheet).
4. **Color:** The effluent limitation is based on the water quality criterion for **Class SB** waters as specified in Rule 1303.2.B.2.e of PRWQSR, and the WQC.
5. **Dissolved Oxygen (DO):** The effluent limitation is based on the water quality criterion for **Class SB** waters as specified in Rule 1303.2.B.2.a of PRWQSR, and the WQC.
6. **Enterococci:** The discharge consists of domestic sewage that is a source of pathogens. To ensure that the recreational use of the water body is met, effluent limitations for Enterococci are established in the permit and are based on the water quality criterion for **Class SB** waters as specified in Rule 1303.2.B.2.c of PRWQSR, and the WQC.
7. **Oil and Grease:** The effluent limitation is based on the water quality standards as specified in Rule 1303.1.H of PRWQSR, and the WQC.

8. **Other Pathogenic Organisms:** The effluent limitation is based on the water quality criterion for all waters in Puerto Rico as specified in Rule 1303.1.I of PRWQSR, and the IQC.
9. **pH:** The effluent limitation for pH is based on technology-based secondary treatment standards for POTWs for **Class SB** waters as specified in Rule 1303.2.B.2.d of PRWQSR, and the IWQC. In no case the pH will lie outside of 7.3 to 8.5, standard pH units, except when it is altered by natural causes.
10. **Solids and Other Matters:** The effluent limitation is based on the water quality standards as specified in Rule 1303.1.A of PRWQSR, and the WQC.
11. **Surfactants:** The effluent limitation is based on the water quality criterion for **Class SB** waters as specified in Rule 1303.2.B.2.i of PRWQSR, and the WQC.
12. **Suspended, Colloidal or Settleable Solids:** The effluent limitation is based on the water quality standards as specified in Rule 1303.1.E of PRWQSR, and the WQC.
13. **Taste and Other Producing Substances:** The effluent limitation is based on the water quality criterion for **Class SB** waters as specified in Rule 1303.2.B.2.g of PRWQSR, and the WQC.
14. **Temperature:** The effluent limitation for temperature is based on the water quality criterion for all waters in Puerto Rico as specified in Rule 1303.1.D.1 of PRWQSR, and the WQC.
15. **Turbidity:** The effluent limitation is based on the water quality criterion for **Class SB** waters as specified in Rule 1303.2.B.2.f of PRWQSR, and the WQC.
16. **Copper, Free Cyanide, Mercury, Nitrogen, Residual Chlorine, Silver, and Sulfide:** The effluent limitations are based on the water quality standards for **Class SB** waters as specified in Rule 1303.1.J.1 of PRWQSR, and the WQC.
17. **Total Nitrogen (TKN, NO₂, NO₃):** The effluent limitation is based on the water quality standards for **Class SB** waters as specified in Rule 1303.2.B.2.k of PRWQSR, and the WQC.
18. **Whole Effluent Toxicity (WET):** The permit establishes a requirement for the Permittee to conduct accelerated testing and develop a Toxicity Reduction Evaluation (TRE) Workplan as Special Conditions. These requirements are necessary to ensure that the Permittee has a process for addressing effluent toxicity if toxicity is observed.

B. Effluent Limitations Summary Table

1. Outfall Number 001

Parameter	Units	Effluent limitations					
		Averaging period	Highest Reported Value (1)	Existing limits	Interim limits	Final limits	Basis
BOD ₅	mg/L	Average monthly	23.0	30.0	n/a	30.0	TBEL
		Average weekly	37.8	45.0		45.0	
BOD ₅ percent removal	%	Daily maximum	87	85	n/a	85	TBEL
Color	Pt-Co	Daily Maximum	20	Monitor only	n/a	Monitor only	WQBEL
Copper	µg/L	Daily maximum	10.57	3.73	n/a	3.73	WQBEL
Dissolved Oxygen	mg/L	Daily Maximum	4.9	≥ 4.0	n/a	≥ 5.0	WQBEL
Free Cyanide	µg/L	Daily maximum	1.38	1.0	n/a	1.0	WQBEL
Enterococci	col/100 mL	Daily maximum	76.04	35 col/100 mL	n/a	35 col/100 mL	WQBEL
Flow	MGD	Daily maximum	2.06	3.02	n/a	3.02	WQBEL
Mercury	µg/L	Daily maximum	0.028	0.051	n/a	0.051	WQBEL

Parameter	Units	Effluent limitations					
		Averaging period	Highest Reported Value (1)	Existing limits	Interim limits	Final limits	Basis
Oil and Grease	mg/L	Average Monthly	1.724	Monitor only	n/a	Monitor only	WQBEL
Other Pathogenic Organisms	--	--	--	--	n/a	Monitor only	WQBEL
pH	SU	Daily maximum	7.7 – 7.3	7.3 – 8.5	n/a	7.3 – 8.5	WQBEL
Residual Chlorine	mg/L	Daily maximum	237	500	n/a	7.5	WQBEL
Silver	µg/L	Daily maximum	6.22	2.24	n/a	2.24	WQBEL
Solids and Other Matter	--	--	--	Monitor only	n/a	Monitor only	WQBEL
Sulfide (Undissociated H ₂ S)	µg/L	Daily maximum	0.1	2.0	n/a	2.0	WQBEL
Surfactants	µg/L	Daily maximum	168	500	n/a	500	WQBEL
Suspended, Colloidal or Settleable Solids	mL/L	Average Monthly Maximum Daily	--	Monitor only	n/a	Monitor only	WQBEL
Temperature	°C	Average Monthly Maximum Daily	29	<32.2	n/a	<30.0	WQBEL
Total Nitrogen (TKN, NO ₂ , NO ₃)	µg/L	Average Monthly	--	--	n/a	5,000	WQBEL
TSS	mg/L	Average monthly Average weekly	23.22 34.95	Monitor only	n/a	Monitor only	TBEL
TSS percent removal	%	Daily maximum	88	85	n/a	n/a	TBEL
Turbidity	NTU	Daily maximum	12	10	n/a	10	WQBEL

Notes, Footnotes and Abbreviations:

Dashes (--) indicate there are no effluent data, no limitations, or no monitoring requirements for this parameter.

Table above only includes parameter limitations as stated in the Past and current NPODES permits. As previously stated, PRASA has a Consent Decree (CD) with EPA in which this facility is included. In this CD, the Camuy-Hatillo WWTP has interim limits for some of the parameters in the table above which are not included. But, to determine a violation EPA will consider any interim limitations applicable.

(1) Wastewater data from DMRs dated February 1, 2016 to May 31, 2020, NPDES Permit Renewal July 30, 2020 Application.

2. Outfall 001 Narrative Limitations

- a. The waters of Puerto Rico shall not contain any substance, attributable to the discharge at such concentration which, either alone or as result of synergistic effects with other substances, is toxic or produces undesirable physiological responses in humans, fish, or other fauna or flora.
- b. The water of Puerto Rico shall be substantially free from floating non-petroleum oils and greases as well as petroleum derived oils and greases.
- c. The waters of Puerto Rico shall not contain floating debris, scum, or other floating materials attributable to discharges in amounts sufficient to be unsightly or deleterious to the existing or designated uses of the water body.
- d. Solids from wastewater sources shall not cause deposition in or be deleterious to the existing or designated uses of the waters.
- e. Taste and odor-producing substances shall not be present in amounts that will interfere with primary contact recreation, or will render any undesirable taste or odor to edible aquatic life.
- f. No toxic substances shall be discharged, in toxic concentrations, other than those allowed as specified in the NPDES permit, Those toxic substances included in the permit renewal application, but not regulated by the NPDES permit, shall not exceed the concentrations specified in the applicable regulatory limitations.
- g. Except by natural causes, no heat may be added to the waters of Puerto Rico, which would cause the temperature of any site to exceed 86 °F (30.0 °C).

- h. Color: Shall not be altered by other than natural causes.
- i. Other Pathogenic Substances: These waters shall be free from other pathogenic organisms different to coliforms and enterococci.

C. Monitoring Requirements

NPDES regulations at 40 CFR 122.48 require that all permits specify requirements for recording and reporting monitoring results. The Part III of the Permit establishes monitoring and reporting requirements to implement federal and state requirements. The following provides the rationale for the monitoring and reporting requirements for this facility.

1. Influent Monitoring Requirements

For POTWs: **To calculate percent removal values, influent monitoring is required for BOD₅ and TSS in accordance with 40 CFR 133.102. Influent monitoring must be conducted before any treatment, other than de-gritting, and before any addition of any internal waste stream.**

2. Effluent Monitoring Requirements

Effluent monitoring frequency and sample type have been established in accordance with the requirements of 40 CFR 122.44(i) and recommendations in EPA's TSD. Consistent with 40 CFR Part 136 monitoring data for toxic metals must be expressed as total recoverable metal. Effluent monitoring and analyses shall be conducted in accordance with EPA test procedures approved under 40 CFR Part 136, Guidelines Establishing Test Procedures for the Analysis of Pollutants Under the Clean Water Act, as amended. For situations where there may be interference, refer to Solutions to Analytical Chemistry Problems with Clean Water Act Methods (EPA 821-R-07-002). A licensed chemist authorized to practice the profession in Puerto Rico shall certify all chemical analyses. All bacteriological tests shall be certified by a microbiologist or licensed medical technologist authorized to practice the profession in Puerto Rico.

The sampling point for Outfall 001 shall be located immediately after the primary flow measuring device of the effluent of the treatment system.

D. Compliance with Federal Anti-Backsliding Requirements and Puerto Rico's Anti-Degradation Policy

Federal regulations at 40 CFR 131.12 require that state water quality standards include an anti-degradation policy consistent with the federal policy. The discharge is consistent with the anti-degradation provision of 40 CFR 131.12, 72 Federal Register 238 (December 12, 2007, pages 70517-70526) and DNER's *Anti-Degradation Policy Implementation Procedure* in Attachment A of PRWQSR. In addition, CWA sections 402(o)(2) and 303(d)(4) and federal regulations at 40 CFR 122.44(l) prohibit backsliding in NPDES permits. Further, the Region 2 Antbacksliding Policy provides guidance regarding relaxation of effluent limitations based on water quality for Puerto Rico NPDES permits. These anti-backsliding provisions require effluent limitations in a reissued permit to be as stringent as those in the previous permit with some exceptions where limitations may be relaxed.

- Existing effluent limitations for **Fecal Coliforms, Nickel and Nitrogen** have been **removed** based on CWA section 402(o)(2)(B)(i). CWA section 402(o)(2)(B)(i) authorizes the backsliding of effluent limitations if information is available which was not available at the time of permit issuance that would have justified the application of a less stringent effluent limitation at the time of permit issuance. Based on review of effluent data since issuance of the existing permit, the modified discharge does not show a reasonable potential for the exceedance of water quality criteria for these parameters.
- The proposed NPDES permit contains water quality-based effluent limitations for **Other Pathogenic Organisms and Total Nitrogen** which were **not included** in the previous NPDES permit. Pursuant to Section 401 (d) of the Act and 40 C.F.R. 122.44 (d) and 124.55, all State certified limitations and requirements contained in a Section 401 certification must be incorporated into a NPDES permit issued by EPA. The water quality-based limitations referenced in this paragraph have been included in the draft NPDES permit, based on DNER's WQC.
- The water quality-based effluent limitation from the previous permit for **Temperature and Residual Chlorine** have been replaced with a **more stringent** water quality-based limitation in the Intent to Issue a IWQC issued by the DNER. Pursuant to Section 401 (d) of the Act and 40 C.F.R. 122.44 (d) and 124.55, all State certified limitations and requirements contained in a Section 401 certification

must be incorporated into a NPDES permit issued by EPA. The water quality-based effluent limitations referenced in this paragraph have been included in the draft NPDES permit, based on DNER's IWQC.

- The effluent limitations in the permit are at least as stringent as the effluent limitations in the existing permit, with the exception of effluent limitation for **Dissolved Oxygen**. The effluent limitation for this pollutant is **less stringent** than those in the existing permit. This relaxation of effluent limitations is consistent with the anti-backsliding requirements of CWA section 401(o), 40 CFR 122.44(l), EPA Region 2's Anti-backsliding Policy dated August 10, 1993, and Puerto Rico's Anti-Degradation Policy Implementation Procedure established in PRWQSR. CWA Sec. 402(o)(2)(B)(i) allows backsliding if information is available which was not available at the time of permit issuance and would have justified a less stringent effluent limitation at the time of permit issuance. EPA has determined that it is appropriate to relax the effluent limitation for these parameters without violating anti-backsliding provisions of the CWA, in accordance with section 402(o)(2), since one of the exceptions to the provisions has been satisfied; and section 402(o)(3) since it complies with DNER's IWQS which include antidegradation requirements. The DNER WQC constitutes a determination that the limit is sufficient to assure that the water quality standards are or will be attained.

PART III. RATIONALE FOR STANDARD AND SPECIAL CONDITIONS

A. Standard Conditions

In accordance with 40 CFR 122.41, standard conditions that apply to all NPDES permits have been incorporated by reference in Part IV.A.1 of the permit and expressly in Attachment B of the permit. The Permittee must comply with all standard conditions and with those additional conditions that are applicable to specified categories of permits under 40 CFR 122.42 and specified in Part IV.A.2 of the Permit.

B. Special Conditions

In accordance with 40 CFR 122.42 and other regulations cited below, special conditions have been incorporated into the permit. This section addresses the justification for special studies, additional monitoring requirements, Best Management Practices, Compliance Schedules, and/or special provisions for POTWs as needed. The special conditions for this facility are as follows:

1. Special Conditions from the Water Quality Certificate

In accordance with 40 CFR 124.55, EPA has established Special Conditions from the IWQC in the permit that DNER determined were necessary to meet PRWQSR. The Special Conditions established in this section are only those conditions from the IWQC that have not been established in other parts of the permit.

2. Best Management Practices (BMP) Plan

In accordance with 40 CFR 122.2 and 122.44(k), BMPs are schedules of activities, prohibitions of practices, maintenance procedures, and other management practices to prevent or reduce the pollution to waters of the United States. The Permittee is required to develop a BMP Plan in Part IV.B.3.a of the permit to control or abate the discharge of pollutants.

3. Compliance Schedules

A compliance schedule has not been authorized for any pollutant or parameter in the permit on the basis of 40 CFR 122.47.

4. Other Special Conditions

Special Condition B.2 was modified from the requirement imposed in the water quality certificate issued by the Puerto Rico DNER. EPA has imposed the semi-annually testing requirement to collect data necessary to determine whether this discharge has the reasonable potential to cause or contribute to an exceedance of Puerto Rico's water quality standards for toxicity, pursuant to water quality based permitting requirements at 40 CFR 122.44(d)(1), which requires EPA and delegated states to evaluate each National Pollutant Discharge Elimination System (NPDES) permit for the potential to exceed state numeric or narrative water quality standards, including those for toxics, and to establish effluent

limitations for those facilities with the "reasonable potential" to exceed those standards. These federal regulations require both chemical specific limits, based on the state numeric water quality standards or other criteria developed by EPA, and whole effluent toxicity effluent limits.

Special Condition B.2 was also modified to make clarify the right of EPA to reopen this permit to include additional toxicity requirements if warranted.

5. Additional Special Conditions

a. Pretreatment Requirements: In accordance with 40 CFR Part 403, EPA has established responsibilities of Federal, State, and local government, industry and the public to implement Pretreatment Standards to control pollutants from the industrial users which may pass through or interfere with POTW treatment processes or which may contaminate sewage sludge.

b. Biosolids (Sewage Sludge) Requirements: Biosolids are a primary organic solid product produced by wastewater treatment process that can be beneficially recycled. 40 CFR Part 503 establishes requirements for the final use or disposal of sewage sludge when biosolids are: applied to land to condition the soil or fertilize crops or other vegetation; placed on a surface disposal site for final disposal; or fired in a biosolids incinerator. The rule also indicates that if biosolids are placed in a municipal solid waste landfill, they must meet the provisions of 40 CFR Part 258.

PART IV. COMPLIANCE WITH APPLICABLE PROVISIONS OF OTHER FEDERAL LAWS OR EXECUTIVE ORDERS

A. Coastal Zone Management Act

Under 40 CFR 122.49(d), and in accordance with the Coastal Zone Management Act of 1972, as amended, 16 *United States Code* (U.S.C.) 1451 *et seq.* section 307(c) of the act and its implementing regulations (15 CFR Part 930), EPA may not issue an NPDES permit that affects land or water use in the coastal zone until the Permittee certifies that the proposed activity complies with the Coastal Zone Management Program in Puerto Rico, and that the discharge is certified by the Commonwealth of Puerto Rico to be consistent with the Commonwealth's Coastal Zone Management Program. The Permittee has indicated the outfall is in a coastal area managed by the Commonwealth's Coastal Zone Management Program which has been consistent with the program.

B. Endangered Species Act

Under 40 CFR 122.49(c), EPA is required pursuant to section 7 of the Endangered Species Act (ESA), 16 U.S.C. 1531 *et seq.* and its implementing regulations (50 CFR Part 402) to ensure, in consultation with the National Marine Fisheries Service (NMFS) and U.S. Fish and Wildlife Service (USFWS) that the discharge authorized by the permit is not likely to jeopardize the continued existence of any endangered or threatened species or adversely affect its critical habitat. On April 16, 2009, EPA designated PRASA (a non-Federal representative) to conduct informal consultations or prepare a biological assessment for Section 7 Consultations, according to 50 CFR 402.8. In the past, no federally listed endangered or threatened species, or critical habitat, are in the vicinity of the discharge. Therefore, it has been determined that the discharge is not likely to affect species or habitat listed under the ESA.

C. Environmental Justice – Not Applicable.

D. Coral Reef Protection

Under Executive Order 13089, *Coral Reef Protection*, EPA is required to ensure that discharge authorized under the permit will not degrade any coral reef ecosystem. No corals or coral ecosystems are in the vicinity of the discharge.

E. Climate Change

EPA has considered climate change when developing the conditions of the permit. This is in accordance with the draft *National Water Program 2012 Strategy: Response to Climate Change* that identifies ways to address climate change impacts by NPDES permitting authorities (77 Federal Register 63, April 2, 2012, 19661-19662). Climate

change is expected to affect surface waters in several ways, affecting both human health and ecological endpoints. As outlined in the draft National Water Program 2012 Strategy, EPA is committed to protecting surface water, drinking water, and ground water quality, and diminishing the risks of climate change to human health and the environment, through a variety of adaptation and mitigation strategies. These strategies include encouraging communities and NPDES permitting authorities to incorporate climate change strategies into their water quality planning, encouraging green infrastructure and recommending that water quality authorities consider climate change impacts when developing water load and load allocations for new TMDLs, identifying and protecting designated uses at risk from climate change impacts. The 2010 *NPDES Permit Writers' Manual* also identifies climate change considerations for establishing low-flow conditions that account for possible climatic changes to stream flow. The conditions established in the permit are consistent with the draft National Water Program 2012 Strategy.

F. National Historic Preservation Act – Not applicable since this is a renovation.

G. Magnuson-Stevens Fishery Conservation and Management Act

Under 40 CFR 122.49, EPA is required to ensure that the discharge authorized by the permit will not adversely affect Essential Fish Habitat (EFH) as specified in section 305(b)(2) of the Magnuson-Stevens Fishery Conservation and Management Act (MSFCMA), 16 U.S.C. 1801 *et seq.* On April 16, 2009, EPA designated PRASA (a non-Federal representative) to conduct informal consultations or prepare a biological assessment for Section 7 Consultations, according to 50 CFR 402.8. In the past, the discharge has not affected EFH. Therefore, it has been determined that the discharge is not likely to affect species or habitat listed under the ESA.


PART V. PUBLIC PARTICIPATION

The procedures for reaching a final decision on the draft permit are set forth in 40 CFR Part 124 and are described in the public notice for the draft permit, which is published on EPA's website at www.epa.gov/region02/water/permits.html. Included in the public notice are requirements for the submission of comments by a specified date, procedures for requesting a hearing and the nature of the hearing, and other procedures for participation in the final agency decision. EPA will consider and respond in writing to all significant comments received during the public comment period in reaching a final decision on the draft permit. Requests for information or questions regarding the draft permit should be directed to


Lalitssa López
EPA Region 2, Caribbean Environmental Protection Division
Permit Writer Phone: 787-977-5857
Permit Writer Email: lopez.lalitssa@epa.gov

ATTACHMENT A — FACILITY MAP AND FLOW SCHEMATIC

The facility map and flow schematic are attached as provided by the discharger in the application.

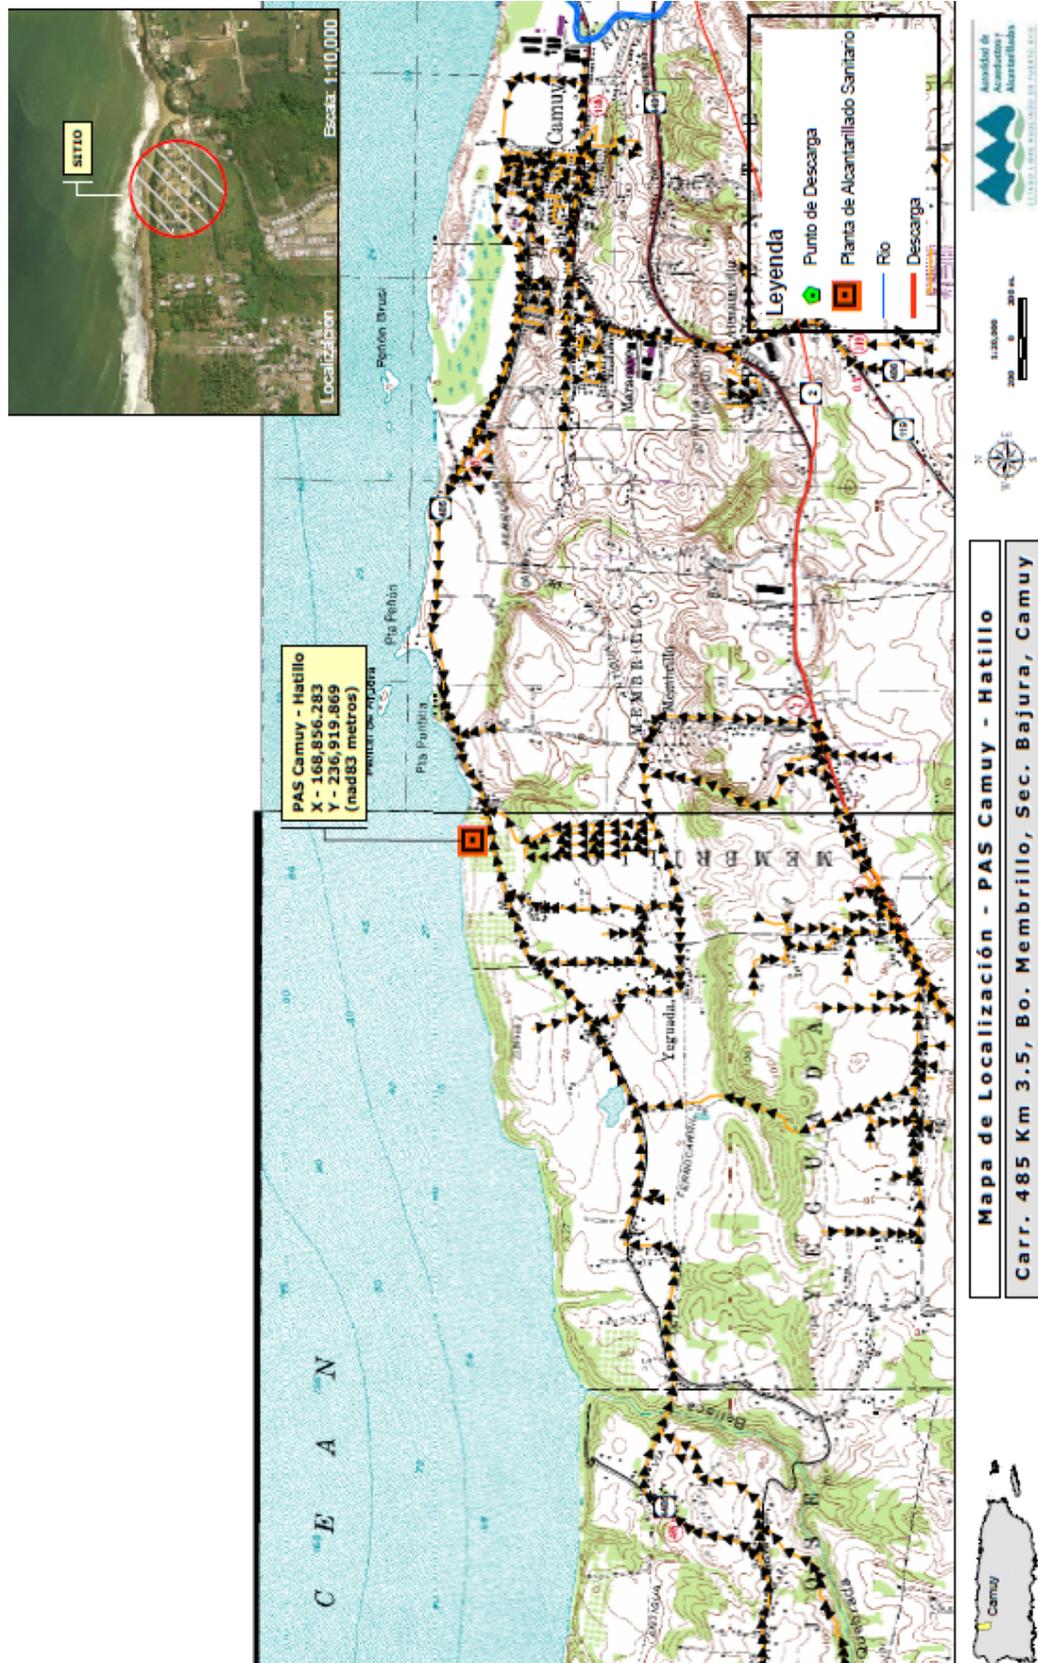

Flow Diagram Camuy-Hatillo WWTP

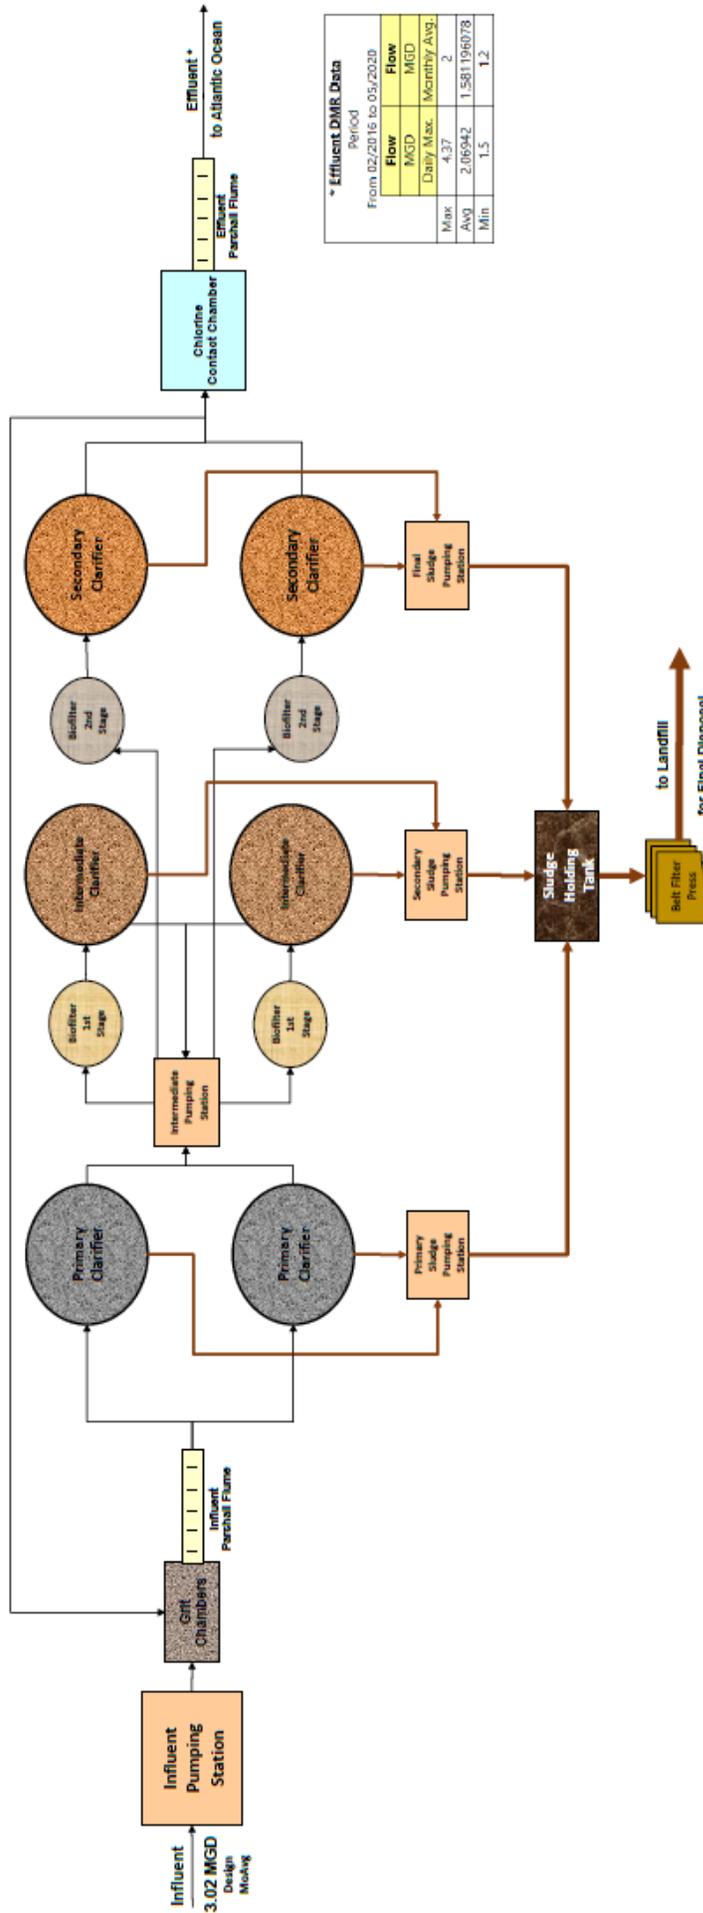

* Effluent DMR Data
Period
From 02/2016 to 05/2020

	Flow	Flow
	MGD	MGD
	Daily Max.	Monthly Avg.
Max	4.37	2
Avg	2.06942	1.581196078
Min	1.5	1.2