



**National Pollutant Discharge Elimination System Permit  
issued to**

**Permittee:**

Dunn Paper – East Hartford, LLC  
40 Forbes Street  
East Hartford, CT 06108

**Location Address:**

Dunn Paper – East Hartford, LLC  
40 Forbes Street  
East Hartford, CT 06108

**Permit ID:** CT0002127

**Issuance Date:** [To be determined]

**Receiving Water Body:** Hockanum River

**Effective Date:** [To be determined]

**Receiving Water Body ID:** CT4500-00\_01

**Permit Expires:** [To be determined]

**SECTION 1: GENERAL PROVISIONS**

- 1.1 This permit is reissued in accordance with Section 22a-430 of Chapter 446k, Connecticut General Statutes (“CGS”), and Regulations of Connecticut State Agencies (“RCSA”) adopted thereunder, as amended, and Section 402(b) of the Clean Water Act (“CWA”), as amended, 33 USC 1251, *et. seq.*, and pursuant to an approval dated September 26, 1973, by the Administrator of the United States Environmental Protection Agency for the State of Connecticut to administer a National Pollutant Discharge Elimination System (“NPDES”) permit program.
- 1.2 **Dunn Paper – East Hartford, LLC** (“Permittee”) shall comply with all conditions of this permit including the following sections of the RCSA which have been adopted pursuant to Section 22a-430 of the CGS and are hereby incorporated into this permit. Your attention is especially drawn to the notification requirements of subsections (i)(2), (i)(3), (j)(1), (j)(6), (j)(8), (j)(9)(C), (j)(10)(C), (j)(11)(C), (D), (E), and (F), (k)(3) and (4) and (l)(2) of Section 22a-430-3.

**Section 22a-430-3: General Conditions**

- (a) Definitions
- (b) General
- (c) Inspection and Entry
- (d) Effect of a Permit
- (e) Duty to Comply
- (f) Proper Operation and Maintenance
- (g) Sludge Disposal
- (h) Duty to Mitigate
- (i) Facility Modifications; Notification
- (j) Monitoring, Records and Reporting Requirements
- (k) Bypass
- (m) Effluent Limitation Violations (Upsets)
- (n) Enforcement
- (o) Resource Conservation
- (p) Spill Prevention and Control
- (q) Instrumentation, Alarms, Flow Recorders
- (r) Equalization

Section 22a-430-4: Procedures and Criteria

- (a) Duty to Apply
  - (b) Duty to Reapply
  - (c) Application Requirements
  - (d) Preliminary Review
  - (e) Tentative Determination
  - (f) Draft Permits, Fact Sheets
  - (g) Public Notice, Notice of Hearing
  - (h) Public Comments
  - (i) Final Determination
  - (j) Public Hearings
  - (k) Submission of Plans and Specifications, Approval
  - (l) Establishing Effluent Limitations and Conditions
  - (m) Case by Case Determinations
  - (n) Permit Issuance or Renewal
  - (o) Permit Transfer
  - (p) Permit Revocation, Denial or Modification
  - (q) Variances
  - (s) Treatment Requirements
- 1.3 Violations of any of the terms, conditions, or limitations contained in this permit may subject the Permittee to enforcement action including, but not limited to, seeking penalties, injunctions and/or forfeitures pursuant to applicable sections of the CGS and RCSA.
- 1.4 Any false statement in any information submitted pursuant to this permit may be punishable as a criminal offense under Section 22a-438 or 22a-131a of the CGS or in accordance with Section 22a-6, under Section 53a-157b of the CGS.
- 1.5 The authorization to discharge under this permit may not be transferred without prior written approval of the Commissioner of Energy and Environmental Protection ("Commissioner"). To request such approval, the Permittee and proposed transferee shall register such proposed transfer with the Commissioner, at least thirty (30) days prior to the transferee becoming legally responsible for creating or maintaining any discharge which is the subject of the permit transfer. Failure, by the transferee, to obtain the Commissioner's approval prior to commencing such discharge(s) may subject the transferee to enforcement action for discharging without a permit pursuant to applicable sections of the CGS and RCSA.
- 1.6 No provision of this permit and no action or inaction by the Commissioner shall be construed to constitute an assurance by the Commissioner that the actions taken by the Permittee pursuant to this permit will result in compliance or prevent or abate pollution.
- 1.7 Nothing in this permit shall relieve the Permittee of other obligations under applicable federal, state and local law.
- 1.8 An annual fee shall be paid for each year this permit is in effect as set forth in Section 22a-430-7 of the RCSA.
- 1.9 The Permittee shall operate and maintain its collection and treatment system in accordance with its Operation and Maintenance Plan and with any approvals issued in accordance with RCSA Section 22a-430-3(i)(3). The Permittee shall revise and maintain the Operation and Maintenance Plan upon the Commissioner's request or to address equipment or operational changes in accordance with RCSA Section 22a-430-3(f)(2).

- 1.10 The Permittee shall implement its Spill Prevention and Control Plan in accordance with RCSA Section 22a-430-3(p) and 22a-430-4(c)(10). The plan shall include practices, procedures and facilities designed to prevent, minimize and control spills, leaks or such other unplanned releases of all toxic or hazardous substances and any other substances to prevent pollution of the waters of the state. Such requirements shall, unless otherwise allowed by the Commissioner, apply to all facilities used for storing, handling, transferring, loading or unloading such substances, including manufacturing areas. The Permittee shall revise and maintain the Spill Prevention and Control Plan upon the Commissioner's request or to address equipment or operational changes.

## SECTION 2: DEFINITIONS

- 2.1 The definitions of the terms used in this permit shall be the same as the definitions contained in Section 22a-423 of the CGS and Section 22a-430-3(a) and 22a-430-6 of the RCSA.

- 2.2 In addition to the above, the following definitions shall apply to this permit:

"40 CFR" means Title 40 of the Code of Federal Regulations.

"Annually" in the context of any sampling frequency found in Section 5, shall mean the sample must be collected in the month of October. In the event that the discharge does not occur in this sampling month, the Permittee shall sample during the next discharge event. The Permittee is required to sample the discharge one time a year.

"Average Monthly Limit" means the maximum allowable "Average Monthly Concentration" as defined in Section 22a-430-3(a) of the RCSA when expressed as a concentration (e.g., mg/l). Otherwise, it means "Average Monthly Discharge Limitation" as defined in Section 22a-430-3(a) of the RCSA.

"Composite Sample" means a sample collected over a specified period of time in order that the results are representative of the monitored activity over the same time period.

*Connecticut Water Quality Standards* means the regulations adopted under RCSA Sections 22a-426-1 through 22a-426-9, as amended.

"Daily composite" means (1) a composite sample taken over a full operating day consisting of grab samples collected at equal intervals of no more than sixty (60) minutes and combined proportionally to flow, or (2) a composite sample continuously collected over a full operating day proportionally to flow.

"Daily Concentration" means the concentration of a substance as measured in a daily composite sample, or the arithmetic average of all grab sample results defining a grab sample average.

"Daily Quantity" means the quantity of waste discharged during an operating day.

"Dilution Factor" means the inverse of the "Instream Waste Concentration".

"DMR" means Discharge Monitoring Report.

"Grab Sample Average" ("GSA") means the arithmetic average of all grab sample analyses. Grab samples shall be collected at least once every four hours over a full operating day for as long as a discharge exists on that day (minimum of two grab samples per day).

"IC" means "Inhibition Concentration".

"IC<sub>25</sub>" means a point estimate of the toxicant concentration that would cause a twenty-five (25) percent reduction in a non-lethal biological measurement of the test organism, such as reproduction or growth.

“Instantaneous Limit” means the highest allowable concentration of a substance as measured by a grab sample, or the highest allowable measurement of a parameter as obtained through instantaneous monitoring.

“In-stream Waste Concentration” (“IWC%”) means the concentration (as a percent) of the effluent in the receiving water after mixing has occurred in the allocated zone of influence.

“LC” means Lethal Concentration

“LC<sub>50</sub>” means the concentration lethal to fifty (50) percent of the test organisms during a specific period.

“Lowest Observed Effect Concentration” (“LOEC”) means the lowest concentration of an effluent or toxicant to which organisms are exposed in a life cycle or partial life-cycle test, which causes adverse effects on the test organisms.

“Maximum Daily Limit” means the maximum allowable “Daily Concentration” (defined above) when expressed as a concentration (e.g., mg/l). Otherwise, it means the maximum allowable “Daily Quantity” as defined above, unless it is expressed as a flow quantity. If expressed as a flow quantity, it means “Maximum Daily Flow” as defined in Section 22a-430-3(a) of the RCSA.

“No Observed Effect Concentration” (“NOEC”) means the highest concentration of an effluent or toxicant to which organisms are exposed in a life cycle or partial life-cycle test, that causes no observable adverse effects on the test organisms.

“Quarterly”, in the context of a sampling frequency, means sampling is required in the months of January, April, July, and October.

"Range During Month" ("RDM"), as a sample type, means the lowest and the highest values of all of the monitoring data for the reporting month.

“Reporting Frequency” means the frequency at which monitoring results must be provided.

“Semi-Annual” in the context of a sampling frequency, means the sample must be collected in the months of January and July.

### **SECTION 3: COMMISSIONER'S DECISION**

- 3.1 The Commissioner has issued a final determination and found that continuance of the existing discharge will not cause pollution of the waters of the state. The Commissioner’s decision is based on Application No. 201301708 for permit reissuance received on April 1, 2013, and the administrative record established in the processing of that application.
- 3.2 Upon the effective date of this permit and continuing until this permit expires or is modified or revoked, the Commissioner hereby authorizes the Permittee to discharge in accordance with the terms and conditions of this permit, the information provided in Application No. 201301708, received by the Commissioner on April 1, 2013, and all modifications and approvals issued by the Commissioner or the Commissioner’s authorized agent, for the discharge and/or activities authorized by, or associated with this Permit.
- 3.3 The Commissioner reserves the right to make appropriate revisions to the permit in order to establish any appropriate effluent limitations, schedules of compliance, or other provisions which may be authorized under the Federal Clean Water Act or the CGS or regulations adopted thereunder, as amended. The permit as modified or renewed under this paragraph may also contain any other requirements of the Federal Clean Water Act or the CGS or regulations adopted thereunder which are then applicable.

#### **SECTION 4: GENERAL EFFLUENT LIMITATIONS**

- 4.1 The Permittee shall assure that the surface water affected by the subject discharge shall conform to the *Connecticut Water Quality Standards*.
- 4.2 No discharge shall contain, or cause in the receiving stream, a visible oil sheen or floating solids, or cause visible discoloration or foaming in the receiving stream.
- 4.3 No discharge shall cause acute or chronic toxicity in the receiving water body beyond any zone of influence specifically allocated to that discharge in this permit.
- 4.4 The temperature of any discharge shall not increase the temperature of the receiving stream above 85 °F, or in any case, raise the temperature of the receiving stream by more than 4 °F.

#### **SECTION 5: SPECIFIC EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS**

- 5.1 The discharge is restricted by and shall be monitored in accordance with the following tables in this section. The wastewater discharge shall not exceed the effluent limitations in these tables and shall otherwise conform to the specific terms and conditions listed in the tables. The Permittee shall comply with the “Footnotes” and “Remarks” noted in the tables that follow. Such footnotes and remarks are enforceable like any other term or condition of this permit.
- 5.2 The wastewaters authorized/approved by this permit shall be collected, treated, and discharged in accordance with this permit and with any approvals issued by the Commissioner or his/her authorized agent for the discharges and activities authorized by or associated with this permit. Any wastewater discharges not expressly identified in these tables or otherwise approved to be discharged by this permit shall not be authorized by this permit.
- 5.3 All samples shall be comprised of only the wastewater described in these tables. Samples shall be collected prior to combination with receiving waters or wastewater of any other type, and after all approved treatment units, if applicable. Samples and measurements taken for the purpose of monitoring shall be representative of the discharge during standard operating conditions. Collection of permit-required effluent samples in any location other than the authorized location noted in this permit shall be a violation of this permit.
- 5.4 In cases where limits and sample type are specified but sampling is not required by this permit, the limits specified shall apply to all samples which may be collected and analyzed by the Department of Energy and Environmental Protection (“DEEP”) personnel, the Permittee, or other parties.
- 5.5 The Permittee shall operate the facility and implement procedures in the Operation and Maintenance manual to prevent a bypass of the UV treatment and disc filter, and prevent a direct discharge to the flume from the cement tank.

Table A

Discharge Serial Number: DSN 001-1						Monitoring Location: 1 (EXTERNAL OUTFALL)				
Wastewater Description: Treated tissue paper manufacturing wastewater										
Monitoring Location Description: At the final effluent discharge point prior to the river water treatment wastewater connection										
Discharge is to: Hockanum River			Zone of Influence: 552,062 gallons per hour			Instream Waste Concentration: 2.21 %		Outfall Location: Latitude (41.77611°) and Longitude (-72.60667°)		
PARAMETER	NET DMR CODE	UNITS	FLOW/TIME BASED MONITORING				INSTANTANEOUS MONITORING			MINIMUM LEVEL <sup>2</sup>
			Average Monthly Limit	Maximum Daily Limit	Sample/ Reporting Frequency <sup>1</sup>	Sample Type or Measurement to be reported	Instantaneous Limit or Required Range	Sample/ Reporting Frequency	Sample Type or Measurement to be Reported	
Aluminum, Total	01105	µg/L	NA	---	Monthly	Daily Composite	NA	NR	NA	10
Anthracene	34220	µg/L	NA	NA	NR	NA	---	Semi-Annual	Grab	4.92
Biochemical Oxygen Demand, 5-day (BOD <sub>5</sub> )	00310	mg/L	25.0	50.0	Weekly	Daily Composite	75.0	NR	Grab	
Biochemical Oxygen Demand, 5-day (BOD <sub>5</sub> )	00310	kg/day	326	595	Weekly	Daily Composite	NA	NR	Grab	
Chlorine, Total Residual	50060	mg/L	0.15	0.3	Monthly	Grab Sample Average	0.45	NR	Grab	0.02
Copper, Total	01042	µg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	3
Epichlorohydrin	81679	µg/L	NA	---	Annually	Grab Sample Average	NA	NR	NA	20.0
Flow Rate, Average Daily <sup>3</sup>	00056	gpd	300,000	NA	Daily	Total Daily Flow	NA	NR	NA	
Flow, Maximum during 24-hr period <sup>3</sup>	50047	gpd	NA	500,000	Daily	Total Daily Flow	NA	NR	NA	
Formaldehyde	71880	µg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Lead, Total	01051	µg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	1
Nitrogen, Ammonia (total as N)	00610	mg/L	NA	---	Monthly	Daily Composite	NA	NR	Grab	
Nitrogen, Kjeldahl (total as N)	00625	mg/L	NA	---	Monthly	Daily Composite	NA	NR	NA	
Nitrogen, Nitrate (total as N)	00620	mg/L	NA	---	Monthly	Daily Composite	NA	NR	NA	
Nitrogen, Nitrite (total as N)	00615	mg/L	NA	---	Monthly	Daily Composite	NA	NR	NA	
Nitrogen, Total (as N) <sup>6</sup>	00600	mg/L	---	---	Monthly	Calculated	NA	NR	NA	
Nitrogen, Total <sup>6</sup>	00600	lbs/day	---	---	Monthly	Calculated	NA	NR	NA	
Oil & Grease, Total	00556	mg/L	10.0	20.0	Semi-Annual	Grab Sample Average	30.0	NR	Grab	
Pentachlorophenol <sup>4</sup>	39032	µg/L	8.2	16.5	Monthly	Daily Composite	16.5	NR	Grab	5.0
Pentachlorophenol <sup>4</sup>	39032	kg/day	NA	0.146	Monthly	Daily Composite	NA	NR	NA	
pH, Maximum <sup>3</sup> (Ends 18 months after permit's effective date)	61941	SU	NA	NA	NR	NA	9.0	Continuous	RDM	
pH, Minimum <sup>3</sup> (Ends 18 months after permit's effective date)	61942	SU	NA	NA	NR	NA	6.0	Continuous	RDM	
Phenanthrene	34461	µg/L	NA	NA	NR	NA	---	Semi-Annual	Grab	49.17
Phosphorus, Total	00665	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	0.1
Phosphorus, Total	00665	lbs/day	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Temperature	00011	°F	NA	NA	NR	NA	---	Continuous	Continuous	

Table A

Discharge Serial Number: DSN 001-1							Monitoring Location: 1 (EXTERNAL OUTFALL)			
Wastewater Description: Treated tissue paper manufacturing wastewater										
Monitoring Location Description: At the final effluent discharge point prior to the river water treatment wastewater connection										
Discharge is to: Hockanum River			Zone of Influence: 552,062 gallons per hour			Instream Waste Concentration: 2.21 %		Outfall Location: Latitude (41.77611°) and Longitude (-72.60667°)		
PARAMETER	NET DMR CODE	UNITS	FLOW/TIME BASED MONITORING				INSTANTANEOUS MONITORING			MINIMUM LEVEL <sup>2</sup>
			Average Monthly Limit	Maximum Daily Limit	Sample/ Reporting Frequency <sup>1</sup>	Sample Type or Measurement to be reported	Instantaneous Limit or Required Range	Sample/ Reporting Frequency	Sample Type or Measurement to be Reported	
Total Suspended Solids	00530	mg/L	20.0	40.0	Weekly	Daily Composite	60.0	NR	Grab	
Total Suspended Solids	00530	kg/day	261	535	Weekly	Daily Composite	NA	NR	Grab	
Trichlorophenol <sup>4</sup>	81848	µg/L	6.5	13.0	Monthly	Daily Composite	13.0	NR	Grab	2.5
Trichlorophenol <sup>4</sup>	81848	kg/day	NA	0.050	Monthly	Daily Composite	NA	NR	Grab	
Volatile Organics, Total <sup>6</sup>	78237	µg/L	NA	NA	NR	NA	---	Semi-Annual	Grab	
Zinc, Total	01092	µg/L	0.2	0.41	Quarterly	Daily Composite	0.51	NR	Grab	20
APPLICABLE 18 MONTHS AFTER THE EFFECTIVE DATE OF PERMIT										
pH, Maximum <sup>3</sup>	61941	SU	NA	NA	NR	NA	8.0	Continuous	RDM	
pH, Minimum <sup>3</sup>	61942	SU	NA	NA	NR	NA	6.5	Continuous	RDM	

## TABLE FOOTNOTES AND REMARKS

**Footnotes:**

- <sup>1</sup> The first entry in this column is the "Sample Frequency." If a "Reporting Frequency" does not follow this entry, then the "Reporting Frequency" is monthly.
- <sup>2</sup> Refer to Section 6.4 of this permit. The minimum levels ("MLs") identified in this table represent the highest acceptable MLs that shall be achieved by the Permittee's analytical methods.
- <sup>3</sup> For this parameter, the Permittee shall maintain at the facility a record of the Total Daily Flow and pH range for each operating day. The Permittee shall report on its DMR the "Average Daily Flow", "Maximum Daily Flow", and pH for each month and shall provide the record of the Total Daily Flow and pH range as an attachment to the DMR.
- <sup>4</sup> See Section 8.5.
- <sup>5</sup> Monitoring for Total Volatile Organics ("VOCs") shall be performed on a grab sample of the effluent on the same day that the aquatic toxicity sample is collected; it should not be collected as an aliquot of the aquatic toxicity composite sample. The analysis shall include all analytes listed in Table 1 – Purgeables of EPA Method 624.1. Total VOCs shall be reported as the sum of the concentrations of any analytes detected above the method detection limit. The full lab report, including minimum levels of the analytes determined to be non-detect, and the concentration of the detected analytes, shall be attached to the DMR.
- <sup>6</sup> Total Nitrogen means the sum of the concentrations of: Total Kjeldahl Nitrogen + Nitrate Nitrogen + Nitrite Nitrogen. The concentration-based value shall be multiplied by the Total Daily Flow and converted to lbs/day.

**Remarks:**

- Abbreviations used for units are as follows: °F means degrees Fahrenheit; gpd means gallons per day; kg/day means kilograms per day; lbs/day means pounds per day; mg/L means milligrams per liter; SU means Standard Units; µg/L means micrograms per liter. Other abbreviations are as follows: NA means Not Applicable; NR means Not Reportable (unless sampling is conducted relative to Section 5.4 of this permit); RDM means Range During Month.
- If "----" is noted in the limits column in the table, this means that a limit is not specified but a value must be reported on the DMR.
- Analyses that indicate that a parameter was not detected or that was detected less than the noted ML shall be reported in accordance with Section 6.6.
- In calculating average concentrations, use zeros for values reported as less than the ML.
- "Continuous", used in this table as a "Sample" or "Sample Type", means monitoring that produces one or more data points in fifteen minutes or less.

Table B – Acute Toxicity Monitoring										
Discharge Serial Number: DSN 001-AT							Monitoring Location Codes: T – Acute toxicity effluent results and chemical analyses			
Wastewater Description: Treated tissue paper manufacturing wastewater										
Monitoring Location Description: At the final effluent discharge point prior to the river water treatment wastewater connection										
Discharge is to: Hockanum River		Zone of Influence: 552,062 gallons per hour			Instream Waste Concentration: 2.21 %		Outfall Location: Latitude (41.77611°) and Longitude (-72.60667°)			
PARAMETER	NET DMR CODE	UNITS	FLOW/TIME BASED MONITORING				INSTANTANEOUS MONITORING			MINIMUM LEVEL <sup>5</sup>
			Average Monthly Limit	Minimum Daily Limit or Maximum Daily Limit <sup>1</sup>	Sample/ Reporting Frequency <sup>2, 3</sup>	Sample Type or Measurement to be reported <sup>4</sup>	Instantaneous Limit or Required Range	Sample/ Reporting Frequency	Sample Type or Measurement to be Reported	
Whole Effluent Toxicity (WET)										
Acute Aquatic Toxicity <sup>6</sup> <i>Daphnia pulex</i> , LC <sub>50</sub>	TAA3D	%	NA	≥100	Quarterly	Daily Composite	≥100	NR	Grab	
Acute Aquatic Toxicity <sup>6</sup> <i>Pimephales promelas</i> , LC <sub>50</sub>	TAA6C	%	NA	≥100	Quarterly	Daily Composite	≥100	NR	Grab	
Chemical Analyses Required with Acute Whole Effluent Toxicity Monitoring – See Section 7.1.6. for Acute Testing <sup>7</sup>										
Date of Acute WET Chemistry Sample Collection <sup>8</sup>	51883	YYYYMMDD	NA	---	Quarterly	Calculated	NA	NR	NA	
Alkalinity	00410	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Aluminum, Total	01105	µg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	10
Biochemical Oxygen Demand, 5-day (BOD <sub>5</sub> )	00310	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Chlorine, Total Residual	50060	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	0.02
Copper, Total	01042	µg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	3
Formaldehyde	71880	µg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Hardness, Total	00900	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Lead, Total	01051	µg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	1
Nitrogen, Ammonia (total as N)	00610	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Nitrogen, Kjeldahl (total as N)	00625	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Nitrogen, Nitrate (total as N)	00620	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Nitrogen, Nitrite (total as N)	00615	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Nitrogen, Total (as N) <sup>9</sup>	00600	mg/L	NA	---	Quarterly	Calculation	NA	NR	NA	
pH	00400	SU	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Specific Conductance	00095	uMhos/cm	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Total Suspended Solids	00530	mg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	
Zinc, Total	01092	µg/L	NA	---	Quarterly	Daily Composite	NA	NR	NA	20

**Table B – Acute Toxicity Monitoring**

Discharge Serial Number: <b>DSN 001-AT</b>							Monitoring Location Codes: <b>T – Acute toxicity effluent results and chemical analyses</b>			
Wastewater Description: <b>Treated tissue paper manufacturing wastewater</b>										
Monitoring Location Description: <b>At the final effluent discharge point prior to the river water treatment wastewater connection</b>										
Discharge is to: <b>Hockanum River</b>		Zone of Influence: <b>552,062 gallons per hour</b>			Instream Waste Concentration: <b>2.21 %</b>			Outfall Location: <b>Latitude (41.77611°) and Longitude (-72.60667°)</b>		
PARAMETER	NET DMR CODE	UNITS	FLOW/TIME BASED MONITORING				INSTANTANEOUS MONITORING			MINIMUM LEVEL <sup>5</sup>
			Average Monthly Limit	Minimum Daily Limit or Maximum Daily Limit <sup>1</sup>	Sample/ Reporting Frequency <sup>2, 3</sup>	Sample Type or Measurement to be reported <sup>4</sup>	Instantaneous Limit or Required Range	Sample/ Reporting Frequency	Sample Type or Measurement to be Reported	

**TABLE FOOTNOTES AND REMARKS**

**Footnotes:**

- <sup>1</sup> WET limits are expressed as a minimum daily limit, meaning the minimum allowable daily discharge over the course of the 24-hour sampling period. Chemical results analyzed in conjunction with WET tests shall be reported as the max value collected during the 24-hour sampling period.
- <sup>2</sup> The first entry in this column is the “Sample Frequency”. If a “Reporting Frequency” does not follow this entry and the “Sample Frequency” is more frequent than monthly, then the “Reporting Frequency” is monthly. If the “Sample Frequency” is specified as monthly, or less frequent, then the “Reporting Frequency” is monthly.
- <sup>3</sup> If more than one toxicity sample is collected during a single month, report subsequent WET and chemistry results as an attachment to the DMR in accordance with Section 8.2 of this permit.
- <sup>4</sup> Daily composite samples shall be collected for acute toxicity tests consistent with the methodology outlined in Section 7.1 of this permit.
- <sup>5</sup> “Minimum Level” refers to Section 6.4 of this permit.
- <sup>6</sup> Acute toxicity testing shall be conducted in accordance with Section 7.1 of this permit. The LC<sub>50</sub> results (in %) for the acute toxicity testing shall be reported on the DMR. The Aquatic Toxicity Monitoring Report (“ATMR”) shall be completed for each toxicity testing event and submitted in accordance with Section 8.2 of this permit.
- <sup>7</sup> Chemical analyses shall be conducted on samples used in the acute toxicity tests. These analyses shall be conducted on all samples used in the acute toxicity test and reported under Monitoring Location T. Results shall also be included on the ATMR and submitted in accordance with Section 8.2 of this permit.
- <sup>8</sup> The Permittee shall report the date of sample collection for the acute toxicity test and associated chemistry data in the format: year month day (YYYYMMDD).
- <sup>9</sup> Total Nitrogen means the sum of the concentrations of: Total Kjeldahl Nitrogen + Nitrate Nitrogen + Nitrite Nitrogen.

**Remarks:**

1. Abbreviations used for units are as follows: lbs/day means pounds per day; mg/L means milligrams per liter; SU means Standard Units; µg/L means micrograms per liter; uMhos/cm means micromhos per centimeter. Other abbreviations are as follows: NA means Not Applicable; NR means Not Reportable (unless sampling is conducted relative to Section 5.4 of this permit); RDS means Range During Sampling; RDM means Range During Month.
2. If “---” is noted in the limits column in the table, this means that a limit is not specified but a value must be reported on the DMR.
3. Analyses that indicate that a parameter was not detected or that was detected less than the noted ML shall be reported in accordance with Section 6.6.

**Table C – Chronic Toxicity Monitoring**

Discharge Serial Number: <b>DSN 001-CT</b>							Monitoring Location Codes: <b>Y – Chronic toxicity effluent results</b> <b>O – Day 1 chronic toxicity chemical analyses</b> <b>P – Day 3 chronic toxicity chemical analyses</b> <b>Q – Day 5 chronic toxicity chemical analyses</b> <b>R – Day 1 upstream monitoring</b> <b>S – Day 3 upstream monitoring</b> <b>T – Day 5 upstream monitoring</b>				
Wastewater Description: <b>Treated tissue paper manufacturing wastewater</b>											
Monitoring Location Description: <b>At the final effluent discharge point prior to the river water treatment wastewater connection</b>											
Discharge is to: <b>Hockanum River</b>			Zone of Influence: <b>552,062 gallons per hour</b>			Instream Waste Concentration: <b>2.21 %</b>			Outfall Location: <b>Latitude (41.77611°) and Longitude (-72.60667°)</b>		
PARAMETER	NET DMR CODE	UNITS	FLOW/TIME BASED MONITORING				INSTANTANEOUS MONITORING			MINI- MUM LEVEL <sup>4</sup>	MONIT- ORING LOCA- TION
			Average Monthly Limit	Maximum Daily Limit	Sample/ Reporting Frequency <sup>1, 2</sup>	Sample Type or Measurement to be Reported <sup>3</sup>	Instantaneous Limit or Required Range	Sample/ Reporting Frequency	Sample Type or Measurement to be Reported		
<b>Whole Effluent Toxicity (WET)</b>											
Chronic Aquatic Toxicity (Survival) <sup>5</sup> <i>Ceriodaphnia dubia</i> , C-NOEC	TOP3B	%	NA	---	Annually	Daily Composite	NA	NR	NA		Y
Chronic Aquatic Toxicity (Reproduction) <sup>5</sup> <i>Ceriodaphnia dubia</i> , C-NOEC	TPP3B	%	NA	---	Annually	Daily Composite	NA	NR	NA		Y
Chronic Aquatic Toxicity (Survival) <sup>5</sup> <i>Pimephales promelas</i> , C-NOEC	TOP6C	%	NA	---	Annually	Daily Composite	NA	NR	NA		Y
Chronic Aquatic Toxicity (Growth) <sup>5</sup> <i>Pimephales promelas</i> , C-NOEC	TPP6C	%	NA	---	Annually	Daily Composite	NA	NR	NA		Y
<b>Chemical Analyses Required with Chronic Whole Effluent Toxicity Monitoring – See Section 7.2.7. for Chronic Testing <sup>6</sup></b>											
Date of Chronic WET Chemistry Sample Collection <sup>7</sup>	51883	YYYYMMDD	NA	---	Annually	Calculated	NA	NR	NA		O, P, Q; R, S, T
Alkalinity	00410	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Aluminum, Dissolved	01106	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Aluminum, Total	01105	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA	10	O, P, Q; R, S, T
Biochemical Oxygen Demand, 5-day (BOD <sub>5</sub> )	00310	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Carbon, Dissolved Organic	00681	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Chlorine, Total Residual	50060	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA	0.02	O, P, Q; R, S, T
Copper, Dissolved	01040	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Copper, Total	01042	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA	3	O, P, Q; R, S, T

**Table C – Chronic Toxicity Monitoring**

Discharge Serial Number: <b>DSN 001-CT</b>							Monitoring Location Codes: <b>Y – Chronic toxicity effluent results</b> <b>O – Day 1 chronic toxicity chemical analyses</b> <b>P – Day 3 chronic toxicity chemical analyses</b> <b>Q – Day 5 chronic toxicity chemical analyses</b> <b>R – Day 1 upstream monitoring</b> <b>S – Day 3 upstream monitoring</b> <b>T – Day 5 upstream monitoring</b>				
Wastewater Description: <b>Treated tissue paper manufacturing wastewater</b>											
Monitoring Location Description: <b>At the final effluent discharge point prior to the river water treatment wastewater connection</b>											
Discharge is to: <b>Hockanum River</b>			Zone of Influence: <b>552,062 gallons per hour</b>			Instream Waste Concentration: <b>2.21 %</b>			Outfall Location: <b>Latitude (41.77611°) and Longitude (-72.60667°)</b>		
PARAMETER	NET DMR CODE	UNITS	FLOW/TIME BASED MONITORING				INSTANTANEOUS MONITORING			MINI- MUM LEVEL <sup>4</sup>	MONIT- ORING LOCA- TION
			Average Monthly Limit	Maximum Daily Limit	Sample/ Reporting Frequency <sup>1, 2</sup>	Sample Type or Measurement to be Reported <sup>3</sup>	Instantaneous Limit or Required Range	Sample/ Reporting Frequency	Sample Type or Measurement to be Reported		
Formaldehyde	71880	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Hardness, Total	00900	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Lead, Dissolved	01049	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Lead, Total	01051	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA	1	O, P, Q; R, S, T
Nitrogen, Ammonia (total as N)	00610	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Nitrogen, Kjeldahl (total as N)	00625	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Nitrogen, Nitrate (total as N)	00620	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Nitrogen, Nitrite (total as N)	00615	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Nitrogen, Total (as N) <sup>8</sup>	00600	mg/L	NA	---	Annually	Calculation	NA	NR	NA		O, P, Q; R, S, T
pH	00400	SU	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Specific Conductance	00095	uMhos/cm	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Total Suspended Solids	00530	mg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Zinc, Dissolved	01090	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA		O, P, Q; R, S, T
Zinc, Total	01092	µg/L	NA	---	Annually	Daily Composite	NA	NR	NA	20	O, P, Q; R, S, T

**Table C – Chronic Toxicity Monitoring**

Discharge Serial Number: <b>DSN 001-CT</b>	Monitoring Location Codes: <b>Y – Chronic toxicity effluent results</b> <b>O – Day 1 chronic toxicity chemical analyses</b> <b>P – Day 3 chronic toxicity chemical analyses</b> <b>Q – Day 5 chronic toxicity chemical analyses</b> <b>R – Day 1 upstream monitoring</b> <b>S – Day 3 upstream monitoring</b> <b>T – Day 5 upstream monitoring</b>
--	---

Wastewater Description: **Treated tissue paper manufacturing wastewater**

Monitoring Location Description: **At the final effluent discharge point prior to the river water treatment wastewater connection**

Discharge is to: <b>Hockanum River</b>	Zone of Influence: <b>552,062 gallons per hour</b>	Instream Waste Concentration: <b>2.21 %</b>	Outfall Location: <b>Latitude (41.77611°) and Longitude (-72.60667°)</b>
---	---	--	---

PARAMETER	NET DMR CODE	UNITS	FLOW/TIME BASED MONITORING				INSTANTANEOUS MONITORING			MINI- MUM LEVEL <sup>4</sup>	MONIT- ORING LOCA- TION
			Average Monthly Limit	Maximum Daily Limit	Sample/ Reporting Frequency <sup>1, 2</sup>	Sample Type or Measurement to be Reported <sup>3</sup>	Instantaneous Limit or Required Range	Sample/ Reporting Frequency	Sample Type or Measurement to be Reported		

**TABLE FOOTNOTES AND REMARKS**

**Footnotes:**

- <sup>1</sup> The first entry in this column is the “Sample Frequency”. If a “Reporting Frequency” does not follow this entry and the “Sample Frequency” is more frequent than monthly, then the “Reporting Frequency” is monthly. If the “Sample Frequency” is specified as monthly, or less frequent, then the “Reporting Frequency” is monthly.
- <sup>2</sup> If more than one toxicity sample is collected during a single month, report subsequent WET and chemistry results in accordance with Section 8.2 of this permit.
- <sup>3</sup> Daily composite samples shall be collected for chronic toxicity tests consistent with the methodology outlined in Section 7.2 of this permit.
- <sup>4</sup> “Minimum Level” refers to Section 6.4 of this permit.
- <sup>5</sup> Chronic toxicity testing shall be conducted in accordance with Section 7.2 of this permit. The C-NOEC (Chronic-No Observed Effect Concentration) results (in %) for the conditions noted in this table shall be reported on the DMR. The ATMR shall be completed for each chronic toxicity testing event and submitted in accordance with Section 8.2 of this permit.
- <sup>6</sup> Chemical analyses shall be conducted on all samples used in the chronic toxicity tests. These analyses shall be conducted on an undiluted aliquot of each effluent sample and each sample of upstream receiving water used in the chronic toxicity test. Results for effluent sampling from day 1, day 3, and day 5 of the chronic toxicity test shall be reported under Monitoring Location O, P, and Q, respectively. Receiving water (upstream) results from day 1, day 3, and day 5 of sampling shall be reported under reported under Monitoring Location R, S, and T, respectively. Results shall also be included on the ATMR and submitted in accordance with Section 8.2 of this permit.
- <sup>7</sup> The Permittee shall report the dates of sample collection for each day of chronic toxicity test chemistry sampling (days 1, 3, and 5) in the format: year month day (YYYYMMDD).
- <sup>8</sup> Total Nitrogen means the sum of the concentrations of: Total Kjeldahl Nitrogen + Nitrate Nitrogen + Nitrite Nitrogen.

**Remarks:**

1. Abbreviations used for units are as follows: mg/L means milligrams per liter; SU means Standard Units; µg/L means micrograms per liter; uMhos/cm means micromhos per centimeter. Other abbreviations are as follows: NA means Not Applicable; NR means Not Reportable (unless sampling is conducted relative to Section 5.4 of this permit).
2. If “---” is noted in the limits column in the table, this means that a limit is not specified but a value must be reported on the DMR.
3. Analyses that indicate that a parameter was not detected or that was detected less than the noted ML shall be reported in accordance with Section 6.6.

## SECTION 6: SAMPLE COLLECTION, HANDLING AND ANALYTICAL TECHNIQUES

- 6.1 All samples shall be collected, handled, and analyzed in accordance with the methods approved under 40 CFR 136, unless another method is required under 40 CFR subchapter N or unless an alternative method has been approved in writing pursuant to 40 CFR 136.5. To determine compliance with limits and conditions established in this permit, monitoring must be performed using sufficiently-sensitive methods approved pursuant to 40 CFR 136 for the analysis of pollutants having approved methods under that part, unless a method is required under 40 CFR subchapter N or unless an alternative method has been approved in writing pursuant to 40 CFR 136.5. Monitoring parameters which do not have approved methods of analysis defined in 40 CFR 136 shall be collected, handled, and analyzed in accordance with the methods in Section 6.2, below.
- 6.2 The latest, most up-to-date, of the following test method(s) as well as the following container, preservation, and hold time requirements, shall be used to analyze the parameters identified below:

PARAMETER	METHOD OF ANALYSIS	CONTAINER/PRESERVATION/MAXIMUM HOLDING TIME
Formaldehyde	EPA 1667	Per Method 1667
2,4,5-Trichlorophenol	EPA 1653	Per Method 1653
2,4,6-Trichlorophenol	EPA 1653	Per Method 1653
Pentachlorophenol	EPA 1653	Per Method 1653

- 6.3 All metals analyses identified in this permit shall refer to analyses for Total Recoverable Metal as defined in 40 CFR 136, unless otherwise specified.
- 6.4 The term Minimum Level ("ML") refers to either the sample concentration equivalent to the lowest calibration point in a method or a multiple of the method detection limit ("MDL"). MLs may be obtained in several ways: They may be published in a method; they may be sample concentrations equivalent to the lowest acceptable calibration point used by the laboratory; or they may be calculated by multiplying the MDL in a method, or the MDL determined by a lab, by a factor of 3. The MLs specified in Section 5 Tables A - C represent the minimum concentrations at which quantification must be achieved and verified during the chemical analyses for the parameters identified in Section 5 Tables A - C. Analyses for these parameters must include check standards within ten percent of the specified ML or calibration points equal to or less than the specified ML.
- 6.5 The value of each parameter for which monitoring is required under this permit shall be reported to the maximum level of accuracy and precision possible, consistent with the requirements of this Section of the permit.
- 6.6 Analyses for which quantification was verified to be below a ML, including non-detect, shall be reported as zero on the DMR for purposes of determining compliance with effluent limitations or conditions specified in this permit. The Permittee shall attach documentation demonstrating the ML of the analysis as an attachment to the DMR and identify the ML as a comment on the DMR.
- 6.7 It is a violation of this permit for a Permittee or his/her designated agent, to manipulate test samples in any manner, to delay sample shipment, or to terminate or to cause to terminate a toxicity test. Once initiated, all toxicity tests must be completed.
- 6.8 Analyses required under this permit shall be performed in accordance with CGS Section 19a-29a. An "environmental laboratory", as that term is defined in the referenced section, that is performing analyses required by this permit, shall be registered and have certification acceptable to the Commissioner, as such registration and certification is necessary.

## SECTION 7: AQUATIC TOXICITY TESTING

7.1 **ACUTE TESTING REQUIREMENTS.** The Permittee shall conduct acute aquatic toxicity testing for DSN 001-AT as follows:

7.1.1 **TEST METHOD:** Acute aquatic toxicity shall be performed as prescribed in the reference document *Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms* (EPA-821-R-02-012), or the most current version, with any exceptions or clarifications noted below.

7.1.2 **SAMPLE COLLECTION AND HANDLING:**

7.1.2.1 Composite samples shall be chilled as they are collected. Grab samples shall be chilled immediately following collection. Samples shall be held at 0-6 °C until aquatic toxicity testing is initiated.

7.1.2.2 Effluent samples shall not be dechlorinated, filtered, or modified in any way prior to testing for acute aquatic toxicity unless specifically approved in writing by the Commissioner for monitoring at this facility.

7.1.2.3 Tests for acute aquatic toxicity shall be initiated within 36 hours of sample collection.

7.1.3 **TEST SPECIES AND TEST DURATION:** Monitoring for aquatic toxicity to determine compliance with the acute toxicity limits in this permit shall be conducted as follows:

7.1.3.1 For 48-hours utilizing neonatal *Daphnia pulex* (less than 24-hours old).

7.1.3.2 For 48-hours utilizing larval *Pimephales promelas* (1-14 days old with no more than 24-hours range in age).

7.1.4 **ACUTE ENDPOINT:** Survival at 48-hours measured by LC<sub>50</sub>.

7.1.5 **TEST CONDITIONS:**

7.1.5.1 Tests for acute aquatic toxicity shall be conducted as prescribed for static non-renewal tests.

7.1.5.2 Definitive (multi-concentration) testing, with LC<sub>50</sub> as the endpoint, shall be conducted to determine compliance with limits on acute aquatic toxicity and monitoring conditions and shall incorporate, at a minimum, the following effluent concentrations:  
100%, 75%, 50%, 25%, 12.5% and 6.25%.

7.1.5.4 Synthetic freshwater prepared with deionized water adjusted to a hardness of 50 mg/L (±5 mg/L) as CaCO<sub>3</sub> shall be used as dilution water.

7.1.5.5 Organisms shall not be fed during the tests.

7.1.5.6 Copper nitrate shall be used as the reference toxicant.

7.1.5.7 Dissolved oxygen, pH, and temperature shall be measured in the control and in all test concentrations at the beginning of the test, daily thereafter, and at test termination.

7.1.5.9 Specific conductance, pH, alkalinity, hardness, and total residual chlorine shall be measured in the undiluted effluent sample and in the dilution (control) water at the beginning of the test and at test termination. If total residual chlorine is not detected at test initiation, it does not need to be measured at test termination.

- 7.1.6 **CHEMICAL ANALYSIS:** All effluent samples used in the acute toxicity test shall, at a minimum, be analyzed and results reported in accordance with the provisions listed in Section 5 Table B and Section 6.1 for the parameters identified on Section 5 Table B of the permit.
- 7.1.7 **TEST ACCEPTABILITY CRITERIA:** For the test results to be acceptable, control survival must equal or exceed 90%. If the laboratory control fails to meet test acceptability criteria for either of the test organisms at the end of the respective test period, then the test is considered invalid and the test must be repeated with a newly collected sample in accordance with Section 9.4.
- 7.1.8 **TEST COMPLIANCE:** Compliance with limits on Acute Toxicity shall be determined as follows:
- 7.1.8.1 For limits expressed as a minimum LC<sub>50</sub> value, compliance shall be demonstrated when the results of a valid definitive acute aquatic toxicity test indicates that the LC<sub>50</sub> value for the test is greater than or equal to the acute toxicity limit.
- 7.1.9 **REPORTING:** Results of acute toxicity monitoring shall be documented on an ATMR and reported to the Commissioner by the last day of the month following the month in which samples are collected in accordance with Section 8.2 of this permit. The report shall include the items identified in Section 8.2 of this permit. Endpoints to be reported are: 48-hour LC<sub>50</sub>.
- 7.2 **CHRONIC TESTING REQUIREMENTS.** The Permittee shall conduct chronic toxicity testing for DSN 001-CT as follows:
- 7.2.1 **TEST METHOD:** Chronic aquatic toxicity testing shall be performed as prescribed in the reference document *Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms*, EPA-821-R-02-013, or the most current version, with the following exceptions or clarifications noted below.
- 7.2.2 **SAMPLE COLLECTION AND HANDLING:**
- 7.2.2.1 Composite samples shall be chilled as they are being collected. Samples shall be held at 0-6 °C until chronic aquatic toxicity testing is initiated.
- 7.2.2.2 Effluent samples shall not be dechlorinated, filtered, or modified in any way prior to testing for chronic aquatic toxicity unless specifically approved in writing by the Commissioner for monitoring at this facility.
- 7.2.2.3 Tests for chronic aquatic toxicity shall be initiated within 36 hours of sample collection.
- 7.2.3 **TEST SPECIES AND TEST DURATION:** Monitoring for chronic aquatic toxicity to determine compliance with the chronic toxicity limits/conditions in the permit shall be conducted as follows:
- 7.2.3.1 For seven days utilizing neonatal *Ceriodaphnia dubia* (less 24-hours old)
- 7.2.3.2 For seven days utilizing newly-hatched *Pimephales promelas* (less 24-hours old).
- 7.2.4 **CHRONIC ENDPOINTS:**
- 7.2.4.1 *Ceriodaphnia dubia*: Survival and Reproduction
- 7.2.4.2 *Pimephales promelas*: Survival and Growth
- 7.2.5 **DILUTION WATER:** Hockanum River water shall be collected upstream (before the dam) of the area influenced by the discharge and shall be used as site control water (0% effluent) and dilution water in the toxicity tests. The Permittee shall document the dilution water sampling location by providing coordinates and/or a map of the location.

#### 7.2.6 TEST CONDITIONS:

- 7.2.6.1 Testing for chronic aquatic toxicity shall be conducted as prescribed in the reference document for static daily renewal tests.
- 7.2.6.2 Daily composite samples of the discharge and grab samples of the Hockanum River for use as site water and dilution water shall be collected on: Day 1 of the test (for test initiation and renewal on Day 2 of the test); Day 3 of the test (for test solution renewal on Day 3 and Day 4 of the test); and on Day 5 of the test, (for test solution renewal on Day 5, Day 6, and Day 7 of the test). Samples shall not be dechlorinated, pH or hardness adjusted, or chemically altered in any way.
- 7.2.6.3 Test concentrations shall be comprised of a minimum of five dilutions (100%, 50%, 25%, 12.5%, 6.25%, and 0% effluent), laboratory control water, and site dilution water.
- 7.2.6.4 Dissolved oxygen, pH, and temperature shall be measured in each sample of effluent and the Hockanum River water sample prior to and immediately following renewal of the test solutions.
- 7.2.6.5 Synthetic freshwater prepared with deionized water adjusted to a hardness of 50 mg/l ( $\pm 5$  mg/l) as  $\text{CaCO}_3$  prepared as described in *Short-Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms* (EPA-821-R-02-013) shall be used as laboratory control water.
- 7.2.7 **CHEMICAL ANALYSIS:** Chemical analysis for the parameters identified in Section 5 Table C of the permit shall be conducted on an undiluted aliquot of each effluent sample and each sample of upstream Hockanum River used in the test. The chemical analysis shall be analyzed and results reported in accordance with the provisions listed in Section 5 Table C and Section 6.1 of the permit.
- 7.2.8 **TEST ACCEPTABILITY CRITERIA:** If the laboratory control fails to meet test acceptability criteria specified in the reference document for either of the test organisms at the end of the respective test period, then the test is considered invalid and the test must be repeated.
- 7.2.9 **REPORTING:** A report detailing the results of the chronic toxicity monitoring shall be documented on an ATMR and submitted to the Commissioner by the last day of the month following the month in which samples were collected in accordance with Section 8.2 of this permit. The report shall include the items identified in Section 8.2 of this permit. Endpoints to be reported are: 48-hour  $\text{LC}_{50}$  (survival), 7-day  $\text{LC}_{50}$  (survival), 7-day C-NOEC (survival), 7-day C-LOEC (survival), 7-day C-NOEC (growth), 7-day C-LOEC (growth), 7-day C-NOEC (reproduction), 7-day C-LOEC (reproduction), 7-day  $\text{IC}_{25}$  (growth and reproduction).

### SECTION 8: REPORTING REQUIREMENTS

- 8.1 The results of chemical analyses and any aquatic toxicity test required by this permit shall be submitted electronically using NetDMR. Monitoring results shall be reported at the monitoring frequency specified in this permit. Any monitoring required more frequently than monthly shall be reported on an attachment to the DMR, and any additional monitoring conducted in accordance with 40 CFR 136, or another method required for an industry-specific waste stream under 40 CFR subchapter N, or other methods approved by the Commissioner, shall also be included on the DMR, or as an attachment, if necessary, and the results of such monitoring shall be included in the calculation and reporting of the data submitted in the DMR. Calculations for all limitations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified by the Commissioner in the permit. All aquatic toxicity reports shall also be included as an attachment to the DMR. A report shall also be included with the DMR which includes a detailed explanation of any violations of the limitations specified. DMRs, attachments, and reports, shall continue to be submitted electronically in accordance with Section 8.4 below. However, if the DMRs, attachments, and reports are required to be submitted in hard copy form, they shall be received at this address by the last day of the month following the month in which samples are collected:

Bureau of Materials Management and Compliance Assurance  
Water Permitting and Enforcement Division (Attn: DMR Processing)  
Connecticut Department of Energy and Environmental Protection  
79 Elm Street  
Hartford, CT 06106-5127

- 8.2 The ATMR associated with aquatic toxicity monitoring shall include all applicable items identified in Section 12 of EPA-821-R-02-012 and in Section 10 of EPA-821-R-02-013, including complete and accurate aquatic toxicity test data, including percent survival of test organisms in each replicate test chamber, LC<sub>50</sub> values and 95% confidence intervals for definitive test protocols, and all supporting chemical/physical measurements performed in association with any aquatic toxicity test, including measured daily flow and hours of operation for the 30 consecutive operating days prior to sample collection. The ATMR shall be submitted electronically as an attachment to the DMR and via email to: DEEP.IndustrialWETReports@ct.gov. The ATMR required by Sections 5 and 7 shall be received at this address by the last day of the month following the month in which the samples are collected.
- 8.3 If this permit requires monitoring of a discharge on a calendar basis (e.g., monthly, quarterly, etc.), but a discharge has not occurred within the frequency of sampling specified in the permit, the Permittee must submit the DMR and ATMR, as scheduled, indicating no discharge has occurred using NODI Code C "NO DISCHARGE". For those permittees whose required monitoring is discharge dependent (e.g., per batch), the minimum reporting frequency is monthly. Therefore, if there is no discharge during a calendar month for a batch discharge, a DMR must be submitted indicating such by the end of the following month.
- 8.4 NetDMR Reporting Requirements:
- The Permittee shall report electronically using NetDMR, a web-based tool that allows permittees to electronically submit DMRs and other required reports through a secure internet connection. The Permittee and/or the signatory authority shall electronically submit DMRs required under this permit to the Commissioner using NetDMR in satisfaction of the DMR submission requirements of Sections 5, 6, 7, 8 and 9 of this permit. All sampling and monitoring records required under the permit, including any monitoring conducted more frequently than monthly or any additional monitoring conducted in accordance with 40 CFR 136, shall be submitted to the Commissioner as an electronic attachment to the DMR in NetDMR. The Permittee shall also electronically file any written report of noncompliance described in Section 9 of this permit as an attachment in NetDMR. DMRs shall be submitted electronically to the Commissioner no later than the last day of the month following the completed reporting period. NetDMR is accessed from: <http://www.epa.gov/netdmr>.
- 8.5 Pentachlorophenol (PCP) and Trichlorophenol (TCP) Monitoring: In accordance with [40 CFR 430.124](#) (Pulp, Paper and Paperboard Category, Subpart L), the Permittee is authorized to forego monitoring of PCP and TCP, provided the following:
- 8.5.1 Chlorophenolic-containing biocides shall not be used in any of the facility operations.
- 8.5.2 The Permittee shall attach an annual statement to the DMR for the month of January, certifying there has been no use of PCP and TCP at the facility since filing of the last certification. This certification statement shall be as follows:
- "Based on my inquiry of the person or persons directly responsible for managing compliance with the *Effluent limitations representing the degree of effluent reduction attainable by the application of the best available technology economically achievable (BAT)* 40 CFR 430.124 (The Pulp, Paper, and Paperboard Point Source Category), I certify that, to the best of my knowledge and belief, there has been no use of **pentachlorophenol** and **trichlorophenol** at the facility since filing of the last certification."
- 8.5.3 In the event that any of these chemical parameters are found to be present or are expected to be present based on changes that occur in the Permittee's operations, the Permittee shall notify DEEP and must immediately comply with the monitoring requirements provided in Section 5 above.

- 8.5.4 On or before fifty-four (54) months after the effective date of this permit, the Permittee shall collect a representative sample of DSN 001-1 and analyze for PCP and TCP according to Section 6.2 and 6.4. The results shall be reported in NetDMR.

## **SECTION 9: RECORDING AND REPORTING OF VIOLATIONS, ADDITIONAL TESTING REQUIREMENTS**

### **9.1 *Noncompliance Notifications:***

- 9.1.1 In accordance with Section 22a-430-3(j)(8), 22a-430-3(j)(11)(D), 22a-430-3(k)(4), and 22a-430-3(i)(3) of the RSCA, the Permittee shall notify the Commissioner of the following actual or anticipated noncompliance with the terms or conditions of this permit within two hours of becoming aware of the circumstances. All other actual or anticipated violations of the permit shall be reported to the Commissioner within 24 hours of becoming aware of the circumstances:
- 9.1.1.1 A noncompliance that is greater than two times an effluent limitation;
- 9.1.1.2 A noncompliance of any minimum or maximum daily limitation or excursion beyond a minimum or maximum daily range;
- 9.1.1.3 Any condition that may endanger human health or the environment, including but not limited to noncompliance with whole effluent toxicity WET limitations;
- 9.1.1.4 A failure or malfunction of monitoring equipment used to comply with the monitoring requirements of this permit;
- 9.1.1.5 Any actual or potential bypass of the Permittee's collection system or treatment facilities; or
- 9.1.1.6 Expansions or significant alterations of any wastewater collection, treatment facility, or its method of operation for the purpose of correcting or avoiding a permit violation.
- 9.1.2 Notifications shall be submitted via the Commissioner's online Noncompliance Notification Form: <https://portal.ct.gov/deep/water-regulating-and-discharges/industrial-wastewater/compliance-assistance/notification-requirements>.
- 9.1.3 Within five days of any notification of noncompliance in accordance with Sections 9.1.1.1 through 9.1.1.6 of this permit, the Permittee shall submit a follow-up report using the Commissioner's online Noncompliance Follow-up Report Form: <https://portal.ct.gov/deep/water-regulating-and-discharges/industrial-wastewater/compliance-assistance/notification-requirements>.
- The follow-up report shall contain, at a minimum, the following information: (i) A description of the noncompliance and its cause; (ii) the period of noncompliance, including exact dates and times; (iii) if the noncompliance has not been corrected, the anticipated time it is expected to continue; and (iv) steps taken or planned to correct the noncompliance and reduce, eliminate and prevent recurrence of the noncompliance.
- 9.1.4 Within 30 days of any notification of facility modifications reported in accordance with Section 9.1.1.6 of this permit, the Permittee shall submit a written follow-up report by submitting a "Facility and Wastewater Treatment System Modification Request for Determination" for the review and approval of the Commissioner. The report shall fully describe the changes made to the facility and reasons therefor.
- 9.1.5 Notification of an actual or anticipated noncompliance or facility modification does not stay any term or condition of this permit.

- 9.2 In accordance with Section 22a-430-3(j)(11)(E) of the RSCA, the Permittee shall notify the Commissioner within 72 hours and in writing within 30 days when he or she knows or has reason to believe that the concentration in the discharge of any substance listed in the application, or any toxic substance as listed in Appendix B or D of RSCA Section 22a-430-4, has exceeded or will exceed the highest of the following levels: (1) One hundred micrograms per liter; (2) Two hundred micrograms per liter for acrolein and acrylonitrile, five hundred micrograms per liter for 2,4-dinitrophenol and for 2-methyl-4, 6-dinitrophenol; and one milligram per liter for antimony; (3) An alternative level specified by the Commissioner, provided such level shall not exceed the level which can be achieved by the Permittee's treatment system; or (4) A level two times the level specified in the Permittee's application.

72-hour initial notifications shall be submitted via the Commissioner's online Noncompliance Notification Form. 30-day follow-up reports shall be submitted via the Commissioner's online Noncompliance Follow-up Report Form. The Forms are available at the Commissioner's website, here: <https://portal.ct.gov/deep/water-regulating-and-discharges/industrial-wastewater/compliance-assistance/notification-requirements>.

- 9.3 In addition to any other written reporting requirements, the Permittee shall report any instances of noncompliance with this permit with its DMR. Such reporting shall be due no later than the last day of the month following the reporting period in which the noncompliant event occurred. The information provided in the DMR shall include, at a minimum: the type of violation, the duration of the violation, the cause of the violation, and any corrective action(s) or preventative measure(s) taken to address the violation.
- 9.4 If any sample analysis indicates that an aquatic toxicity effluent limitation in Section 5 of this permit has been exceeded, or that the test was invalid, another sample of the effluent shall be collected and tested for aquatic toxicity and associated chemical parameters, as described above in Sections 5 and 7. The exceedance or invalid test shall be reported to Commissioner in accordance with Section 9.1. The results shall be submitted to the Commissioner within 30 days of the exceedance or invalid test. The results and the associated ATMR shall be reported in accordance with Sections 5 and 8.2 of the permit. Results of all tests, whether valid or invalid, shall be reported. If more than one toxicity sample is collected during a single month, report subsequent WET and chemistry results as an attachment to the DMR in accordance with Section 8.2.
- 9.5 If any two consecutive test results or any three test results in a twelve-month period indicate that an aquatic toxicity limit has been exceeded, the Permittee shall immediately take all reasonable steps to eliminate toxicity wherever possible and shall also submit a report, for the review and written approval of the Commissioner, which describes in detail the steps taken or that shall be taken to eliminate the toxic impacts of the discharge on the receiving water and it shall also include a proposed schedule for implementation. Such report shall be submitted in accordance with the timeframe set forth in Section 22a-430-3(j)(10)(C) of the RSCA. The Permittee shall implement all actions in accordance with the approved report and schedule.

## SECTION 10: COMPLIANCE SCHEDULE

- 10.1 **THERMAL VERIFICATION SUTDY.** Pursuant to Section 316(a) of the Federal Water Pollution Control Act, 33 U.S.C. § 1326(a) regarding the thermal component of the discharge, the Permittee shall comply with the following to verify that the thermal discharge from DSN 001-1 will not cause or contribute to an instream water quality violation of the ambient daily maximum and maximum allowable increase in temperature of 4°F:

- 10.1.1 **SCOPE OF STUDY:** On or before six (6) months after the date of issuance of this permit, the Permittee shall submit for the Commissioner's review, a scope of study for the thermal verification required in Section 10.2 of this permit. The scope of study shall provide all necessary details on how the study will be performed and shall include a schedule that identifies study commencement and completion dates. The scope of study shall include at a minimum:

- 10.1.1.1 In situ sampling during summer (July – September) and winter (January – March) with vertical plume monitoring, and summer mapping occurring at or near 7Q10 conditions;

- 10.1.1.2 Upstream and downstream sampling locations;
- 10.1.1.3 Hydrographic and real time temperature surveys;
- 10.1.1.4 Thermal plume mappings;
- 10.1.1.5 Record of both the rate of discharge (gph) during the study, and total daily flow for each mapping; and
- 10.1.1.6 Record of the river flow during the mapping obtained from the USGS gage 01192500 in East Hartford, including the hydrographs.
- 10.1.2 **FIELD VERIFICATION:** On or before two (2) years after the DEEP's concurrence of the scope of study, the Permittee shall conduct a field verification study of the thermal discharge impact to the Hockanum River.
- 10.1.3 **REPORT SUBMITTAL:** On or before four (4) months from completing the field verification study, the Permittee shall submit a Thermal Verification Report describing the results of this study for the Commissioner's review. The study shall include but not be limited to all in situ data collected and analyzed in an electronic and editable format, thermal plume mapping reflecting the current outfall release cross-sectional area and potential aquatic impacts within wetlands and watercourse(s) in the thermal plume. The thermal plume mapping shall include, at a minimum:
  - 10.1.3.1 Map of the nearfield area, circumscribed by a radial distance extending outward from the location of the discharge (DSN 001-1) into the receiving water body, at a scale of no greater than 100 feet per inch. Such map shall also delineate the location of any watercourses, discharges, designated tidal wetlands, and structural features such as bridges and culverts. The cross-sectional bathymetry for any areas where the thermal data is different than expected;
  - 10.1.3.2 Thermal isotherms delineating the areal extent of the plume equivalent to a  $\Delta T$  of 4°F and a maximum temperature of 85°F or ambient temperature, if ambient temperature is above 85°F in increments of 1°F. Isotherms shall be labeled for both maximum temperature and maximum temperature increase beginning at the outfall and at  $\Delta T$  of 4°F intervals. Isotherms should be labeled from point of discharge until the thermal component of that plume has been reduced to ambient temperatures both horizontally and vertically. Nearfield temperature increases should be well documented to determine the localized effect of high temperature discharges;
  - 10.1.3.3 Measurements will be taken during the summer months (July – September) and winter months (January - March), during a normal operating day;
  - 10.1.3.4 The report should compare conditions on the days of the study to 7Q10 conditions and extrapolate the plume contours expected under 7Q10 conditions; and
  - 10.1.3.5 Sampling and water quality data should be provided as an excel spreadsheet, and contour lines, monitoring locations, and bathymetry should be provided as an Arc GIS Pro geospatial project using the State Plane Connecticut FIPS coordinate system.
- 10.2 **PER – AND POLYFLUOROALKYL SUBSTANCES (“PFAS”) SAMPLING PLAN.** On or before thirty (30) days after the effective date of this permit, the Permittee shall employ or retain one or more qualified professionals acceptable to the Commissioner to prepare the documents and implement or oversee the actions required by this section of the permit and shall, by that date, notify the Commissioner in writing of the identity of such professionals. Such professionals employed or retained by the Permittee shall have demonstrated knowledge of PFAS and the sampling protocols and analytical laboratory methods associated with identifying and quantifying PFAS. The Permittee shall employ or retain one or more qualified professionals acceptable to the Commissioner until the actions required by this section of the permit have

been completed, and within ten (10) days after employing or retaining any professional(s) other than one(s) originally identified under this paragraph, the Permittee shall notify the Commissioner in writing of the identity of such other professional. The Permittee shall submit to the Commissioner a description of the professional's education, experience, and training, which is relevant to the work required by this permit within ten (10) days after a request for such a description. Nothing in this paragraph shall preclude the Commissioner from finding a previously acceptable professional unacceptable.

- 10.2.1 **PLAN SUBMITTAL:** On or before one-hundred and twenty (120) days after the effective date of this permit, the Permittee shall submit for the Commissioner's review and approval a sampling plan for the analysis of PFAS in the intake and DSN 001-1 using sufficiently sensitive test methods. PFAS analyses shall be performed using the methods approved by EPA pursuant to 40 CFR 136 and performed by a lab certified by Connecticut Department of Public Health. If no such test method is approved by EPA pursuant to 40 CFR 136, PFAS analyses shall be performed in accordance with EPA Method 1633 (see <https://www.epa.gov/cwa-methods/cwa-analytical-methods-and-polyfluorinated-alkyl-substances-pfas>). The sampling plan must indicate at least two sampling events of the prescribed discharge. At a minimum this plan must identify the test method, laboratory, and sampling protocols including sample quality control procedures to be implemented.
- 10.2.2 **CONDUCT PFAS SAMPLING:** On or before thirty (30) days after the Commissioner's approval, the Permittee shall conduct PFAS sampling in accordance with the approved plan and shall submit the analytical report to DEEP within thirty (30) days of receiving the results
- 10.3 **pH EFFLUENT LIMITS.** The Permittee shall achieve compliance with the pH effluent limitations in Table A of Section 5 of this permit as soon as possible, but in no event later than 18 months after the effective date of this permit, in accordance with the following:
- 10.3.1 **COMPLIANCE PLAN.** On or before 90 days after the date of issuance of this permit, the Permittee shall submit for the Commissioner's review and written approval a comprehensive plan and thorough report which describes and evaluates alternative actions which may be taken by the Permittee to achieve compliance with the pH limitations in Section 5 of this permit. Such report shall:
- 10.3.1.1 Evaluate alternative actions to achieve compliance with Section 5 limits including, but not limited to, pollutant source reduction, process changes/innovations, chemical substitutions, recycle and zero discharge systems, water conservation measures, and other internal and/or end-of-pipe treatment technologies;
  - 10.3.1.2 State in detail the most expeditious schedule for performing each alternative;
  - 10.3.1.3 List all permits and approvals required for each alternative, including but not limited to any permits required under Sections 22a-32, 22a-42a, 22a-342, 22a-361, 22a-368 or 22a-430 of the CGS;
  - 10.3.1.4 Propose a preferred alternative or combination of alternatives with supporting justification; and
  - 10.3.1.5 Propose a detailed program and schedule, including the start and anticipated end dates, to perform all actions required by the preferred alternative including but not limited to a schedule for submission of engineering plans and specifications on any internal and/or end of pipe treatment facilities, start and completion of any construction activities related to any treatment facilities, and applying for and obtaining all permits and approvals required for such actions.
- 10.4 **SEMI-ANNUAL STATUS REPORTS.** The Permittee shall submit to the Commissioner semi-annual status reports on June 30th and December 31st of each year, beginning sixty (60) days after the date of approval of the report referenced in Sections 10.1 - 10.3. Status reports shall include the following:
- 10.4.1 A description of the work performed by the Permittee during the past six (6) months towards

compliance with Sections 10.1 - 10.3 above;

- 10.4.2 An assessment of whether the Permittee is on schedule to comply with the compliance deadline; and
- 10.4.3 If the Permittee is not on-track to comply with the compliance deadline, the steps the Permittee will take to comply.
- 10.4.4 Status reports of Section 10.1 shall include the start and anticipated end dates of the studies, fieldwork, and anticipated report submission date.
- 10.5 **CERTIFICATION OF ACTIONS.** The Permittee shall perform the approved actions in accordance with the approved schedule. Within fourteen (14) days after completing such actions, the Permittee shall certify to the Commissioner in writing that the actions have been completed as reviewed/approved.
- 10.6 **COMMISSIONER APPROVAL.** The Permittee shall use best efforts to submit to the Commissioner all documents required by this section of the permit in a complete and approvable form. If the Commissioner notifies the Permittee that any document or other action is deficient, and does not approve it with conditions or modifications, it is deemed disapproved, and the Permittee shall correct the deficiencies and resubmit it within the time specified by the Commissioner or, if no time is specified by the Commissioner, within thirty days of the Commissioner's notice of deficiencies. In approving any document or other action under this Compliance Schedule, the Commissioner may approve the document or other action as submitted or performed or with such conditions or modifications as the Commissioner deems necessary to carry out the purposes of this section of the permit. Nothing in this paragraph shall excuse noncompliance or delay.
- 10.7 **DATES.** The date of submission to the Commissioner of any document required by this section of the permit shall be the date such document is received by the Commissioner. The date of any notice by the Commissioner under this section of the permit, including but not limited to notice of approval or disapproval of any document or other action, shall be the date such notice is personally delivered or the date three (3) days after it is mailed by the Commissioner, whichever is earlier. Except as otherwise specified in this permit, the word "day" as used in this section of the permit means calendar day. Any document or action which is required by this section only of the permit, to be submitted, or performed, by a date which falls on, Saturday, Sunday, or, a legal Connecticut or federal holiday, shall be submitted or performed on or before the next day which is not a Saturday, Sunday, or legal Connecticut or federal holiday.
- 10.8 **NOTIFICATION OF NONCOMPLIANCE.** Except as otherwise provided in this permit, in the event that the Permittee becomes aware that it did not or may not comply, or did not or may not comply on time, with any requirement of this section of the permit or of any document required hereunder, the Permittee shall immediately notify the Commissioner and shall take all reasonable steps to ensure that any noncompliance or delay is avoided or, if unavoidable, is minimized to the greatest extent possible. In so notifying the Commissioner, the Permittee shall state in writing the reasons for the noncompliance or delay and propose, for the review and written approval of the Commissioner, dates by which compliance will be achieved, and the Permittee shall comply with any dates that may be approved in writing by the Commissioner. Notification by the Permittee shall not excuse noncompliance or delay, and the Commissioner's approval of any compliance dates proposed shall not excuse noncompliance or delay unless specifically so stated by the Commissioner in writing.
- 10.9 **NOTICE TO COMMISSIONER OF CHANGES.** Within fifteen (15) days of the date the Permittee becomes aware of a change in any information submitted to the Commissioner under this section of the permit, or that any such information was inaccurate or misleading or that any relevant information was omitted, the Permittee shall submit the correct or omitted information to the Commissioner.
- 10.10 **SUBMISSION OF DOCUMENTS.** Any document, other than a discharge monitoring report, required to be submitted to the Commissioner under Section 10 or 11 of the permit shall, unless otherwise specified in writing by the Commissioner, be directed to:

[DEEP.IndustrialNPDESCompliance@ct.gov](mailto:DEEP.IndustrialNPDESCompliance@ct.gov) with the subject line "Dunn Paper – CT0002127"

## SECTION 11: ALUMINUM OPTIMIZATION PLAN

- 11.1 On or before 180 days after the effective date of this permit, the Permittee shall develop and submit for the Commissioner's review an Aluminum Optimization Plan ("Plan") to minimize aluminum discharged through DSN 001-1.
- 11.1.1 **QUALIFIED PROFESSIONAL.** On or before thirty (30) days after the date of issuance of this permit, the Permittee shall retain one or more qualified professionals acceptable to the Commissioner to prepare the documents and implement or oversee the actions required by this section of the permit and shall, by that date, notify the Commissioner in writing of the identity of such professional. The Permittee shall retain one or more qualified professionals acceptable to the Commissioner until the actions required by this section of the permit have been completed, and within ten (10) days after retaining any professional other than one originally identified under this paragraph, the Permittee shall notify the Commissioner in writing of the identity of such other professional. The professional retained to perform the Plan shall be a qualified professional with experience in the operational and/or design of industrial wastewater treatment facilities. The Permittee shall submit to the Commissioner a description of a professional's education, experience, and training that is relevant to the work required by this permit within ten (10) days after a request for such a description. Nothing in this paragraph shall preclude the Commissioner from finding a previously acceptable professional unacceptable.
- 11.1.2 **CONTENTS OF THE PLAN.** The Plan shall evaluate and identify methods for the Permittee to minimize aluminum discharged through DSN 001-1 to the Hockanum River by implementing optimization techniques that minimize the aluminum discharge using primarily existing facilities and equipment, to the maximum extent practicable. At a minimum the Plan shall:
- 11.1.2.1 Evaluate current and alternative methods of operating the Permittee's manufacturing and wastewater treatment facility, including operational, process, treatment, material, and chemical substitutions, and equipment changes to reduce aluminum from the DSN 001-1 discharge. At a minimum, the methods evaluated shall include: operational and process changes to enhance effluent aluminum removal by the wastewater treatment facility; optimization of chemical usage and feed systems to minimize aluminum entering the wastewater discharge; chemical or material substitutions to eliminate or reduce aluminum entering the wastewater treatment facility; and pollution prevention and source reduction strategies to minimize aluminum usage at the manufacturing facility and entering the wastewater discharge;
- 11.1.2.2 Determine which current or alternative methods will be most effective at minimizing aluminum levels in the discharge. Current methods of operating the facility may be most effective at minimizing aluminum if demonstrated by the Section 11.1.2.1 of this permit; and
- 11.1.2.3 Include a proposed implementation schedule for those methods which were determined to be most effective at minimizing aluminum.
- 11.1.3 **IMPLEMENTATION.** The Permittee shall implement the Plan sixty (60) days following submittal to the Commissioner, unless the Commissioner rejects the Plan prior to that date.
- 11.1.4 **ANNUAL REPORTS.** The Permittee shall submit to the Commissioner annual status reports as an attachment to the January DMR. Status reports shall include, but not be limited to, a detailed description of progress made by the Permittee in performing actions required by this section of the permit in accordance with the proposed schedule including, but not limited to, a description of the optimization methods implemented under the Plan during the previous calendar year; whether the techniques are performing as expected; and the aluminum discharge trends relative to the previous year.
- 11.1.5 **PLAN REVISIONS.** The Permittee shall revise and maintain the Plan upon the Commissioner's request or by the Permittee to address equipment or operational changes.

This permit is hereby issued on [**To be determined**].

---

JENNIFER PERRY, P.E.  
Bureau Chief

JP/ JG

DRAFT

# National Pollutant Discharge Elimination System Permit Factsheet

## SECTION 1 - FACILITY SUMMARY

<b>Applicant</b>	Dunn Paper – East Hartford, LLC
<b>Permit No.</b>	CT0002127
<b>Application No.</b>	201301708
<b>Date Application Received</b>	April 1, 2013
<b>Location Address</b>	40 Forbes Street, East Hartford, CT 06108
<b>Facility Contact</b>	Jeffrey Brashich, Environmental Engineer Office Phone: 860-466-4181 Email: <a href="mailto:BrashichJ@BiOriginSP.com">BrashichJ@BiOriginSP.com</a>
<b>Mailing Address</b>	40 Forbes Street, East Hartford, CT 06108
<b>DMR Contact</b>	Jeffrey Brashich Office Phone: 860-466-4181 Email: <a href="mailto:BrashichJ@BiOriginSP.com">BrashichJ@BiOriginSP.com</a>
<b>Secretary of State Business Id</b>	0741767
<b>Permit Term</b>	5 Years
<b>Permit Category</b>	National Pollutant Discharge Elimination System – Industrial Major
<b>SIC &amp; NAICS Code(S)</b>	2621, 322121
<b>Applicable Effluent Guidelines</b>	40 CFR 430 Subpart L
<b>Permit Type</b>	Reissuance
<b>Ownership</b>	Private
<b>Receiving Water</b>	Hockanum River
<b>Waterbody Segment Id's</b>	CT4500-00_01
<b>Waterbody Classification</b>	B
<b>Discharge Locations</b>	DSN 001: Latitude 41.77611 Longitude -72.60667
<b>Compliance Actions</b>	Compliance schedule for PFAS monitoring & thermal study
<b>Deep Staff Engineer</b>	Joseph Grandelski, 860-424-3608 <a href="mailto:Joseph.grandelski@ct.gov">Joseph.grandelski@ct.gov</a>

## **TABLE OF CONTENTS**

SECTION 1 - FACILITY SUMMARY.....	1
1.1    PERMIT FEES.....	4
1.1.1    APPLICATION FEE: .....	4
1.1.2    ANNUAL FEE:.....	4
1.2    APPLICATION SUBMITTAL INFORMATION.....	4
1.3    OTHER PERMITS .....	4
1.4    FACILITY DESCRIPTION .....	5
1.5    DESCRIPTION OF INDUSTRIAL PROCESS .....	5
1.6    TREATMENT SYSTEM DESCRIPTION.....	5
1.6.1    RAW WATER TREATMENT .....	5
1.6.2    PROCESS WATER TREATMENT.....	6
1.6.3    SOLIDS TREATMENT .....	6
1.7    FACILITY CHANGES.....	6
1.8    COMPLIANCE HISTORY .....	8
1.9    GENERAL ISSUES RELATED TO THE APPLICATION .....	9
1.9.1    FEDERALLY RECOGNIZED INDIAN LAND.....	9
1.9.2    COASTAL AREA/COASTAL BOUNDARY .....	9
1.9.3    ENDANGERED SPECIES.....	9
1.9.4    AQUIFER PROTECTION AREAS .....	9
1.9.5    CONSERVATION OR PRESERVATION RESTRICTION .....	10
1.9.6    PUBLIC WATER SUPPLY WATERSHED.....	10
SECTION 2 - RECEIVING WATER BODY INFORMATION .....	10
2.1    DESIGNATED USES .....	10
2.2    IMPAIRMENTS AND TMDLS .....	10
SECTION 3 - PERMIT CONDITIONS AND EFFLUENT LIMITATIONS .....	11
3.1    POLLUTANTS OF CONCERN.....	11
3.2    BASIS FOR LIMITS .....	12
3.3    EFFLUENT LIMIT GUIDELINES.....	12
3.3.1    TECHNOLOGY BASED EFFLUENT LIMITATIONS.....	13
3.4    WATER QUALITY BASED EFFLUENT LIMITATIONS.....	14
3.4.1    WATERBODY AMBIENT CONDITIONS.....	15
3.4.2    ZONE OF INFLUENCE.....	16
3.4.3    REASONABLE POTENTIAL ANALYSIS.....	16
3.4.4    WHOLE EFFLUENT TOXICITY .....	17

3.4.5	THERMAL EVALUATION .....	18
3.5	COMPARISON OF LIMITS .....	20
3.6	SAMPLING FREQUENCY, TYPE, AND REPORTING .....	21
3.6.1	SUFFICIENTLY SENSITIVE METHODS: .....	22
3.7	OTHER PERMIT CONDITIONS .....	22
3.8	COMPLIANCE SCHEDULE.....	23
3.9	ANTIDegradation EVALUATION .....	23
3.10	ANTI-BACKSLIDING.....	24
3.11	COOLING WATER INTAKE STRUCTURE §316(B).....	24
3.12	VARIANCES AND WAIVERS .....	24
3.13	E-REPORTING .....	24
SECTION 4 - SUMMARY OF NEW PERMIT CONDITIONS AND LIMITS FROM THE PREVIOUS PERMIT .....		25
SECTION 5 - PUBLIC PARTICIPATION PROCEDURES .....		27
5.1	INFORMATION REQUESTS .....	27
5.2	PUBLIC COMMENT .....	27

## 1.1 PERMIT FEES

### 1.1.1 APPLICATION FEE:

FEE	INVOICE NO.	AMOUNT	DATE PAID
Filing Fee:	DEP217941	\$1,300	04/01/2013
Processing Fee:	DEP220556	\$13,650	05/26/2015

### 1.1.2 ANNUAL FEE:

WASTEWATER CATEGORY (per RCSA 22a-430-7)	SUBCATEGORY (total maximum daily flow, gallons per day)	DSN	ANNUAL FEE (per RCSA 22a-430- 7 and CGS 22a-6f)
Pulp and Paper Mills	>50,000 gpd	001-1	\$8,425
<b>TOTAL</b>			<b>\$8,425</b>

## 1.2 APPLICATION SUBMITTAL INFORMATION

On April 1, 2013, the Department of Energy and Environmental Protection (“DEEP”) received an application (Application 201301708) from Cellu Tissue, LLC dba Clearwater Paper – East Hartford (“Permittee”, “Applicant”) in East Hartford, CT for the renewal of its NPDES Permit CT0002127, expiring on October 6, 2013 (“the previous permit”). Consistent with the requirements of Section 22a-6g of the Connecticut General Statutes (“CGS”), the Applicant caused a Notice of Permit Application to be published in The Hartford Courant on September 19, 2013. On May 17, 2013, the application was determined to be timely and administratively sufficient.

On July 8, 2015, DEEP approved a license transfer from Cellu Tissue LLC to Dunn Paper – East Hartford, LLC (“Dunn Paper”) for NPDES Permit CT0002127 and NPDES Permit Renewal Application 201301708.

The Permittee seeks authorization for the following in Application 201301708:

DSN	PROPOSED AVERAGE DAILY FLOW (gpd)	PROPOSED MAXIMUM DAILY FLOW (gpd)	PROPOSED WASTESTREAMS	TREATMENT TYPE	DISCHARGE TO
001	300,000	500,000	Tissue paper manufacturing wastewater	pH adjustment, coagulation, flocculation, solids removal with dissolved air floatation, ultraviolet (“UV”), and a disc filter	Hockanum River

## 1.3 OTHER PERMITS

The Permittee has permit coverage for other wastewater discharges under the following permitting mechanisms:

- Stormwater from the site is permitted under the *General Permit for the Discharge of Stormwater Associated with Industrial Activity* (GSI001634).
- Water treatment wastewater is permitted under the *Comprehensive General Permit for Discharges to Surface Water and Groundwater* (CTCSW0043), which includes River Adams Filter backwash and treated river water from the Dynasand filter.

- Miscellaneous wastewaters from the site are permitted under the *General Permit for the Discharge of Wastewaters from Significant Industrial Users* (CTSIU0085), which includes water treatment wastewater from the Parkson Lamellar gravity settler and Dynasand filter, boiler blowdown from two natural gas boilers, and other process wastewater from blowdown of the Heat Recovery Steam Generator (HRSG).
- Other paper mill wastewater is permitted under Pretreatment Permit SP0002347, which includes wastewater collected in floor drains from the machine room, converting area, and boiler/motor room, from the surge tank, and filtrate from the sludge press and dewatering drum.

The Permittee also has a diversion permit (DIV-201105690) that authorizes the consumptive diversion of 0.850 million gallons per day (“MGD”) of Hockanum River water and return of diverted water, after in-mill treatment, to the river.

## **1.4 FACILITY DESCRIPTION**

Dunn Paper is a specialty tissue paper manufacturing facility located in East Hartford, CT on 3.5 acres. Paper manufacturing operations have occurred at this site since 1811, prior to which the site operated as a saw mill as early as 1789 (<https://connecticutmills.org/find/details/j.h.-walker-company>). The Permittee has maintained a NPDES permit since 1974.

## **1.5 DESCRIPTION OF INDUSTRIAL PROCESS**

Dunn Paper – East Hartford, LLC is a business that performs tissue paper manufacturing. Pulp, purchased from suppliers, is mixed with water, beaten into a fiber slurry and through a series of steps, the slurry is conditioned mechanically and with chemicals to obtain the desired properties and consistency. The fiber slurry is transferred to the paper machine where it forms a large sheet. As the sheet passes through the paper machine, water is removed. Finally, the sheet is dried in a Yankee Dryer, wound onto rolls, and then cut to the customers’ required sizes. The tissue is processed into final products at the customers’ locations, which includes products such as hygiene and sanitary products, and medical supplies.

The mill and wastewater treatment system operates 24 hours per day, 7 days per week. Dunn Paper operates one paper machine (PM No. 2). PM No. 1 was idled in 2015, with no current plans to be brought back online. The wastewater is discharged to the Hockanum River by way of DSN 001-1 under this permit.

## **1.6 TREATMENT SYSTEM DESCRIPTION**

See Attachment A for an Effluent Plant Flow Diagram

### **1.6.1 RAW WATER TREATMENT**

Water used at the facility is either supplied by the Metropolitan District Commission or diverted from the Hockanum River. Water withdrawn from the river is treated prior to use with the River Water Clarification System. The treatment system consists of filtering through the Haywood filter and Adams filter to remove large debris. The discharge of backwash wastewater from the Adams Filters to the river is permitted under the *Comprehensive General Permit for Discharges to Surface Water and Groundwater*. Following filtration, biocides (sodium hypochlorite and ChemTreat CL15) are added to the filtered water to treat for biological growth. Next, a coagulant (Epic WW58) and a flocculant (ChemTreat P812A) are added, and the solids settle out in the Lamella gravity settler. Solids from the settler are discharged to the sanitary sewer under the *General Permit for the Discharge of Wastewaters from Significant Industrial Users*. Clarified water flows through a Parkson Dynasand filter. From there, water is directed to the shower water tank or through the main mill pump to be used in the manufacturing process. Sodium hypochlorite and ChemTreat

CL15 are again dosed into the shower water tank and after the main mill pump to reduce biological growth buildup in the paper machine headbox and machine showers. The water treatment wastewater discharges are authorized under *Comprehensive General Permit for Discharges to Surface Water and Groundwater as described* in Section 1.3 Other Permits. The effluent of water treatment wastewaters enters the discharge flume downstream of the final effluent monitoring location for DSN 001-1 of this permit, as required by a compliance schedule under the previous permit (see Section 1.8 Compliance History).

#### 1.6.2 PROCESS WATER TREATMENT

Process water from PM No. 2 flows into the saveall pit, a collection tank, and is then pumped to a sump ("channel"). Channel lift pumps work to move water from the channel to the Dissolved Air Floatation ("DAF") clarifiers. There are two DAF clarifiers, DAF #1 and DAF #2, which are used alternately to remove solids from the tissue manufacturing wastewater. A portion of influent water to the DAFs is saturated with dissolved air. Water flows into the main chamber of the DAF where it is chemically treated with a high-charge coagulant (Epic WW 2400 or Parafloc 197) and a flocculant (ChemTreat P812A). Soda ash and aluminum sulfate are added to control pH. The suspended solids rise to the surface of the water, where they are skimmed and directed either through the fines tank to the pulpers or the paper machine, or through the sludge tank to solids treatment. Clarified water from the DAF enters the cement tank, which is a 20,000-gallon holding tank, where it can be used again for process water or discharged as wastewater via DSN 001-1. A kidney loop is installed on the cement tank and pumps water through UV treatment and then a 50-micron disc filter. A bypass line around the UV treatment allows for limited maintenance in the circumstances when the UV bulbs need to be replaced. A portion of the treated water from the disc filter is recycled to the shower water tank for use as process water, while the remainder is either discharged as effluent via DSN 001-1 or recirculated to the cement tank, depending on the operating level in the cement tank. Approximately 70-80 percent of the treated wastewater is reused in the process on-site, and approximately 20-30 percent is discharged to the Hockanum River.

#### 1.6.3 SOLIDS TREATMENT

Disc filter rejects are pumped back to the channel. Recovered fiber from the DAF units is either pumped to the fines tank to be returned to a pulper/beater or is pumped to the sludge tank. Unusable fiber is dewatered in the sludge tank and pH adjusted via soda ash and aluminum sulfate as needed. A flocculant (ChemTreat P812A) and a coagulant (Epic WW58) are added to the dewatered sludge, and then it is thickened in a dewatering drum and belt press. The thickened sludge is disposed of off-site as nonhazardous waste. Filtrate is returned to the channel for treatment.

### 1.7 FACILITY CHANGES

In June of 2015, Dunn Paper idled operations of PM No. 1. Previously, DAF #1 treated wastewater from PM No. 1 while DAF #2 treated wastewater from PM No. 2. With PM No. 1 removed from operations, the wastewater from PM No. 2 is now alternately treated by DAF #1 or DAF #2, which provides redundancy for cleaning and maintenance of either DAF.

There have been no permit modifications since the last permit renewal, but there have been facility and treatment system modifications performed in accordance with Section 22a-430-3(i) of the Regulations of the Connecticut State Agencies ("RCSA"). The regulations require that permittees notify DEEP and obtain written approval of any facility expansion or process change that may result in an increased or new discharge or constitute a new source, and of any expansion or significant changes made to a wastewater collection system, treatment system, or its method of operation in accordance with RCSA Section 22a-430-

3(i). These regulatory provisions are commonly referred to as “3(i) determinations”. DEEP will review the notification and determine if the change can be implemented under the current permit or if the requested change requires a permit modification to protect waters of the State in accordance with RCSA Section 22a-430-4(p). The following are a list of 3(i) determinations since the previous permit:

<b>3(i) Number</b>	<b>3(i) Description</b>	<b>Date Issued</b>	<b>Change Implemented at the time of Public Notice</b>
N/A	Authorization to use Nalco HYG-25 and Nalco Accu-Valor 100A in the chlorine dioxide generator. These chemicals have since been replaced.	4/10/2012	Yes
N/A	Authorized installation of “sidehill screens” to the piping lines that feed the #1 and #2 clarifiers, installation of an aeration pump and changing the configuration of feed piping into DAF clarifier, and installation of a Seimans rotary disc filter with 30 micron screen.	3/9/2012	Yes
201508832	Authorized replacement of the Hach sc100 pH/TSS controller with a Hach sc200 controller.	12/10/2015	Yes
201615685	Approval to make process piping modifications, installation of a new filtration system, repurposing of an existing water storage tank, additional use of an existing disc filter, and new controls and instrumentation	2/3/2017	Yes
201702681	An approval to replace the manually-actuated bypass valves from the Kroftas to the emergency surge tank, in the case of pH or TSS exceedances, with automatic valves controlled by the mill’s computerized control system. If the emergency surge tank level exceeds 70%, excess wastewater would be diverted into the dirty fines tank until 50% capacity is reached, in which case the computerized control system would trigger a plant shutdown. Additionally, Dunn Paper requested authorization to install an overflow pipe on the main white water collection tank (cement tank) to the channel to prevent accidental overflow of the tank’s contents into the flume that discharges to the river when the disc filter is out of service or unable to keep up with the demand of the Kroftas. Water from the channel is pumped to the diversion tank or back to the Krofta. Further preventative measures to prevent of an overflow of the cement tank to the river were also approved via 3(i) application 202005965.	4/19/2017	Yes
201906108	Approval to use previously trialed Yankee dryer coating, water treatment and felt conditioning chemicals (ChemTreat FO180, CR180, CR310, CR100, P806, CL15, & FE212; and Holland EPIC WW2400) to enhance paper production and the water treatment system.	5/30/2019	Yes
202005965	Approval to install three new valves to prevent a future bypass discharge to the river. This includes a fail closed valve between DAF #1 and the cement tank, a fail open valve between DAF #1 and the diversion tank, and a fail open valve between DAF #2 and the diversion tank.	6/4/2020	Yes

202103532	Approval to extend the DSN 001-1 discharge pipe 80 inches and install a manually operated butterfly valve. These changes protect the lowest points in the building from flooding in the event of a 100-year flood and meet the requirements of their insurer's flood response plan.	3/16/2021	Yes
202104741	Approval to install and operate a disinfection system immediately before the disc filter. ETS-UV Disinfection Generator-SW Model treats the papermill wastewater with UV light for improved toxicity results in DSN 001-1.	4/26/2021	Yes
202306714	Approval to bypass UV treatment for limited maintenance purposes was approved on September 18, 2023. The UV bulbs require periodic replacement as they become less effective or burn out.	9/18/2023	Yes
202411636 & 202411637	Approval to reroute the backwash piping lines of the Disc Filter and Ergo Filter from the white water collection channel to the diversion tank. Currently, the filter backwash is directed to the channel, which is then treated by the dissolved air flotation ("DAF") treatment unit. Pulp fibers that are captured in the DAF are directed back to the paper machine via the fines tank. Redirecting the backwash to the solids treatment system will improve the removal of solids in the filter backwash, thereby improving the quality of pulp fiber collected in the fines tank.	1/10/2025	No
202501020	Approval to use Kymene 1500LV as a wet-strength chemical dosed into the dump chest in place of Kymene 557H.	2/28/2025	No

## 1.8 COMPLIANCE HISTORY

Based on Discharge Monitoring Reports ("DMRs") and Aquatic Toxicity Monitoring Reports ("ATMRs") submitted to DEEP, the Permittee reported the following effluent violations in the last five years:

EFFLUENT VIOLATIONS IN THE PAST 5 YEARS					
Month/ Year	DSN	Parameter	Type of Limit	Permitted Limit	Reported Value
4/9/2019	001-1	LC <sub>50</sub> Static 48Hr Acute <i>D. Pulex</i>	Daily Minimum	100 %	86.3 %
4/30/2019	001-1	LC <sub>50</sub> Static 48Hr Acute <i>D. Pulex</i>	Daily Minimum	100 %	48.4 %
7/23/2019	001-1	LC <sub>50</sub> Static 48Hr Acute <i>D. Pulex</i>	Daily Minimum	100 %	67.8%
1/14/2020	001-1	LC <sub>50</sub> Static 48Hr Acute <i>D. Pulex</i>	Daily Minimum	100 %	80.0 %
2/25/2020	001-1	LC <sub>50</sub> Static 48Hr Acute <i>D. Pulex</i>	Daily Minimum	100 %	83.3 %
4/14/2020	001-1	LC <sub>50</sub> Static 48Hr Acute <i>D. Pulex</i>	Daily Minimum	100 %	75.0 %
7/21/2020	001-1	LC <sub>50</sub> Static 48Hr Acute <i>D. Pulex</i>	Daily Minimum	100 %	88.2 %

The violations were thought to be caused by pathogens, so the Permittee proposed installation of UV disinfection. The UV system was brought online in late 2022 and the acute toxicity failures ceased in 2020. There have been no LC<sub>50</sub> Static 48Hr Acute *D. Pulex* failures in the last 4 years.

Is the Permittee subject to an ongoing enforcement action? ☐ Yes ☒ No

Consent Order No. COWRIN23002 was issued to the Permittee on October 2, 2023, for a bypass of the disc filter that resulted in a discharge of wastewater highly concentrated with total suspended solids (“TSS”), and a report of a fish kill on December 22, 2016. The Permittee also exceeded the maximum pH limit on April 5, 2017; violated the aquatic toxicity limit on October 11, 2016, November 11, 2016, and February 8, 2017; exceeded the biochemical oxygen demand, 5-day (“BOD<sub>5</sub>”) limit on November 6, 2017; caused foaming in the river on August 30, 2018; reported a bypass of the wastewater treatment system on December 4, 2019; reported a release of process wastewater to the river on April 26, 2022; and was cited for numerous violations during an inspection on January 11-12, 2023, including failure to maintain records, failure to comply with reporting requirements, failure to collect, handle, and analyze samples appropriately, failure to operate and maintain the wastewater collection system, failure to obtain approval for use of treatment chemicals, and numerous violations around exceedances of and reporting of the aquatic toxicity limit seven times between 2019 and 2020. The Permittee had demonstrated compliance prior to the consent order being issued, so the consent order only included a civil penalty. The Permittee paid the penalty on November 11, 2023, and a Certificate of Compliance was issued to the Permittee on December 6, 2023. Some of the actions the Permittee took to come into compliance included: installing UV treatment before the disc filter, which eliminated aquatic toxicity failures; installing new valves to prevent bypasses of treatment, particularly in cases of power failure; submitted approval requests for chemical changes that had already occurred; installation of visual and audible alarms for TSS and pH on DAF #1, DAF #2, and the discharge flume; and updated their Operations and Maintenance Plan to reflect these and other facility changes.

Did the previous permit have a compliance schedule? ☒ Yes ☐ No

Section 9 of the previous permit required the Permittee to (1) relocate the River Adams Filter backwash connection to after the monitoring location for DSN 001; (2) relocate the treated river water pipeline from the 30,000-gallon tank to the main water process pipeline; and (3) relocate the bypass of (partially) treated river water discharge piping to after the final effluent monitoring location for DSN 001. The Permittee confirmed that the relocation of the Adams Filter backwash connection was completed on November 25, 2008; the relocation of the treated river water pipeline was completed on October 31, 2008; and the relocation of the bypass for treated river water discharge piping was completed on October 1, 2008. These discharges are now permitted under Registration No. CTC SW0043 (see Section 1.3 Other Permits).

## **1.9 GENERAL ISSUES RELATED TO THE APPLICATION**

### **1.9.1 FEDERALLY RECOGNIZED INDIAN LAND**

As provided in the permit application, the site is not located on federally-recognized Indian land.

### **1.9.2 COASTAL AREA/COASTAL BOUNDARY**

The activity is not located within a coastal boundary as defined in CGS 22a-94(b).

### **1.9.3 ENDANGERED SPECIES**

The site is not located within an area identified as a habitat for endangered, threatened or special concern species according to the June 2024 “State and Federal Listed Species and Natural Communities Map”.

### **1.9.4 AQUIFER PROTECTION AREAS**

As provided in the permit application, the site is not located within a protected area identified on a Level A or B map.

#### 1.9.5 CONSERVATION OR PRESERVATION RESTRICTION

As provided in the permit application, the property is not subject to a conservation or preservation restriction.

#### 1.9.6 PUBLIC WATER SUPPLY WATERSHED

As provided in the permit application, the site is not located within a public water supply watershed.

## **SECTION 2 - RECEIVING WATER BODY INFORMATION**

### **2.1 DESIGNATED USES**

The receiving waterbody, the Hockanum River, is identified as CT4500-00\_01, which includes the section from the mouth at the Connecticut River in East Hartford up to the Cellu Company Dam. The outfall is located downstream of this dam. This segment of the Hockanum River is classified as a Class B surface water. The designated uses for Class B waters are: (1) habitat for fish and other aquatic life and wildlife; (2) recreation; (3) navigation; and (4) industrial and agricultural water supply ([RCSA 22a-426-4\(h\)](#)).


### **2.2 IMPAIRMENTS AND TMDLS**

This section of the Hockanum River was assessed pursuant to CWA §305(b) as part of Connecticut's 2022 Integrated Water Quality Report. That assessment determined that this section of the Hockanum River is not supporting its designated use of habitat for fish, other aquatic life and wildlife ([https://portal.ct.gov/-/media/deep/water/water\\_quality\\_management/305b/2022/final-2022-iwqr-appendix-a-1-connecticut-305b-assessment-results-for-rivers-and-streams.pdf](https://portal.ct.gov/-/media/deep/water/water_quality_management/305b/2022/final-2022-iwqr-appendix-a-1-connecticut-305b-assessment-results-for-rivers-and-streams.pdf)). This section of the Hockanum River is listed on Connecticut's 303(d) list of impaired waterbodies; the causes of impairment are unknown ([https://portal.ct.gov/-/media/deep/water/water\\_quality\\_management/305b/2022/final-2022-iwqr-appendix-b-1-list-of-impaired-waters-for-connecticut-epa-category-5.pdf](https://portal.ct.gov/-/media/deep/water/water_quality_management/305b/2022/final-2022-iwqr-appendix-b-1-list-of-impaired-waters-for-connecticut-epa-category-5.pdf)). This section of the Hockanum River is subject to the Hockanum River Regional Basin *E. coli* Total Maximum Daily Load ("TMDL") (<https://portal.ct.gov/-/media/deep/water/tmdl/ctfinaltmdl/hockanum>) and A Total Maximum Daily Load Analysis to Achieve Water Quality Standards for Dissolved Oxygen in Long Island Sound ([https://portal.ct.gov/-/media/deep/water/lis\\_water\\_quality/nitrogen\\_control\\_program/tmdlpdf.pdf](https://portal.ct.gov/-/media/deep/water/lis_water_quality/nitrogen_control_program/tmdlpdf.pdf)), which is based on control of total nitrogen. All fresh waterbodies in Connecticut are subject to the Northeast Regional Mercury Total Maximum Daily Load ([https://portal.ct.gov/-/media/deep/water/tmdl/ctfinaltmdl/ne\\_hg\\_tmdl](https://portal.ct.gov/-/media/deep/water/tmdl/ctfinaltmdl/ne_hg_tmdl)).

A review of Attachment O of the application revealed that fecal coliform and mercury were believed absent, and two samples analyzed for mercury were both non-detect. Therefore, monitoring for these parameters has not been included in the permit. Monitoring requirements for ammonia, total Kjeldahl nitrogen, nitrate, and nitrite, have been included in the permit in response to the Long Island Sound TMDL.

This section of the Hockanum River is also listed in the 2022-2024 Priority List of Waters for Action Plan Development ([https://portal.ct.gov/-/media/deep/water/water\\_quality\\_management/305b/2022/final-2022-iwqr-appendix-c-1-priority-list-for-action-plan-development-2022-2024.pdf](https://portal.ct.gov/-/media/deep/water/water_quality_management/305b/2022/final-2022-iwqr-appendix-c-1-priority-list-for-action-plan-development-2022-2024.pdf)) under the Interim Phosphorus Strategy, which is an alternative restoration approach for total phosphorus. Phosphate is a component of one of the chemicals used by the Permittee, so monitoring requirements for total phosphorus have been included in the permit.

Figure 1: Image of discharge location

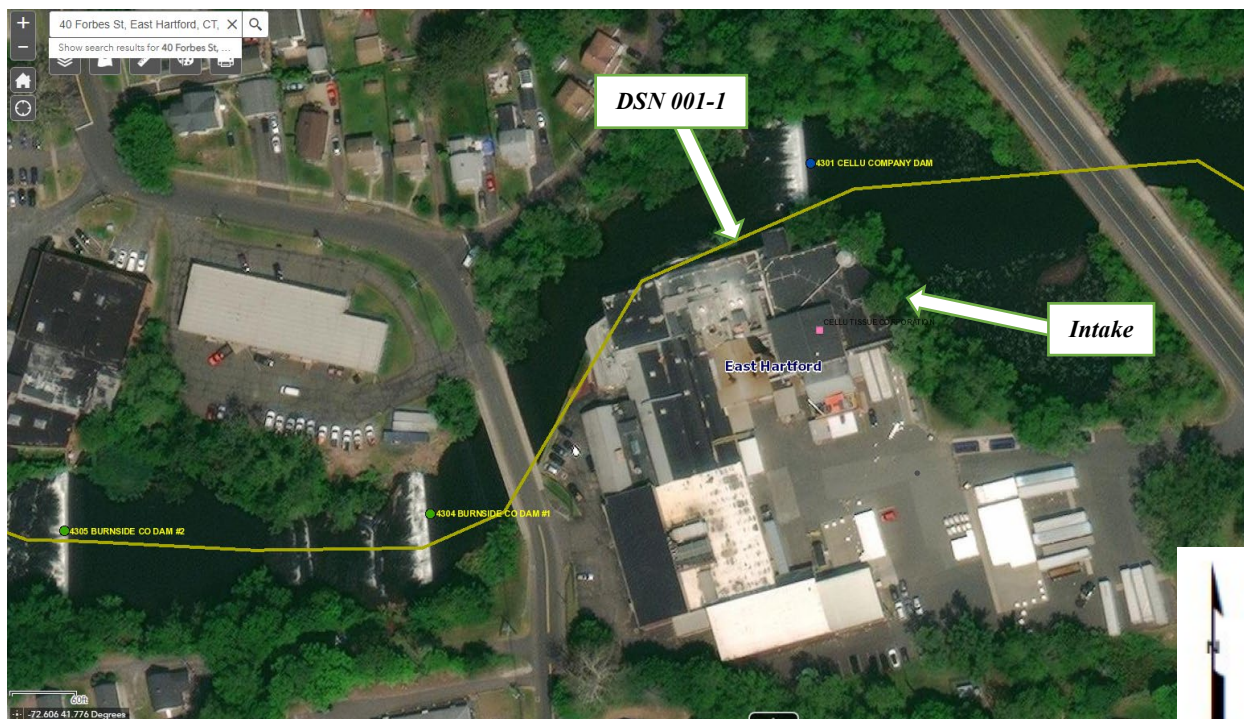

## SECTION 3 - PERMIT CONDITIONS AND EFFLUENT LIMITATIONS

### 3.1 POLLUTANTS OF CONCERN

The following pollutants are included in the permit for the reasons noted below:

POLLUTANT	REASON FOR INCLUSION			
	POLLUTANT WITH AN APPLICABLE TECHNOLOGY-BASED LIMIT	POLLUTANT WITH A WASTE LOAD ALLOCATION FROM A TMDL	POLLUTANT IDENTIFIED AS PRESENT IN THE EFFLUENT THROUGH SAMPLING	POLLUTANT OTHERWISE EXPECTED TO BE PRESENT IN THE EFFLUENT
Aluminum, Total			X	
Anthracene			X	
BOD <sub>5</sub>	X			
Chlorine, Total Residual			X	
Copper, Total			X	
Epichlorohydrin				X
Formaldehyde			X	
Lead, Total				X
Nitrogen, Ammonia (total as N)			X	
Nitrogen, Kjeldahl Total			X	
Nitrogen, Nitrate (total as N)			X	

POLLUTANT	REASON FOR INCLUSION			
	POLLUTANT WITH AN APPLICABLE TECHNOLOGY-BASED LIMIT	POLLUTANT WITH A WASTE LOAD ALLOCATION FROM A TMDL	POLLUTANT IDENTIFIED AS PRESENT IN THE EFFLUENT THROUGH SAMPLING	POLLUTANT OTHERWISE EXPECTED TO BE PRESENT IN THE EFFLUENT
Nitrogen, Nitrite (total as N)			X	
Nitrogen, Total			X	
Oil and Grease, Total			X	
Pentachlorophenol	X			
pH	X			
Phenanthrene			X	
Phosphorus, Total			X	
Temperature			X	
Total Suspended Solids	X			
Trichlorophenol	X			
Volatile Organics, Total			X	
Zinc, Total			X	

### 3.2 BASIS FOR LIMITS

Technology and water-quality based requirements are considered when developing permit limits. Technology-based effluent limits (“TBELs”) represent the minimum level of control imposed under the Clean Water Act (“CWA”). Industry-specific technology-based limits are set forth in 40 CFR 405 – 471 (EPA’s Effluent Limitation Guidelines) and in Regulations of Connecticut State Agencies (“RCSA”) Section 22a-430-4(s)(2). Water quality-based limits (“WQBELs”) are designed to protect water quality and are determined using the procedures set for in EPA’s *Technical Support Document for Water Quality-Based Toxics Control*, 1991 (“TSD”). When both technology and water quality-based limits apply to a particular pollutant, the more stringent limit would apply. In addition, water quality-based limits are required when any pollutant or pollutant parameter (conventional, non-conventional, toxic, and whole effluent toxicity) is or may be discharged at a level that causes, has reasonable potential to cause, or contributes to an excursion above any water quality criteria. Numeric water quality criteria (“WQC”) are found in RCSA Section 22a-429-9 of the *Connecticut Water Quality Standards* (“WQS”).

### 3.3 EFFLUENT LIMIT GUIDELINES

The following Effluent Limit Guidelines and Standards were reviewed to determine their applicability to the facility’s operations, waste streams, and discharge, DSN 001-1:

EPA promulgated initial Effluent Limit Guidelines and Standards for the Pulp, Paper and Paperboard category (40 CFR Part 430) in 1974 and 1977, amended the regulations in 1982 and 1986, and promulgated a major amendment covering toxic pollutants in 1998 (the Cluster Rules). Subpart L applies to the manufacture of tissue papers at nonintegrated mills; filter and non-woven papers at nonintegrated mills; and paperboard at nonintegrated mills. The Permittee produces tissue paper from purchased pulp, therefore, Subpart L is applicable.

Subpart J was also considered, which applies to the production of paperboard from wastepaper from noncorrugating medium furnish or from corrugating medium furnish; tissue paper from wastepaper without deinking at secondary fiber mills; molded products from wastepaper without deinking; and builders' paper and roofing felt from wastepaper. The Permittee utilizes virgin pulp and not wastepaper, therefore, Subpart J is not applicable.

Subpart L prescribes Best Practicable Control Technology Currently Available (“BPT”) for pollutants BOD<sub>5</sub>, TSS, and pH for continuous dischargers (40 CFR 430.122), and Best Available Technology Economically Achievable (“BAT”) for pollutants pentachlorophenol (“PCP”) and trichlorophenol (“TCP”) (40 CFR 430.124). Best Conventional Control Technology (“BCT”) for conventional pollutants (40 CFR 430.123) are the same as the effluent limitations specified for BPT. The Permittee is not subject to New Source Performance Standards (“NSPS”), based on the definition of “new source” defined under 40 CFR 430.01(j) and 40 CFR 122.2. The process and production equipment associated with PM No. 2 have not been totally replaced since the promulgation of the NSPS for the nonintegrated-tissue papers subcategory as part of the 1982 Amendment to the Pulp, Paper, and Paperboard point source category.

Federal Effluent Limitations are given below (as of June 2025):

Pollutant	40 CFR 430.122 (BPT)		40 CFR 430.124 (BAT)	
	Maximum Daily	Average Monthly	Maximum Daily	Maximum Daily
	Kg/kgg (or lbs/1,000 lb)	Kg/kgg (or lbs/1,000 lb)	Kg/kgg (or lbs/1,000 lb)	mg/L
BOD <sub>5</sub>	11.4	6.25		
TSS	10.25	5.0		
pH	( <sup>1</sup> )	( <sup>1</sup> )		
Pentachlorophenol			0.0028	(0.029)(22.9)/y
Trichlorophenol			0.00096	(0.010)(22.9)/y
y = wastewater discharged in kgal per ton of product				

<sup>1</sup> Within the range of 5.0 to 9.0 at all times.

### 3.3.1 TECHNOLOGY BASED EFFLUENT LIMITATIONS

Technology-based treatment requirements represent the minimum level of control that must be imposed under CWA §§ 301(b) and 402 to meet Best Practicable Control Technology Currently Available (“BPT”) for conventional pollutants and some metals, Best Conventional Control Technology (“BCT”) for conventional pollutants, and Best Available Technology Economically Achievable (“BAT”) for toxic and non-conventional pollutants. *See* 40 CFR § 125 Subpart A and RCSA Section 22a-430-4(l)(4)(A).

Subpart A of 40 CFR Part 125 establishes criteria and standards for the imposition of technology-based treatment requirements in permits under § 301(b) of the CWA, including the application of EPA promulgated Effluent Limitation Guidelines (“ELGs”) and case-by-case determinations of effluent limitations under CWA § 402(a)(1). EPA promulgates New Source Performance Standards (“NSPS”) under CWA § 306 and 40 CFR § 401.12. *See also* 40 CFR §§ 122.2 (definition of “new source”) and 122.29.

In the absence of published technology-based effluent guidelines, the permit writer is authorized under CWA § 402(a)(1)(B) and RCSA Section 22a-430-4(m) to establish effluent limitations on a case-by-case basis using Best Professional Judgment (“BPJ”).

In the development of permit limits for BOD<sub>5</sub>, TSS, pH, PCP, and TCP, DEEP compared EPA’s Pulp, Paper and Paperboard Categorical Limits (40 CFR Part 430, Subpart L) and limits in the previous permit, in accordance with RCSA Section 22a-430-4(l)(4)(A)(xxiii). In accordance with 40 CFR 430.124 (Pulp, Paper and Paperboard Category), the Permittee may, in lieu of analyzing for pentachlorophenol and trichlorophenol, include an annual statement on the DMR certifying that there has been no use of pentachlorophenol and trichlorophenol at the facility.

BPT effluent limitations for non-integrated mills where tissue papers are produced from purchased pulp			
Pollutant	40 CFR 430, Subpart L Effluent Limits	Production-based limits <sup>1</sup> (converted to kg/day)	Concentration limits <sup>2</sup>
<b>BOD<sub>5</sub></b>	MDL = 11.4 kg / kkg of product	MDL: $\frac{11.4 \text{ kg}}{\text{kkg}} \times \frac{52.2 \text{ kkg}}{\text{day}} = 595 \frac{\text{kg}}{\text{day}}$	MDL = 314 mg/L
	AML = 6.25 kg / kkg of product	AML: $\frac{6.25 \text{ kg}}{\text{kkg}} \times \frac{52.2 \text{ kkg}}{\text{day}} = 326 \frac{\text{kg}}{\text{day}}$	AML = 172 mg/L
<b>TSS</b>	MDL = 10.25 kg / kkg of product	MDL: $\frac{10.25 \text{ kg}}{\text{kkg}} \times \frac{52.2 \text{ kkg}}{\text{day}} = 535 \frac{\text{kg}}{\text{day}}$	MDL = 283 mg/L
	AML = 5.0 kg / kkg of product	AML: $\frac{5.0 \text{ kg}}{\text{kkg}} \times \frac{52.2 \text{ kkg}}{\text{day}} = 261 \frac{\text{kg}}{\text{day}}$	AML = 138 mg/L
<b>pH</b>	5.0 – 9.0		
BAT effluent limitations for non-integrated mills where tissue papers are produced from purchased pulp			
Pollutant	40 CFR 430, Subpart L Effluent Limits		
	MDL (kg / kkg of product)	MDL <sup>3</sup> (mg/L)	
<b>PCP</b>	MDL = 0.0028 kg / kkg of product $= \frac{0.0028 \text{ kg}}{\text{kkg}} \times \frac{52.2 \text{ kkg}}{\text{day}} = 0.146 \text{ kg/day}$	MDL = (0.029)(22.9)/y $= \frac{(0.029)(22.9)}{5.22} = 0.127 \frac{\text{mg}}{\text{L}}$	
<b>TCP</b>	MDL = 0.00096 kg / kkg of product $= \frac{0.00096 \text{ kg}}{\text{kkg}} \times \frac{52.2 \text{ kkg}}{\text{day}} \times = 0.050 \text{ kg/day}$	MDL = (0.010)(22.9)/y $= \frac{(0.010)(22.9)}{5.22} = 0.043 \frac{\text{mg}}{\text{L}}$	

<sup>1</sup> Current production is 115,000 lbs/day:

$$Production = \frac{115,000 \text{ lbs}}{\text{day}} \times \frac{\text{kg}}{2.20 \text{ lbs}} \times \frac{\text{kkg}}{1000 \text{ kg}} = \frac{52.2 \text{ kkg}}{\text{day}}$$

<sup>2</sup> Based on production-based limit, and converted to a concentration-based limit by dividing by the maximum daily flow:

$$limit \left( \frac{\text{kg}}{\text{day}} \right) \times 1,000,000 \frac{\text{mg}}{\text{kg}} \times \frac{\text{day}}{500,000 \text{ gal}} \times \frac{\text{gal}}{3.785 \text{ L}}$$

<sup>3</sup> y = wastewater discharged in kgal per ton of product:

$$y = \frac{300,000 \text{ gal}}{\text{day}} \times \frac{\text{kgal}}{1000 \text{ gal}} \times \frac{\text{day}}{115,000 \text{ lbs}} \times \frac{2000 \text{ lbs}}{\text{ton}}$$
$$= 5.22 \text{ kgal of wastewater/ton of product}$$

### 3.4 WATER QUALITY BASED EFFLUENT LIMITATIONS

The CWA and federal regulations require that effluent limitations based on water quality considerations be established for point source discharges when such limitations are necessary to meet state or federal water quality standards that are applicable to the designated receiving water. This is necessary when less stringent TBELs would interfere with the attainment or maintenance of water quality criteria in the receiving water. See CWA § 301(b)(1)(C) and 40 CFR §§ 122.44(d)(1), 122.44(d)(5), 125.84(e) and 125.94(i).

TBELs were included for BOD<sub>5</sub>, TSS, pH, pentachlorophenol, and trichlorophenol. BOD<sub>5</sub> and TSS do not have numeric water quality criteria, so no water quality-based effluent limits (“WQBELs”) were derived

for these parameters. WQBELs for pentachlorophenol and trichlorophenol were not derived because the Permittee certified that these pollutants are not used at the facility, and a review of prior quarterly monitoring indicated that these parameters have not been detected; hence monitoring will not be required.

### 3.4.1 WATERBODY AMBIENT CONDITIONS

According to the report “Flow Durations, Low-Flow Frequencies, and Monthly Median Flows for Selected Streams in Connecticut through 2005” (<https://pubs.usgs.gov/sir/2007/5270/pdf/SIR2007-5270.pdf>), the 7Q10 of the Hockanum River at the USGS station number 01192500 is 22.7 cubic feet per second (“cfs”) for a drainage area of 73.4 mi<sup>2</sup>. According to the USGS StreamStats application (<https://streamstats.usgs.gov/ss/>), the drainage area of Dunn Paper’s outfall location is 74.4 mi<sup>2</sup>. The approximate streamflow at Dunn Paper’s outfall is:

$$7Q10_{outfall} = 7Q10_{gage} \times \frac{Drainage\ Area_{outfall}}{Drainage\ Area_{gage}} = 22.7 \times \frac{74.4}{73.4} = 23.0\ cfs$$

Ambient river conditions were downloaded from USGS Water Data for the Nation - Gage 01192500 Hockanum River Near East Hartford, CT (<https://waterdata.usgs.gov/monitoring-location/01192500/#parameterCode=00065&period=P7D&showMedian=false>) and collected during annual chronic aquatic toxicity testing, which requires collection of a sample of ambient river water upstream of the discharge. The average background concentrations of pollutants used in this reasonable potential analysis for the years 2019-2024 are given in the table below:

Hockanum River Background Concentrations of Pollutants, 2019-2024	
Pollutant	Concentration
Ammonia	0.17 mg/L
Chloroform	0 ug/L
Copper	3.9 ug/L
Formaldehyde	23 ug/L
Nickel	1.1 ug/L
Zinc	11.9 ug/L

Ambient Measurements for Ammonia Calculations			
Months	Average	Minimum	Maximum
pH (S.U.)			
April – October	7.6	7.0	8.5
November – March	7.5	7.2	7.7
Temperature (°C)			
April – October	18.9	6.7	26.3
November – March	4.8	2.3	9.0

RCSA 22a-426-9 specifies that the WQC for ammonia is dependent on the presence of salmonids, pH, and temperature of the receiving stream. DEEP stocks trout in the Hockanum River. Brown trout were documented upstream in 1995 and 2008 at Station 14235, according to the CT DEEP Fish Community Data – Inland Waters (<https://cteco.uconn.edu/projects/fish/viewer/index.html>). There is also a Trout Management Area upriver, which was last stocked in May 2024 according to

the Connecticut Trout Stocking GIS map (<https://ctdeep.maps.arcgis.com/apps/webappviewer/index.html?id=70d13bc033854b89a87c04b1d11b1a43>). The following equations were used to calculate the ammonia criteria:

A) The one-hour average concentration:

$$[0.275/(1 + 10^{(7.204-pH)})] + [39.0/(1 + 10^{(pH-7.204)})]$$

B) The four-day average concentration = 2.5 times the value of the 30-day average concentration.

C) The 30-day average concentration:

$$[0.0577/(1 + 10^{(7.688-pH)})] + [2.487/(1 + 10^{(pH-7.688)})] \times [MIN(2.85, 1.45 \times (10^{(0.028(25-T))}))]$$

The criteria were calculated for two periods of the year: April through October and November through March. Maximum ambient values were used to calculate the acute (1-hour exposure) criteria, as organisms are more sensitive to ammonia with increasing pH and temperature. Average ambient values were used to calculate the chronic (4-day and 30-day exposure) criteria. The inputs and criteria are presented in the table below:

Months	One-Hour Acute Criteria (mg/L)	Four-Day Chronic Criteria (mg/L)	30-Day Chronic Criteria (mg/L)
April – October	3.2	7.5	3.0
November – March	14.4	17.1	6.8

### 3.4.2 ZONE OF INFLUENCE

The previously allocated zone of influence (“ZOI”) of 552,062 gph is being carried forward.

### 3.4.3 REASONABLE POTENTIAL ANALYSIS

Pursuant to CWA § 301(b)(1)(C) and 40 CFR § 122.44(d)(1), NPDES permits must contain any requirements in addition to TBELs that are necessary to achieve water quality standards established under § 303 of the CWA. *See also* 33 U.S.C. § 1311(b)(1)(C). In addition, limitations “must control any pollutant or pollutant parameter (conventional, non-conventional, or toxic) which the permitting authority determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any water quality standard, including State narrative criteria for water quality.” 40 CFR § 122.44(d)(1)(i). To determine if the discharge causes, or has the reasonable potential to cause, or contribute to an excursion above any WQS, EPA considers: 1) existing controls on point and non-point sources of pollution; 2) the variability of the pollutant or pollutant parameter in the effluent; 3) the sensitivity of the species to toxicity testing (when evaluating whole effluent toxicity); and 4) where appropriate, the dilution of the effluent by the receiving water. *See* 40 CFR § 122.44(d)(1)(ii).

If the permitting authority determines that the discharge of a pollutant will cause, has the reasonable potential to cause, or contribute to an excursion above WQSs, the permit must contain WQBELs or require additional monitoring if there is insufficient data to develop a WQBEL, for that pollutant. *See* 40 CFR § 122.44(d)(1)(i).

Consistent with the TSD, a reasonable potential analysis (“RPA”) compared the projected concentrations in the receiving waterbody after discharge with the applicable water quality criteria using the following information:

- Discharge monitoring data from July 2019 to July 2024;
- Hockanum River water quality data from USGS Station 01192500 (<https://waterdata.usgs.gov/>);
- Ambient water monitoring data from annual chronic toxicity testing;
- Hockanum River water quality criteria for freshwater;
- Allocated Zone of Influence; and
- Statistical multiplier in Table 3-1 of the Technical Support Document For Water Quality-based Toxics Control ([EPA/505/2-90-001](https://www.epa.gov/505/2-90-001)).

An RPA was conducted for the following parameters: aluminum, chlorine, copper, lead, nickel, zinc, chloroform, formaldehyde, and ammonia. The analysis considered the zone of influence of 552,062 gph and the average daily permitted flow of 300,000 gpd (12,500 gph). Details of the analysis are presented in Attachment B. A discussion of the elevated levels of aluminum are included in Section 3.7 below.

Epichlorohydrin, pentachlorophenol, and trichlorophenol were regularly monitored in the last permit cycle and were never detected in the effluent. An RPA was not conducted for these parameters.

Anthracene and phenanthrene were detected in the initial screening of the effluent at levels below the water quality criteria. Anthracene and phenanthrene are chemicals used in dyes, plastics, and pesticides. The only dye that is used on site is an edge marker, and possibly ink on the outside of the pulp bales. Anthracene and phenanthrene are both polycyclic aromatic hydrocarbons, which are a byproduct of burning fossil fuels (<https://archive.epa.gov/epawaste/hazard/wastemin/web/pdf/phenanth.pdf>). Due to the uncertainty of the presence of these chemicals in the wastewater, semi-annual monitoring has been included to collect data to further assess the presence and variability of the pollutants in the discharge.

The RPA did not indicate that WQBELs are needed. Calculations are included as Attachment B.

#### 3.4.4 WHOLE EFFLUENT TOXICITY

The Permittee shall comply with effluent standards or prohibitions established by CWA § 307(a) and RCRA Section 22a-430-4(l) and may not discharge toxic pollutants in concentrations or combinations that are harmful to humans, animals, or aquatic life.

If toxicity is suspected in the effluent, DEEP may require the Permittee to perform acute or chronic whole effluent toxicity testing.

Dunn Paper’s previous permit required quarterly testing of acute toxicity and contained a limit of  $LC_{50} > 100\%$ . The previous permit also required annual testing of chronic toxicity. As noted in Section 1.8 Compliance History, the Permittee had seven exceedances of its acute toxicity limit that occurred between April 2019 and July 2020, with the lowest  $LC_{50}$  result of 48.4% in April 2019.

Acute toxic units:

$$TUa = \frac{100}{LC_{50}} = \frac{100}{48.4} = 2.07 TUa$$

$$TUC = \frac{100}{IC_{25}} = \frac{100}{100} = 1.00 TUC$$

A standard coefficient of variation of 0.6 is assumed, which corresponds to a statistical multiplier of 2.3.

Dilution Factor:

$$DF = \frac{ZOI + \text{Average Permitted flow for effluent (gph)}}{\text{Average permitted flow for effluent (gph)}} = \frac{552,062 + 12,500}{12,500} = 45.16$$

Instream Waste Concentration:

$$IWC = \frac{1}{DF} \times 100\% = 2.21\%$$

Projected TUa and TUC in the receiving water:

$$\text{Projected } TUa = \text{highest } TUa \times \text{multiplier} \times IWC = 2.07 \times 2.3 \times \frac{1}{45.16} = 0.11$$

$$\text{Projected } TUC = 1.00 \times 2.3 \times \frac{1}{45.16} = 0.051$$

The EPA's TSD recommends using acute toxicity criteria and chronic toxicity criteria of TUa = 0.3 and TUC = 1.0. Both the projected TUa and TUC are below the criteria. Historically, there were several aquatic toxicity failures in 2019-2020, as documented in the compliance history (Section 1.8 of the fact sheet). Therefore, a permit limit is needed.

The maximum daily limit for toxicity is based on the concentration that will prevent toxicity within the receiving stream as specified in Section 22a-430-3(j)(7)(B)(i) of the RCSA. Chronic toxicity shall be assumed to occur at any discharge concentration which exceeds the LC<sub>50</sub> concentration determined in an acute toxicity test multiplied by an application factor of 0.05.

Chronic toxicity if:  $IWC \geq LC_{50} \times 0.05$

Rearranged:  $LC_{50} \leq IWC \times 20$

Limit:  $LC_{50} \leq 2.21\% \times 20 = 44\%$

This is less stringent than the previous permit limit of  $LC_{50} \leq 100\%$ , so the previous limit will be carried forward.

### 3.4.5 THERMAL EVALUATION

Section 316(a) of the Federal Water Pollution Control Act, U.S.C. § 1326(a) provides that the thermal component of any discharge will assure the protection and propagation of a balanced indigenous population of shellfish, fish and wildlife in and on the receiving water body. The CT WQS for Allowable Temperature Increase in Class B waters states, "There shall be no changes from natural conditions that would impair any existing or designated uses assigned to this Class and, in no case exceed 85°F, or in any case raise the temperature of surface water more than 4°F" (RCSA 22a-426-9(a)(1)). The CT WQS also allow that a "zone of influence for assimilation of a thermal discharge shall be no greater than 25% of the cross-sectional area or volume of flow of the receiving water" (RCSA 22a-426-4(l)(8)).

The Permittee heats their process water to 180°F for production purposes, and maximum daily discharge temperatures have ranged from 60°F to 121°F over the past five years. This thermal component of their process water demonstrates a risk of exceeding the CT WQS. Dunn Paper's previous permit did not require temperature monitoring or contain a temperature limit. However, in order to demonstrate compliance with the CT WQS, the Permittee conducted a thermal evaluation of their discharge in the receiving water in 2014 and submitted a Thermal Mapping & Biothermal Assessment to DEEP in January 2015. The Permittee also continued to monitor the temperature of the discharge on a daily basis. The study included mapping the thermal plume during August 21, 2014, and August 27, 2014, and the study concluded that while the discharge exceeded water quality criteria at the end of the pipe, the proposed zone of influence was contained to an embayment surrounding the outfall that was less than 25% of the cross-sectional area of the receiving water, and the temperature at the edge of this zone would not exceed the WQC. This area would not impede fish passage, and temperatures at the border of this zone would induce fish to avoid this area. The study concluded that under current operating conditions, the proposed zone of influence was supportive of a balanced indigenous community.

DEEP's evaluation of the study found that it did not evaluate the effects of the thermal component of the discharge during the winter period when elevated discharge temperatures may have a greater effect on the receiving stream. This is a concern given that data from the last three years shows that the Permittee's discharge no longer exhibits lower temperatures during the winter months.

During the most recent five years (2019-2024), Dunn Paper reported discharging an average of 245,000 gpd, which is a significant decrease from the 400,000 – 475,000 gpd reported during the thermal evaluation period. The flow decrease is a result of the use of only one paper machine instead of two and implementation of water conservation strategies, including increased reuse of process water and a reduction of the use of river and city water in the shower water tank, which historically helped to lower discharge temperatures.

Additionally, the plume mapping conducted in 2014 was representative of discharge temperatures up to 106°F. Maximum daily discharge temperatures for the period July 2019 through June 2024 were greater than 106°F on at least 25% of days in that period, and the maximum daily discharge temperature over that period was 121°F, which is a significant increase from the period when the study was conducted. DEEP conducted a one-way analysis of variance (ANOVA) of the means of the discharge temperatures recorded during July to September 2014 and compared those to discharge temperatures recorded during the most recent summer period for which data was available (July to September 2023), and found a statistically significant difference between the means of those two time periods. In order to confidently conclude that the thermal component of the discharge is supportive of a balanced indigenous biotic community and that the discharge is not violating the CT WQS, another thermal verification study is required.

A compliance schedule is included in the permit, requiring the Permittee to conduct a thermal verification study under conditions more representative of the current operations at the facility, including an evaluation of the effect of the discharge on the receiving water during the winter period. Monitoring of the intake and discharge temperatures have been included in the permit. The permit may be reopened to incorporate limits after submittal and review of the new thermal verification study.

### 3.5 COMPARISON OF LIMITS

After preparing and evaluating applicable technology-based effluent limitations and water quality-based effluent limitations, the most stringent limits are applied in the permit, as indicated by the bold values. Pollutants of concern that only require monitoring without limits are not included in the below table.

PARAMETER	UNITS	LIMITS						
		TECHNOLOGY (40 CFR 430, Subpart L)		WATER QUALITY		PREVIOUS PERMIT		
		Average Monthly Limit	Maximum Daily Limit	Average Monthly Limit	Maximum Daily Limit	Average Monthly Limit	Maximum Daily Limit	Maximum Instantaneous Limit
Acute Toxicity, <i>Daphnia pulex</i> , LC <sub>50</sub>	%				44		100	100
Acute Toxicity, <i>Pimephales promelas</i> , LC <sub>50</sub>	%				44		100	100
Biochemical Oxygen Demand, 5-day (BOD <sub>5</sub> )	mg/L	172	314			25.0	50.0	75.0
Biochemical Oxygen Demand, 5-day (BOD <sub>5</sub> )	kg/day	326	595					
Chlorine, Total Residual	mg/L					0.15	0.3	0.45
Oil & Grease, Total	mg/L					10.0	20.0	30.0
Pentachlorophenol	µg/L		127			8.2	16.5	16.5
Pentachlorophenol	kg/day		0.146					
Total Suspended Solids	mg/L	138	283			20.0	40.0	60.0
Total Suspended Solids	kg/day	261	535					
Trichlorophenol	µg/L		43			6.5	13.0	13.0
Trichlorophenol	kg/day		0.050					
Zinc, Total	mg/L					0.2	0.41	0.51
		Min	Max	Min	Max	Min	Max	
pH	S.U.	5.0	9.0	6.5	8.0	6.0	9.0	

The current (concentration-based) permit limits for BOD<sub>5</sub>, TSS, PCP, and TCP are more stringent than the calculated TBELs, based on the current production and maximum daily flow requested. Therefore, the current limits will be carried forward in accordance with anti-backsliding. WQBELs for pH have been set equivalent to the WQC for Class B surface waters, which is more stringent than the previous permit or TBELs.

### 3.6 SAMPLING FREQUENCY, TYPE, AND REPORTING

Sample type and sampling frequency were determined in accordance with RCSA Sections 22a-430-3(j)(3), 22a-430-3(j)(7), 22-430-4(l)(4)(A), and 22a-430-4(m):

Sample Type	Sample Frequency	Parameter	Reason for Inclusion / Basis for Limits
Daily Composite	Annually	Chronic Aquatic Toxicity, <i>Ceriodaphnia dubia</i>	Monitoring only, based on reasonable potential (RP) for toxicity to occur in receiving stream.
		Chronic Aquatic Toxicity, <i>Pimephales promelas</i>	
	Quarterly	Acute Toxicity, <i>Daphnia pulex</i> , LC <sub>50</sub>	Reasonable potential for toxicity to occur in receiving stream. Limit based on anti-backsliding.
		Acute Toxicity, <i>Pimephales promelas</i> , LC <sub>50</sub>	
		Copper, Total	Monitoring only, based on BPJ. No RP to exceed WQC.
		Formaldehyde	Monitoring only, based on BPJ. No RP to exceed WQC.
		Lead, Total	Monitoring only, based on BPJ. Detected at elevated concentration in ambient monitoring.
		Phosphorus, Total	Monitoring only, based on BPJ. Present in wastewater.
		Zinc, Total	Limit based on anti-backsliding. No RP to exceed WQC.
	Monthly	Aluminum, Total	Monitoring only, based on BPJ. Detected at elevated concentration in ambient monitoring.
		Nitrogen, Ammonia (total as N)	Monitoring only, based on BPJ. Present in wastewater.
		Nitrogen, Kjeldahl (total as N)	
		Nitrogen, Nitrate (total as N)	
		Nitrogen, Nitrite (total as N)	
		Nitrogen, Total	
		Pentachlorophenol	Mass-based limits, monitoring frequency, and certification allowance based on 40 CFR Part 430. More stringent concentration limit based on anti-backsliding.
		Trichlorophenol	
	Weekly	Biochemical Oxygen Demand, 5-day (BOD <sub>5</sub> )	Mass-based limit is a TBEL. More stringent concentration limit based on anti-backsliding.
		Total Suspended Solids	Mass-based limit is a TBEL. More stringent concentration limit based on anti-backsliding.
Grab Sample Average	Annually	Epichlorohydrin	Monitoring only, based on BPJ.
	Semi-Annual	Oil & Grease, Total	Limit based on anti-backsliding.
	Monthly	Chlorine, Total Residual	Limit based on anti-backsliding. RP to exceed WQC.
Grab	Semi-annual	Anthracene	Monitoring only, to collect additional data to characterize the variability of the pollutant discharge. Detected on their permit application screening.
		Phenanthrene	
		Volatile Organics, Total	Monitor only, based on BPJ. Chloroform has been detected in past monitoring at low levels.

### 3.6.1 SUFFICIENTLY SENSITIVE METHODS:

EPA at [40 CFR 122.21\(e\)\(3\)](#) and [40 CFR 122.44\(i\)](#) requires sufficiently sensitive test methods to be utilized for all parameters in a NPDES permit. A method approved under 40 CFR 136 or required through other regulations is sufficiently sensitive when:

- The method minimum level (“ML”) is at or below the level of the applicable water quality criterion or effluent limitation (if below the water quality criterion), whichever is more stringent, for the measured pollutant or pollutant parameter; or
- The method ML is above the applicable water quality criterion, but the amount of the pollutant or pollutant parameter in a facility's discharge is high enough that the method detects and quantifies the level of the pollutant or pollutant parameter in the discharge; or
- The method has the lowest ML of the analytical methods approved under [40 CFR part 136](#) or required under [40 CFR chapter I](#), subchapter N (effluent limit guidelines) or O (sewage sludge) for the measured pollutant or pollutant parameter. Note some effluent limit guidelines (ELGs) will specify a required ML for certain analyses.

DEEP has specified ML requirements in the permit to ensure compliance with the sufficiently sensitive test method regulations. The MLs listed in the NPDES permit are the minimum concentration at which quantification must be achieved and verified during the laboratory analysis of the parameter. These values are not necessarily equivalent to the MLs that would be formally established by a lab under the ML definition at 40 CFR 136. In other words, at a minimum, the permittee’s analytical method must achieve the ML listed in the permit. This may vary from the actual ML established by the lab for the analysis, using the MDL, lowest calibration point, or other acceptable method under 40 CFR 136.

The following MLs are unique to the Permittee’s discharge and have been incorporated into the permit for the given reasons, described below.

<b>List of Minimum Levels Required by the Permit</b>			
<b>Parameter</b>	<b>ML</b>	<b>Unit</b>	<b>Justification</b>
Anthracene	4.92	µg/L	Equal to the lowest applicable WQC for Class B surface waters. Approved EPA Methods are able to quantify below this level.
Pentachlorophenol	5.0	µg/L	Required by the ELG at 40 CFR Part 430 - The Pump, Paper, and Paperboard Point Source Category ( <a href="#">40 CFR 430.01(i)</a> ).
Phenanthrene	49.17	µg/L	Equal to the lowest applicable WQC for Class B surface waters. Approved EPA Methods are able to quantify below this level.
Trichlorophenol	2.5	µg/L	Required by the ELG at 40 CFR Part 430 - The Pump, Paper, and Paperboard Point Source Category ( <a href="#">40 CFR 430.01(i)</a> ).

## 3.7 OTHER PERMIT CONDITIONS

Section 11 of the permit contains a requirement to develop an Aluminum Optimization Plan. Ambient upstream monitoring conducted during the Permittee’s annual chronic toxicity monitoring has indicated elevated levels of aluminum in this section of the Hockanum River. Recognizing that aluminum is a common component of wastewater treatment chemicals, the permit will include a requirement for the

Permittee to develop and implement a plan to minimize the discharge of aluminum to the receiving water, to the maximum extent practicable. This requirement will include a schedule for the Permittee to create an Aluminum Optimization Plan and submit annual reports as an attachment to the January DMR.

### **3.8 COMPLIANCE SCHEDULE**

The permit has a compliance schedule that follows the requirements found under 40 CFR 122.47 and RSCA Section 22a-430-4(l)(3).

#### **PFAS Sampling Plan**

DEEP is requiring effluent monitoring for per- and polyfluoroalkyl substances (“PFAS”) in certain discharges to support further regulatory evaluations regarding the identification of contributing sources of such substances to the state’s surface waters. The Permittee operates under SIC code 2621 and has been identified as a potential source of PFAS in accordance with DEEP’s Industrial NPDES and Pretreatment PFAS Roadmap ([https://portal.ct.gov/-/media/deep/water\\_regulating\\_and\\_discharges/industrial\\_wastewater/2023-09-30-wped-pfas-roadmap.pdf](https://portal.ct.gov/-/media/deep/water_regulating_and_discharges/industrial_wastewater/2023-09-30-wped-pfas-roadmap.pdf)).

As such, this permit contains a compliance schedule requiring the Permittee to develop, submit for approval, and implement a PFAS monitoring and sampling plan to ensure data is representative and undergoes proper quality control and assurance. The industrial classification has been identified as a potential source and the effluent will be sampled to characterize the discharge.

#### **Thermal Verification Study**

Additionally, this permit contains a compliance schedule for the Permittee to conduct a thermal verification study. This includes submittal of a scope of study that will include summer and winter monitoring of the river at low-flow conditions, completing the field verification with plume mapping, and submittal of a Thermal Verification Report indicating the extent of the influence of the thermal discharge on the receiving stream and verification that the thermal discharge will not cause or contribute to an instream water quality violation.

#### **pH Effluent Limits**

Effluent limits for pH are more stringent than the previous permit. The Permittee will require time to evaluate and install treatment options as necessary to come into compliance with the new limits. A compliance schedule has been included in the permit, which requires the Permittee to evaluate alternatives and implement a plan to ensure compliance with the pH limits within 18 months of permit issuance.

### **3.9 ANTIDEGRADATION EVALUATION**

Implementation of the Antidegradation Policy follows a tiered approach pursuant to the federal regulations (40 CFR 131.12) and consistent with the Connecticut Antidegradation Policy included in the Connecticut Water Quality Standards (Section 22a-426-8(b-f) of the RSCA). Tier 1 Antidegradation review applies to all existing permitted discharge activities to all waters of the state. Tiers 1 and 2 Antidegradation reviews apply to new or increased discharges to high quality waters and wetlands, while Tiers 1 and 3 Antidegradation reviews apply to new or increased discharges to outstanding national resource waters.

This discharge is an existing discharge, and the Permittee does not propose an increase in volume or concentration of constituents. Therefore, only the Tier 1 Antidegradation Evaluation and Implementation Review was conducted to ensure that existing and designated uses of surface waters and the water quality

necessary for their protection are maintained and preserved, consistent with Connecticut Water Quality Standards, RCSA Sec.22a-426-8(a)(1). This review involved:

- An evaluation of narrative and numeric water quality standards, criteria and associated policies;
- The discharge activity both independently and in the context of other dischargers in the affected waterbodies; and
- Consideration of any impairment listed pursuant to Section 303d of the federal Clean Water Act or any TMDL established for the waterbody.

DEEP has determined that the discharges or activities are consistent with the maintenance, restoration, and protection of existing and designated uses assigned to the receiving water body by considering all relevant data. Compliance with all the terms and conditions in the new permit would ensure that existing and designated uses of surface waters and the water quality necessary for their protection are maintained and preserved.

### **3.10 ANTI-BACKSLIDING**

This permit has effluent limitations, standards or conditions that are at least as stringent as the final effluent limitations, standards, or conditions in the previous permit as required in 40 CFR 122.44(l) and RCSA Section 22a-430-4(l)(4)(A)(xxiii).

### **3.11 COOLING WATER INTAKE STRUCTURE §316(B)**

§ 316(b) of the Federal Water Pollution Control Act, U.S.C. § 1326(b) states that “any standard established pursuant to § 301 or 306 of this Act and applicable to a point source shall require that the location, design, construction, and capacity of cooling water intake structures (CWIS) reflect the best technology available (BTA) for minimizing adverse environmental impact”.

The federal regulations establish requirements under § 316(b) of the Clean Water Act (CWA) for existing power generating facilities and existing manufacturing and industrial facilities with a cooling water intake structure having a design intake flow greater than 2 million gallons per day of water from waters of the United States and use at least 25 percent of the water they withdraw exclusively for cooling purposes. § 125.92 defines “Cooling water intake structure” as “the total physical structure and any associated constructed waterways used to withdraw cooling water from waters of the United States. The cooling water intake structure extends from the point at which water is first withdrawn from waters of the United States up to and including the intake pumps.”

§ 125.90(b), states “Cooling water intake structures not subject to requirements under §§ 125.94 through 125.99 or subparts I or N of this part must meet requirements under § 316(b) of the CWA established by the Director on a case-by-case, best professional judgment (BPJ) basis.”

Dunn Paper has a diversion permit to withdraw up to 850,000 gallons per day from the Hockanum River. They do not utilize this water for cooling water purposes, therefore, CWA § 316(b) is not applicable.

### **3.12 VARIANCES AND WAIVERS**

The Permittee requested alternative effluent limit for the thermal discharge. Temperature monitoring and a compliance schedule to conduct a thermal verification study under current operating conditions have been incorporated into the permit to evaluate the request.

### **3.13 E-REPORTING**

The Permittee is required to electronically submit documents in accordance with 40 CFR Part 127.

## **SECTION 4 - SUMMARY OF NEW PERMIT CONDITIONS AND LIMITS FROM THE PREVIOUS PERMIT**

- The Permittee requested a reduction of flow limits in the previous permit of an average monthly discharge of 696,000 gpd to 300,000 gpd and a maximum daily discharge of 1,152,000 gpd to 500,000 gpd. The new flow limits have been granted.
- Mass-based limits were added for BOD<sub>5</sub>, TSS, pentachlorophenol, and trichlorophenol based on TBELs. The included concentration-based limits are more stringent than the mass-based limits, based on the maximum daily discharge.
- pH minimum limit has been raised from 6.0 to 6.5, and pH maximum limit has been lowered from 9.0 to 8.0. The previous permit limits were technology-based limits but would not meet the water quality standard listed at RCSA 22a-426-9(a) for Class B waters. The new limits will ensure that the WQC for Class B surface waters will be met at end-of-pipe. A compliance schedule is included which requires the permittee to achieve compliance with the new pH limits.
- A permit condition has also been added requiring the Permittee to conduct an Aluminum Optimization Plan. Monitoring for aluminum has been changed from quarterly to monthly. The Permittee is also required to monitor dissolved organic carbon ("DOC") with their annual chronic toxicity monitoring for the purpose of investigating the need for future aluminum limits related to water quality criteria models dependent on DOC, hardness, and pH.
- Quarterly monitoring for copper and lead was added to the permit to be conducted with acute toxicity testing. Previously, these parameters were only required to be monitored with annual chronic toxicity testing.
- Nickel is no longer required to be monitored as part of the chronic toxicity testing. Based on an evaluation of data, nickel has not been present in the discharge or has only been present at very low concentrations.
- Quarterly monitoring for phosphorus was added because phosphate is present in chemicals used on site, and phosphorus is present in the effluent. The Hockanum River is subject to the "Phosphorus Reduction Strategy for Inland Non-Tidal Waters", pursuant to Public Act 12-155, An Act Concerning Phosphorus Reductions in State Waters ([https://portal.ct.gov/-/media/deep/water/water\\_quality\\_standards/p/pa12155fullccreportpdf.pdf](https://portal.ct.gov/-/media/deep/water/water_quality_standards/p/pa12155fullccreportpdf.pdf)).
- Effluent temperature monitoring was added to the permit.
- Monitoring of anthracene and phenanthrene were included on a quarterly basis in order to assess the frequency and variability of these pollutants within the discharge.
- The permit more clearly specifies that annual PCP and TCP certification is provided in lieu of monitoring. However, the monitoring frequency has been changed from quarterly to monthly per the monitoring requirements of 40 CFR 430.02, in the case that these parameters are determined to be present. The Permittee is required to submit one sample analyzed for PCP and TCP during the permit term utilizing EPA Method 1653 that meets the minimum levels in 40 CFR Part 430.

- The permit includes new language in Section 9 defining the circumstances around noncompliance that are required to be reported to the Commissioner and requires the notifications to be submitted through an online noncompliance form.
- Chemical monitoring that is required with acute and chronic toxicity was previously listed in Sections 6 of the previous permit, and the monitoring requirement for acute aquatic toxicity was listed in Table A of the previous permit. These monitoring requirements have been moved to 001-AT and 001-CT, which will allow the Permittee to report aquatic toxicity results and paired chemical and receiving water monitoring results in NetDMR. Additionally, ATMRs are now required to be submitted electronically rather than in hardcopy.

## **SECTION 5 - PUBLIC PARTICIPATION PROCEDURES**

### **5.1 INFORMATION REQUESTS**

The application has been assigned the following numbers by the Department of Energy and Environmental Protection. Please use these numbers when corresponding with this office regarding this application.

APPLICATION NO. 201301708

PERMIT ID NO. CT0002127

Interested persons may obtain copies of the application from Jeffrey Brashich, Dunn Paper – East Hartford, LLC, 40 Forbes Street, East Hartford, CT 06108, 860-466-4181 or [BrashichJ@BiOriginSP.com](mailto:BrashichJ@BiOriginSP.com).

The application is available for inspection by contacting Joseph Grandelski at [joseph.grandelski@ct.gov](mailto:joseph.grandelski@ct.gov), at the Department of Energy and Environmental Protection, Bureau of Materials Management and Compliance Assurance, 79 Elm Street, Hartford, CT 06106-5127 from 8:30 - 4:30, Monday through Friday.

Any interested person may request in writing that his or her name be put on a mailing list to receive notice of intent to issue any permit to discharge to the surface waters of the state. Such request may be for the entire state or any geographic area of the state and shall clearly state in writing the name and mailing address of the interested person and the area for which notices are requested.

### **5.2 PUBLIC COMMENT**

Prior to making a final decision to approve or deny any application, the Commissioner shall consider written comments on the application from interested persons that are received within thirty (30) days of this public notice. Written comments should be directed to Joseph Grandelski, Environmental Engineer 1, Bureau of Materials Management and Compliance Assurance, Department of Energy and Environmental Protection, 79 Elm Street, Hartford, CT 06106-5127 or [DEEP.IndustrialNPDESPublicComments@ct.gov](mailto:DEEP.IndustrialNPDESPublicComments@ct.gov) and should indicate the Permit ID No. CT0002127 in the subject line. The Commissioner may hold a public hearing prior to approving or denying an application if in the Commissioner's discretion the public interest will be best served thereby, and shall hold a hearing upon receipt of a petition signed by at least twenty five (25) persons. Notice of any public hearing shall be published at least thirty (30) days prior to the hearing.

Petitions for a hearing shall be submitted within thirty (30) days from the date of publication of this public notice and should include the application number noted above and also identify a contact person to receive notifications. Petitions may also identify a person who is authorized to engage in discussions regarding the application and, if resolution is reached, withdraw the petition. The Office of Adjudications will accept electronically-filed petitions for hearing in addition to those submitted by mail or hand-delivered. Petitions with required signatures may be sent to [deep.adjudications@ct.gov](mailto:deep.adjudications@ct.gov) or may be mailed or delivered to DEEP Office of Adjudications, 79 Elm Street, 3<sup>rd</sup> floor, Hartford, CT 06106-5127. If the signed original petition is only in an electronic format, the petition must be submitted with a statement signed by the petitioner that the petition exists only in that form. Original petitions that were filed electronically must also be mailed or delivered to the Office of Adjudications within thirty (30) days of electronic submittal. Additional information can be found at [www.ct.gov/deep/adjudications](http://www.ct.gov/deep/adjudications).

The Connecticut Department of Energy and Environmental Protection is an Affirmative Action/Equal Opportunity Employer that is committed to complying with the requirements of the Americans with Disabilities Act (ADA). If you are seeking a communication aid or service, have limited proficiency in English, wish to file an ADA or Title VI discrimination complaint, or require some other accommodation, including equipment to facilitate virtual participation, please contact the DEEP Office of Diversity and Equity at 860-418-5910 or by email at [deep.accommodations@ct.gov](mailto:deep.accommodations@ct.gov). Any person needing an accommodation for hearing impairment may call the State of Connecticut relay number - 711. In order to

facilitate efforts to provide accommodation, please request all accommodations as soon as possible following notice of any agency hearing, meeting, program, or event.

DRAFT

**Attachment A**  
Effluent Plant Flow Diagram

DRAFT



## Attachment B

### Reasonable Potential Analysis

Reasonable Potential Analysis				
Parameter	Projected maximum effluent concentration	Projected maximum receiving water concentration (mg/L)	Most stringent criteria	Is there reasonable potential to exceed WQC?
Ammonia (Apr – Oct)	$0.62 \times 2.9$ = 1.8 mg/L	$\frac{1.8 \times 300,000 + 0.17 \times 13,249,488}{300,000 + 13,249,488}$ = 0.21 mg/L	3.0 mg/L	No
Ammonia (Nov – Mar)	$0.29 \times 2.3$ = 0.67 mg/L	$\frac{0.67 \times 300,000 + 0.17 \times 13,249,488}{300,000 + 13,249,488}$ = 0.18 mg/L	6.8 mg/L	No
Chlorine	$160 \times 1.6$ = 256 ug/L	$\frac{256 \times 300,000 + 0 \times 13,249,488}{300,000 + 13,249,488}$ = 5.67 ug/L	11 ug/L	No
Chloroform	$0.68 \times 2.9$ = 2.0 ug/L	$\frac{2.0 \times 300,000 + 0 \times 13,249,488}{300,000 + 13,249,488}$ = 0.040 ug/L	17.1 ug/L	No
Copper	$83 \times 4.2$ = 349 ug/L	$\frac{349 \times 300,000 + 3.9 \times 13,249,488}{300,000 + 13,249,488}$ = 12 ug/L	18.1 ug/L	No
Formaldehyde	$1,100 \times 6.8$ = 7,480 ug/L	$\frac{7,480 \times 300,000 + 23 \times 13,249,488}{300,000 + 13,249,488}$ = 188 ug/L	128,000 ug/L	No
Zinc	$39 \times 4.5$ = 176 ug/L	$\frac{176 \times 300,000 + 12 \times 13,249,488}{300,000 + 13,249,488}$ = 15 ug/L	65 ug/L	No



**NOTICE OF TENTATIVE DETERMINATION  
INTENT TO RENEWA NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM PERMIT A  
DISCHARGE INTO THE WATERS OF THE STATE OF CONNECTICUT**

**1.0 TENTATIVE DECISION**

The Commissioner of the Department of Energy and Environmental Protection (“the Commissioner”) hereby gives notice of a tentative determination to renew a permit based on an application and administrative record submitted by Dunn Paper – East Hartford, LLC (“the Applicant”) under Section 22a-430 of the Connecticut General Statutes (“CGS”) for a permit to discharge into the waters of the state.

In accordance with applicable federal and state law, the Commissioner has made a tentative determination that continuance of the existing system to treat the discharge would protect the waters of the state from pollution, and the Commissioner proposes to renew a permit for the discharge to the Hockanum River.

The proposed permit, if issued by the Commissioner, will require that all wastewater be treated to meet the applicable effluent limitations and periodic monitoring to demonstrate that the discharge will not cause pollution.

**2.0 APPLICANT'S PROPOSAL**

Dunn Paper – East Hartford, LLC proposes to discharge a maximum of 500,000 gallons per day of tissue paper manufacturing wastewater to the Hockanum River from paper manufacturing operations at a paper mill.

The name and mailing address of the permit Applicant are: Dunn Paper – East Hartford, LLC, 40 Forbes Street, East Hartford, CT 06108.

The activity takes place approximately 250 feet upstream of the Forbes Street bridge over the Hockanum River and approximately 50 feet downstream of the Cellu Company Dam, on the southern bank of the Hockanum River.

**3.0 REGULATORY CONDITIONS**

**3.1 Type of Treatment**

DSN 001-1: pH adjustment, coagulation, flocculation, solids removal with dissolved air floatation, ultraviolet (“UV”), and a disc filter

**3.2 Effluent Limitations**

This permit contains effluent limitations consistent with Best Available Technology (“BAT”) and Best Practicable Technology (“BPT”), and which will meet Water Quality Standards including the Anti-Degradation Policy, when the Applicant complies with all permit requirements.

In accordance with Section 22a-430-4(l) of the Regulations of Connecticut State Agencies, the permit contains effluent limitations for the following types of toxic substances: heavy metals and acid organic compounds.

**3.3 Compliance Schedule**

This permit contains enforceable compliance schedules which require the Applicant to:

- 1) Conduct a thermal verification study and submit the report to the Commissioner.
- 2) Develop, submit for the Commissioner’s approval, and implement a per-and poly-fluoroalkyl substances (“PFAS”) sampling plan.

- 3) Achieve compliance with the new pH effluent limits.

#### **4.0 COMMISSIONER'S AUTHORITY**

The Commissioner of the Department of Energy and Environmental Protection is authorized to approve or deny such permits pursuant to Section 402(b) of the Federal Water Pollution Control Act, as amended, 33 USC 1251, et. seq. and Section 22a-430 of the CGS and the Water Discharge Permit Regulations (Section 22a-430-3 and 4 of the RCSA).

#### **5.0 INFORMATION REQUESTS**

The application has been assigned the following numbers by the Department of Energy and Environmental Protection. Please use these numbers when corresponding with this office regarding this application.

APPLICATION NO. 201301708

PERMIT ID NO. CT0002127

Interested persons may obtain copies of the application from from Jeffrey Brashich, Dunn Paper – East Hartford, LLC, 40 Forbes Street, East Hartford, CT 06108, 860-466-4181 or [BrashichJ@BiOriginSP.com](mailto:BrashichJ@BiOriginSP.com).

The application is available for inspection by Joseph Grandelski at [joseph.grandelski@ct.gov](mailto:joseph.grandelski@ct.gov), at the Department of Energy and Environmental Protection, Bureau of Materials Management and Compliance Assurance, 79 Elm Street, Hartford, CT 061065127 from 8:30-4:30, Monday through Friday.

Any interested person may request in writing that his or her name be put on a mailing list to receive notice of intent to issue any permit to discharge to the surface waters of the state. Such request may be for the entire state or any geographic area of the state and shall clearly state in writing the name and mailing address of the interested person and the area for which notices are requested.

#### **6.0 PUBLIC COMMENT**

Prior to making a final decision to approve or deny any application, the Commissioner shall consider written comments on the application from interested persons that are received within 30 days of this public notice. Written comments should be directed to Joseph Grandelski, Environmental Engineer 1, Bureau of Materials Management and Compliance Assurance, Department of Energy and Environmental Protection, 79 Elm Street, Hartford, CT 061065127 or [DEEP.IndustrialNPDESPublicComments@ct.gov](mailto:DEEP.IndustrialNPDESPublicComments@ct.gov) and should indicate the Permit ID No. CT0002127 in the subject line. The Commissioner may hold a public hearing prior to approving or denying an application if in the Commissioner's discretion the public interest will be best served thereby, and shall hold a hearing upon receipt of a petition signed by at least twenty-five- persons. Notice of any public hearing shall be published at least thirty (30) days prior to the hearing.

#### **7.0 PETITIONS FOR HEARING**

Petitions for a hearing shall be submitted within thirty (30) days from the date of publication of this public notice and should include the application number noted above and also identify a contact person to receive notifications. Petitions may also identify a person who is authorized to engage in discussions regarding the application and, if resolution is reached, withdraw the petition. The Office of Adjudications will accept electronically-filed petitions for hearing in addition to those submitted by mail or hand-delivered. Petitions with required signatures may be sent to [deep.adjudications@ct.gov](mailto:deep.adjudications@ct.gov) or may be mailed or delivered to DEEP Office of Adjudications, 79 Elm Street, 3rd floor, Hartford, 06106-5127. If the signed original petition is only in an electronic format, the petition must be submitted with a statement signed by the petitioner that the petition exists only in that form. Original petitions that were filed electronically must also be mailed or delivered to the Office of Adjudications within thirty (30) days of electronic submittal. Additional information can be found at [www.ct.gov/deep/adjudications](http://www.ct.gov/deep/adjudications).

The Connecticut Department of Energy and Environmental Protection is an Affirmative Action/Equal Opportunity Employer that is committed to complying with the requirements of the Americans with Disabilities Act (ADA). If you are seeking a communication aid or service, have limited proficiency in English, wish to file an ADA or Title

VI discrimination complaint, or require some other accommodation, including equipment to facilitate virtual participation, please contact the DEEP Office of Diversity and Equity at 860-418-5910 or by email at [deep.accommodations@ct.gov](mailto:deep.accommodations@ct.gov). Any person needing an accommodation for hearing impairment may call the State of Connecticut relay number - 711. In order to facilitate efforts to provide accommodation, please request all accommodations as soon as possible following notice of any agency hearing, meeting, program, or event.

A handwritten signature in black ink, appearing to read 'Audra', with a long, sweeping horizontal stroke extending to the right.

---

Audra Dickson, Director  
Water Permitting and Enforcement Division  
Bureau of Materials Management and Compliance Assurance  
Department of Energy and Environmental Protection

Dated: June 13, 2025