



REGION 10 ADMINISTRATOR

SEATTLE, WA 98101

Petersburg Borough
Wastewater Treatment Plant
Application for a Modified NPDES Permit
Under Section 301(h) of the Clean Water Act

Final Decision of the Regional Administrator
Pursuant to 40 CFR Part 125, Subpart G

I have reviewed the attached evaluation analyzing the merits of the Borough of Petersburg's request and application for a variance from secondary treatment requirements of the Clean Water Act pursuant to Section 301(h) of the Act for the Borough of Petersburg's wastewater treatment plant. It is my decision that the Borough of Petersburg be granted a variance pursuant to Section 301(h) of the Act for the Borough of Petersburg's wastewater treatment plant in accordance with the terms, conditions, and limitations of the final 301(h)-modified NPDES permit AK0021458.

My decision is based on available information specific to the discharge from the Borough of Petersburg's wastewater treatment plant. It is not intended to assess the need for secondary treatment in general, nor does it reflect on the necessity for secondary treatment by other publicly owned treatment works discharging to the marine environment.

Under the procedures of permit regulations at 40 CFR Part 124, public notice and comment regarding the draft version of this decision and accompanying NPDES permit were made available to all interested persons.

The date of this decision initiates the 30-day appeal period set forth in 40 CFR 124.19(a)(3). EPA regulations regarding the effective date for the decision and the procedures for filing a petition for review are set forth in 40 CFR Part 124. Information about the administrative appeal process may be obtained online at <http://www.epa.gov/eab> or by contacting the Clerk of the EAB at (202) 233-0122.

The Notice of Final Decision will also be posted on the EPA Region 10 website.

signed 9/30/2025
Daniel D. Opalski
Deputy Regional
Administrator

**Borough of Petersburg Wastewater Treatment Plant
Application For A Modified NPDES Permit Under Section
301(h) Of The Clean Water Act**

Decision Document

August 2025

United States Environmental Protection Agency

Region 10

1200 6th Avenue

Seattle, WA 98101

Table of Contents

1) Introduction.....	4
2) Decision Criteria	5
3) Summary of Findings	7
4) Decision and Recommendation	8
5) Description of Treatment System	9
6) Description of Receiving Waters.....	9
A. General Features.....	9
B. Currents and Flushing	10
7) Physical Characteristics of the Discharge.....	11
A. Outfall/Diffuser Design and Initial Dilution	11
8) Application of Statutory and Regulatory Criteria.....	13
A. Compliance with Primary or Equivalent Treatment Requirements [CWA Section 301(h)(9); 40 CFR 125.60].....	13
1. Total Suspended Solids	13
2. Biochemical Oxygen Demand.....	15
B. Attainment of Water Quality Standards Related to TSS and BOD ₅ [CWA 301(h)(1); 40 CFR 125.61].....	17
1. Turbidity and Light Transmittance/Attenuation.....	17
2. Dissolved Oxygen	19
C. Attainment of Other Water Quality Standards and Impact of the Discharge on Shellfish, Fish And Wildlife; Public Water Supplies; And Recreation [CWA Section 301(h)(2), 40 CFR 125.62]	21
1. pH.....	22
2. Temperature	23
3. Toxics	23
4. Bacteria	24
D. Impact of the Discharge on Public Water Supplies [40 CFR 125.62(b)]	26
E. Biological Impact of Discharge [40 CFR 125.62(c)]	27
F. Impact of Discharge on Recreational Activities [40 CFR 125.62(d)].....	30
G. Establishment of Monitoring Programs [CWA 301(h)(3), 40 CFR 125.63]	31
1. Influent/Effluent Monitoring Program [40 CFR 125.63(d)].....	31
2. Receiving Water Quality Monitoring Program [40 CFR 125.63(c)]	32

3. Biological Monitoring Program [40 CFR 125.63(b)]	32
H. Effect of Discharge on Other Point and Nonpoint Sources [CWA 301(h)(4), 40 CFR 125.64]	34
I. Urban Area Pretreatment Program [CWA 301(h)(6), 40 CFR 125.65]	34
J. Industrial and Nonindustrial Sources and Toxics Control [CWA 301(h)(7), 40 CFR 125.66].....	34
1. Chemical Analysis and Toxic Pollutant Source Identification [40 CFR 125.66(a) and (b)]	34
2. Industrial Pretreatment Program [40 CFR 125.66(c)]	35
3. Nonindustrial Source Control Program [40 CFR 125.66(d)]	35
K. Effluent Volume and Amount of Pollutants Discharged [40 CFR 125.67]	35
L. Compliance with other Applicable Laws [40 CFR 125.59]	36
1. Coastal Zone Management Act	36
2. Marine Protection, Research, and Sanctuaries Act	36
3. Endangered Species Act	36
4. Essential Fish Habitat	37
M. State Determination and Concurrence [40 CFR 125.61(b)(2); 40 CFR 125.64(d)]	37
9) References	39
10) Appendices	40
A. Facility and Outfall Locations	40
B. Facility Figures and Process Flow Diagram	42
C. Discharge Monitoring Data (2018-2023)	45
D. Alaska WQS	47
E. Equations and Analysis	53
1. Section 8.B.1: Attainment of TSS Standard	53
2. Section 8.B.2: Attainment of DO Standard	53
3. Section 8.C.3. Toxics Analysis	55
F. Dilution Modeling Report	55

List of Tables

Table 1. Current Predictions by Tide Type and Current Velocity Bands for 2020.....	11
Table 2. Influent and Effluent TSS Data (6/2018-05/2023)	15
Table 3. Influent and Effluent BOD Data (6/2018-5/2023).....	17
Table 4. Secchi Depth Monitoring.....	18
Table 5. ZID Boundary Turbidity Monitoring (NTU)	19
Table 6. Reference Site Turbidity Monitoring (NTU)	19
Table 7. Fecal Coliform DMR Summary Data (6/2018-5/2023)	24
Table 8. Fecal Coliform Statistic by Station (2002-2006).....	25
Table 9. Total Volatile Solids and Total Solids Results.....	28
Table 10. Species Observed during 2005 Biological Monitoring	30
Table 11. Discharge Monitoring Data (2018-2023)	45
Table 12. Alaska WQS for Turbidity for Marine Uses	47
Table 13. Alaska WQS for Dissolved Gas for Marine Uses.....	48
Table 14. Alaska WQS for pH for Marine Uses	49
Table 15. Alaska WQS for Temperature for Marine Uses.....	50
Table 16. Alaska WQS for Toxics for Marine Uses.....	51
Table 17. Alaska WQS for Bacteria for Marine Uses	52
Table 18. Dissolved Oxygen Analysis.....	54

List of Figures

Figure 1. Minimum Monthly Percent TSS Removal (06/2018 – 05/2023)	14
Figure 2. Average Monthly Influent and Effluent TSS Concentrations (06/2018-05/2023)	14
Figure 3. BOD ₅ Percent Removal (6/2018-5/2023)	16
Figure 4. Monthly Influent and Effluent BOD ₅ Concentrations (6/2018-5/2023).....	16
Figure 5. Facility Location Satellite.....	40
Figure 6. Facility Location Small Scale	41
Figure 7. Petersburg WWTP Map.....	42
Figure 8. Petersburg Borough Sewer Outfall Plan View and Cross Section	43
Figure 9. Process Schematic.....	44

1) Introduction

The Borough of Petersburg, Alaska, (“the applicant,” “Petersburg,” or “the permittee”) has requested a renewal of its variance (sometimes informally called a “waiver” or “modification”) under Section 301(h) of the Clean Water Act (the Act or CWA) from the secondary treatment requirements contained in Section 301(b)(1)(B) of the Act, 33 USC § 1311(b)(1)(B).

The United States Environmental Protection Agency, Region 10 (EPA) approved Petersburg’s most recent National Pollutant Discharge Elimination System (NPDES) permit for the Petersburg Wastewater Treatment Plant (“WWTP” or “the facility”) and issued a CWA Section 301(h)-modified permit on November 20, 2001 (AK0021458) (hereafter referred to as the 2001 permit). The 2001 permit became effective on December 24, 2001, and expired on December 26, 2006. A timely and complete NPDES application for permit reissuance was submitted by the permittee on July 13, 2006. Pursuant to 40 CFR 122.6, the permit has been administratively continued and remains fully effective and enforceable.

The 301(h) variance is being sought for the Petersburg WWTP; a publicly owned treatment works (POTW). The applicant is seeking a 301(h) variance to discharge wastewater receiving less-than-secondary treatment from a single outfall into Frederick Sound. The effluent quality attainable by secondary treatment is defined in the regulations at 40 CFR Part 133 in terms of biochemical oxygen demand (BOD₅), total suspended solids (TSS), and pH. Pursuant to 40 CFR 133.102, secondary treatment requirements for TSS, BOD₅, and pH are as follows:

TSS: (1) The 30-day average concentration shall not exceed 30 mg/l;
 (2) The 7-day average concentration shall not exceed 45 mg/l; and
 (3) The 30-day average percent removal shall not be less than 85%.

BOD₅: (1) The 30-day average concentration shall not exceed 30 mg/l;
 (2) The 7-day average concentration shall not exceed 45 mg/l; and
 (3) The 30-day average percent removal shall not be less than 85%.

pH: The pH of the effluent shall be maintained within the limits of 6.0 to 9.0 pH standard units.

The permittee requested a modification for TSS, BOD₅, and pH.

This document presents EPA Region 10’s findings and conclusions as to whether the applicant’s proposed 301(h)-modified discharge (proposed discharge) will comply with the criteria set forth in sections 301(h) of the Act, as implemented by regulations at 40 CFR Part 125, Subpart G, and Alaska Water Quality Standards (Alaska WQS), as amended.

2) Decision Criteria

Under Section 301(b)(1)(B) of the Act, POTWs in existence on July 1, 1977, are required to meet effluent limits based on secondary treatment as defined by the Administrator of EPA ("the Administrator"). Secondary treatment is defined by the Administrator in terms of three parameters: TSS, BOD₅, and pH. Uniform national effluent limitations for these pollutants were promulgated and included in NPDES permits for POTWs issued under Section 402 of the CWA, POTWs were required to comply with these limitations by July 1, 1977.

Congress subsequently amended the Act, adding Section 301(h) which authorizes the Administrator, with State concurrence, to issue NPDES permits that modify the secondary treatment requirements of the Act with respect to certain discharges. P.L. 95-217, 91 Stat. 1566, as amended by P.L. 97-117, 95 Stat. 1623; and S303 of the Water Quality Act of 1987. Section 301(h) provides that:

[T]he Administrator, with the concurrence of the State, may issue a permit under section 402 [of the Act] which modifies the requirements of subsection (b)(1)(B) of this section [the secondary treatment requirements] with respect to the discharge of any pollutant from a publicly owned treatment works into marine waters, if the applicant demonstrates to the satisfaction of the Administrator that:

- (1) there is an applicable water quality standard specific to the pollutant for which the modification is requested, which has been identified under section 304(a)(6) of [the CWA];*
- (2) the discharge of pollutants in accordance with such modified requirements will not interfere, alone or in combination with pollutants from other sources, with the attainment or maintenance of that water quality which assures protection of public water supplies and the protection and propagation of a balanced, indigenous population of shellfish, fish and wildlife, and allows recreational activities, in and on the water;*
- (3) the applicant has established a system for monitoring the impact of such discharge on a representative sample of aquatic biota, to the extent practicable, and the scope of the monitoring is limited to include only those scientific investigations which are necessary to study the effects of the proposed discharge;*
- (4) such modified requirements will not result in any additional requirements on any other point or nonpoint source;*
- (5) all applicable pretreatment requirements for sources introducing waste into such treatment works will be enforced;*
- (6) in the case of any treatment works serving a population of 50,000 or more, with respect to any toxic pollutant introduced into such works by an industrial discharger for which pollutant there is no applicable pretreatment requirement in*

effect, sources introducing waste into such works are in compliance with all applicable pretreatment requirements, the applicant has in effect a pretreatment program which, in combination with the treatment of discharges from such works, removes the same amount of such pollutant as would be removed if such works were to apply secondary treatment to discharges and if such works had no pretreatment program with respect to such pollutant;

- (7) to the extent practicable, the applicant has established a schedule of activities designed to eliminate the entrance of toxic pollutants from nonindustrial sources into such treatment works;*
- (8) there will be no new or substantially increased discharges from the point source of the pollutant into which the modification applies above that volume of discharge specified in the permit; and*
- (9) the applicant at the time such modification becomes effective will be discharging effluent which has received at least primary or equivalent treatment and which meets the criteria established under [section 304(a)(1) of the CWA] after initial mixing in the waters surrounding or adjacent to the point at which such effluent is discharged.*

For the purposes of this subsection the phrase “the discharge of any pollutant into marine waters” refers to a discharge into deep waters of the territorial sea or the waters of the contiguous zone, or into saline estuarine waters where there is strong tidal movement and other hydrological and geological characteristics which the Administrator determines necessary to allow compliance with paragraph (2) of this subsection, and [section 101(a)(2) of the Act]. For the purposes of paragraph (9), “primary or equivalent treatment” means treatment by screening, sedimentation, and skimming adequate to remove at least 30 percent of the biological oxygen demanding material and of the suspended solids in the treatment works influent, and disinfection, where appropriate. A municipality which applies secondary treatment shall be eligible to receive a permit pursuant to this subsection which modifies the requirements of subsection (b)(1)(B) of this section with respect to the discharge of any pollutant from any treatment works owned by such municipality into marine waters. No permit issued under this subsection shall authorize the discharge of sewage sludge into marine waters. In order for a permit to be issued under this subsection for the discharge of a pollutant into marine waters, such marine waters must exhibit characteristics assuring that water providing dilution does not contain significant amounts of previously discharged effluent from such treatment works. No permit issued under this subsection shall authorize the discharge of any pollutant into saline estuarine waters which at the time of application do not support a balanced, indigenous population of shellfish, fish and wildlife, or allow recreation in and on the waters or which exhibit ambient water quality below applicable

water quality standards adopted for the protection of public water supplies, shellfish, fish and wildlife or recreational activities or such other standards necessary to assure support and protection of such uses. The prohibition contained in the preceding sentence shall apply without regard to the presence or absence of a causal relationship between such characteristics and the applicant's current or proposed discharge. Notwithstanding any of the other provisions of this subsection, no permit may be issued under this subsection for discharge of a pollutant into the New York Bight Apex consisting of the ocean waters of the Atlantic Ocean westward of 73 degrees 30 minutes west longitude and westward of 40 degrees 10 minutes north latitude.

On August 9, 1994, EPA promulgated final regulations implementing these statutory criteria at 40 CFR Part 125, Subpart G. The regulations provide that a Section 301(h)-modified NPDES permit may not be issued in violation of 40 CFR 125.59(b) which requires, among other things, compliance with provisions of the Coastal Zone Management Act, as amended, 16 USC 1451 *et seq.*, the Endangered Species Act (ESA), as amended, 16 USC 1531 *et seq.*, Title III of the Marine Protection Research and Sanctuaries Act, as amended, 16 USC 1431 *et seq.*, the Magnuson-Stevens Fishery Conservation and Management Act, as amended, 16 USC 1801 *et seq.*, and any other applicable provisions of local, state, and federal laws or Executive Orders.

In accordance with 40 CFR 125.59(i), the decision to grant or deny a CWA Section 301(h) waiver shall be made by the Administrator¹ and shall be based on the applicant's demonstration that it has met all the requirements of 40 CFR 125.59 through 125.68, as described in this 301(h) Decision Document (301(h) DD). EPA has reviewed all data submitted by the applicant in the context of applicable statutory and regulatory criteria and has presented its findings and conclusions in this 301(h) DD.

3) Summary of Findings

Based upon review of the data, references, and empirical evidence furnished by the applicant and other relevant sources, EPA Region 10 makes the following findings with regarding the statutory and regulatory criteria:

1. The applicant's proposed discharge will comply with Alaska WQS for dissolved oxygen and turbidity. [CWA Section 301(h)(1), 40 CFR 125.61]
2. The applicant has demonstrated it can consistently achieve Alaska WQS and federal CWA Section 304(a)(1) water quality criteria at and beyond the zone of initial dilution (ZID). [CWA Section 301(h)(9), 40 CFR 125.62(a)]

¹ The authority to make tentative (and final) decisions on the eligibility of publicly owned treatment works for variances from the secondary treatment requirements of the Clean Water Act pursuant to Section 301(h) of the CWA has been delegated to the Regional Administrators.

3. The applicant's proposed discharge, alone or in combination with pollutants from other sources, will not adversely impact public water supplies or interfere with the protection and propagation of a balanced indigenous population (BIP) of shellfish, fish, and wildlife, and will allow for recreational activities in an on the water. [CWA Section 301(h)(2), 40 CFR 125.62(b), (c), (d)]
4. The applicant has a well-established and adequate program to monitor the impact of its proposed discharge on aquatic biota and has demonstrated it has adequate resources to continue the program. These monitoring requirements will remain enforceable terms of the permit. [CWA Section 301(h)(3), 40 CFR 125.63]
5. The applicant's proposed discharge will not result in any additional treatment requirements on any other point or nonpoint sources.
6. The facility serves a population less than 50,000 people, so does not need to develop an urban area pretreatment program [CWA Section 301(h)(6), 40 CFR 125.65]
7. The applicant will develop an industrial pretreatment program and will continue to implement its nonindustrial source control program, consisting of public outreach and education designed to minimize the amount of toxic pollutants that enter the treatment system from nonindustrial sources. [CWA Section 301(h)(7); 40 CFR 125.65; 40 CFR 125.66]
8. There will be no new or substantially increased discharges from the point source of the pollutants to which the Section 301(h) variance applies above those specified in the permit. [CWA Section 301(h)(8), 40 CFR 125.67]
9. The Section 301(h) modified permit contains the special conditions required regarding effluent limitations and mass loadings, schedules of compliance, and monitoring and reporting requirements [40 CFR 125.68]
10. The discharge is not expected to conflict with applicable provisions of State, local, or other Federal laws or Executive Orders, including compliance with the Coastal Zone Management Act of 1972, as amended, 16 USC1451 *et seq.*; the Endangered Species Act of 1973, as amended, 16 USC 1531 *et seq.*; Title III of the Marine Protection, Research and Sanctuaries Act, as amended, 16 USC 1431 *et seq.*; and the Magnuson-Stevens Fishery Conservation and Management Act, as amended, 16 USC 1801 *et seq.* [40 CFR 125.59(b)(3)]
11. The applicant has demonstrated the proposed discharge will comply with federal primary treatment requirements. [CWA Section 301(h)(9), 40 CFR 125.60]

4) Decision and Recommendation

Based on the findings in Section 3, above, EPA has concluded that the applicant's proposed discharge will comply with the requirements of CWA section 301(h), and 40 CFR Part 125, Subpart G. Accordingly, EPA has decided to grant the applicant a CWA Section 301(h) variance renew their modified NPDES Permit AK0021458.

5) Description of Treatment System

The Petersburg WWTP serves the community of Petersburg, Alaska, which has a population of approximately 3,000 people. According to the facility, the design flow is 1.2 MGD monthly average flow and 3.6 MGD maximum daily flow; with a design flow >1 MGD, the facility is considered a major POTW. In accordance with 40 CFR 125.58(c), the facility is a “small applicant” under CWA section 301(h). The collection system is not a combined sanitary sewer system. The effluent is all domestic in origin. The existing outfall (001) discharges to Frederick Sound approximately 1,200 feet (366 meters) offshore at a depth of 60 feet (18.3 meters) below mean lower low water (MLLW). The outfall location is at the following latitude and longitude: 56.81965°N, -132.92318°W.

Raw sewage enters the WWTP through two primary screens and then proceeds to the grit separator where gravitational and centrifugal forces remove grit. The influent is then routed to two primary clarifiers, and chlorine is intermittently added. Primary sludge and skimmings from the clarifier are moved to the sludge storage tank. The final effluent from the primary clarifiers flow over v-notch weirs at the outlet end of the tanks and is collected in effluent launders where it then flows to the outfall pipe in Frederick Sound.

Separated solids removed from the primary screens are used as a bulking agent in the facility’s composting operation. Sludge and scum are discharged to the sludge storage tank, which acts as an aerobic digester. Sludge from the storage tank is then routed to a belt filter for dewatering, through a variable speed progressive cavity pump with an added polymer, and then into a sludge mixing tank. The mixture then flows through the belt filter press and the dewatered solids are composed on site using either an aerated static or aerated turned pile method. The finished compost meets Class A biosolids requirements. See Appendix A for facility figures, area maps, and the treatment process flow diagram.

6) Description of Receiving Waters

A. General Features

The WWTP discharges into the waters of Frederick Sound, approximately 1,200 feet from the shore of Mitkof Island. Frederick Sound is connected to the Pacific Ocean via Chatham Strait to the northwest and Dry Strait/Sumner Strait to the southeast.

Surface water densities near the outfall vary due to local freshwater inputs from nearby rivers. The major freshwater input to Frederick Sound is the Stikine River, which discharges with an annualized average flow of 55,078 cfs, with the maximum average monthly discharge of 134,000 cfs occurring in June (USGS 2019).

According to the 2001 Fact Sheet, the original, revised, and 1990 application were based on a discharge to a saline estuary. For the 2001 permit, the applicant requested EPA re-evaluate the

waters as “ocean waters,” and EPA decided that either saline waters or ocean waters could be supported. The 301(h) regulations provide the following definitions of saline estuarine and ocean waters:

40 CFR 125.58(v): *Saline estuarine waters* means those semi-enclosed coastal waters which have a free connection to the territorial sea, undergo net seaward exchange with ocean waters, and have salinities comparable to those of the ocean. Generally, these waters are near the mouth of estuaries and have cross-sectional annual mean salinities greater than twenty-five (25) parts per thousand.

40 CFR 125.58(n): *Ocean waters* means those coastal waters landward of the baseline of the territorial seas, the deep waters of the territorial seas, or the waters of the contiguous zone. The term “ocean waters” excludes saline estuarine waters.

Upon review of these definitions EPA has determined the Petersburg discharge is to saline estuarine waters as defined in 40 CFR 125.58(v). Frederick Sound is a semi-enclosed coastal water with a free connection to the territorial sea, undergoes net seaward exchange with ocean waters, and has an annual mean salinity greater than twenty-five parts per thousand. The discharge area is directly north of the Stikine River estuary, the largest tidal estuary in southeast Alaska. The influence of the Stikine River estuary on the discharge area can be seen in satellite imagery showing sediment plumes extending south to Wrangell and north near Petersburg. In addition, there are several smaller tidal saline estuary systems north and south of the discharge area, including Thomas Bay, Farragut Bay, Portage Bay, and LeConte Bay.

Frederick Sound is classified in Alaska WQS as classes 2A(i)(ii)(iii), B(i)(ii), C and D, for use in aquaculture, seafood processing and industrial water supply, water contact and secondary recreation, growth and propagation of fish, shellfish, aquatic life and wildlife, and harvesting for consumption of raw mollusks or other raw aquatic life.

B. Currents and Flushing

Currents in the receiving water are generally reported to flow northwestward with southwestward during large tides. According to NOAA, the mean tide range at Petersburg is 13.56 ft, with a diurnal range of 15.99 feet, and a mean tide level of 8.00 feet above MLLW (NOAA 2019a). At the Wrangell Narrows station (station #1525) off Petersburg, the average maximum flood current is 3.2 knots with a bearing of 246° (generally southwest), the average minimum before ebb is 0.1 knots with a bearing of 334° (generally northwest), and the average maximum ebb is 2.1 knots, with a bearing of 062° (generally northeast) (NOAA 2019b).

As shown in Table 1, 2020 current data for Wrangell Narrows station at the 25-foot depth reveals that annual current velocities associated with flood tides are predicted to be generally greater across all bands than velocities associated with ebb tides, indicating a general dominance of flood tide forces in a southwesterly direction away from the outfall (NOAA 2020). The facility discharges to a saline estuarine environment where tidal currents vary in speed and

direction over the course of a day. This results in the possibility that the effluent waste transported away from the zone of initial dilution (ZID) during the first half of a tidal cycle will be transported back into the ZID on the second half of the tidal cycle. However, if this were to occur, effluent would be additionally diluted in the approximate 5 hours between flood and ebb tides before re-entering the ZID.

Table 1. Current Predictions by Tide Type and Current Velocity Bands for 2020

Tide Type with Current Velocity Bands (knots)	Percent of Total
ebb	25.65%
0-0.5	0.28%
0.5-1	2.38%
1-1.5	6.17%
1.5-2	7.43%
2-2.5	6.13%
2.5-3	2.59%
3-3.5	0.67%
flood	24.81%
1-1.5	1.89%
1.5-2	5.36%
2-2.5	7.22%
2.5-3	6.76%
3-3.5	2.70%
3.5-4	0.88%
slack	49.54%
0-0.5	49.54%
Grand Total	100.00%

7) Physical Characteristics of the Discharge

A. Outfall/Diffuser Design and Initial Dilution

Pursuant to 40 CFR 125.62(a)(1), the outfall and diffuser must be located and designed to provide adequate initial dilution, dispersion, and transport of wastewater to meet all applicable WQS at and beyond the boundary of the ZID during periods of maximum stratification and during other periods when discharge characteristics, water quality, biological seasons, or oceanographic conditions indicate more critical situations may exist.

The WWTP outfall and diffuser are made of an 18-inch diameter ductile iron pipe. The outfall is 1,200 feet in length from MLLW, terminating in a diffuser 45.9 feet (14 m) in length with five 4-inch diameter ports. The effluent is discharged from only two of the five ports, with the other three closed.

Zone of Initial Dilution (ZID)

Section 301(h)(9) of the CWA and 40 CFR 125.62 require 301(h) discharges to meet state WQS and federal CWA section 304(a) criteria at the boundary of the ZID, which is the region of initial mixing surrounding or adjacent to the end of the outfall pipe or diffuser ports. The ZID may not be larger than allowed by mixing zone restrictions in applicable WQS. 40 CFR 125.58(dd). The dilution ratio achieved at the completion of initial mixing at the edge of the ZID is used to determine compliance with these requirements. Dilution is defined as the ratio of the total volume of the sample (ambient water plus effluent) to the volume of effluent in the sample. The ZID is not intended to describe the area bounding the entire mixing process or the total area impacted. Rather, the ZID, or region of *initial mixing*, is the area of rapid, turbulent mixing of the effluent and receiving water and results from the interaction between the buoyancy and momentum of the discharge and the density and momentum of the receiving water. Initial dilution is normally complete within several minutes after discharge. In guidance, EPA has operationally delimited the ZID to include the bottom area within a horizontal distance equal to the water depth from any point on the diffuser and the water column above that area (Amended 301(h) Technical Support Document; 301(h) TSD). Beyond the ZID boundary (i.e., after initial mixing is complete), the effluent is diluted further by passive diffusion processes and far-field ambient receiving water conditions. The ZID is not inclusive of this far-field mixing process.

The 2001 permit used a dilution factor for the ZID of 100:1. EPA was unable to recreate this dilution factor using available effluent and receiving water data. Thus, EPA modeled the current discharge to determine the dilution achieved at the edge of the ZID using the discharge depth of the facility and tidal predictions from near the facility, in combination with recent effluent and receiving water data. In accordance with the 301(h) TSD, EPA used data reflecting critical discharge and receiving water conditions to determine dilution under critical conditions. The dilution modeling report is included in Appendix F.

According to the model, the discharge achieves initial mixing and a dilution of 67:1 about 60 feet from the outfall at a depth of approximately 50 feet within one minute of discharge under critical discharge and receiving water conditions. EPA used 67:1 dilution as the basis for determining compliance with CWA section 301(h)(9) and 40 CFR 125.62. Consistent with the recommendations in the 301(h) TSD for setting spatial boundaries for the ZID, EPA has established the spatial dimensions of the ZID which include the entire water column within 60 feet of any point of the 45.9-foot diffuser. The ZID was calculated to be a rectangle of 183.7 feet (56 m) long (perpendicular to shore) and 139.3 ft (42.5 m) wide centered around the diffuser. EPA has consulted with ADEC (Alaska Department of Environmental Conservation) and used acute and chronic dilution factors of 7.3:1 and 56:1, respectively. These dilutions fall within the boundary of the ZID.

8) Application of Statutory and Regulatory Criteria

The sections below describe the statutory and regulatory requirements that are applicable to CWA Section 301(h) discharges and explains the basis for certain water quality effluent limits in the final permit.

A. Compliance with Primary or Equivalent Treatment Requirements [CWA Section 301(h)(9); 40 CFR 125.60]

Under CWA section 301(h)(9) and 40 CFR 125.60, the applicant must demonstrate it will be discharging effluent that has received at least primary or equivalent treatment at the time the 301(h)-modified permit becomes effective. 40 CFR 125.58(r) defines primary or equivalent treatment as treatment by screening, sedimentation, and skimming adequate to remove at least 30 percent of the biochemical oxygen demanding material and other suspended solids in the treatment works influent, and disinfection, where appropriate. To ensure the effluent has received primary or equivalent treatment, 40 CFR 125.60 requires the applicant to perform monitoring of their influent and effluent and assess BOD₅ and TSS removal rates based on a monthly average.

Applicants for 301(h) waivers request concentration and loading (lbs/day) limits for BOD₅ and TSS based on what the facility can achieve. Therefore, the technology-based requirements for POTWs with 301(h) waivers are established on a case-by-case basis taking into consideration facility performance and the federal primary treatment standards.

1. Total Suspended Solids

EPA reviewed influent and effluent monitoring data for TSS between 2018 and 2023. A summary table and graphical representation of the data is provided below.

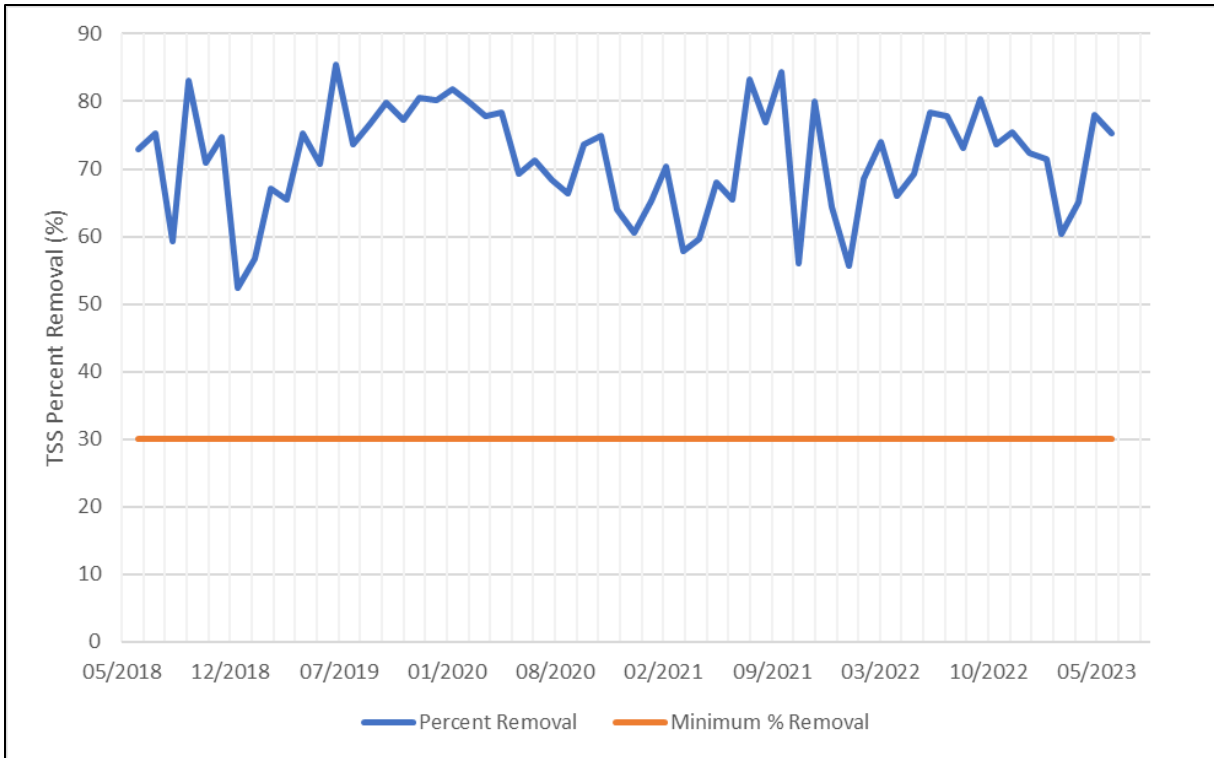


Figure 1. Minimum Monthly Percent TSS Removal (06/2018 – 05/2023)

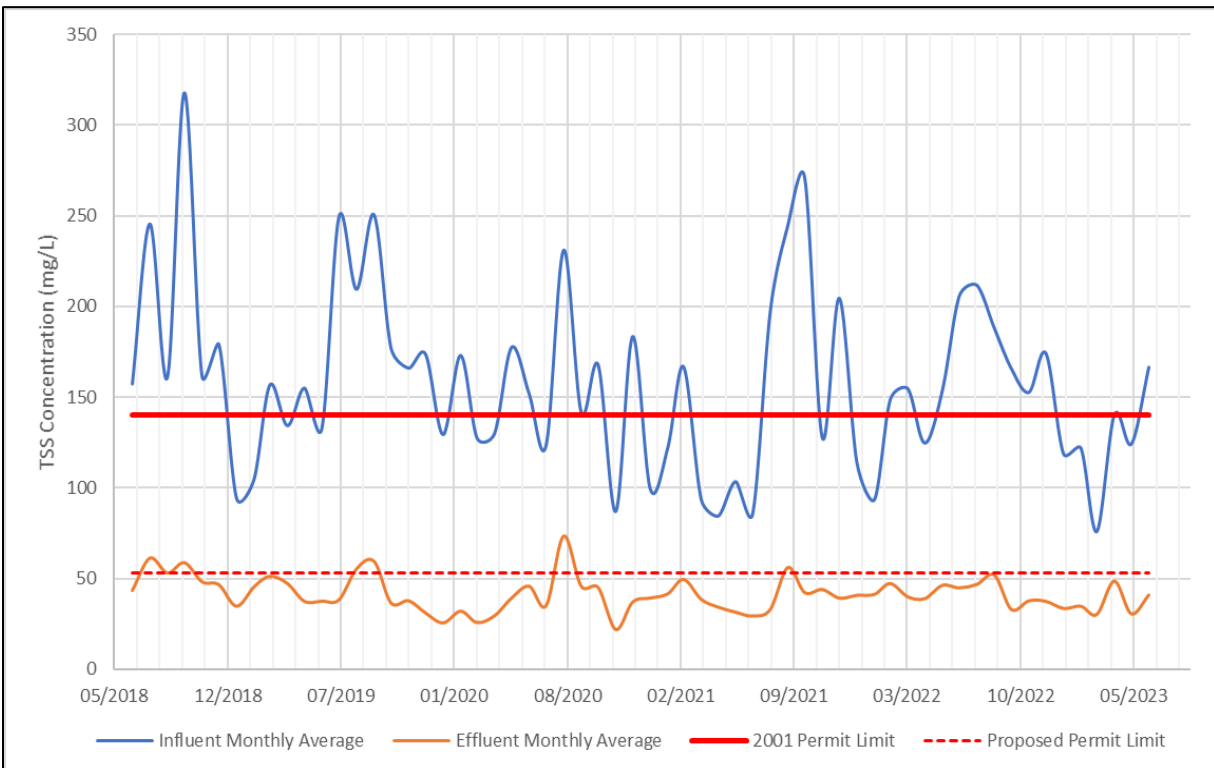


Figure 2. Average Monthly Influent and Effluent TSS Concentrations (06/2018-05/2023)

The facility achieved the minimum 30% removal requirement for TSS 100% of the time between 2018-2023, with the lowest monthly removal being 52%. Between 2018 and 2023 the facility achieved an average of nearly 72% removal of TSS, with maximum percent removal efficiencies as high as 86%.

Table 2. Influent and Effluent TSS Data (6/2018-05/2023)

Statistic	Influent, TSS, mg/L, Mo. Avg	Effluent, TSS, mg/L, Max Daily	Effluent, TSS, mg/L, Mo. Avg	Percent Removal
2001 Limit	---	200	140	≥30%
Count	60	60	60	60
Mean	158	47	41	72
Minimum	76	25	22	52
Max	318	85	73	86
STDV	50	12	10	8
CV	0.84	0.20	0.16	0.13
5th	86	29	26	56
95th	250	68	59	83

The applicant has demonstrated that it will be discharging effluent that has received at least primary treatment for TSS when the 301(h)-modified permit becomes effective. [CWA section 301(h)(9) and 40 CFR 125.60].

2. Biochemical Oxygen Demand

EPA reviewed influent and effluent data for BOD₅ between 2018 and 2023. A summary table and graphical representation of the data is provided below.

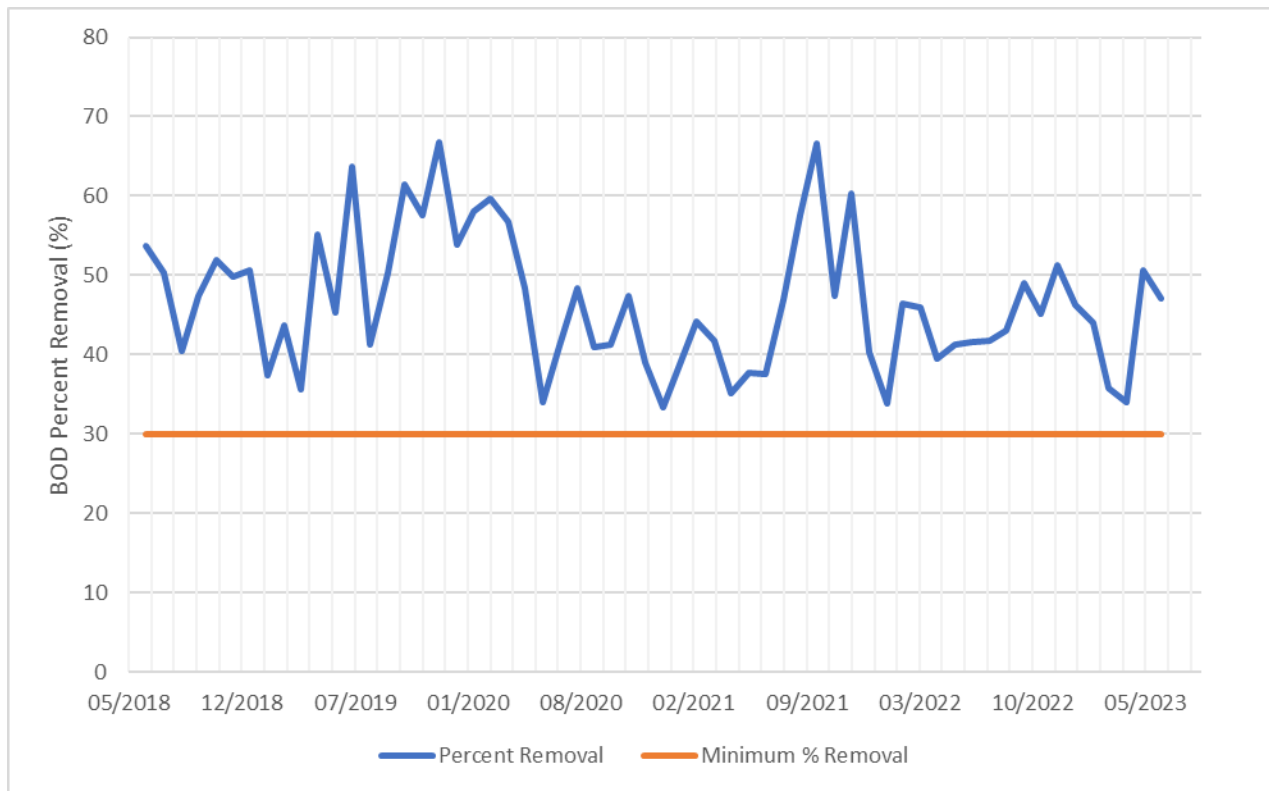


Figure 3. BOD₅ Percent Removal (6/2018-5/2023)

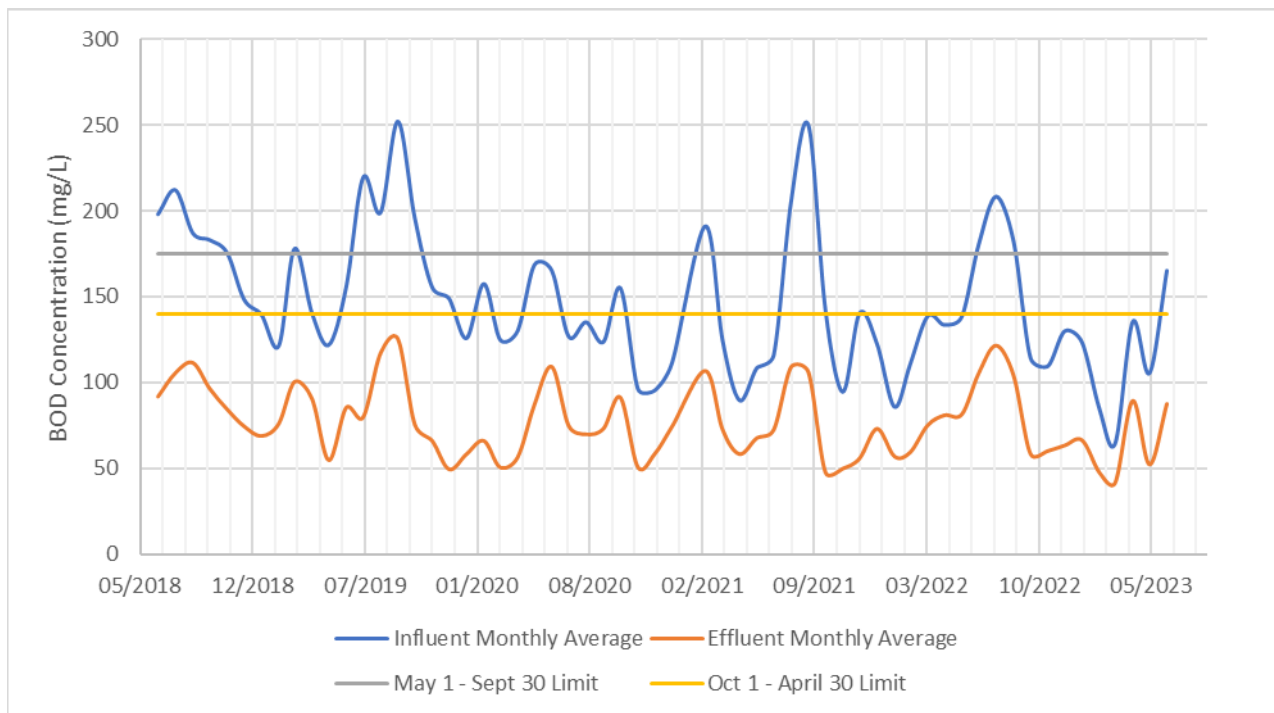


Figure 4. Monthly Influent and Effluent BOD₅ Concentrations (6/2018-5/2023)

The facility achieved the minimum 30% removal requirement for BOD₅ 100% of the time between June 2018 and May 2023. Between 2018 and 2023 the facility achieved an average of 46.7% removal of BOD₅, with maximum percent removal efficiencies as high as 59%.

Table 3. Influent and Effluent BOD Data (6/2018-5/2023)

Statistic	Influent, BOD ₅ , mg/L, Mo. Avg	Effluent, BOD ₅ , mg/L, Max Daily ¹	Effluent, BOD ₅ , mg/L, Mo. Avg ¹	Percent Removal
2001 Limit (5/1-9/30)	---	200	175	≥30%
2001 Limit (10/1-4/30)	---	200	140	≥30%
Count	59	59	59	20
Mean	147	87	77	47
Min	65	42	42	36
Max	252	147	125	59
STDV	41	25	21	7
CV	0.69	0.42	0.36	0.36
5th	86	52	48	36
95th	219	130	117	59

The applicant has demonstrated that it will be discharging effluent that has received at least primary treatment for BOD₅ when the 301(h)-modified permit becomes effective. [CWA section 301(h)(9) and 40 CFR 125.60].

B. Attainment of Water Quality Standards Related to TSS and BOD₅
[CWA 301(h)(1); 40 CFR 125.61]

Under 40 CFR 125.61, which implements CWA section 301(h)(1), there must be water quality standards applicable to the pollutants for which the modification is requested, and the applicant must demonstrate that the proposed discharge will comply with these standards. The applicant has requested modified secondary treatment requirements for BOD₅, which affects dissolved oxygen (DO), TSS, which affects the color or turbidity in the receiving water, and pH. The State of Alaska has water quality standards for DO, turbidity, and pH.

1. Turbidity and Light Transmittance/Attenuation

Alaska WQS applicable to the open waters of Frederick Sound provide that turbidity shall not exceed 25 nephelometric turbidity units (NTU), may not interfere with disinfection, may not cause detrimental effect on established levels of water supply treatment, and may not reduce the depth of the compensation point for photosynthetic activity by more than 10%. In addition, turbidity may not reduce the maximum secchi disc depth by more than 10%. Alaska WQS for turbidity can be found in Appendix D.

The applicant provided receiving water data for turbidity and secchi depth. Sampling was conducted in January 2002, August 2003, January 2004, and August 2005 at the four sites, two sites adjacent to the boundary of the ZID, and two reference sites. Sites 1 and 2 are ZID boundary sites and sites 3 and 4 are reference sites. Monitoring results are presented in Table 4, Table 5, and Table 6 below.

Secchi depths ranged from 4.0 feet in August 2003 to 8.8 feet in January 2002. The average of reference sites 3 and 4 was 5.7 m, while the average for the ZID boundary sites was 6.3 m, approximately 10% lower.

Table 4. Secchi Depth Monitoring

Site	Secchi Depth (m)						
	Jan 2002	Aug 2003	Jan 2004	Aug 2005	Avg	Max	Min
Site 1: ZID Boundary	8.8	4.1	6.8	7.0	6.7	8.8	4.1
Site 2: ZID Boundary	7.9	4.0	5.1	6.9	6.0	7.9	4.0
Site 3: Reference	6.0	4.5	5.0	5.0	5.1	6.0	4.5
Site 4: Reference	7.9	4.1	5.0	8.4	6.4	8.4	4.1

The applicant provided 36 readings for turbidity in the receiving water at surface, mid, and bottom depths (bottom depth of 60 feet). Turbidity results were not provided for the January 2002 sampling event, and the facility reported that the probe used to measure turbidity was malfunctioning. Average receiving water turbidity values at ZID boundary sites 1 and 2 were 4.9, 4.3, and 3.5 NTU for surface, mid, and bottom monitoring, respectively. Average values for reference sites 3 and 4 were 7.1, 7.9, 24.5 NTU for surface, mid, and bottom monitoring, respectively. The maximum turbidity values measured at a ZID boundary site of 9.7 NTU was observed in a surface sample taken during August. The maximum turbidity value measured at a reference site of 130 NTU was observed in a bottom sample taken during September and is likely the result of substantial sediment inputs from the nearby Stikine River estuary to the south. Given that the turbidity measured in all samples taken at the ZID boundary are below Alaska's water quality criteria for turbidity of 25 NTU, and measured turbidity at the ZID boundary is generally lower than the values at reference sites, it is not expected that the discharge will result in an excursion above Alaska WQS for turbidity.

Table 5. ZID Boundary Turbidity Monitoring (NTU)

Year	Site	Surface	Mid	Bottom
Aug 2003	Site 1	9.7	3.1	3.4
	Site 2	2	3.3	3.2
Feb 2004	Site 1	3.4	7.8	6.6
	Site 2	4.5	2.8	2.9
Sept 2005	Site 1	8.3	7.8	3
	Site 2	1.5	1.1	2
Max	-	9.7	7.8	6.6
Min	-	1.5	1.1	2
Average	-	4.9	4.3	3.5

Table 6. Reference Site Turbidity Monitoring (NTU)

Year	Site	Surface	Mid	Bottom
Aug 2003	Site 3	2	2	1.8
	Site 4	0.6	2.4	3.2
Feb 2004	Site 3	5.4	4.7	1.2
	Site 4	2.4	5	6.8
Sept 2005	Site 3	27.3	26.1	130
	Site 4	4.8	7.3	4
Max	-	27.3	26.1	130
Min	-	0.6	2	1.2
Average	-	7.1	7.9	24.5

The change in suspended solids in the water column is indirectly related to turbidity measurements. To further assess the potential for the discharge to cause or contribute to an excursion above Alaska WQS for turbidity and light transmittance, EPA determined the maximum change in suspended solids concentration of TSS in the discharge at the edge of the ZID using formula B-32 from the 301(h) TSD. The results show a 1.2 mg/L increase in suspended solids in the receiving water after initial dilution, or 1.5%.

As discussed in the 301(h) TSD, an increase in TSS of less than 10% after initial dilution is not expected to have a substantial impact on water quality.

Based on the above analyses, the proposed discharge is expected to comply with Alaska WQS for turbidity and light transmittance/attenuation. See Appendix E for the full equations.

2. Dissolved Oxygen

The effect of the effluent on ambient DO can occur in the nearshore and far-field as effluent mixes with the receiving water and the oxygen demand of the effluent BOD₅ load is exerted. Pursuant to 40 CFR 125.61(b)(1) and 125.62(a)(1), the applicant must demonstrate that the

proposed discharge will comply with WQS for DO and that the outfall and diffuser are located and designed to provide adequate initial dilution, dispersion, and transport of wastewater such that the discharge does not exceed WQS at and beyond the ZID. In the previous permit issuance, ADEC determined that the receiving waters classified as both coastal and estuarine must meet the standards for both (i.e., DO may not be less than 5.0 mg/L at any time or depth). Therefore, Alaska WQS for DO applicable to Frederick Sound provide that DO may not be less than 5.0 mg/L except where natural conditions cause this value to be depressed, and in no case may DO levels exceed 17 mg/L [18 AAC 70.15(a)(i)]. Alaska WQS for DO are shown in Appendix D.

In accordance with EPA's 301(h) TSD, EPA assessed attainment of the WQS for DO based on review of effluent (June 2018 - May 2023) and receiving water monitoring data (2002-2005).

The 301(h) TSD (USEPA 1994) provides several procedures for assessing whether a proposed discharge will meet WQS for DO at the edge of the ZID. Methods include calculating the final DO concentration of the effluent at the edge of the ZID using discharge and receiving water data and assessing the accumulation of suspended solids around the outfall.

DO Concentration at the Edge of the ZID

EPA calculated the DO concentration at the ZID boundary using receiving water data provided by the applicant and the procedures described in Equation B-5 of the 301(h) TSD.

The discharge results in a maximum near field DO depletion at the ZID of 0.14 mg/L (2.0%) from ambient concentrations (Appendix E of this TDD). The minimum DO concentration of the receiving water immediately following initial dilution is between 5.48 mg/L and 7.06 mg/L and varies by water depth and location (reference or outfall), with a minimum DO concentration of 6.82 mg/L on the surface, and a maximum DO concentration on the edge of the ZID of 7.06 mg/L. These values meet Alaska WQS as described in Appendix D.

Far Field DO Impacts

To assess the potential for far field impacts to DO, the final BOD₅ concentration after initial mixing was determined using the simplified procedures described in Appendix B of the 301(h) TSD and outlined in Appendix E of this 301(h) TDD. The calculation resulted in a final BOD₅ concentration of 2.72 mg/L after initial mixing, a concentration that is not anticipated to cause or contribute to any measurable far field DO impacts beyond the ZID.

Suspended Solids Accumulation

Impacts to DO concentrations resulting from the discharge of wastewater can also be assessed by examining the accumulation of suspended solids. 40 CFR 125.62 states that wastewater and particulates must be adequately dispersed following initial dilution so as not to adversely affect water use areas. The accumulation of suspended solids may lower DO in near-bottom waters and cause changes in the benthic communities. Accumulation of suspended solids in the vicinity

of a discharge is influenced by the amount of solids discharged, the settling velocity distribution of the particles in the discharge, the plume height-of-rise, and current velocities. Hence, sedimentation of suspended solids is generally of little concern for small discharges into well-flushed receiving waters.

The applicant provided a certification on September 7, 2023, stating that there are no known water quality issues associated with the accumulation of suspended solids from the discharge in accordance with 40 CFR 125.66(d)(2).

To evaluate the potential impact of solids sedimentation, a simplified approach for small dischargers that are not likely to have sediment accumulation problems can be found in Figure B-2 of the 301(h) TSD. To use Figure B-2 of the 301(h) TSD to evaluate whether steady state solids accumulation will result in excess sediment accumulation to cause a 0.2 mg/L oxygen depression, the TSS mass emissions rate is needed, as well as plume height-of-rise. The mass emission or loading rate was calculated using the TSS concentration limit, facility design flow, and a conversion factor (Loading (lbs/day)) = $78 \text{ mg/L} \times 1.2 \text{ MGD} \times 8.34 = 781 \text{ lbs/day}$, or 1722 kg/day . Plume height-of-rise was calculated to be 72 feet (22 meters) using the approach on page B-5 in the 301(h) TSD, which involves multiplying the water depth at the point of discharge (60 feet at MLLW) by the design flow of 1.2 MGD. When a height-of-rise of 22 meters and a loading rate of 1,722 kg/day are input in Figure B-1, and the figure is extrapolated for a height-of-rise of 22 meters, steady state accumulation is below the line at which greater than 0.2 mg/L oxygen depression is expected. Per the 301(h) TSD, no further analysis is needed to demonstrate that accumulating solids will not result in unacceptable DO depressions.

Based on the above analyses of DO depletion and suspended solids accumulation, the proposed discharge is expected to comply with Alaska WQS for DO. For the complete equations used in this analysis refer to Appendix E.

C. Attainment of Other Water Quality Standards and Impact of the Discharge on Shellfish, Fish And Wildlife; Public Water Supplies; And Recreation [CWA Section 301(h)(2), 40 CFR 125.62]

CWA section 301(h)(2) requires that the proposed discharge not interfere, either alone or in combination with other sources, with the attainment or maintenance of that water quality which assures protection of public water supplies and protection and propagation of a balanced, indigenous population of shellfish, fish, and wildlife, and allows recreational activities in and on the water. Pursuant to 40 CFR 125.62(a), the applicant's outfall and diffuser must be located and designed to provide adequate initial dilution, dispersion, and transport of wastewater such that the discharge does not exceed, at and beyond the ZID, all applicable EPA-approved state WQS and, where no such standards exist, EPA's CWA section 304(a)(1) aquatic life criteria for acute and chronic toxicity and human health criteria for carcinogens and noncarcinogens, after initial mixing in the waters surrounding or adjacent to the outfall. In addition, 40 CFR 125.59(b)(1) prohibits issuance of a 301(h)-modified permit that would not

assure compliance with all applicable NPDES requirements of 40 CFR Part 122; under these requirements a permit must ensure compliance with all applicable WQS².

Attainment of WQS for DO and turbidity was previously discussed. In accordance with 40 CFR 125.62(a), the applicant must also demonstrate that the proposed discharge will attain other WQS, including those for pH, temperature, toxic pollutants, and bacteria.

EPA used Alaska WQS and the processes described in the 301(h) TSD and the 1991 *Technical Support Document for Water Quality-based Toxics Control* to determine whether the proposed discharge has the reasonable potential to cause or contribute to an excursion above Alaska WQS, to calculate WQBELs, and to assess compliance with CWA section 301(h)(2) and 40 CFR 125.62.

To determine reasonable potential, EPA compares the maximum projected receiving water concentration after mixing to the WQS for that pollutant. If the projected receiving water concentration exceeds the WQS, there is reasonable potential for that pollutant to cause or contribute to an excursion above Alaska WQS, and a WQBEL must be included in the permit. If a permittee is unable to meet their WQBEL, it would fail to satisfy CWA section 301(h)(9) and 40 CFR 125.62 and would be ineligible for a CWA Section 301(h) modification.

Pursuant to 40 CFR 125.62(a)(1)(iv), EPA's evaluation of compliance with WQS must be based upon conditions reflecting periods of maximum stratification and during other periods when discharge characteristics, water quality, biological seasons, or oceanographic conditions indicate more critical situations may exist, commonly referred to as critical conditions.

1. pH

The applicant requested a CWA Section 301(h) modification for pH to 6.5 to 8.0 s.u. The applicant's request for a 301(h) modification for pH does not apply since the request is more stringent than the secondary treatment TBELs for pH. The proposed discharge must still meet the WQS for pH. Alaska's WQS provide that pH may not be less than 6.5 or greater than 8.5 and may not vary more than 0.2 pH unit outside of the naturally occurring range.

The effect of pH on the receiving water following initial dilution was estimated using Table 1 in the 301(h) TSD (*Estimated pH Values After Initial Dilution*).

EPA reviewed DMR data for pH between 2018 and 2023. The facility met the pH limits in the 2001 permit 100% of the time. The effluent pH ranged from 6.6 to 7.9, meeting the Alaska WQS for pH at the point of discharge (end of pipe). By utilizing the minimum measured effluent pH

² ADEC authorized an acute and chronic dilution of 11:1 and 19:1, respectively, in its final 401 certification. These dilutions are based on meeting ADEC's mixing zone guidance. To meet Alaska WQS, EPA is using the chronic dilution factor to calculate pollutant effluent limits. Since these dilutions fall within the boundary of the ZID, these effluent limits also comply with CWA Section 301(h)(9) and 40 CFR 125.62.

value of 6.6 (choosing a value of 6.5 from the table), an effluent alkalinity of 0.5 meq/L (suggested as reasonable for primary effluents with small industrial components on page 65 of the 301(h) TSD), a seawater temperature of 15°C (95th percentile of trapping depth temperature was 8.2°C), and an initial dilution of 67, the expected resulting pH range after initial dilution is 6.95 to 8.49 over an assumed seawater pH range of 7.00 to 8.50. This is within the range of 6.5 to 8.5 and does not vary more than 0.2 pH units outside the naturally occurring range, and therefore meets the Alaska WQS for pH.

The proposed discharge is expected to comply with Alaska WQS for pH after initial mixing at the edge of the ZID.

2. Temperature

Alaska's WQS for temperature provide that the discharge may not cause the temperature of the receiving water to exceed 15°C and the discharge may not cause the weekly average temperature to increase more than 1°C. The maximum rate of change may not exceed 0.5°C per hour. Normal daily temperature cycles may not be altered in amplitude or frequency.

EPA reviewed surface water and DMR data from the facility to assess whether the modified discharge will comply with Alaska WQS for temperature. The maximum ocean temperature recorded at the trapping depth (mid-level depth) of the discharge during receiving water monitoring from 2002 to 2005 was 8.2°C, and the maximum recorded effluent temperature between 2018 and 2023 was 15.1°C. EPA conducted a mass balance analysis using these values and calculated a final receiving water temperature of 8.3°C after initial dilution. Based upon the above analysis the proposed discharge is expected to comply with Alaska WQS for temperature at the edge of the ZID.

3. Toxics

Alaska WQS for toxics for marine uses can be found in 18 AAC 70.020(b)(23) and the *Alaska Water Quality Criteria Manual for Toxics* (ADEC, 2022).

To assess whether the proposed discharge will comply with Alaska WQS for toxics after initial mixing, EPA reviewed DMR data collected between 2018 and 2023 and the results of two priority pollutant scans submitted with the 2006 permit application.

Several pollutants were reported above their respective detection limits. Using this data, EPA performed reasonable potential analyses using the numeric criteria in the *Alaska Water Quality Criteria Manual for Toxics* (ADEC 2022) and the processes outlined in the *Technical Support Document for Water Quality-based Toxics Control* (USEPA 1991). No pollutants have the reasonable potential to cause or contribute to an excursion above the Alaska WQS at the edge of the ZID. The effluent limits developed are protective of Alaska WQS, and the proposed discharge is expected to comply with Alaska WQS for toxics after initial mixing at the edge of the ZID.

4. Bacteria

Alaska's WQS for bacteria are found at 18 AAC 17.020(b)(14).

Fecal Coliform

Alaska's most restrictive marine criterion for fecal coliform bacteria concentrations is in areas protected for the harvesting and use of raw mollusks and other aquatic life. The WQS specifies that the geometric mean of samples shall not exceed 14 MPN/100 mL, and that not more than 10 percent of the samples shall exceed:

- 43 MPN/100 mL for a five-tube decimal dilution test;
- 49 MPN/100 mL for a three-tube decimal dilution test;
- 28 MPN/100 mL for a twelve-tube single dilution test;
- 31 CFU/100 mL for a membrane filtration test.

This standard must be met at the edge of the ZID.

On January 22, 1996, ADEC provided a CWA Section 401 Certificate of Reasonable Assurance (401 Certification) that included a mixing zone defined as an arc of a circle with a 1600-meter radius, centered on the outfall going from one shoreline to the other extending on either side of the outfall line and over the diffuser, and extending from the marine bottom to the surface. ADEC reauthorized this mixing zone in 2001. In the 2001 permit, the number of fecal coliform bacteria in the primary treated effluent was not to exceed a 30-day average of 1.0 million FC per 100 mL and a daily limit of 1.5 million FC per 100 mL of sample. Outside this mixing zone, the fecal coliform concentrations were not to exceed a maximum of 14 FC/100 mL for a monthly average and 43 FC/100 mL for a daily maximum.

Petersburg WWTP DMR data from the past 5 years shows monthly geometric mean fecal coliform values ranges from 90,000—995,830 FC/100mL, with a 95th percentile of 925,140 FC/100mL. Summary statistics of DMR data are provided in Table 7 below.

Table 7. Fecal Coliform DMR Summary Data (6/2018-5/2023)

Fecal Coliform (FC/100/mL)	# of samples	Min	Max	95 th Percentile	Average	Geomean
Daily Max	60	110,000	1,183,300	1,063,330	623,230	562,660
Monthly Geometric Mean	60	90,000	995,830	925,140	501,760	445,230

The 2001 permit required the facility to conduct fecal coliform sampling twice annually (once during the wet and once during the dry season), at five receiving water locations in the vicinity of the discharge and ADEC-authorized mixing zone.

The results of the facility's available fecal coliform sampling results are presented in Table 8 below and in Appendix B.2 of the Fact Sheet.

Table 8. Fecal Coliform Statistic by Station (2002-2006)

	# of Samples	Min (FC/100mL)	Max (FC/100mL)	Average (FC/100mL)	Median (FC/100mL)	Geomean (FC/100mL)
Station 1	9	1.0	30.0	12.6	8.0	6.3
Station 2	9	1.0	30.0	9.0	2.0	3.9
Station 3	9	1.0	113.0	16.3	1.0	3.3
Station 4	9	1.0	30.0	5.4	1.0	2.3
Station 5	9	1.0	23.0	3.4	1.0	1.4
Station 1: Shoreline area closest to discharge point/diffuser. Station 2: Shoreline area just outside of the farthest east point of where the mixing zone touches the shoreline. Station 3: Shoreline area just outside of the farthest west point of where the mixing zone touches the shoreline. Station 4: Just outside of the down current edge of the 1600-meter mixing zone. Station 5: Just outside of the open ocean edge of the 1600-meter mixing zone.						

The maximum fecal coliform result of 113 FC/100mL occurred at Station 3 at the shoreline east of the diffuser at the east edge of the mixing zone. CWA section 301(h)(9) requires 301(h) discharges to meet WQS and federal CWA section 304(a) criteria at the edge of the ZID. The current 1,600 m mixing zone for fecal coliform is inconsistent with the statutory or regulatory definition of a ZID: *the region of initial mixing surrounding or adjacent to the outfall*.

Consistent with CWA section 301(h)(9) and 40 CFR 125.62, EPA used the 67:1 dilution achieved at the edge of the ZID to evaluate reasonable potential and assess compliance with CWA section 301(h)(9) and 40 CFR 125.62. ADEC will not reauthorize the 1,600 m mixing zone for fecal coliform and the point of compliance for all bacteria limits is now the edge of the ZID.

Using effluent data from 2018 to 2023 and the same process and equations as those used for toxics, EPA conducted a reasonable potential analysis and determined fecal coliform has the reasonable potential to cause or contribute to an excursion above the Alaska WQS at the point of discharge.

ADEC included final fecal limitations as a condition of their certification under CWA Section 401 that come into effect five years after the effective date of the permit. The EPA has incorporated these final limits into the final permit and has established interim fecal coliform limits based upon facility performance.

The interim and final effluent limits developed for fecal coliform will be protective of Alaska WQS after initial mixing at the edge of the ZID and will satisfy the requirements of CWA section 301(h)(9) and 40 CFR 125.63(a).

Enterococcus Bacteria

Enterococci bacteria are indicator organisms of harmful pathogens recommended by EPA to protect primary contact recreation for marine waters. In October 2000, Congress amended the Clean Water Act with the Beaches Environmental Assessment and Coastal Health Act (BEACH Act, 33 U.S.C. 1313 et seq.). The amendment required EPA to develop new or revised CWA criteria for pathogens and pathogen indicators. States and territories with coastal recreation waters were then required to adopt enterococci bacteria criteria into their WQS. EPA approved Alaska's WQS for enterococcus in 2017. The WQS at 18 AAC 70.020(b)(14)(B)(i) for contact recreation specifies that the enterococci bacteria concentration shall not exceed 35 enterococci CFU/100mL, and not more than 10% of the samples may exceed a concentration of 130 enterococci CFU/100mL.

The 2001 permit does not contain an effluent limitation for enterococcus bacteria because there were no applicable enterococcus WQS in effect when the permit was issued in November 2001.

40 CFR 122.44(d)(1) requires EPA to account for existing controls on discharges when determining whether a discharge has the reasonable potential to cause or contribute to an excursion of state WQS. The WWTP does not currently disinfect its effluent, resulting in the high bacterial loads observed in the available fecal coliform data. The 2001 permit did not require enterococcus monitoring, but it reasons that the high fecal coliform loads observed are also indicative of high loads of other pathogens commonly found in WWTP effluents, including enterococcus. With the available fecal coliform data and lack of disinfection capacity at the facility, EPA has determined there is reasonable potential for the discharge to cause or contribute to an excursion above Alaska WQS for enterococcus.

ADEC included final enterococcus limitations as a condition of their certification of the permit under CWA Section 401 that come into effect five years after the effective date of the permit. The EPA has incorporated these final limits into the final permit.

The final effluent limits developed for enterococcus will be protective of Alaska WQS after mixing at the edge of the ZID and will satisfy the requirements of CWA section 301(h)(9) and 40 CFR 125.63(a).

D. Impact of the Discharge on Public Water Supplies [40 CFR 125.62(b)]

40 CFR 125.62(b) requires that the applicant's proposed discharge must allow for the attainment or maintenance of water quality that assures protection of public water supplies and must not interfere with the use of planned or existing public water supplies. According to the 2006 permit application, there are no existing or planned public water supply intakes in the vicinity of the discharge. Therefore, EPA concludes that the applicant's proposed discharge will have no effect on the protection of public water supplies and will not interfere with the use of planned or existing public water supplies.

E. Biological Impact of Discharge [40 CFR 125.62(c)]

40 CFR 125.62(c) requires that in addition to complying with applicable WQS, the proposed discharge must allow for the attainment or maintenance of water quality that assures the protection and propagation of a balanced indigenous population (BIP) of shellfish, fish, and wildlife. A BIP of shellfish, fish, and wildlife must exist immediately beyond the ZID and in all other areas beyond the ZID where marine life is actually or potentially affected by the applicant's discharge. In addition, conditions within or beyond the ZID must not cause or contribute to extreme adverse biological impacts, including, but not limited to, the destruction of distinctive habitats of limited distribution, the presence of disease epicenter, or the simulation of phytoplankton blooms which have adverse effects beyond the ZID, interfere with estuarine migratory pathways within the ZID, or result in the accumulation of toxic pollutants or pesticides at levels which exert adverse effects on the biota within the ZID.

In accordance with the guidance for small dischargers in the 301(h) TSD, EPA has considered the following characteristics of the Petersburg WWTP discharge as indicators that there is a low potential for impact on the biota in the vicinity of the discharge: the location of the discharge is greater than 10m, the steady-state accumulation of suspended solids is less than 25 g/m², there is a low potential for impact on local fisheries, and less than 0.1% of the flow is from industrial users. Toxic conditions are not expected because the effluent achieves rapid mixing within minutes of discharge, minimizing the potential exposure area. There is no evidence that the ZID is a disease epicenter, interfering with estuarine migratory pathways, or resulting in the accumulation of toxics at levels exerting adverse effects on biota within the ZID.

The 2001 permit required the facility to implement a biological monitoring program in order to monitor for discharge-related ecosystem impacts, evaluate whether the discharge changes the amount of organic material in seafloor sediment, determine whether the discharge changes the benthic community, and generate data that allows the EPA to evaluate BIP-related permit conditions. Under the program, the facility was required to sample for total volatile solids (TVS) and benthic fauna in August of the fourth year of the permit within the ZID, beyond the ZID boundary, and at a reference station. Because kelp beds are important habitat for fish and invertebrates, kelp bed monitoring was also required under the 2001 permit in August of the second and fourth year to ensure that the discharge does not adversely impact such habitat.

As directed, the facility conducted biological monitoring in August 2005 and kelp bed monitoring in August of 2003 and 2005. For biological monitoring, the following stations were established: 1) Station #1: a reference station 1.25 miles NW of the outfall near Kupreanof Island; 2) Station #2: within the ZID; and 3) Station #3: 20 meters beyond the ZID at an equivalent depth to the outfall.

The following observations were provided by the applicant in their submitted Biological Monitoring Report (City of Petersburg, 2005) for the three stations:

Station 1: Reference Station

Sediment was characterized by large gravel and pebbles with small cobbles. Algal turf was observed on the cobble surfaces, which per the report indicates low disturbance. *Crutose corraline* algae, encrusting bryozoans, and sponges were also observed on cobbles and gravel. Benthic macroinvertebrate abundance and diversity appeared to be high. TVS analysis of finer sediments indicated that the organic content of the surface sediments was 1.4% by weight. See Table 9 for TVS data.

Station 2: Within the ZID

Sediments were observed to be similar to those at the reference station, as was habitat composition and species diversity and abundance. Several fish species were also observed. Significant organic accumulation was not observed within the ZID. TVS concentrations in the ZID are approximately twice those at the reference site (average of 3% by weight).

Station 3: Beyond the ZID Boundary

Sediments were observed to be similar to those at the reference station, as was habitat composition and species diversity and abundance. Several fish species were also observed. Significant organic accumulation was not observed beyond the ZID boundary, with TVS average concentrations of 1.8% by weight, slightly higher than the reference station.

Table 9. Total Volatile Solids and Total Solids Results

Sample Location	Date and Time	Method	Total Volatile Solids (TVS), % Dry Basis	Method	Total Solids (%)
Station 1 Replicate 1	8/25/2005	EPA 160.4	1.4	EPA160.3	82.5
Station 1 Replicate 2	8/25/2005	EPA 160.4	1.4	EPA160.3	82.7
Station 1 Replicate 3	8/25/2005	EPA 160.4	1.4	EPA160.3	80.9
Station 2 Replicate 1	8/25/2005	EPA 160.4	1.8	EPA160.3	80.1
Station 2 Replicate 2	8/25/2005	EPA 160.4	3.5	EPA160.3	65.4
Station 2 Replicate 3	8/25/2005	EPA 160.4	3.8	EPA160.3	64.9
Station 3 Replicate 1	8/25/2005	EPA 160.4	1.1	EPA160.3	88.2
Station 3 Replicate 2	8/25/2005	EPA 160.4	1.6	EPA160.3	84.5
Station 3 Replicate 3	8/25/2005	EPA 160.4	2.6	EPA160.3	74.7

As seen in Table 9, TVS concentrations within the ZID are greater than those at Sites 1 and 2, indicating organic loading that may be attributable to the discharge. However, at all three sites, the ratio of TVS to Total Solids is low, indicating low organic contributions from the facility (or other sources) that may adversely affect the benthic community. The Biological Monitoring Report concludes that no visible layer of fine silt/floc was observed at any of the stations, that strong tidal forces limit organic accumulation in the area, all three sites were characterized by abundant and diverse macro invertebrate assemblages (see Table 10), and that the discharge does not appear to result in significant changes to the benthic community in the vicinity of the outfall.

In the applicant's 2006 Questionnaire, they refer to their 1990 Questionnaire concerning biological conditions in the vicinity of the discharge. The facility reported that numerous Bull Kelp beds are found in the vicinity of the outfall, nearshore, and extending to the 60-foot depth contour. Aerial photographs of the surface of the water to capture kelp beds were provided in the Kelp Bed Monitoring Report (City of Petersburg 2005a) included with the application. The aerial photographs captured general kelp bed status along the entire coastline. To provide more specific information about the impact of the discharge on kelp beds within the ZID, the new permit is requiring an underwater kelp survey and underwater photographs in place of the aerial photographs.

The applicant also noted in their 2006 Questionnaire that due to strong currents in the area, distinctive habitats of limited distribution are not likely to be adversely impacted by the modified discharge.

For these reasons, it is reasonable to conclude that the facility's discharge is not causing significant changes in the benthic community structure. The Biological Monitoring Program from the 2001 permit is being retained in the final permit, with the exception of the TVS component, which has been removed from the permit and the substitution of an underwater kelp survey and photographs in place of the aerial photographs. For additional information refer to Part 8.G.3

Table 10. Species Observed during 2005 Biological Monitoring

Table 3, Species Observed, City of Petersburg Biological Monitoring - August 2005									
Taxon	Group	Scientific Name	Common Name	Station 1 (reference)		Station 2 (Within ZID)		Station 3 (Outside ZID)	
				Observed	Abundance	Observed	Abundance	Observed	Abundance
Rhodophyta	Red Algae	numerous species	Algal Turf	Y	C	Y	R	Y	R
		<i>Lithothamnium</i> sp.	Coralline Algae (Crustose)	Y	C	Y	C	Y	C
		<i>Palmaria</i> sp.	Red Algae (frilly)	Y	R	Y	A	Y	R
		<i>Constantinea</i> sp.	Cup and Saucer Algae	Y	C	N		N	
Porifera	Demospongiae	<i>Halichondria panicea</i>	Orange Encrusting Sponge	Y	R	Y	C	Y	C
Cnidaria	Anthozoa	<i>Physalis gurneyi</i>	Sea Pen	N		Y	C	Y	R
		<i>Pachycerianthus fimbriatus</i>	Tube Dwelling Anemone	N		N		Y	R
Annelida	Polychaeta	<i>Schizobranchia insignis</i>	Feather Duster Worm	Y	R	N		N	
		<i>Spirorbis</i> sp.	Tube Worm	Y	R	Y	C	Y	C
Mollusca	Gastropoda	<i>Neptunea lyrata</i>	Lyre Whelk	N		N		Y	R
		<i>Amphissa columbiana</i>	Wrinkled Amphissa	N		Y	R	N	
	Polyplacophora	<i>Tonicella lineata</i>	Lined Chiton	N		N		Y	R
		<i>Hiatella arctica</i>	Clam	Y	C	Y	C	Y	C
		<i>Macoma</i> sp.	Clam	Y	R	Y	R	Y	R
		<i>Eualus</i> sp.	Shrimp (clear w/white stripes/black rostrum)	Y	R	Y	A	Y	C
Arthropoda	Decapoda	<i>Elasochirus</i> sp.	Hermit Crab	Y	R	N		N	
		<i>Pagurus</i> sp.	Hermit Crab	Y	R	N		N	
		<i>Hyas lyratus</i>	Lyre Crab	Y	R	Y	A	N	
		<i>Terebratulina unguicula</i>	Lamp Shell	Y	R	N		Y	C
Brachiopoda	Brachiopod	<i>Eucratea loricata</i>	Bryozoan (branched)	N		Y	R	Y	C
Bryozoa	Ectoprocts	<i>Membranipora</i> sp.	Bryozoan (encrusting)	Y	C	Y	C	Y	C
Echinodermata	Echinoidea	<i>Strongylocentrotus droebachiensis</i>	Green Sea Urchin	Y	C	Y	R	N	
		<i>Henricia leviuscula</i>	Blood Star	Y	C	N		Y	R
	Astroidea	<i>Evasterias troschelii</i>	False Ochre Star	Y	C	Y	R	Y	R
		<i>Pycnopodia helianthoides</i>	Sunflower Star	Y	R	Y	R	Y	C
		<i>Ophiura</i> sp.	Brittle Star	Y	C	Y	C	Y	C
	Ophiuroidea	<i>Pleuronectes bilineatus</i>	Rock Sole	N		Y	R	Y	C
Osteichthyes	Cottidae	unidentified	Sculpin Orange w/ Black Fins	N		Y	C	Y	R

Y = Species observed at this station N = Species not observed at this station R = Species relative abundance low (rare) C = Species common A = Species relative abundance high (abundant)

Additionally, there have been no known cases of mass mortalities of fish or invertebrates, no increased incidence of disease in marine organisms, and no other known cases of adverse biological impacts. The small volume of the discharge, the small area of the ZID relative to the width of Frederick Sound, and the results of the biological monitoring indicate that the discharge will have not cause or contribute to significant biological impacts.

Considering the above evidence, EPA has concluded that the discharge allows for the attainment or maintenance of water quality that assures the protection and propagation of a BIP of shellfish, fish, and wildlife, and will not cause or contribute to adverse biological impacts.

F. Impact of Discharge on Recreational Activities [40 CFR 125.62(d)]

Under 40 CFR 125.62(d), the applicant's discharge must allow for the attainment or maintenance of water quality that allows for recreational activities beyond the ZID, including, without limitation, swimming, diving, boating, fishing, picnicking, and sports activities along shorelines and beaches. There must be no federal, state, or local restrictions on recreational activities within the vicinity of the applicant's outfall unless such restrictions are routinely imposed around sewage outfalls. The 2006 permit application stated that no impacts on

recreational activities were expected due to the proposed discharge. Due to cold water temperatures, swimming is not expected to be common in Frederick Sound.

The Technical Review Report prepared for the 2001 permit stated that there is a large recreational fishery in the Petersburg area beyond the ZID. The report describes many species that are fished for in the area, including chinook salmon (*Oncorhynchus tshawytscha*), pink salmon (*Oncorhynchus gorbuscha*), coho salmon (*Oncorhynchus kisutch*), Dolly Varden (*Salvelinus malma*), cutthroat trout (*Salmo clarki*), halibut (*Hippoglossus stenolepis*), herring (*Clupea pallasii*), pink shrimp (*Pandalus borealis*), sidestripe shrimp (*Pandalopsis dispar*), spot shrimp (*Pandalus platyceros*), red king crab (*Paralithodes camtschatica*), brown king crab (*Lithodes aequispina*), tanner crab (*Chionoecetes bairdi*), and Dungeness crab (*Cancer magister*). No adverse effects to fishing have been reported. Clams are harvested primarily in the winter due to the possibility of paralytic shellfish poisoning (PSP) during the summer. Restrictions on shellfish harvesting due to PSP were also noted in the 1985 Technical Review Report and are not thought to be due to the discharge.

The 2001 permit required signs to be placed on the shoreline near the 1600-meter fecal coliform mixing zone and the outfall line that state primary treated domestic wastewater is being discharged, mixing zones exist, and certain activities such as the harvesting of shellfish for raw consumption and bathing should not take place within the mixing zone. EPA has retained the requirement to place these signs on the shoreline and outfall line in the final permit until the final fecal coliform and enterococcus limits are maintained.

The applicant has demonstrated that the proposed discharge meets the requirements to allow for the attainment or maintenance of water quality which allows for recreational activities beyond the ZID.

G. Establishment of Monitoring Programs [CWA 301(h)(3), 40 CFR 125.63]

Under 40 CFR 125.63, which implements Section 301(h)(3) of the Act, the applicant must have a monitoring program designed to provide data to evaluate the impact of the proposed discharge on the marine biota, demonstrate compliance with applicable WQS, and measure toxic substances in the discharge. The applicant must demonstrate the capability to implement these programs upon issuance of a 301(h)-modified NPDES permit. In accordance with 40 CFR 125.63(a)(2), the applicant's monitoring programs are subject to revision as may be required by EPA.

1. Influent/Effluent Monitoring Program [40 CFR 125.63(d)]

40 CFR 125.63(d) requires an effluent monitoring program and the applicant proposes continuation of the current monitoring program. In addition to the Section 301(h) specific monitoring requirements, Section 308 of the CWA and 40 CFR 122.44(i) require monitoring in permits to determine compliance with effluent limitations. Monitoring may also be required to gather effluent and surface water data to determine if additional effluent limitations are

required and/or to monitor effluent impacts on receiving water quality. Throughout the previous permit term (and the administratively continued period), the applicant submitted effluent monitoring data as required by the 2001 permit.

Summary statistics of the effluent data submitted by the permittee between 2018 and 2023 is presented in Appendix C.

The final permit retains largely the same effluent and influent monitoring requirements and includes the new requirement to monitor the effluent for enterococcus, per- and polyfluoroalkyl substances (PFAS), chlorine, copper, and zinc, and WET; and removes the requirement to monitor settleable solids. Consistent with 40 CFR 125.66, the final permit also includes a requirement for the permittee to perform an analysis of their effluent for all toxics and pesticides identified in 40 CFR 401.15 twice every five years, once during the wet season and once during the dry season.

2. Receiving Water Quality Monitoring Program [40 CFR 125.63(c)]

40 CFR 125.63(c) requires that the receiving water quality monitoring program must provide data adequate to evaluate compliance with applicable WQS. The applicant proposes continuation of the current receiving water monitoring program. As is the case of effluent monitoring, NPDES permits include receiving water monitoring requirements to allow for compliance assessment, and to determine if additional effluent limitations and/or monitoring requirements are necessary in future permitting actions.

EPA is retaining most of the receiving water monitoring program from the 2001 permit in the final permit. Changes to the receiving water monitoring program include the addition of enterococcus to the suite of parameters analyzed and the movement of the ZID boundary sites from the edge of the 2001 mixing zone at 1600 meters to the edge of the ZID in the final permit. Sampling at the edge of the 1600-meter mixing zone is no longer required because the 1600-meter mixing zone is not being reauthorized by ADEC and the point of compliance for all parameters is now the edge of the ZID, which is 60 feet from the outfall.

3. Biological Monitoring Program [40 CFR 125.63(b)]

40 CFR 125.63(b) requires a permittee to implement a biological monitoring program that provides data adequate to evaluate the impact of the applicant's discharge on the marine biota. Such a program should, at a minimum, allow for evaluation of any ecosystems impacts; any changes in the amount of organic material in the seafloor sediment; any changes to benthic communities; and the effectiveness/bases for permit conditions.

The Biological Monitoring Program in the 2001 permit consisted of a benthic survey, sediment analysis for total volatile solids (TVS), and kelp bed monitoring within the ZID, at a reference location, and within 20 m beyond the ZID at an equivalent depth as the outfall.

Based on the results of the TVS analysis of sediment, it does not appear that excess organic sediment is accumulating around the outfall as compared to stations at the ZID boundary and reference sites.

Based on visual observations of the benthic infauna collected in sediment samples, it does not appear that the Petersburg outfall discharge is causing significant changes in the benthic community structure.

Based on the results of the kelp bed monitoring, it does not appear the discharge is causing significant changes in the kelp beds.

The Biological Monitoring Program from the 2001 permit is largely being retained in the final permit with the exception of the TVS sampling component, which has been removed from the final permit.

The 301(h) regulations at 40 CFR 125.63(b)(2) provide that small 301(h) applicants are not subject to sediment analysis requirements if they discharge at depths greater than 10 meters and can demonstrate through a suspended solids deposition analysis that there will be negligible seabed accumulation in the vicinity of the modified discharge. The Petersburg WWTP discharges at depths greater than 10 meters and the suspended solids deposition analysis provided below demonstrates there will be negligible seabed accumulation in the vicinity of the discharge.

Figure B-2 in Appendix B of the 1994 Amended Section 301(h) Technical Support Document provides a simplified graphical method for small estuarine dischargers to assess the potential for suspended solids deposition around their outfall using the reported daily solids mass emission rate (y-axis in Fig. B-2) and the height-of-rise of the discharge (x-axis in Fig. B-2). For the discharge height-of-rise, also known as the plume trapping depth, the height-of-rise from dilution modeling should be used, or 0.6 times the water depth, whichever is larger. With a discharge depth of ~18.3 meters (~60 feet) and a trapping depth of ~15 meters (~50 feet), the height-of-rise of the Petersburg discharge is approximately 15 meters (~50 feet); 15 meters (~50 feet) was selected for the x-axis in Figure B-2.

The guidance recommends calculating the suspended solids daily mass emission rate using the average flow rate and an average suspended solids concentration. The reported maximum monthly average flow rate from the Petersburg WWTP between 2016 and 2021 was approximately 0.64 million gallons per day and the maximum monthly average TSS concentration was 73 mg/L. To determine the daily loading of solids the monthly average concentration of TSS was multiplied by the reported average monthly flow and the loading conversion factor of 8.34 (see Footnote 1 in Table 1 of the final permit for more information on mass loading calculations).

73 mg/L X 0.64 million gallons per day X 8.34=389.6 lbs/day

Using this loading rate along the y-axis and 15 meters along the x-axis in Figure B-2, the projected steady state sediment accumulation is expected to be well below 25g/m². The EPA considers this to be a negligible accumulation of sediment.

Therefore, the applicant has satisfied the requirement of 40 CFR 125.63(b)(2) and the requirement to conduct sediment TVS analysis has been removed from the final permit. The EPA also removed the requirement from Permit Part I.E. to store and maintain benthic and TVS samples.

H. Effect of Discharge on Other Point and Nonpoint Sources [CWA 301(h)(4), 40 CFR 125.64]

Under 40 CFR 125.64, which implements Section 301(h)(4) of the Act, the applicant's proposed discharge must not result in the imposition of additional treatment requirements on any other point or nonpoint source. The applicant reports that the proposed discharge would not place any additional treatment requirements on point or nonpoint sources. Pursuant to 40 CFR 125.64(b), the applicant is required to submit a determination signed by the State of Alaska indicating whether the applicant's discharge will result in an additional treatment pollution control, or other requirement on any other point or nonpoint sources. The State determination must include a discussion of the basis for its conclusion.

ADEC provided the determination required under 40 CFR Part 125.64 in their final 401 certification. For additional information refer to Part M – State Determination and Concurrence.

I. Urban Area Pretreatment Program [CWA 301(h)(6), 40 CFR 125.65]

Under 40 CFR 125.65, dischargers serving a population greater than 50,000 are required to have a pretreatment program. As previously discussed, the Petersburg WWTP serves a population of approximately 3,000 people, so this provision is not applicable to this analysis.

J. Industrial and Nonindustrial Sources and Toxics Control [CWA 301(h)(7), 40 CFR 125.66]

1. Chemical Analysis and Toxic Pollutant Source Identification [40 CFR 125.66(a) and (b)]

Under 40 CFR 125.66(a) and (b), applicants are required to perform chemical testing for toxic pollutants and pesticides and identify the source of any parameters detected.

The 2001 permit required two toxic pollutant scans to be submitted with the permit reapplication. As previously discussed, the permittee conducted two toxic pollutant scans, and EPA used the results in the development of the final permit.

Pursuant to 40 CFR 125.66, the final permit requires an updated toxics and pesticides scan and source identification analysis to be submitted at the time of permit reapplication.

2. Industrial Pretreatment Program [40 CFR 125.66(c)]

40 CFR 125.66(c) requires that applicants that have known or suspected industrial sources of toxic pollutants shall have an approved pretreatment program in accordance with the requirements of 40 CFR Part 403 (Pretreatment Regulations).

The facility has one industrial user, the Petersburg Baler Facility, a solid waste bailing facility. The Petersburg WWTP receives the discharge from the baler facility via a main that connects to the sewer collection system. The baler facility meets the definition of an industrial source under 40 CFR 125.58(j). Therefore, the permit requires the Borough of Petersburg to develop a pretreatment program in accordance with 40 CFR 403. Further details of the pretreatment program are discussed in the Fact Sheet and final permit. After the Borough of Petersburg develops, and EPA approves, the pretreatment program, EPA will modify the permit to incorporate the pretreatment program.

Pursuant to 40 CFR 126.66, the final permit requires an updated industrial user survey be submitted at the time of permit reapplication.

3. Nonindustrial Source Control Program [40 CFR 125.66(d)]

40 CFR 125.66(d), which implements Section 301(h)(6) of the Act, requires the applicant to submit a proposed public education program designed to minimize the entrance of non-industrial toxic pollutants and pesticides into its POTW. The applicant must also develop and implement additional nonindustrial source control programs on the earliest possible schedule. The requirement to develop and implement additional nonindustrial source control programs does not apply to a small Section 301(h) applicant that certifies there are no known or suspected water quality, sediment accumulation, or biological problems related to toxic pollutants or pesticides in its discharge.

The applicant provided this certification to EPA on April 8, 2022, as well as documentation that a public education program meeting the requirements of 40 CFR 125.66(d)(1) has been developed and implemented. In June 2002, the applicant published a letter in the Petersburg weekly newspaper (the Petersburg Pilot) intended to educate wastewater customers about the Borough of Petersburg WWTP, toxic and hazardous substances found in households, and how to control nonindustrial toxic pollutants and pesticides in the Borough's collection system. Therefore, EPA concludes that Petersburg has satisfied the requirements for nonindustrial source control.

K. Effluent Volume and Amount of Pollutants Discharged [40 CFR 125.67]

Under 40 CFR 125.67, which implements Section 301(h)(7) of the Act, the applicant's proposed discharge may not result in any new or substantially increased discharges of the pollutant to which the modification applies above the discharge specified in the 301(h)-modified permit. The applicant has applied on the basis of the current discharge and does not propose any new

or substantially increased discharges of TSS, BOD₅, and pH the parameters for which the facility has requested a waiver.

L. Compliance with other Applicable Laws [40 CFR 125.59]

Under 40 CFR 125.59(b)(3), a 301(h)-modified permit may not be issued if such issuance would conflict with applicable provisions of state, local, or other federal laws or executive orders. As part of the application renewal, the applicant must demonstrate compliance with all applicable Alaska and federal laws and regulations, and executive orders, including the Coastal Zone Management Act, Marine Protection Research and Sanctuaries Act, the Endangered Species Act, and the Magnuson-Stevens Fishery Conservation and Management Act.

1. Coastal Zone Management Act

Alaska withdrew from the voluntary National Coastal Zone Management Program on July 1, 2011 (NOAA 2019c). Without State participation in the Coastal Zone Management Program Act, there is no consistency analysis to perform, and EPA has fulfilled the requirements.

2. Marine Protection, Research, and Sanctuaries Act

Under 40 CFR 125.59(b)(3), no Section 301(h) modified permit shall be issued if such issuance would conflict with Title III of the Marine Protection, Research, and Sanctuaries Act (MPRSA), 16 USC 1431 *et seq.*, which authorizes the Secretary of Commerce (i.e., NOAA) to designate and protect areas of the marine environment with special national significance due to their conservation, recreational, ecological, historical, scientific, cultural, archeological, educational or esthetic qualities as national marine sanctuaries. In the U.S., there are 14 national marine sanctuaries and two marine national monuments, none of which are in Alaska (NOAA 2019d).

The final permit is therefore expected to comply with Title III of the MPRSA.

3. Endangered Species Act

Under 40 CFR 125.59(b)(3), no Section 301(h) modified permit shall be issued if such issuance would conflict with the ESA, 16 USC 1531 *et seq.* The ESA requires federal agencies to consult with the National Marine Fisheries Service (NMFS) and/or the U.S. Fish and Wildlife Service (USFWS) (collectively, “the Services”) if their actions could beneficially or adversely affect any threatened or endangered species (ESA-listed species) or such species designated critical habitat.

Pursuant to ESA Section 7, on August 30, 2024, the EPA requested concurrence from the NMFS that renewal of the 301(h)-modified NPDES permit for the Petersburg WWTP is not likely to adversely affect the following threatened, endangered, or candidate species or their designated critical habitats:

- Western Distinct Population Segment (Western DPS or WDPS) Steller sea lions, and

- Mexico DPS humpback whales
- Sunflower sea star

On October 15, 2024, the NMFS concurred with EPA's determination that renewal of AK0021458 is not likely to adversely affect any ESA-listed species or designated critical habits under their jurisdiction.

No ESA-listed species or designated critical habitat under the jurisdiction of USFWS were identified.

4. Essential Fish Habitat

Under 40 CFR 125.59(b)(3), no Section 301(h) modified permit shall be issued if such issuance would conflict with the Magnuson-Stevens Fishery Conservation and Management Act (MSFCMA), 16 USC 1801 *et seq.*, which protects against adverse impacts to Essential Fish Habitat (EFH). The MSFCMA requires federal agencies to consult with NMFS when any activity proposed to be permitted, funded, or undertaken by a federal agency may have an adverse effect on designated EFH as defined by the MSFCMA. The EFH regulations define an *adverse effect* as any impact that reduces quality and/or quantity of EFH and may include direct (e.g. contamination or physical disruption), indirect (e.g. loss of prey, reduction in species' fecundity), site-specific, or habitat-wide impacts, including individual, cumulative, or synergistic consequences of actions.

EPA prepared a EFH assessment to assess the impacts of the discharge on EFH and submitted to NMFS on August 30, 2024. Based upon the analysis and conclusions of the EFH assessment, the reissuance of the 301(h)-modified NPDES permit to Petersburg will not adversely affect EFH.

M. State Determination and Concurrence [40 CFR 125.61(b)(2); 40 CFR 125.64(d)]

Under 40 CFR 125.61(b)(2), the applicant must provide a determination signed by the state or interstate agency(s) authorized to provide certification under 40 CFR 124.53 and 124.54 that the proposed discharge will comply with applicable provisions of state law, including WQS. This determination must include a discussion of the basis for the conclusion reached. Furthermore, pursuant to 40 CFR 124.53 and 124.54, the state must either grant a certification pursuant to Section 401(a)(1) of the CWA or waive this certification before EPA may issue a 301(h)-modified permit. The applicant did not provide this certification at the time of application, or the determination required by 40 CFR 125.61(b)(2).

40 CFR 125.64(d) requires applicants to provide a determination from the state or interstate agency(s) having authority to establish wasteload allocations indicating whether the applicant's discharge will result in an additional treatment pollution control, or other requirement on any other point or nonpoint sources. The state determination shall include a discussion of the basis for its conclusion. The applicant did not submit this determination with their application.

The EPA requested that ADEC provide final 401 certification and the determinations under 40 CFR 125.61(b)(2) and 125.64(b) during the public notice period of the draft permit and tentative 301(h) decision. ADEC provided final 401 certification and the requested determinations on December 6, 2024.

9) References

ADEC. 2023. *18 AAC 70, Water Quality Standards, As Amended Through November 13, 2022*. Approved by the EPA in 2023. Available at: <https://www.epa.gov/wqs-tech/water-quality-standards-regulations-alaska>.

ADEC. 2022. *Alaska Water Quality Criteria Manual for Toxic and other Deleterious Organic and Inorganic Substances*. Available at: <https://www.epa.gov/system/files/documents/2023-05/akwqs-toxics-manual.pdf>

USEPA. 1991. *Technical Support Document for Water Quality-based Toxics Control*. EPA/505/2-90-001.

Alaska Coastal Management Program Withdrawal from the National Coastal Management Program Under the Coastal Zone Management Act (CZMA). 76 FR 39857. 39857-39858. Published July 7, 2011. <https://www.federalregister.gov/documents/2011/07/07/2011-16987/alaska-coastal-management-program-withdrawal-from-the-national-coastal-management-program-under-the>

USEPA. 1994. *Amended Section 301(h) Technical Support Document*. EPA-842-B-94-007.

NOAA. 2019a. High and Low Water Predictions West Coast of North and South America Including the Hawaiian Islands. Retrieved at https://tidesandcurrents.noaa.gov/tide_predictions.html

NOAA. 2019b. Tidal Current Tables 2020 Pacific Coast of North America and Asia. Retrieved at https://tidesandcurrents.noaa.gov/historic_tide_tables.html.

NOAA. 2019c. *Coastal Zone Management Programs*. Web. <https://coast.noaa.gov/czm/mystate/>.

NOAA. 2019d. *National Marine Sanctuaries*. Web. <https://sanctuaries.noaa.gov/>.

10) Appendices

A. Facility and Outfall Locations



Figure 5. Facility Location Satellite

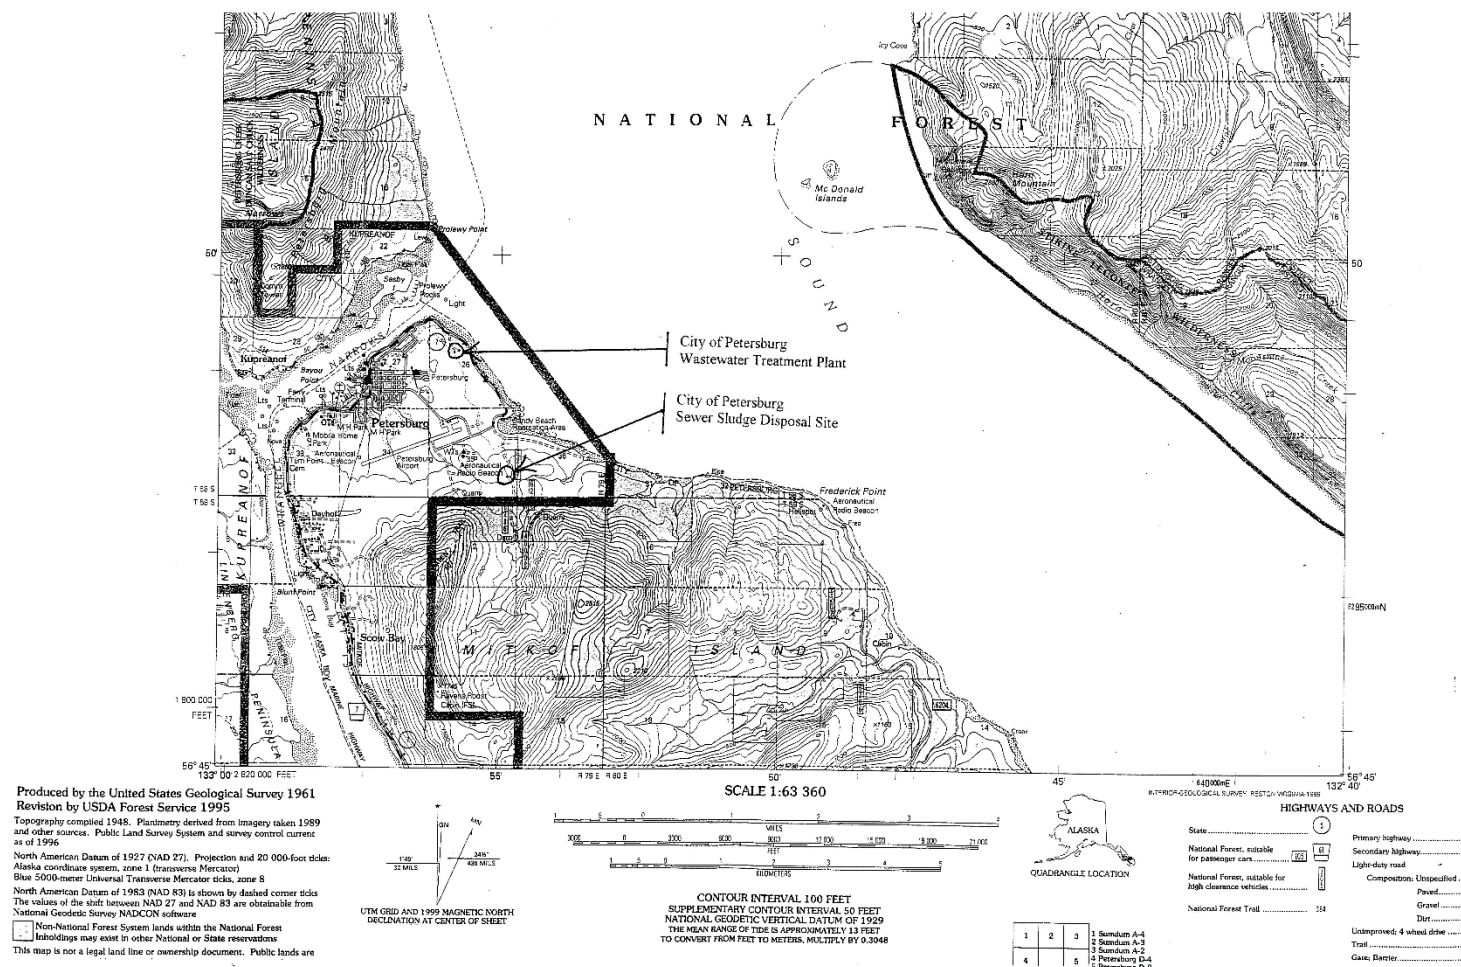


Figure 6. Facility Location Small Scale

B. Facility Figures and Process Flow Diagram

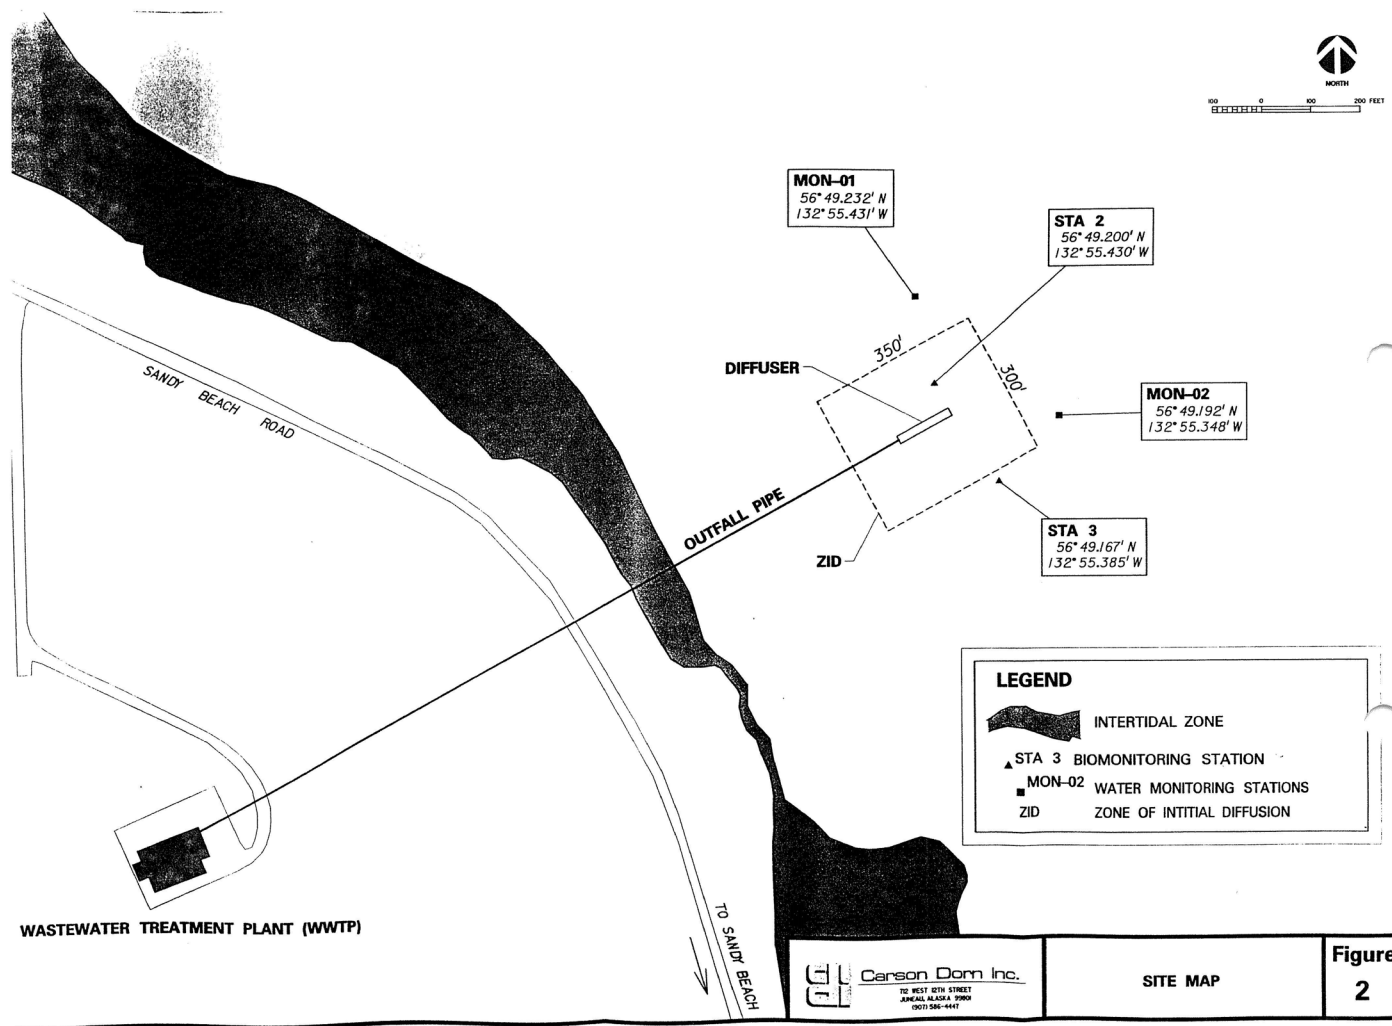


Figure 7. Petersburg WWTP Map

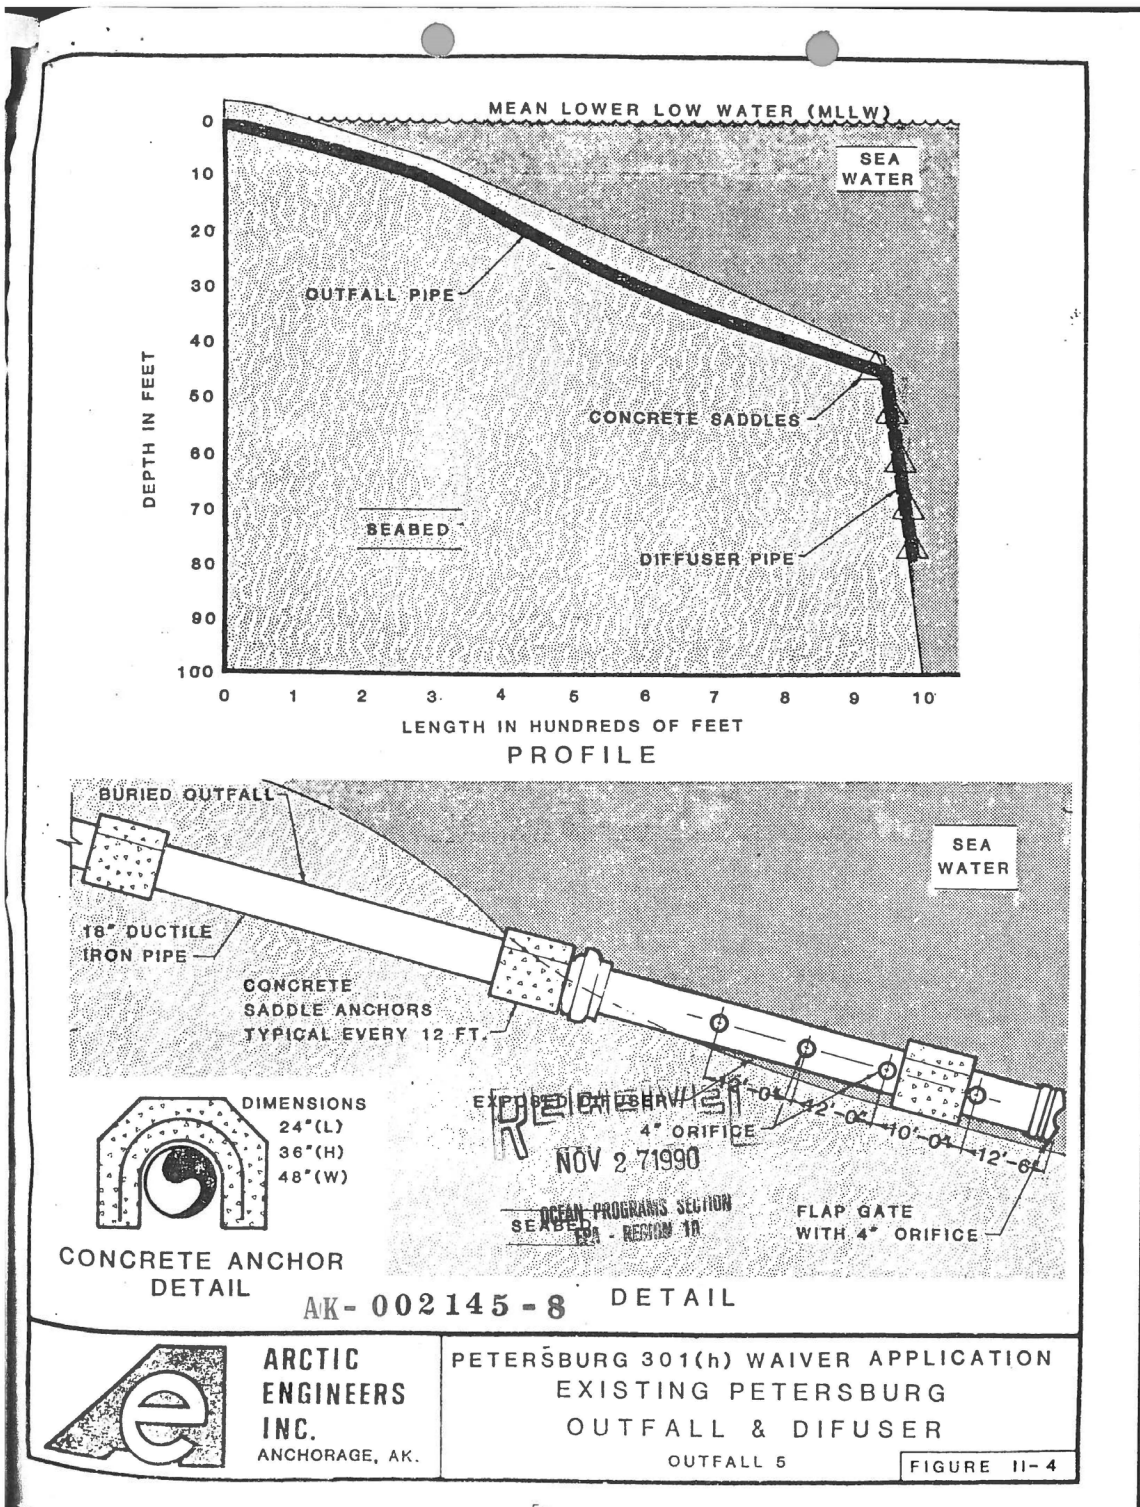


Figure 8. Petersburg Borough Sewer Outfall Plan View and Cross Section

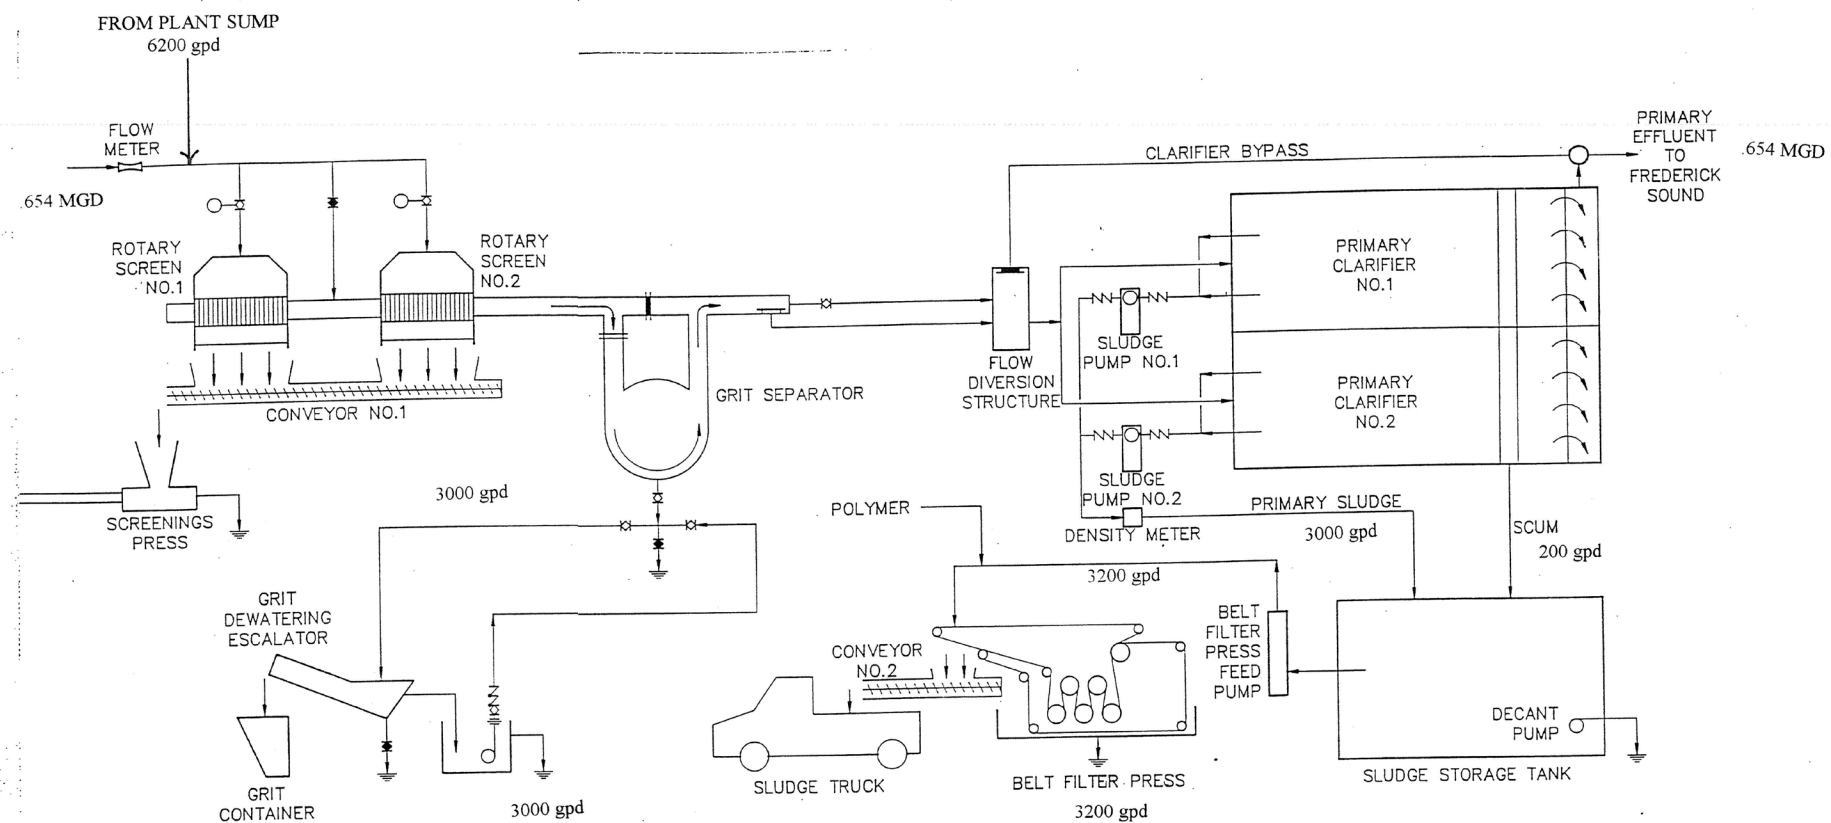


Figure 9. Process Schematic

C. Discharge Monitoring Data (2018-2023)

Table 11. Discharge Monitoring Data (2018-2023)

Parameter	Effluent Flow		BOD, 5-day, 20 deg. C, Influent		BOD, 5-day, 20 deg. C, Effluent					Total Suspended Solids, Influent		Total Suspended Solids, Effluent				
	DAILY MX (MGD)	MO AVG (MGD)	MO AVG (mg/L)	MO AVG (lbs/day)	DAILY MX (mg/L)	MO AVG (mg/L)	DAILY MX (lbs/day)	MO AVG (lbs/day)	% Removal	MO AVG (mg/L)	MO AVG (lbs/day)	DAILY MX (mg/L)	MO AVG (mg/L)	DAILY MX (lbs/day)	MO AVG (lbs/day)	% Removal
06/30/2018	0.504	0.328	198.0	495.2	117.3	91.7	255.3	228.9	54.7	157.3	430.5	53.0	43.4	130.0	116.7	72.9
07/31/2018	0.639	0.329	212.0	513.6	112.0	105.5	267.1	254.9		245.4	595.0	77.7	61.2	185.3	147.5	75.2
08/31/2018	0.705	0.359	187.0	627.3	132.7	111.4	529.2	404.0		161.0	527.3	54.7	53.0	321.6	214.7	59.3
09/30/2018	0.824	0.379	183.0	633.2	114.7	96.4	363.0	316.2	45.2	317.7	1266.0	65.0	58.7	302.5	214.1	83.1
10/31/2018	1.136	0.476	175.5	925.6	92.0	84.3	602.3	413.5		161.7	704.9	55.0	48.2	276.2	205.3	70.9
11/30/2018	0.865	0.506	148.5	695.1	83.0	74.5	346.8	334.0		179.0	856.5	52.0	46.5	273.2	215.9	74.8
12/31/2018	1.091	0.452	139.5	406.9	70.5	68.8	244.2	204.4	52.3	94.4	335.8	37.3	34.7	233.0	160.0	52.3
01/31/2019	1.294	0.484	121.5	375.5	76.5	76.0	237.4	234.8		104.7	326.0	55.7	45.4	175.1	140.7	56.8
02/28/2019	0.355	0.279	178.0	378.8	110.5	100.3	244.2	214.8		156.7	333.5	58.0	51.2	128.2	109.7	67.1
03/31/2019	1.074	0.400	140.5	452.0	122.5	90.5	344.9	297.1	38.3	134.3	488.2	56.7	47.2	222.3	168.8	65.4
04/30/2019	0.810	0.431	122.0	524.9	57.3	54.7	325.0	239.9		155.0	607.4	40.0	37.4	226.8	150.6	75.2
05/31/2019	0.516	0.323	155.7	394.1	91.6	85.3	219.3	215.0		133.0	344.4	42.0	37.5	122.6	100.8	70.7
06/30/2019	1.075	0.396	219.4	696.0	90.1	79.7	260.1	243.5	54.9	249.3	794.1	45.3	38.2	116.3	115.2	85.5
07/31/2019	0.417	0.299	198.9	464.1	125.7	116.9	284.6	272.3		209.4	446.0	57.0	55.2	117.9	117.2	73.7
08/31/2019	1.114	0.434	252.0	628.9	129.9	125.3	326.2	310.4		250.4	629.2	67.0	59.4	152.0	145.8	76.8
09/30/2019	1.611	0.537	195.8	602.2	78.1	75.5	241.0	231.9	51.2	177.0	544.3	44.0	36.5	135.8	109.2	79.9
10/31/2019	1.270	0.501	155.5	468.0	67.3	66.0	203.2	198.4		166.0	499.5	47.7	37.7	142.8	113.2	77.3
11/30/2019	1.111	0.615	149.0	977.5	62.7	49.4	359.2	346.4		173.7	1145.0	36.7	31.0	234.4	222.3	80.6
12/31/2019	0.861	0.490	125.9	464.8	61.4	58.2	231.5	215.0	58.6	129.4	477.5	29.0	25.5	109.3	94.4	80.2
01/31/2020	1.005	0.476	157.5	446.2	76.0	66.0	187.3	180.5		173.0	500.9	33.3	32.0	111.4	90.8	81.9
02/29/2020	1.009	0.542	125.0	545.9	52.0	50.5	219.8	219.2		127.4	557.2	27.7	25.7	116.4	111.5	80.0
03/31/2020	0.802	0.430	130.1	536.2	62.4	56.3	288.3	226.7	59.0	130.0	537.9	33.3	29.5	153.9	119.3	77.8
04/30/2020	0.844	0.422	168.5	414.7	110.0	87.0	257.8	211.1		177.4	438.4	49.7	39.2	116.5	95.1	78.3
05/31/2020	0.561	0.329	165.2	423.3	114.9	109.1	311.9	285.3		151.9	386.1	50.0	45.7	124.7	118.6	69.3
06/30/2020	0.784	0.450	126.9	556.3	78.7	74.7	396.4	327.6	40.9	123.5	530.4	35.3	35.0	174.8	152.0	71.3
07/31/2020	0.951	0.432	135.2	783.2	77.9	69.8	488.6	392.1		231.0	1248.8	85.0	73.4	674.2	407.1	68.3
08/31/2020	0.924	0.557	123.8	578.3	85.3	73.1	368.6	335.1		141.7	664.3	48.7	45.7	295.3	223.1	66.4
09/30/2020	1.090	0.395	155.1	459.2	117.5	91.2	288.1	264.2	44.8	167.7	521.7	47.0	45.0	159.2	137.2	73.7
10/31/2020	1.061	0.437	96.6	350.9	53.7	50.8	224.4	188.3		87.0	314.5	24.7	21.9	79.4	79.0	74.9
11/30/2020	1.923	0.528	95.5	397.5	66.3	58.3	255.8	239.6		183.4	155.7	38.0	37.0	183.4	155.7	64.1
12/31/2020	1.817	0.582	111.6	491.3	89.5	74.3	370.0	327.6	39.8	99.5	449.2	44.0	39.2	215.1	177.6	60.5
01/31/2021	1.049	0.473								122.2	623.0	42.7	41.5	264.2	216.0	65.3
02/28/2021	0.758	0.352	191.0	427.3	118.2	106.7	241.5	238.1		166.7	369.3	58.0	49.5	118.5	109.9	70.3
03/31/2021	0.770	0.488	124.5	486.0	81.5	72.5	298.2	272.8	44.1	93.7	351.3	39.3	38.5	177.3	148.3	57.8
04/30/2021	0.783	0.414	89.8	405.7	58.9	58.3	268.5	263.2		84.5	383.0	35.0	34.2	162.9	154.3	59.7
05/31/2021	0.530	0.351	108.6	351.3	74.2	67.6	254.5	224.4		103.5	331.6	31.7	31.4	129.5	106.3	68.0
06/30/2021	0.871	0.400	116.0	398.0	97.4	72.4	264.8	249.2	36.2	85.8	300.7	37.0	29.3	107.0	103.8	65.5
07/31/2021	0.500	0.302	205.5	467.6	110.9	109.0	258.0	248.3		197.0	448.6	35.0	32.9	81.4	74.9	83.3
08/31/2021	1.047	0.430	249.5	737.6	118.6	105.8	363.0	312.8		244.4	715.8	57.3	56.0	175.4	165.0	76.9
09/30/2021	1.202	0.604	142.3	1038.6	50.7	47.6	361.9	350.9	56.9	270.7	1957.5	58.7	42.2	419.1	307.9	84.3
10/31/2021	1.538	0.526	94.7	625.6	57.9	49.8	533.6	354.0		127.7	891.3	53.0	43.9	679.8	392.1	56.0
11/30/2021	0.984	0.438	140.5	526.6	63.6	55.8	216.9	216.7		204.5	747.5	49.7	39.2	169.1	149.5	80.0
12/31/2021	0.631	0.339	122.4	393.9	88.3	73.0	284.3	234.8	47.6	114.0	367.0	42.7	40.7	137.5	131.0	64.3
01/31/2022	1.527	0.623	86.0	342.2	64.0	56.9	257.8	226.1		93.5	385.7	42.7	41.2	221.5	171.0	55.7
02/28/2022	1.031	0.551	110.8	642.3	71.2	59.3	489.3	339.3		148.7	911.9	67.7	47.2	465.2	286.1	68.6
03/31/2022	0.699	0.424	138.7	342.7	82.0	75.0	210.0	186.2	46.4	154.7	381.6	48.0	39.9	122.9	99.4	74.0
04/30/2022	0.499	0.301	133.6	348.4	98.2	80.9	240.3	221.7		124.7	326.1	42.0	38.9	134.9	110.9	66.0
05/31/2022	0.715	0.327	138.5	338.6	86.1	81.4	204.7	200.4		153.5	374.9	49.7	46.2	132.6	114.9	69.3
06/30/2022	0.515	0.302	180.6	366.4	112.6	105.4	222.5	215.0	39.5	205.7	417.7	52.3	44.8	96.4	90.5	78.3
07/31/2022	0.697	0.356	208.3	532.3	146.7	121.5	351.1	310.5		211.7	540.4	54.0	46.7	129.3	119.7	77.9
08/31/2022	1.016	0.422	182.3	483.4	107.6	104.0	294.4	275.6		188.0	496.7	67.0	51.9	159.8	133.8	73.1
09/30/2022	0.968	0.467	114.5	422.8	75.7	58.4	233.0	219.0	44.3	165.7	530.4	33.0	32.9	106.9	104.2	80.3
10/31/2022	1.196	0.635	109.6	349.7	81.3	60.1	197.3	192.3		152.7	479.0	46.0	37.7	141.0	126.3	73.6
11/30/2022	1.313	0.464	130.0	379.1	71.5	63.3	219.3	194.3		174.2	483.6	37.7	37.4	150.3	119.0	75.4
12/31/2022	0.642	0.338	123.3	377.0	82.2	66.3	209.1	202.5	46.7	118.9	371.9	40.3	33.5	103.8	103.1	72.3
01/31/2023	0.987	0.473	84.6	278.6	56.0	47.4	159.1	155.7		121.8	310.7	34.7	34.7	94.3	88.8	71.4
02/28/2023	0.793	0.460	64.8	329.5	42.0	41.6	216.8	211.7		76.0	386.5	31.0	30.2	160.0	153.4	60.3
03/31/2023	0.657	0.345	135.4	312.0	107.6	89.3	260.2	207.1	37.8	140.3	322.7	60.7	48.5	146.8	112.8	65.1
04/30/2023	0.723	0.424	105.6	443.9	58.7	52.2	275.0	215.8		124.2	536.4	39.3	30.5	130.8	117.9	78.0
05/31/2023	0.622	0.318	165.2	385.9	108.8	87.5	236.8	204.5		166.5	398.2	47.7	40.9	103.8	96.2	75.3
Count	60	60	59	59	59	59	59	59	20	60	60	60	60	60	60	60
Average	0.922	0.432	146.5	495.6	87.3	77.0	290.9	256.2	47.0	158.1	546.6	47.1	41.3	187.2	148.9	71.5
Min	0.355	0.279	64.8	278.6	42.0	41.6	159.1	155.7	36.2	76.0	155.7	24.7	21.9	79.4	74.9	52.3
Max	1.923	0.635	252.0	1038.6	146.7	125.3	602.3	413.5	59.0	317.7	1957.5	85.0	73.4	679.8	407.1	85.5
5th percentile	0.499	0.301	86.0	329.5	52.0	47.6	197.3	186.2	36.3	85.9	310.9	29.1	25.9	94.4	88.9	56.0
95th percentile	1.607	0.614	219.4	925.6	129.9	116.9	529.2	392.1	59.0	250.3	1243.6	67.7	59.4	462.9	306.8	83.3

Parameter	pH, Eff. (s.u.)		Fecal Coliform, Eff., CFU/100 mL		Ammonia-N, Eff. (mg/L)	DO, Eff.(mg/L)		Settleable Solids, Eff. (mg/L)	Temp, Eff., (deg C)
Row Labels	Max	Min	DAILY MX	MO GEO	DAILY MX	Max	Min	MO AVG	MO AVG
06/30/2018	7.0	6.9	983333	672778	15.0	4.7	3.5	0.2	11.1
07/31/2018	7.0	7.0	1183333	927778	24.0	4.6	3.2	0.1	13.5
08/31/2018	7.1	7.0	1133333	872222	30.0	7.6	3.1	0.1	12.8
09/30/2018	7.2	7.0	911111	702222	18.0	4.5	3.4	0.1	12.0
10/31/2018	7.0	7.0	816667	709445	15.0	8.2	3.6	0.1	9.4
11/30/2018	7.1	7.0	529167	354945	13.0	7.8	4.8	0.1	8.4
12/31/2018	7.1	7.0	225000	157500	18.0	9.6	4.8	0.1	7.5
01/31/2019	7.3	7.0	557778	505139	14.0	8.4	5.9	0.1	6.6
02/28/2019	7.2	7.0	883333	747000	19.0	6.9	4.2	0.1	6.4
03/31/2019	7.0	7.0	575000	343500	22.0	9.6	4.0	0.1	5.5
04/30/2019	7.3	7.0	711111	500556	25.0	9.9	4.4	0.1	6.2
05/31/2019	7.1	7.0	650000	587500	21.0	4.2	3.0	0.1	10.8
06/30/2019	7.1	7.0	638889	511945	20.0	5.2	3.1	0.1	12.4
07/31/2019	7.1	6.9	966667	963889	26.0	3.5	3.0	0.1	14.3
08/31/2019	7.0	6.9	1066667	995834	23.0	8.0	2.8	0.1	13.6
09/30/2019	7.2	7.0	766667	761112	17.0	7.4	3.5	0.1	12.0
10/31/2019	7.2	7.0	844444	631389	15.0	9.4	3.4	0.1	9.7
11/30/2019	7.1	6.9	430833	400000	10.0	9.7	3.3	0.1	6.0
12/31/2019	7.4	7.1	833333	610555	9.5	7.5	6.4	0.1	7.6
01/31/2020	7.4	7.1	1000000	835834	20.0	11.0	3.7	0.1	5.7
02/29/2020	7.4	7.1	783333	605417	5.6	11.2	9.2	0.1	5.2
03/31/2020	7.2	7.0	474167	447500	9.6	8.9	4.1	0.1	5.6
04/30/2020	7.2	7.0	877778	658056	16.8	9.9	2.6	0.1	6.0
05/31/2020	7.2	6.7	694444	611389	19.0	6.2	3.4	0.1	8.3
06/30/2020	7.1	7.0	426667	333334	10.0	7.9	5.1	0.1	10.3
07/31/2020	7.2	6.9	975000	808334	28.0	8.2	3.1	0.1	12.0
08/31/2020	7.1	6.8	783333	652917	10.0	7.3	5.2	0.1	13.4
09/30/2020	7.0	6.9	825000	776389	12.0	4.5	3.0	0.1	13.0
10/31/2020	7.0	6.8	210000	156000	12.0	6.3	4.5	0.1	11.0
11/30/2020	7.1	6.9	110000	90000	16.0	7.9	3.8	0.1	8.3
12/31/2020	7.1	6.9	465000	325500	7.8	10.1	4.9	0.1	6.6
01/31/2021	7.3	6.9	433333	336667	13.0	10.5	4.7	0.1	6.1
02/28/2021	7.2	7.1	550000	477084	23.6	8.2	4.3	0.1	6.6
03/31/2021	7.4	7.0	491667	423056	11.0	10.6	7.0	0.1	4.5
04/30/2021	7.1	6.8	512500	426250	9.8	9.3	3.1	0.1	6.2
05/31/2021	7.1	6.9	283111	187556	10.7	7.7	3.4	0.1	8.8
06/30/2021	7.0	6.9	794444	604306	0.3	8.1	3.1	0.1	11.2
07/31/2021	7.1	6.9	811111	689722	28.0	5.1	3.2	0.1	13.7
08/31/2021	7.0	6.8	325000	196500	19.1	4.2	2.8	0.1	14.9
09/30/2021	6.8	6.6	794445	573473	6.6	8.7	5.0	0.1	12.6
10/31/2021	7.0	6.6	240000	225000	4.4	9.7	5.2	0.1	9.9
11/30/2021	6.9	6.7	405000	305000	13.0	9.2	4.8	0.1	8.2
12/31/2021	6.9	6.6	413333	395000	12.0	6.6	3.1	0.1	6.2
01/31/2022	7.4	6.8	552000	426000	15.0	11.5	7.6	0.1	3.6
02/28/2022	7.4	7.3	716000	413000	13.0	11.6	5.6	0.1	4.3
03/31/2022	7.3	7.2	523333	450000	18.0	8.9	5.1	0.1	5.1
04/30/2022	7.2	7.0	788889	544445	13.0	7.1	3.3	0.1	6.8
05/31/2022	7.2	7.1	638889	543611	24.0	3.6	2.9	0.1	9.8
06/30/2022	7.2	7.0	950000	875000	22.0	3.1	2.9	0.1	12.5
07/31/2022	7.3	7.0	966667	630000	32.0	4.0	2.9	0.1	14.5
08/31/2022	7.5	7.1	537778	513889	25.0	4.5	2.9	0.1	15.1
09/30/2022	7.2	7.1	421667	361250	15.0	8.5	2.8	0.1	14.3
10/31/2022	7.1	6.9	383333	223667	17.0	8.5	3.2	0.1	12.8
11/30/2022	7.1	7.0	300000	205000	17.0	9.1	3.3	0.1	9.4
12/31/2022	7.0	6.9	417500	348750	19.0	5.6	3.4	0.1	7.4
01/31/2023	7.3	7.1	417500	346250	18.0	10.3	4.3	0.1	6.2
02/28/2023	7.1	6.9	240000	144250	9.3	9.6	5.2	0.1	5.6
03/31/2023	7.2	6.9	400000	374167	21.0	10.1	3.9	0.1	5.6
04/30/2023	7.5	7.0	363333	229667	8.4	9.5	4.7	0.1	5.7
05/31/2023	7.9	6.6	391667	381250	18.0	4.2	3.0	0.1	9.5
Count	60	60	60	60	60	60	60	60	60
Average	7.2	6.9	623231	501763	16.3	7.7	4.0	0.1	9.1
Min	6.8	6.6	110000	90000	0.3	3.1	2.6	0.1	3.6
Max	7.9	7.3	1183333	995834	32.0	11.6	9.2	0.2	15.1
5th percentile	6.9	6.6	225750	156075	5.7	3.6	2.8	0.1	4.5
95th percentile	7.5	7.1	1063334	925139	28.0	11.2	7.0	0.1	14.5

D. Alaska WQS

Table 12. Alaska WQS for Turbidity for Marine Uses

Water Quality Standards for Designated Uses	
POLLUTANT & WATER USE	CRITERIA
(24) TURBIDITY, FOR MARINE WATER USES	
(A) Water Supply (i) aquaculture	May not exceed 25 nephelometric turbidity units (NTU).
(A) Water Supply (ii) seafood processing	May not interfere with disinfection.
(A) Water Supply (iii) industrial	May not cause detrimental effects on established levels of water supply treatment.
(B) Water Recreation (i) contact recreation	Same as (24)(A)(i).
(B) Water Recreation (ii) secondary recreation	Same as (24)(A)(i).
(C) Growth and Propagation of Fish, Shellfish, Other Aquatic Life, and Wildlife	May not reduce the depth of the compensation point for photosynthetic activity by more than 10%. May not reduce the maximum secchi disk depth by more than 10%.
(D) Harvesting for Consumption of Raw Mollusks or Other Raw Aquatic Life	Same as (24)(C).

Table 13. Alaska WQS for Dissolved Gas for Marine Uses

Water Quality Standards for Designated Uses	
POLLUTANT & WATER USE	CRITERIA
(15) DISSOLVED GAS, FOR MARINE WATER USES	
(B) Water Supply (i) aquaculture	Surface dissolved oxygen (D.O.) concentration in coastal water may not be less than 6.0 mg/l for a depth of one meter except when natural conditions cause this value to be depressed. D.O. may not be reduced below 4 mg/l at any point beneath the surface. D.O. concentrations in estuaries and tidal tributaries may not be less than 5.0 mg/l except where natural conditions cause this value to be depressed. In no case may D.O. levels exceed 17 mg/l. The concentration of total dissolved gas may not exceed 110% of saturation at any point of sample collection.
(A) Water Supply (ii) seafood processing	Not applicable.
(A) Water Supply (iii) industrial	Not applicable.
(C) Water Recreation (i) contact recreation	Same as (15)(A)(i).
(B) Water Recreation (ii) secondary recreation	Same as (15)(A)(i).
(C) Growth and Propagation of Fish, Shellfish, Other Aquatic Life, and Wildlife	Same as (15)(A)(i).
(D) Harvesting for Consumption of Raw Mollusks or Other Raw Aquatic Life	Same as (15)(A)(i).

Table 14. Alaska WQS for pH for Marine Uses

Water Quality Standards for Designated Uses	
POLLUTANT & WATER USE	CRITERIA
(18) pH, for marine water uses (variation of pH for waters naturally outside the specified range must be toward the range)	
(A) Water Supply (i) Aquaculture	May not be less than 6.5 or greater than 8.5, and may not vary more than 0.2 pH unit outside of the naturally occurring range.
(A) Water Supply (ii) seafood processing	May not be less than 6.0 or greater than 8.5.
(A) Water Supply (iii) industrial	May not be less than 5.0 or greater than 9.0
(D) Water Recreation (i) contact recreation	May not be less than 6.0 or greater than 8.5. If the natural pH condition is outside this range, substances may not be added that cause any increase in buffering capacity of the water.
(B) Water Recreation (ii) secondary recreation	Same as (18)(A)(iii).
(C) Growth and Propagation of Fish, Shellfish, Other Aquatic Life, and Wildlife	Same as (18)(A)(i).
(D) Harvesting for Consumption of Raw Mollusks or Other Raw Aquatic Life	Same as (18)(A)(ii).

Table 15. Alaska WQS for Temperature for Marine Uses

Water Quality Standards for Designated Uses	
POLLUTANT & WATER USE	CRITERIA
(22) TEMPERATURE, FOR MARINE WATER USES	
(C) Water Supply (i) aquaculture	May not cause the weekly average temperature to increase more than 1° C. The maximum rate of change may not exceed 0.5° C per hour. Normal daily temperature cycles may not be altered in amplitude or frequency.
(A) Water Supply (ii) seafood processing	May not exceed 15° C.
(A) Water Supply (iii) industrial	May not exceed 25° C.
(E) Water Recreation (i) contact recreation	Not applicable.
(B) Water Recreation (ii) secondary recreation	Not applicable.
(C) Growth and Propagation of Fish, Shellfish, Other Aquatic Life, and Wildlife	Same as (22)(A)(i).
(D) Harvesting for Consumption of Raw Mollusks or Other Raw Aquatic Life	Same as (22)(A)(i).

Table 16. Alaska WQS for Toxics for Marine Uses

Water Quality Standards for Designated Uses	
POLLUTANT & WATER USE	CRITERIA
(23) TOXIC AND OTHER DELETERIOUS ORGANIC AND INORGANIC SUBSTANCES, FOR MARINE WATER USES	
(D) Water Supply (i) aquaculture	Same as (23)(C).
(A) Water Supply (ii) seafood processing	The concentration of substances in water may not exceed the numeric criteria for aquatic life for marinewater shown in the <i>Alaska Water Quality Criteria Manual</i> (see note 5). Substances may not be introduced that cause, or can reasonably be expected to cause, either singly or in combination, odor, taste, or other adverse effects on the use.
(A) Water Supply (iii) industrial	Concentrations of substances that pose hazards to worker contact may not be present.
(F) Water Recreation (i) contact recreation	There may be no concentrations of substances in water, that alone or in combination with other substances, make the water unfit or unsafe for the use.
(B) Water Recreation (ii) secondary recreation	Concentrations of substances that pose hazards to incidental human contact may not be present.
(C) Growth and Propagation of Fish, Shellfish, Other AquaticLife, and Wildlife	The concentration of substances in water may not exceed the numeric criteria for aquatic life for marine water and human health for consumption of aquatic organisms only shown in the <i>Alaska Water Quality Criteria Manual</i> (see note 5), or any chronic and acute criteria established in this chapter, for a toxic pollutant of concern, to protect sensitive and biologically important life stages of resident species of this state. There may be no concentrations of toxic substances in water or in shoreline or bottom sediments, that, singly or in combination, cause, or reasonably can be expected to cause, adverse effects on aquatic life or produce undesirable or nuisance aquatic life, except as authorized by this chapter. Substances may not be present in concentrations that individually or in combination impart undesirable odor or taste to fish or other aquatic organisms, as determined by either bioassay or organoleptic tests.
(D) Harvesting for Consumptionof Raw Mollusks or Other Raw Aquatic Life	Same as (23)(C).

Table 17. Alaska WQS for Bacteria for Marine Uses

Water Quality Standards for Designated Uses	
POLLUTANT & WATER USE	CRITERIA
(14) BACTERIA, FOR MARINE WATER USES	
(A) Water Supply (i) aquaculture	For products normally cooked, the geometric mean of samples taken in a 30-day period may not exceed 200 fecal coliform/100 ml, and not more than 10% of the samples may exceed 400 fecal coliform/100 ml. For products not normally cooked, the geometric mean of samples taken in a 30-day period may not exceed 20 fecal coliform/100 ml, and not more than 10% of the samples may exceed 40 fecal coliform/100 ml.
(A) Water Supply (ii) seafood processing	In a 30-day period, the geometric mean of samples may not exceed 20 fecal coliform/100 ml, and not more than 10% of the samples may exceed 40 fecal coliform/100 ml.
(A) Water Supply (iii) industrial	Where worker contact is present, the geometric mean of samples taken in a 30-day period may not exceed 200 fecal coliform/100 ml, and not more than 10% of the samples may exceed 400 fecal coliform/100 ml.
(B) Water Recreation (i) contact recreation	In a 30-day period, the geometric mean of samples may not exceed 35 enterococci CFU/100 ml, and not more than 10% of the samples may exceed a statistical threshold value (STV) of 130 enterococci CFU/100 ml.
(B) Water Recreation (ii) secondary recreation	In a 30-day period, the geometric mean of samples may not exceed 200 fecal coliform/100ml, and not more than 10% of the samples may exceed 400 fecal coliform/100ml.
(C) Growth and Propagation of Fish, Shellfish, Other Aquatic Life, and Wildlife	Not applicable.
(D) Harvesting for Consumption of Raw Mollusks or Other Raw Aquatic Life	The geometric mean of samples may not exceed 14 fecal coliform/100 ml; and not more than 10% of test samples may exceed; <ul style="list-style-type: none"> - 43 MPN per 100 ml for a five-tube decimal dilution test; - 49 MPN per 100 ml for a three-tube decimal dilution test; - 28 MPN per 100 ml for a twelve-tube single dilution test; - 31 CFU per 100 ml for a membrane filtration test (see note 14).

E. Equations and Analysis

1. Section 8.B.1: Attainment of TSS Standard

EPA calculated the maximum change in the concentration of TSS at the edge of the ZID using formula B-32 from the 301(h) TSD. The average weekly TSS limitation of 78 mg/L and the modeled critical initial dilution of 67:1 were used in the equation. The results show a 1.2 mg/L increase in suspended solids in the receiving water after initial dilution, or 1.5%.

Formula B-32

$$SS = SS_e/S_a$$

where,

SS = change in suspended solids concentration following initial dilution

SS_e = effluent suspended solids concentration (78 mg/L)

S_a = critical initial dilution (67:1)

$$78/67 = 1.16 \text{ mg/L}$$

2. Section 8.B.2: Attainment of DO Standard

EPA calculated the final concentration of DO at the boundary of the ZID using equation B-5 from the 301(h) TSD. The analysis is presented in Table 18 below.

Table 18. Dissolved Oxygen Analysis

Dissolved Oxygen in mg/L	Surface	Mid	Bottom	Notes
Ambient DO concentration (DO_a) = (reference sites)	7.0	6.2	5.6	minimum observed at two reference sites
Ambient DO concentration (DO_a) = (ZID boundary sites)	7.2	6.5	5.7	minimum observed at two outfall sites
Effluent DO concentration (DO_e) =	2.8	2.8	2.8	5 th Percentile of minimum
Immediate DO demand (IDOD) =	5.0	5.0	5.0	Table B-3 301(h) TSD ¹
Initial dilution (S_a) =	67	67	67	Dilution modeling results
Final DO at ZID boundary using reference site ambient DO $DO_f = DO_a + (DO_e - IDOD - DO_a)/S_a =$ (using reference site ambient DO)	6.86	6.07	5.48	Equation B-5 from 301(h) TSD, using reference site ambient DO and 100:1 ZID dilution
Final DO at ZID boundary assuming 0 mg/L effluent (worst-case) $DO_f = DO_a + (DO_e - IDOD - DO_a)/S_a =$	>6.82	>6.03	>5.44	Worst-Case
FINAL DO at ZID Boundary using outfall site ambient DO $DO_f = DO_a + (DO_e + IDOD - DO_a)/S_a =$ (using ZID boundary ambient DO)	7.06	6.37	5.58	Equation B-5 from 301(h) TSD, using outfall site ambient DO and 100:1 ZID dilution
Depletion at Refence Sites (Reference Site DO – Final DO at ZID using reference site ambient DO)	-0.14 (2.0%)	-0.13 (2.0%)	-0.12 (2.1%)	
Depletion at ZID Boundary Sites (Outfall site DO – Final DO at ZID boundary using outfall site ambient DO)	-0.14 (1.9%)	-0.13 (2.0%)	-0.12 (2.1%)	
¹ Primary facility, effluent BOD ₅ 150-200 mg/L, travel time 0-100 minutes.				

The final BOD₅ after initial dilution was also calculated to assess the potential for far field DO using a simplified procedure from Appendix B of the 301(h) TSD. The maximum reported average monthly BOD₅ value is first converted to ultimate BOD₅ by multiplying it by the constant 1.46. The ultimate BOD₅ is then divided by the initial dilution factor (100) to determine the final BOD₅ after initial dilution.

Max BOD₅: 125 mg/L

Ultimate BOD₅: 125 mg/L x 1.46 = 183 mg/L

Final BOD₅: 183 mg/L ÷ 67 = 2.72 mg/L BOD₅

A final BOD₅ concentration of 2.72 mg/L after initial dilution is not expected to cause or contribute to any measurable far field DO impacts.

3. Section 8.C.3. Toxics Analysis

The following mass-balance equation was used to determine whether the discharge has reasonable potential to cause or contribute to an excursion above Alaska WQS:

$$Cd = \frac{Ce + [Cu (Sa - 1)]}{Sa} \text{ where}$$

Cd = Resultant magnitude or predicted concentration at edge of mixing zone, µg/L

Ce = Maximum projected effluent concentration, µg/L

Cu = Background receiving water concentration, µg/L

Sa = dilution factor

The maximum projected effluent concentration (Ce) in the mass balance equation is represented by the highest reported concentration measured in the effluent multiplied by a reasonable potential multiplier. The reasonable potential multiplier accounts for uncertainty in the data. The multiplier decreases as the number of data points increases and variability of the data decreases. Variability is measured by the coefficient of variation (CV) of the data. When there is not enough data to reliably determine a CV (n<10), the TSD recommends using 0.6 as a default value. A partial listing of reasonable potential multipliers can be found in Table 3-1 of the TSD.

The resulting maximum projected effluent concentration is then divided by the minimum critical dilution. This product represents the maximum effluent concentration at the edge of the ZID. The maximum effluent concentration at the edge of the ZID is then added to the background concentration, Cu, which is represented by the 95th percentile value from the background data set (the 5th percentile value is used for DO). The sum Cd represents the projected maximum receiving water concentration at the edge of the ZID. This concentration is compared to the water quality criterion to determine whether a water-quality based effluent limitation is needed.

If the receiving water concentration at the edge of the ZID exceeds the water-quality criteria a water-quality based effluent limitation is developed. If a permittee is unable to meet their WQBEL they would fail to satisfy CWA 301(h)(9) and 40 CFR 125.62 and would be ineligible for a 301(h)-modified permit.

No pollutants have reasonable potential at the edge of the ZID. A summary of the reasonable potential analyses used to develop WQBELs is located in Appendix D of the Fact Sheet.

F. Dilution Modeling Report

The dilution modeling report is attached to the end of this document.

FINAL

Mixing Zone Dilution Modeling for Six Alaska POTWs

Prepared for:

United States Environmental Protection Agency
Cincinnati Procurement Operations Division
Cincinnati, Ohio 45268

USEPA OW Contract: 68HERC20D0010; Task Order: 68HERV21F0114

Technical Support for National Pollutant Discharge
Elimination System (NPDES), Clean Water Act Section 301(h),
and Endangered Species Act Section 7 Implementation
in EPA Region 10 NPDES Permits Section

Prepared by:



739 Hastings St.
Traverse City, MI 48686
Contact: Douglas Endicott

Phone: (231) 941-2230

Email: dendicott@glec.com
www.glec.com

Date: August 5, 2021

Table of Contents

Table of Contents	ii
List of Tables	ii
List of Figures	ii
Mixing Zone Dilution Modeling for Six Alaska POTWs	1
Haines	8
Ketchikan	15
Petersburg	23
Sitka	28
Skagway	35
Wrangell	42
Summary	47
References	50
Appendix: VP and FARFIELD Output for Each Location	51

	<u>No. of Pages</u>
Appendix: VP and FARFIELD Output for Each Location	52

List of Tables

Table 1. Maximum Effluent FC Concentrations Based on EPA (1991) Reasonable Potential Procedure (Maximum Monthly Concentrations Reported in DMRs Over the Past 5 Years)	2
Table 2. Summary of Data Used for Mixing Zone Dilution Modeling	5
Table 3. Haines mixing zone dilution modeling results	11
Table 4. Ketchikan Mixing Zone Dilution Modeling Results	18
Table 5. Petersburg Mixing Zone Dilution Modeling Results	25
Table 6. Sitka Mixing Zone Dilution Modeling Results	31
Table 7. Skagway Mixing Zone Dilution Modeling Results	38
Table 8. Wrangell Mixing Zone Dilution Modeling Results	44
Table 9. Average Dilution Factor Predictions at Distances from the Discharge Point Corresponding to 1- 10 Times the Depth of Discharge	47
Table 10. Average Dilution Factor Predictions at the Distance from the Outfall to Shore	47
Table 11. Dilution Factor Predictions at Distances Equal to Initial Mixing Region Boundaries	48
Table 12. Dilution Factors and Mixing Zone Distances Required to Attain FC Criteria	49

List of Figures

Figure 1. Aerial View of the POTW Outfall Location at Haines	8
Figure 2. Vertical Ambient Profile of Temperature, Salinity and Density in Haines Mixing Zones Resulting in Least Mixing	9
Figure 3. Haines Discharge Plume Boundary Plan View from Above	14
Figure 4. Haines Discharge Plume Centerline and Boundary Profile View from Side	14
Figure 5. Haines Discharge Plume Average and Centerline Dilution vs. Distance from Outfall	14
Figure 6. Aerial View of the POTW Outfall Location at Ketchikan	15

Figure 7. Vertical Ambient Profile of Temperature, Salinity and Density in Ketchikan Mixing Zone Resulting in Least Mixing.....	16
Figure 8. Ketchikan Discharge Plume Boundary Plan View from Above.....	21
Figure 9. Ketchikan Discharge Plume Centerline and Boundary Profile View from Side	21
Figure 10. Ketchikan discharge plume average and centerline dilution vs. distance from outfall	22
Figure 11. Aerial View of the POTW Outfall Location at Petersburg.....	23
Figure 12. Vertical Ambient Profile of Temperature, Salinity and Density in Petersburg Mixing Zone Resulting in Least Mixing.....	24
Figure 13. Petersburg Discharge Plume Boundary Plan View from Above.....	27
Figure 14. Petersburg Discharge Plume Centerline and Boundary Profile View from Side	27
Figure 15. Petersburg Discharge Plume Average and Centerline Dilution vs. Distance from Outfall	27
Figure 16. Aerial View of the POTW Outfall Location at Sitka	28
Figure 17. Vertical Ambient Profile of Temperature, Salinity and Density in Sitka Mixing Zone Resulting in Least Mixing	29
Figure 18. Sitka Discharge Plume Boundary Plan View from Above.....	33
Figure 19. Sitka Discharge Plume Centerline and Boundary Profile View from Side	33
Figure 20. Sitka Discharge Plume Average and Centerline Dilution vs. Distance from Outfall.....	34
Figure 21. Aerial View of the POTW Outfall Location at Skagway	35
Figure 22. Vertical Ambient Profile of Temperature, Salinity and Density in Skagway Mixing Zone Resulting in Least Mixing.....	36
Figure 23. Skagway Discharge Plume Boundary Plan View from Above	41
Figure 24. Skagway Discharge Plume Centerline and Boundary Profile View from Side.....	41
Figure 25. Skagway Discharge Plume Average and Centerline Dilution vs. Distance from Outfall	41
Figure 26. Aerial View of the POTW Outfall Location at Wrangell.....	42
Figure 27. Vertical Ambient Profile of Temperature, Salinity and Density in Wrangell Mixing Zone Resulting in Least Mixing.....	43
Figure 28. Wrangell Discharge Plume Boundary Plan View from Above	46
Figure 29. Wrangell Discharge Plume Centerline and Boundary Profile View from Side.....	46
Figure 30. Wrangell Discharge Plume Average and Centerline Dilution vs. Distance from Outfall	46
Figure 31. DF Predictions Graphed as a Function of Distance from the Outfall.....	48

MIXING ZONE DILUTION MODELING FOR SIX ALASKA POTWS

For each of the six POTWs of interest in southeast Alaska (Haines, Ketchikan, Petersburg, Sitka, Skagway, and Wrangell) mixing zone dilution models were developed and applied to predict the steady-state dilution of effluent being discharged into the marine coastal receiving waters. Because of the nature of the discharges and receiving waters, initial dilution models within the EPA-approved Visual Plumes software (EPA 2003) were selected for use. From a modeling perspective, each of the receiving water mixing zones share several important characteristics that led to the selection of Visual Plumes, as opposed to the alternative EPA-approved modeling framework, CORMIX:

- Discharge of buoyant effluent into a deep (20-30 meter), stratified marine water body;
- No shoreline boundaries within 100 meters of the outfalls;
- Relatively small discharge flow rates (0.6-7 MGD); and
- No obstructions in the receiving waters to impede circulation near the outfalls, making tidal build-up of pollutants unlikely.

For each site, appropriate models were applied to predict average dilution at various distances (corresponding to 1-10 times the depth of discharge) from the discharge point, as well as the geometry (depth, width, etc.) of the plume itself. Aquatic life-based mixing zone analyses involve the concept of determining reasonable worst-case values for various parameters because the durations established for these water quality criteria vary for both acute and chronic toxicities (Washington DoE, 2018). The term *reasonable worst-case* refers to the value selected for a specific effluent or receiving water parameter. *Critical conditions* refer to a scenario involving reasonable worst-case parameters, which has been set up to run in a mixing zone model. For this work, steady-state mixing zone models were applied using a combination of parameters (e.g., effluent flow, current speed, density profile) to simulate critical conditions. The predictions were based on input data representing critical conditions demonstrated to minimize the dilution of effluent pollutants. It should be understood that each critical condition (by itself) has a low probability of occurrence.

It should also be understood that mixing zone modeling is not an exact science (Reese et al., 2021). With limited data and numerous variables, mixing zone sizes may be considered best estimates to $\pm 50\%$. Sensitivity analysis and comparison of alternative models were used to develop confidence in the dilution model predictions. All simulations explicitly included fecal coliform (FC) as a pollutant, which required the models to simulate bacterial decay in the receiving waters. Maximum effluent (end-of-pipe) FC concentrations were estimated for modeling by applying the EPA (1991) reasonable potential procedure to maximum monthly concentrations reported over the past five years in Discharge Monitoring Reports (DMRs) provided by EPA Region 10. The maximum effluent FC concentrations for each discharge are presented in Table 1 along with the dilution factors required to meet the Alaska marine water quality standards for harvesting for consumption of raw mollusks or other raw aquatic life (18 AAC 70 Water Quality Standards, amended as of March 5, 2020):

The geometric mean of samples may not exceed 14 fecal coliform/100 ml, and not more than 10% of the samples may exceed 43 MPN per 100 mL for a five-tube decimal dilution test.

Table 1. Maximum Effluent FC Concentrations Based on EPA (1991) Reasonable Potential Procedure (Maximum Monthly Concentrations Reported in DMRs Over the Past 5 Years)

City	Haines	Kechikan	Petersburg	Sitka	Skagway	Wrangell
Maximum expected effluent FC (daily max, 99%; n/100 mL)	2,100,000	2,900,000	2,000,000	3,700,000	2,600,000	190,000
Dilution factor ¹ required to meet 14/100 mL FC criterion	150,000	210,000	140,000	270,000	190,000	14,000
Dilution factor required to meet 43/100 mL FC criterion	50,000	67,000	47,000	87,000	60,000	4,400

Model predictions of the size of the mixing zones required to attain these dilution factors are presented in the summary of this report.

Most mixing zone simulations required the combination of initial dilution and far-field models. Initial dilution models simulate the “initial mixing region” or “hydrodynamic mixing zone” defined to end where the self-induced turbulence of the discharge collapses under the influence of ambient stratification and initial dilution reaches its limiting value (EPA, 1994). At the end of this region/zone the waste field is established and then drifts with the ocean currents and is diffused by oceanic turbulence.

The initial dilution models included UM3, DKHW and NRFIELD, all contained within the Visual Plumes (VP) framework. Although the three initial dilution models run under the same VP interface, they differ in terms of origin and development, underlying assumptions, empirical datasets, solution techniques and coding. UM3 is a three-dimensional Updated Merge (UM) model for simulating single and multiport submerged diffusers. DKHW is an acronym for the Davis, Kannberg and Hirst model, a three-dimensional model for submerged single or multi-port diffusers. DKHW is limited to positively buoyant plumes and considers either single or multiport discharges at an arbitrary horizontal angle into a stratified, flowing current. NRFIELD is based on the Roberts, Snyder and Baumgartner (RSB) model, an empirical model for multiport diffusers (T-risers, each having two ports for a total of 4-ports) in stratified currents. A shortcoming of each of these initial dilution models in VP is their inability to recognize and address lateral boundary constraints, although that is not a major issue for these Alaskan mixing zone sites. Although the original 2001 version of VP is still available from EPA’s CEAM site, it is currently unsupported and known to contain a number of errors (Frick et al. 2010; Frick and Roberts, 2019). We instead used the updated VP version 20, maintained and distributed by the California State Water Resources Control Board, Ocean Standards Unit (<https://ftp.waterboards.ca.gov>).

The Brooks far-field model was used to extend dilution simulations beyond the spatial bounds of initial dilution. Although this model is incorporated in VP, we also used a stand-alone spreadsheet version of the

¹ Dilution Factor, DF = (end of pipe) concentration/mixed concentration.

Brooks model, FARFIELD, that is contained in the Washington Department of Ecology (DoE), *Permit Calculation workbook* (<https://ecology.wa.gov/Regulations-Permits/Guidance-technical-assistance/Water-quality-permits-guidance>). FARFIELD calculates dilution using the method of Brooks (1960) and is recommended by Frick et al. (2010) in lieu of using far-field predictions within VP, since the latter does not allow for the use of linear diffusivity as recommended in estuaries. FARFIELD was used to double-check the far-field results in VP, and in some instances to replace them.

The initial dilution models relied upon a variety of data to characterize the effluent, discharge outfall and receiving water. These data are summarized in Table 2. The data were gathered from a number of sources including EPA Region 10 and the State of Alaska; from the permittees as documented in permit files, as-built drawings and charts, etc.; tidal current predictions made by the National Oceanic and Atmospheric Administration (NOAA); and other literature sources found by Internet search.

All six of the POTWs discharge effluent using deeply-submerged outfalls with diffusers and multiple ports (Table 2). Haines and Petersburg both use two-diffuser ports, while the others use multiport diffusers with 6 to 16 ports. Modeling initial dilution from the four sites using multiport diffusers required additional considerations, because these diffusers have opposing ports (ports on both sides of the diffuser pipe that discharge effluent into opposite directions), creating co-flowing and counter-flowing plumes. Counter-flowing plumes are discharged opposing the ambient current and will generally rise and bend back into the direction from whence they came, eventually merging with the co-flowing plumes that are discharged on the opposite side of the pipe in the direction of the current. This is called cross-diffuser merging (EPA, 2003). Two alternative modeling approaches were applied to simulate initial mixing from opposing ports in the UM3 and DKHW models (NRFIELD models cross-diffuser merging directly). The first approach (“half spacing”) treated the diffuser as if all ports are on one side with half the spacing. In the context of merging plumes, this approach works well when the distances of interest are somewhat beyond the point of merging.

The second approach (“downstream only”) involves simulating only downstream ports. This necessitates doubling the flow per port (assuming there is an even number of ports in the diffuser) and increasing the diameter of the ports to maintain approximately the same densimetric Froude number. With this approach only the downstream ports would be used when determining spacing and number of ports. The Washington DoE Permit Writer’s Manual, Appendix C (2018) discusses the merits of these approaches. When possible, we applied both approaches to modeling cross-diffuser merging and compared the results.

We assumed that all ports on a multiport diffuser discharged effluent flow equally and at the same depth. The multiport diffuser at Ketchikan was unique because it was the only diffuser that combined ports of different sizes. Five 6-inch opposing ports were spaced along a 12-inch manifold, and a sixth 12-inch port was located at the manifold’s end. The CORMIX hydraulic module CorHyd (MixZone, 2020) was used to determine the flow distribution between the 6-inch ports and the 12-inch port. At a nominal flow rate of 5.35 MGD, CorHyd calculated that the 6-inch ports would discharge 52% of the flow, and the remaining 48% would be discharged from the 12-inch port. These same percentages were applied to other flow rates at Ketchikan. Initial model simulations suggested that the plumes emanating from the 12-inch port would not merge with the plume from the other ports, due to the 90° difference in port orientations. Therefore, these plumes were modeled separately.

The diffuser port orifice contraction coefficient is an initial dilution model hydraulic parameter that is specified according to how ports are machined in the diffuser pipe wall (EPA, 2003). For all of the outfalls except Sitka, sharp-edged ports were assumed, and contraction coefficients of 0.61 were specified. For Sitka, the port orifices were bell-shaped, so a contraction coefficient of 1.0 was applied.

Tidal current predictions were used to calculate 10th percentile and average current velocities at each site. The tidal prediction location nearest each discharge site was identified and tidal velocity predictions for 2021 were downloaded from the NOAA Tides & Currents web site (<http://tidesandcurrents.noaa.gov>). These data were imported into a spreadsheet and the predictions for the month in which the critical ambient conditions fell were selected. For Haines, Ketchikan and Skagway, 6-minute tidal velocity predictions were available. The tenth percentile of the absolute value of these velocities were calculated and used as the critical ambient velocity input for mixing zone dilution modeling. For the other locations, only times and velocities for ebb, slack and flood tides were available. The Excel FORECAST function was then used to interpolate hourly values from the tidal velocity predictions, and the tenth percentile of the absolute value of these interpolated hourly values was calculated and used for modeling². These velocities, ranging from 1.4 to 5.9 cm/s, are presented in Table 2. The compass directions of tidal currents (also presented in Table 2) were based on the tidal current predictions, the orientation of the nearest shoreline (presuming currents to flow parallel to the shoreline), and other information from the permit files. The average hourly ebb and flood tidal velocities were calculated similarly and are also presented in Table 2 and were used in the model sensitivity analysis.

The decay of fecal coliform was included in the initial dilution and far-field models by using the Mancini (1978) bacteria model that incorporates four variables (salinity, temperature, solar insolation, and water column absorption) to determine the rate of first-order decay. Summertime solar insolation in southeast Alaska was based upon the models and measurements of Dissing and Wendler (1998). Summertime solar radiation flux, that takes into account both latitude and fractional cloud cover, averaged 190 Watts/m² (16.3 Langleys/hr) in the Alexander Archipelago. The bacterial decay model used ambient water temperature and salinity, and a default light absorption coefficient of 0.16, to calculate decay rates of ~0.0002/d. Decay of fecal coliform was found to be insignificant in comparison to physical dilution at the time and space scales of interest for mixing zone analysis.

² Comparison between linear interpolation and cubic spline interpolation of the tidal velocity predictions suggests that linear interpolation may yield average velocities that could be low by a factor of 1.6 to 2.3. The impact of this discrepancy on DF predictions will be demonstrated via sensitivity analysis.

Table 2. Summary of Data Used for Mixing Zone Dilution Modeling

City	Haines	Ketchikan	Petersburg	Sitka	Skagway	Wrangell
<i>Permit</i>	<i>AK0021385</i>	<i>AK0021440</i>	<i>AK0021458</i>	<i>AK0021474</i>	<i>AK0020010</i>	<i>AK0021466</i>
DMR data available	2011-2020	2013-18	2015-2019	2015-20	2007-19	2007-19
DMR data used	2016-2020	2013-2018	2015-2019	2015-2020	2014-2019	2015-2019
Permit Maximum Flow Rate (MGD ³)	2.9	7.2	3.6	5.3	0.63	3.0
monthly ⁴ average effluent temperature	12.0	14.6 ⁵	13.2	14.0	14.7	17.3
monthly maximum effluent temperature	15.8	20.5	14.6	15.0	17.3	18.4
Outfall						
distance from shore (m)	549	221	366	114	125	457
depth at LWWD (m)	21.3	29.9	18.3	24.4	18.3	30.5
number of diffuser ports	2 (3rd is capped)	6	2 (3 others capped)	16 bell-shaped	8	16
diffuser length (ft)	30	190	45.9	195	25	240
port diameter (in)	3	5@6", 1@12"	4	4	3	3
Elevation of ports above bottom (in)	8	12	9	18	6	6
Port spacing (ft)	15-30 ⁶	40 (20' apart on alternating sides of pipe)	10-34 ⁶	26 (13' apart on alternating sides of pipe)	7	32 (16' apart on alternating sides of pipe)
Port orientation	horizontal	horizontal (opposing/ alternating) + diffuser end	horizontal	horizontal opposing/ alternating	horizontal opposing	horizontal opposing/ alternating

³ Million gallons per day.

⁴ Average effluent temperature for month of limited dilution

⁵ Average of maximum monthly effluent temperatures (no monthly averages in DMR)

⁶ Port spacing is uncertain given information in permit fact sheet.

City	Haines	Ketchikan	Petersburg	Sitka	Skagway	Wrangell
VP discharge angle ⁷ (degrees)	90	115 (5x6" ports), 205 (1x12" port)	115	300	350	90
<i>Receiving Water</i>						
Water body	Portage Cove, Chinook Inlet	Tongass Narrows, Charcoal Point	Frederick Sound	Sitka Sound, Middle Channel	Tiaya Inlet	Zimovia Strait
tidal range (ft)	14.2	13	15	7.7	14.1	13
data source/file ⁸ name for ambient data	NA; used Skagway data	AK0021440_Ketch ikan_temp_salinity	Petersburg_Recei ving Water Data	Sitka Receiving Water Monitoring	Table 2-5_v2	Wrangell FC and RW Monitoring
Ambient salinity/temp profile limiting dilution	Skagway site 1, June 2005	Ketchikan site 3, July 1997	Petersburg site 1, August 2005	Sitka site C, July 2010	Skagway site 1, June 2005	Wrangell site 4, August 2016
NOAA tides & current predictions	Battery Point, Chinook Inlet (SEA0826)	East of Airport (SEA0711)	Cosmos Point (PCT3811)	Sitka Harbor, Channel off Harbor Island (PCT4166)	Tiaya Inlet (SEA0825)	Wrangell Harbor (PCT3131)
Tidal current 10 th percentile (cm/s)	June: 2.1 @ 35', 2.8 @ 133'; 2.3 (interpolated to discharge depth)	July: 5.9 @87'	August: 1.6	July: 1.7	June: 1.4 @37'	August: 4.0
Tidal current average (Ebb/Flood, cm/s)	June: 10.2/10.7 @ 35', 11.3/16.1 @ 133'; 10.5/12.6 (interpolated to discharge depth)	July: 49.2/20.1 @87'	August: 10.4/7.8	July: 10.3/8.0	June: 6.9/12.2 @37'	August: 20.8/23.5
VP current angle ⁷ (degrees)	90	140	120	225	350	90

⁷ Zero degrees is eastward.

⁸ Names of electronic files provided by EPA Region 10 on March 31, 2021.

In the following sections, the modeling of effluent dilution in mixing zones at each site is presented and results are displayed in both tables and graphs. Text output from the VP and FARFIELD model simulations at each location are provided in an appendix to this report.

HAINES

The wastewater treated at Haines is discharged 549 m offshore in Portage Cove, Chinook Inlet (Figure 1), from a 2-port diffuser at a depth of 21.3 m (MLLW⁹). The permitted maximum flow rate is 2.9 MGD. Other site-specific data for the wastewater discharge, outfall, and ambient receiving water is summarized in Table 2. The diffuser port spacing at Haines is uncertain (somewhere in the range of 15 to 30 ft.) due to one of three ports being closed. The models predicted lower DFs for the narrowest port spacing (15 ft.), so that spacing was used for all model simulations.

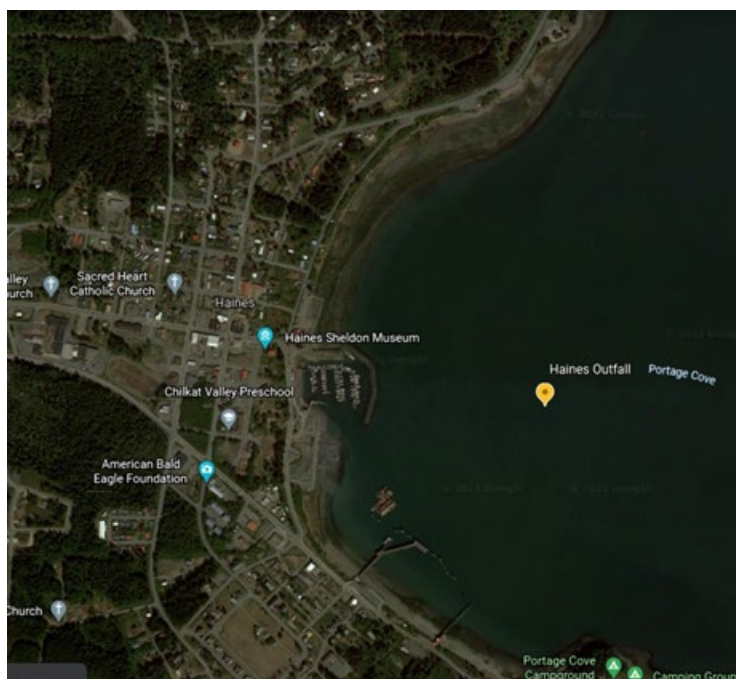


Figure 1. Aerial View of the POTW Outfall Location at Haines

According to the permit fact sheet, the circulation patterns within Portage Cove are not known. The effluent discharged by the Haines WWTP is subject to a net transport of water out of Chinook Inlet due to fresh water supplied by runoff. The period of low net circulation is expected to be December through April, during times of minimum river flow. NOAA 6-minute tidal current predictions from Battery Point, Chinook Inlet (SEA0826) were used to calculate the 10th percentile and average tidal current velocities at 35 and 133 ft. (10.7 and 40.5 m; Table 2), that were then interpolated to the discharge depth of 21.1 m. The resulting 10th percentile current velocity used for modeling was 2.3 cm/s, while the average ebb and flood tidal velocities were 10.5 and 12.6 cm/s.

No specific data were available for vertical profiles of temperature and salinity in Portage Cove or Chinook Inlet. Such data are used to calculate the density profile and define the vertical stratification that limits vertical mixing of the buoyant discharge plume. Instead, we used vertical profiles of temperature and salinity measured in Tiaya Inlet, an adjoining waterway that is also the receiving water body for Skagway's discharge. Vertical profile data were available for five locations that were sampled in October

⁹ Mean lower low water.

2002, July and August 2004, and June 2005. Preliminary initial dilution simulations made with UM3 for profiles measured at four of the locations (the fifth was excluded because it was influenced by freshwater input from a tributary near Skagway), determined that the June 2005 vertical profile from site 1 (shown in Figure 2) was limiting in terms of minimizing effluent dilution. That profile was used for all subsequent dilution modeling at Haines.

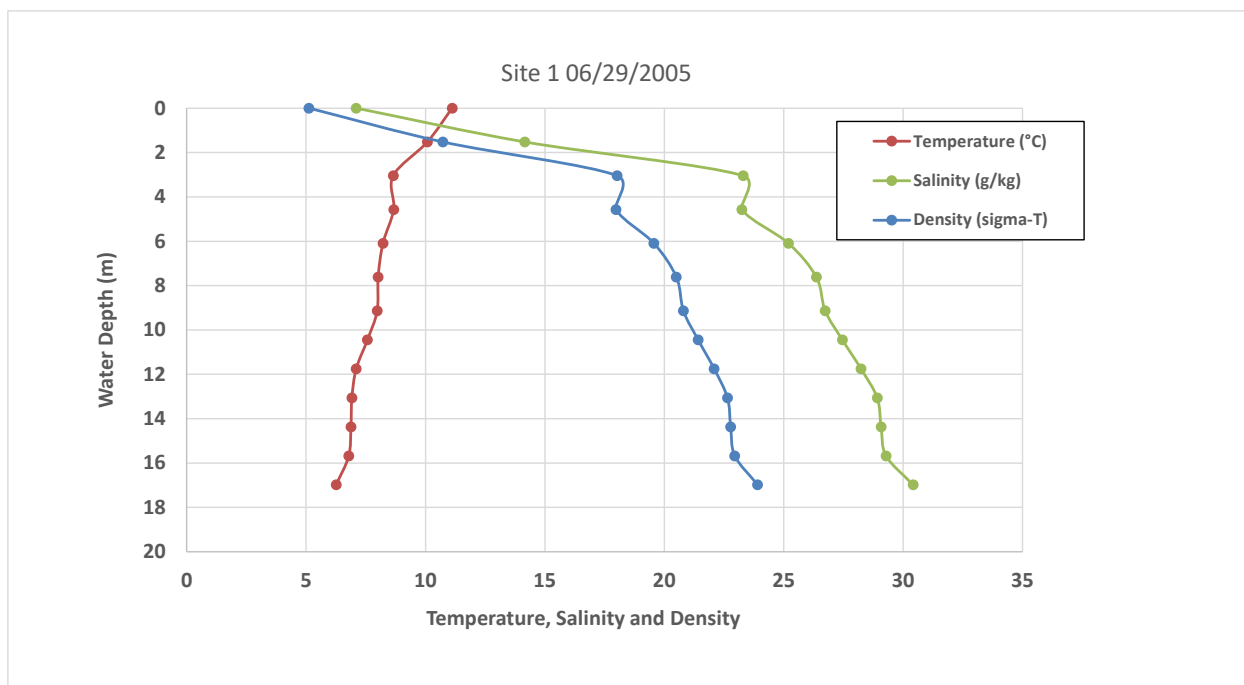


Figure 2. Vertical Ambient Profile of Temperature, Salinity and Density in Haines Mixing Zones Resulting in Least Mixing

Mixing zone dilution modeling results for Haines are summarized in Table 3. The two applicable initial mixing models, UM3 and DKHW, gave nearly identical results for dilution at a distance of 1*depth (Table 3, simulations 10 vs. 11). UM3 was selected for further analysis at Haines. The initial mixing model was combined with the Brooks far-field model to extend dilution predictions beyond the initial mixing region. Dilution factors at distances of 1*depth to 10*depth range from 100 to 766 (Table 3, simulations 15-18); accounting for bacterial decay had a negligible effect on dilution factors. Graphical examples of the dilution model predictions are presented in Figures 3 (plan view from above of the discharge plume boundary), 4 (profile view from the side of the discharge plume centerline and boundary) and 5 (discharge plume average and centerline dilution vs. distance from the outfall). As shown in Table 3, the plume was trapped at a depth of 20 m by the ambient density stratification, the initial mixing region extended 16 m from the outfall, and the travel time to the mixing zone boundaries ranged from 4 minutes (MZ=1*depth) to 143 minutes (MZ=10*depth). A dilution factor of 99 was predicted for the boundary of the initial mixing region and at the distance to the shore (549 m) the DF was 2770.

The sensitivity of the initial mixing model to a number of inputs (effluent temperature¹⁰, current velocity and direction, and discharge flow rate) is demonstrated in simulations 20-28 (Table 3). Of these

¹⁰ The alternative effluent temperature used for sensitivity analysis was the monthly average effluent temperature for the month found to have the most limited dilution.

parameters, DFs were most sensitive to variation in effluent flow rate (Q), with dilution increasing with greater flow. DFs were relatively insensitive to variation in ambient velocity. Sensitivity of the far-field model to bounding values of the diffusion parameter α (alpha) was also found to have a significant effect on dilution factors, as was substituting the 4/3-power law with linear eddy diffusivity (see Washington DoE, 2018 for explanation).

Table 3. Haines mixing zone dilution modeling results

Model simulation	Ambient Input	Model(s)	MZ Distance (m)	Froude Number	Dilution Factor	Dilution Factor w/Bacteria Decay	Trapping depth (m)	Length of Initial Mixing Region (m)	Travel Time to MZ Boundary (min) ¹¹
1. MZ=1*depth	Skagway site 1 Oct. 2002	UM3	21.3	190	117	118	17	>21.3	
2. “ “	Skagway site 2 Oct. 2002	UM3	“ “	191	118	118	17	>21.3	
3. “ “	Skagway site 4 Oct. 2002	UM3	“ “	190	117	118	17	>21.3	
4. “ “	Skagway site 1 Jul. 2004	UM3	“ “	189	117	118	17	>21.3	
5. “ “	Skagway site 2 Jul. 2004	UM3/FF	“ “	185	110	113	19	20	2
6. “ “	Skagway site 4 Jul. 2004	UM3/FF	“ “	181	113	116	19	21	0.5
7. “ “	Skagway site 1 Aug. 2004	UM3	“ “	188	118	118	17	>21.3	
8. “ “	Skagway site 2 Aug. 2004	UM3	“ “	186	117	117	17	>21.3	
9. “ “	Skagway site 4 Aug. 2004	UM3/FF	“ “	181	114	117	19	21	0.2
10. “ “	Skagway site 1 June 2005	UM3/FF	“ “	179	99	104	20	16	5
11. “ “	Skagway site 1 June 2005	DKHW/FF	“ “	179	99	99	20	16	4
12. “ “	Skagway site 2 June 2005	UM3/FF	“ “	183	105	109	20	18	2
13. “ “	Skagway site 4 June 2005	UM3	“ “	185	117	117	17	>21.3	

¹¹ Travel time to MZ boundary was calculated only for distances exceeding length of initial mixing region.

Model simulation	Ambient Input	Model(s)	MZ Distance (m)	Froude Number	Dilution Factor	Dilution Factor w/Bacteria Decay	Trapping depth (m)	Length of Initial Mixing Region (m)	Travel Time to MZ Boundary (min) ¹¹
Different mixing zone distances:									
14. MZ= initial mixing region	Skagway site 1 June 2005	UM3	16	179	99	100	20		1
15. MZ=1*depth	“ “	UM3/FF	21.3	179	100	100	20	16	4
16. MZ=2*depth	“ “	UM3/FF	42.6	179	136	137	20	16	19
17. MZ=5*depth	“ “	UM3/FF	106.5	179	330	331	20	16	65
18. MZ=10*depth	“ “	UM3/FF	213	179	766	768	20	16	143
19. MZ=distance to nearest shore	“ “	UM3/FF	549	179	2770	2780	20	16	386
Model sensitivity:									
20. avg. effluent T=11.975° C	Skagway site 1 June 2005	UM3/FF	21.3	181	100	100	20	16	4
21. ½*current v=1.15 cm/s	“ “	UM3/FF	“ “	178	101	101	20	16	8
22. ¼ *current v=0.575 cm/s		UM3/FF	“ “	179	120	120	20	16	16
23. 2*current v=4.6 cm/s	“ “	UM3/FF	“ “	179	105	105	20	17	2
24. average current v=12.6 cm/s	“ “	UM3/FF	“ “	179	126	126	20	19	4
25. reverse current direction=270°	“ “	UM3/FF	“ “	179	92	92	20	15	4
26. average Q=0.27 MGD	“ “	UM3/FF	“ “	17	63	63	18	5	12
27. Q/2=1.45 MGD	“ “	UM3/FF	“ “	89	87	87	20	11	7
28. 2*Q=5.8 MGD	“ “	UM3	“ “	358	111	111	20	21	0.5

Model simulation	Ambient Input	Model(s)	MZ Distance (m)	Froude Number	Dilution Factor	Dilution Factor w/Bacteria Decay	Trapping depth (m)	Length of Initial Mixing Region (m)	Travel Time to MZ Boundary (min) ¹¹
Far-field model sensitivity to diffusion parameter:									
29. alpha=0.0001	Skagway site 1 June 2005	UM3/FF	213	178	248	249	20	16	143
30. alpha=0.000453	“ “	UM3/FF	“ “	178	1280	1280	20	16	143
31. Linear eddy diffusivity	“ “	UM3/FF	“ “	178	486	488	20	16	143

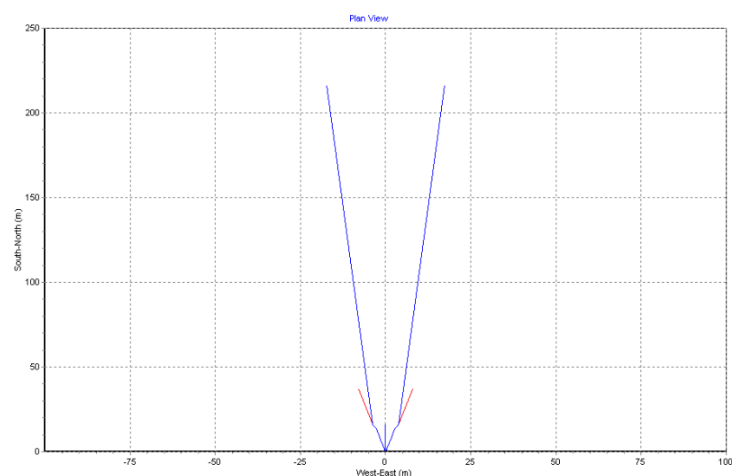


Figure 3. Haines Discharge Plume Boundary Plan View from Above

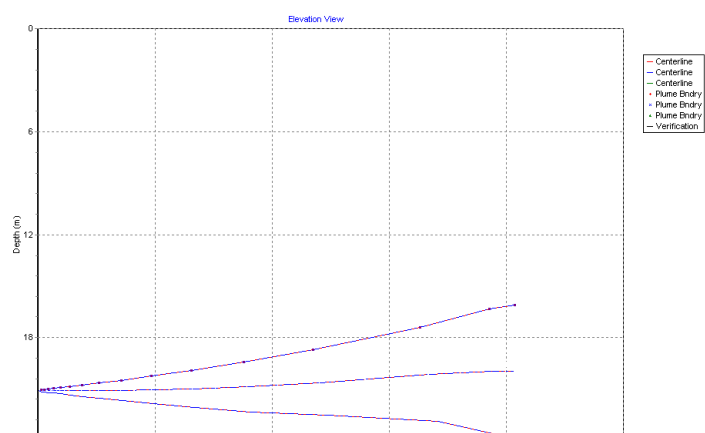


Figure 4. Haines Discharge Plume Centerline and Boundary Profile View from Side

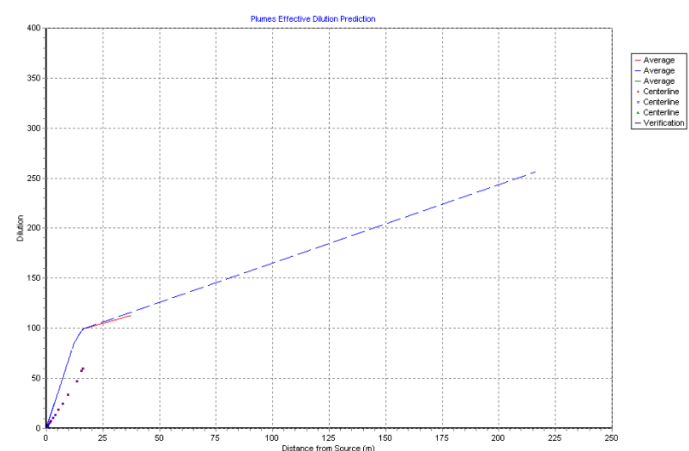


Figure 5. Haines Discharge Plume Average and Centerline Dilution vs. Distance from Outfall

KETCHIKAN

The wastewater treated at Ketchikan is discharged 221 m offshore of Charcoal Point in the Tongass Narrows (Figure 6), at a depth of 29.9 m (MLLW). Other site-specific data for the wastewater discharge, outfall, and ambient receiving water is summarized in Table 2.



Figure 6. Aerial View of the POTW Outfall Location at Ketchikan

Charcoal Point is at the narrowest width of the Narrows and is approximately 400 m wide and 34 m deep. According to the 2000 Permit application, the Tongass Narrows has a net northwest seaward exchange (away from the City and Pennock Island) with the Gulf of Alaska. Strong currents (that do not vary seasonally) provide vertical mixing in Tongass Narrows, minimizing the vertical density gradient and preventing stratification. Ambient tidal current data were collected with a current meter deployed near shore in December 1988 to verify published Tidal Current Table predictions. The data collected indicate that the flood tide current velocity was 34 cm/s, while the ebb tide currents was 1 cm/s in both directions. NOAA 6-minute tidal current predictions from East of Airport (SEA0711) were used to calculate the 10th percentile and average tidal current velocities at a depth of 87 ft. (26.5 m; Table 2). The 10th percentile current velocity used for modeling was 5.9 cm/s, while the average ebb and flood tidal velocities were 49.2 and 20.1 cm/s.

Preliminary initial dilution simulations made with UM3 for five available ambient profiles, determined that the July 1997 vertical profile from Site 3 (Figure 7) was limiting in terms of minimizing effluent dilution. As noted previously, the diffuser at Ketchikan was a hybrid, consisting of five 6-inch ports on a manifold and a single 12-inch port. These were modeled separately, and initial simulations with both UM3 and DKHW demonstrated that effluent dilution from the single 12-inch port was lower than from the five, 6-inch ports. UM3 gave more conservative dilution predictions (see Table 4, simulations 5 vs. 6), so that initial mixing model was selected for further analysis at Ketchikan.

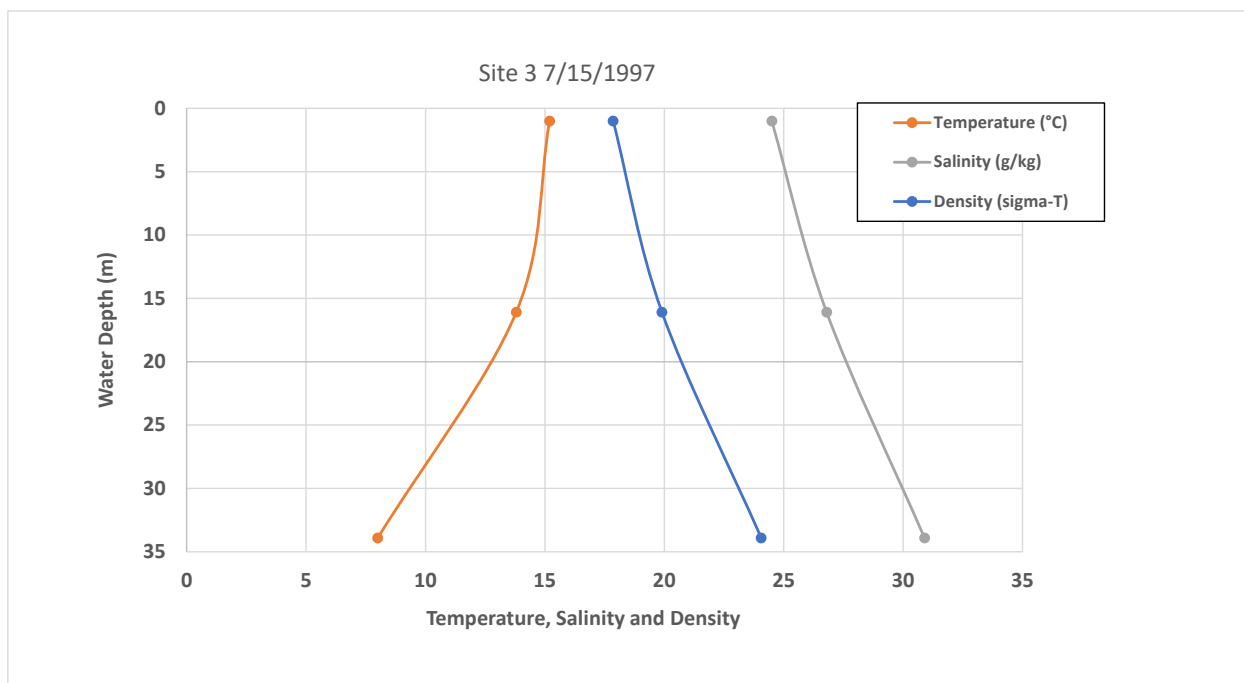


Figure 7. Vertical Ambient Profile of Temperature, Salinity and Density in Ketchikan Mixing Zone Resulting in Least Mixing.

The initial mixing model was combined with the Brooks far-field model to extend dilution predictions beyond the initial mixing region. Because the nearest shoreline was within ten times the plume diameter (calculated as the 10*depth mixing zone distance), it was assumed to impose a boundary constraint on far-field mixing. Following the guidance of Frick et al. (2010), we based far-field predictions at Ketchikan on the linear eddy diffusivity (LED) parameterization in FARFIELD. Sensitivity of DF predictions to this assumption is shown in Table 4 (simulations 20 vs. 31 and 32).

Dilution factors at distances of 1*depth to 10*depth range from 52 to 179 (Table 4, simulations 17-20). It should be noted that the 10*depth distance (299 m) is greater than the distance from the diffuser to shore (221 m), so it may be appropriate to truncate DF predictions at the distance to shore. Graphical examples of the dilution model predictions are presented in Figures 8 (plan view from above of the discharge plume boundary), 9 (profile view from the side of the discharge plume centerline and boundary) and 10 (discharge plume average and centerline dilution vs. distance from the outfall). Note that these figures include dilution model predictions for both the single 12-inch port and the five 6-inch ports. As shown in Table 4, the plume was trapped at a depth of 22 m by the ambient density stratification, the initial mixing region extended 13 m from the outfall. The travel time to the mixing zone boundaries ranged from 5 minutes (MZ=1*depth) to 81 minutes (MZ=10*depth). A dilution factor of 51 was predicted for the boundary of the initial mixing region and at the distance to the shore (221 m) the DF was 141.

The sensitivity of the initial mixing model to a number of inputs (effluent temperature¹², current velocity and direction, and discharge flow rate) is demonstrated in simulations 22-30 (Table 4). Of these parameters, DFs were most sensitive to variation in ambient velocity (simulations 23-26).

¹² The alternative effluent temperature used for sensitivity analysis was the average of maximum monthly effluent temperatures (no monthly averages in DMR).

Table 4. Ketchikan Mixing Zone Dilution Modeling Results

Model simulation	Ambient input	Model(s)	MZ distance (m)	Diffuser port(s)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min)
1. MZ=1*depth	Ketchikan 2000	UM3/FF	29.9	12" port	14	73	75	19	15	4
2. " "	" "	UM3(half spacing)/FF	" "	5x6" ports	18	117	123	22	12	5
3. " "	Ketchikan Pier 12/1988	UM3/FF	" "	12" port	14	158	168	7	17	4
4. " "	" "	UM3(half spacing)/FF	" "	5x6" ports	18	305	324	8	18	3
5. " "	Ketchikan site 3 7/1997	UM3/FF	" "	12" port; limiting	14	52	54	22	13	5
6. " "	" "	DKHW/FF	" "	12" port	14	79	79	24	12	5
7. " "	" "	UM3(DS only, 3 ports x7.35")/FF	" "	5x6" ports	17	60	62	23	12	5
8. " "	Ketchikan site 3 9/1997	UM3/FF	" "	12" port	14	99	104	14	15	4
9. " "	Ketchikan site 3 8/1997	UM3/FF	" "	12" port	13	106	112	12	14	4
10. " "	Ketchikan site 3 7/1996	UM3/FF	" "	12" port	13	99	104	14	15	4
11. " "	Ketchikan site 3 8/1996	UM3/FF	" "	12" port	14	79	83	18	15	4

Model simulation	Ambient input	Model(s)	MZ distance (m)	Diffuser port(s)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min)
12. “ “	Ketchikan site 3 9/1996	UM3/FF	“ “	12" port	14	101	106	15	16	4
13. “ “	Ketchikan site 3 7/1998	UM3/FF	“ “	12" port	14	89	93	16	6	4
14. “ “	Ketchikan site 3 8/1998	UM3/FF	“ “	12" port	13	112	118	13	17	4
15. “ “	Ketchikan site 3 9/1998	UM3/FF	“ “	12" port	14	92	97	16	16	4
Linear eddy diffusivity (LED) far-field model and different mixing zone distances:										
16. MZ= initial mixing region	Ketchikan 3 7/1997	UM3	13	12" port	14	51	52	22		1
17. MZ=1*depth	Ketchikan 3 7/1997	UM3/FF-LED	29.9	“ “	14	52	52	22	13	5
18. MZ=2*depth	“ “	“ “	59.8	“ “	14	62	63	22	13	13
19. MZ=5*depth	“ “	“ “	149.5	“ “	14	105	106	22	13	39
20. MZ=10*depth	“ “	“ “	299 ¹³	“ “	14	179	180	22	13	81
21. MZ=distance to nearest shore	“ “	“ “	221	“ “	14	141	141	22	13	59
Model sensitivity:										
22. avg. effluent T=14.6° C	Ketchikan 3 7/1997	UM3/FF-LED	29.9	12" port	14	52	52	22	13	5

¹³ Distance is greater than the distance from the diffuser to shore.

Model simulation	Ambient input	Model(s)	MZ distance (m)	Diffuser port(s)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min)
23. $\frac{1}{2}$ *current v=2.95 cm/s	“ “	“ “	“ “	“ “	14	54	54	20	13	10
24. $\frac{1}{4}$ *current v=1.475 cm/s	“ “	“ “	“ “	“ “	14	67	67	20	13	19
25. 2*current v=11.8 cm/s	“ “	“ “	“ “	“ “	14	88	88	24	14	2
26. average current v=49.2 cm/s	“ “	UM3	“ “	“ “	14	179	180	27	30	1
27. reverse current direction=320°	“ “	UM3/FF-LED	“ “	“ “	14	47	47	22	10	6
28. Q/4=0.864 MGD	“ “	“ “	“ “	“ “	4	72	72	22	6	7
29. Q/2=1.728 MGD	“ “	“ “	“ “	“ “	7	58	59	22	8	6
30. 2*Q=6.912 MGD	“ “	“ “	“ “	“ “	28	56	57	23	20	3
Far-field model sensitivity to diffusion parameter:										
31. alpha=0.0001	Ketchikan 3 7/1997	UM3/FF	299	12" port	14	94	94	22	13	81
32. alpha=0.000453	“ “	“ “	“ “	“ “	14	396	398	22	13	81

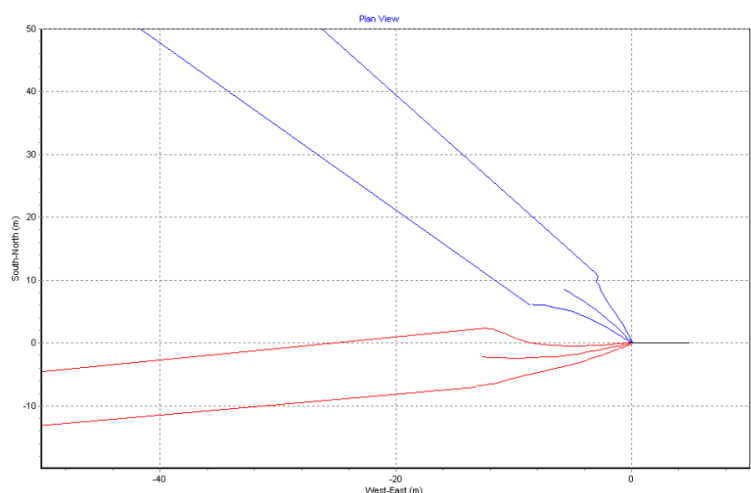


Figure 8. Ketchikan Discharge Plume Boundary Plan View from Above
(plume from 12-inch port is red; plume from five 6-inch ports is blue)

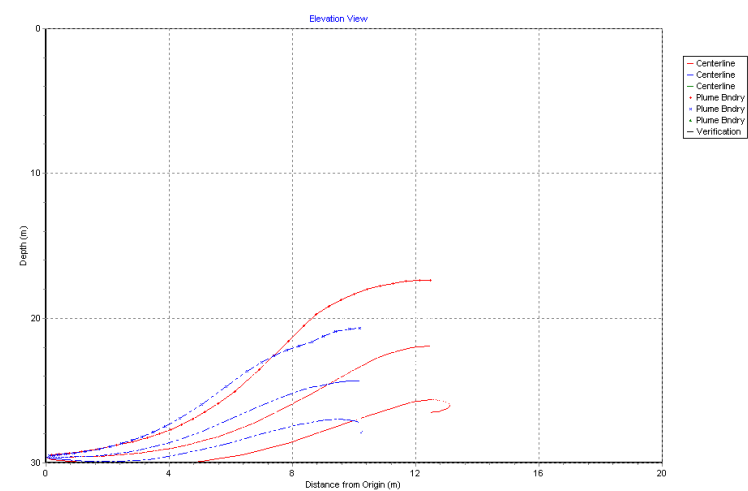


Figure 9. Ketchikan Discharge Plume Centerline and Boundary Profile View from Side

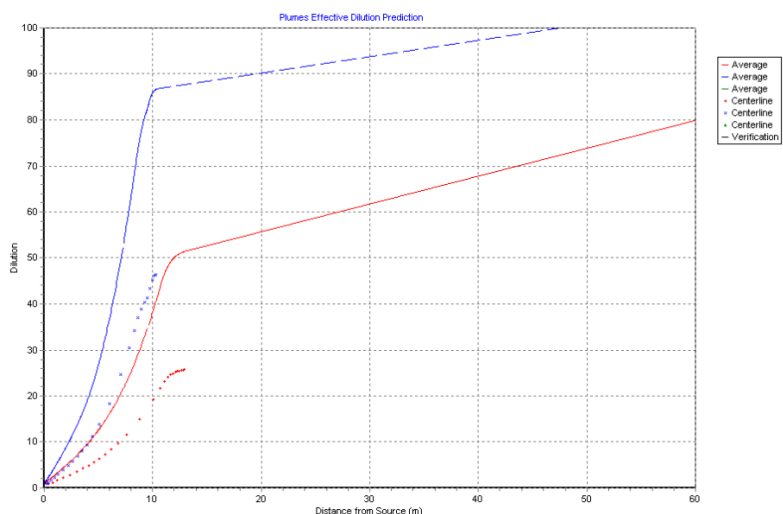


Figure 10. Ketchikan discharge plume average and centerline dilution vs. distance from outfall
Figure is based on graphic output by VP; DFs in far field (beyond 13 m for the 12-inch port) are overestimated because VP assumes 4/3-power law instead of linear eddy diffusivity.

PETERSBURG

Wastewater treated at Petersburg is discharged 366 m offshore in Frederick Sound (Figure 11), from a two-port diffuser at a depth of 18.3 m (MLLW). The permitted maximum flow is 3.6 MGD. Other site-specific data for the wastewater discharge, outfall, and ambient receiving water is summarized in Table 2. The port spacing at Petersburg is uncertain (somewhere in the range of 10 to 34 ft.) due to only two of five diffuser ports being open. The models predicted lower DFs for the narrowest port spacing (10 ft.), so that spacing was used for all model simulations.

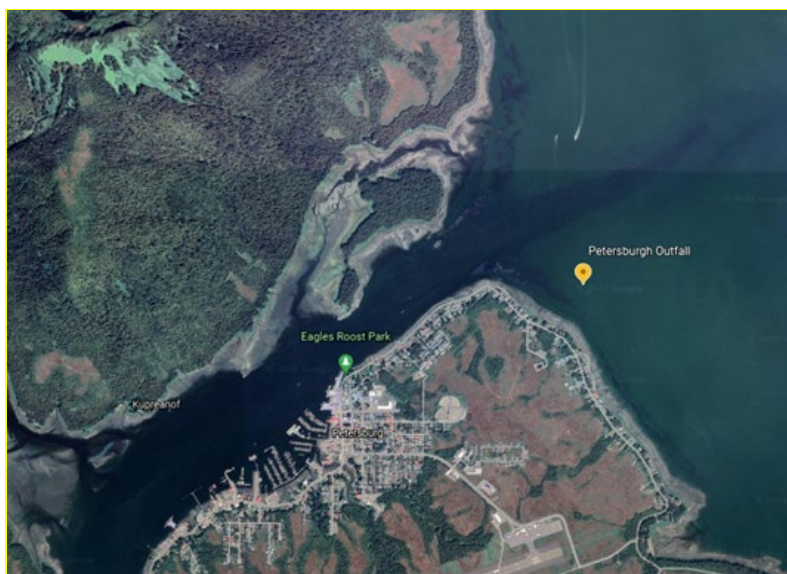


Figure 11. Aerial View of the POTW Outfall Location at Petersburg

Frederick Sound is connected to the Pacific Ocean via Chatham Strait to the northwest and Dry Strait/Sumner Strait to the southeast. According to the 1990 permit questionnaire, surface water densities near the outfall vary due to freshwater inputs from nearby streams. Maximum freshwater input to Frederick Sound occurs in summer (June or July) and minimum freshwater input occurs in March. The freshwater input is due primarily to the combined flows of the Stikine and Iskut Rivers. Currents generally flow northwestward in Frederick Sound with southwestward flows during large tides. NOAA tidal current predictions for nearby Cosmos Point (PCT3811) were used to calculate the 10th percentile current velocity used for modeling, 1.6 cm/s, and the average ebb and flood tidal velocities, 10.4 and 7.8 cm/s. According to the questionnaire, current velocities in the area are reportedly in the range of two to five knots (100 to 260 cm/s), 10 to 100 times larger than the velocities calculated from NOAA tidal current predictions and used for modeling. This discrepancy in the magnitude of ambient velocities could not be resolved given the information available, but may warrant further inquiry.

Preliminary initial dilution simulations made with UM3 for eight available ambient profiles sampled at two ZID boundary monitoring locations in January of 2002 and 2004, and August 2003 and 2005, determined that the August 2005 vertical profile from Site 1 (Figure 12) was limiting in terms of minimizing effluent dilution.

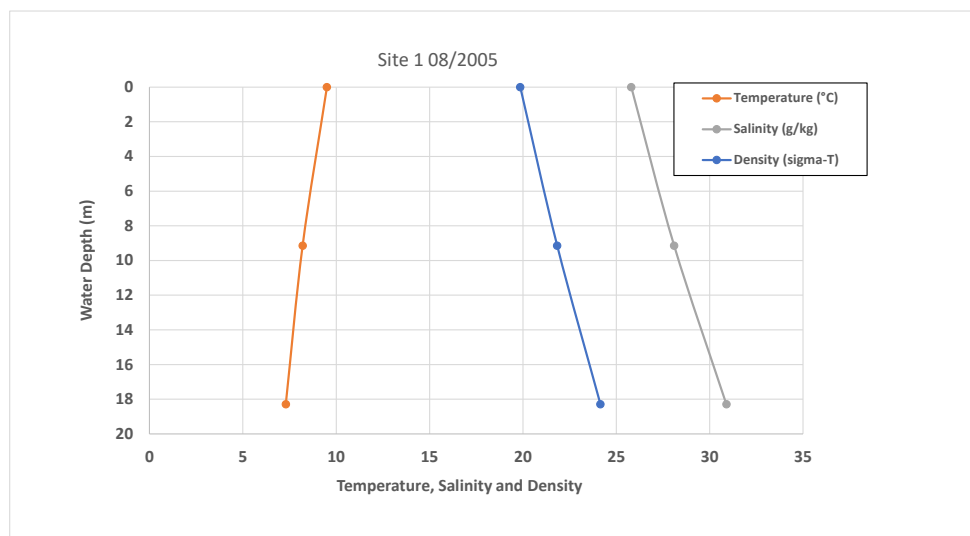


Figure 12. Vertical Ambient Profile of Temperature, Salinity and Density in Petersburg Mixing Zone Resulting in Least Mixing

Mixing zone dilution modeling results for Petersburg are summarized in Table 5. The two applicable initial mixing models, UM3 and DKHW, gave very similar results for dilution at a distance of 1*depth (67 vs. 70). UM3 gave slightly more conservative dilution predictions, so that initial mixing model was selected for further analysis at Petersburg. The initial mixing model was combined with the Brooks far-field model to extend dilution predictions beyond the initial mixing region. Dilution factors at distances of 1*depth to 10*depth range from 67 to 647 (Table 5, simulations 11-14); accounting for bacterial decay had a negligible effect on dilution factors. Graphical examples of the dilution model predictions are presented in Figures 13 (plan view from above of the discharge plume boundary), 14 (profile view from the side of the discharge plume centerline and boundary) and 15 (discharge plume average and centerline dilution vs. distance from the outfall). As shown in Table 5, the plume was trapped at a depth of 14 m by the ambient density stratification, the initial mixing region extended 23 m from the outfall, and the travel time to the mixing zone boundaries ranged from 1 minute (MZ=1*depth) to 167 minutes (MZ=10*depth). A dilution factor of 74 was predicted for the boundary of the initial mixing region and at the distance to the shore (366 m) the DF was 1720.

The sensitivity of the initial mixing model to a number of inputs (effluent temperature, current velocity and direction, and discharge flow rate) is demonstrated in simulations 16-24 (Table 5). DFs were moderately sensitive to variation in ambient velocity (DFs increase with velocity, simulations 17-19) and effluent flow rate (DFs decrease with Q, simulations 21-24). Sensitivity of the far-field model to bounding values of the diffusion parameter α (alpha) was also found to have a significant effect on dilution factors, as was substituting the 4/3-power law with linear eddy diffusivity.

Table 5. Petersburg Mixing Zone Dilution Modeling Results

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min) ¹⁴
1. MZ=1*depth	Petersburg 1 8/2005	UM3	18.3	114	67	67	15	>18.3	
2. “ “	“ “	DKHW	18.3	114	70	70	14	>18.3	
3. “ “	Petersburg 1 8/2003	UM3	18.3	95	72	73	12	>18.3	
4. “ “	Petersburg 1 1/2002	UM3	18.3	114	69	69	14	>18.3	
5. “ “	Petersburg 2 1/2002	UM3	18.3	113	69	69	14	>18.3	
6. “ “	Petersburg 1 1/2004	UM3	18.3	114	69	69	14	>18.3	
7. “ “	Petersburg 2 1/2004	UM3	18.3	114	69	69	14	>18.3	
8. “ “	Petersburg 2 8/2003	UM3	18.3	94	72	72	12	>18.3	
9. “ “	Petersburg 2 8/2005	UM3	18.3	116	68	68	15	>18.3	
Dilution at different distances:									
10. MZ= initial mixing region	Petersburg 1 8/2005	UM3	23	115	74	75	14		1
11. MZ=1*depth	“ “	UM3	18.3	115	67	67	15	>18.3	1
12. MZ=2*depth	“ “	UM3/FF	36.6	115	90	90	14	23	15
13. MZ=5*depth	“ “	UM3/FF	91.5	115	256	257	14	23	72
14. MZ=10*depth	“ “	UM3/FF	183	115	647	650	14	23	167
15. MZ=distance to nearest shore	“ “	UM3/FF	366	115	1720	1730	14	23	358

¹⁴ Travel time to MZ boundary was calculated only for distances exceeding length of initial mixing region.

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min) ¹⁴
Model sensitivity:									
16. avg. effluent T=13.2° C	Petersburg 1 8/2005	UM3	18.3	115	67	68	15	>18.3	
17. ½*current v=0.8 cm/s	“ “	UM3	18.3	115	66	66	15	>18.3	
18. 2*current v=3.2 cm/s	“ “	UM3	18.3	115	70	70	15	>18.3	
19. average current v=10.4 cm/s	“ “	UM3	18.3	115	80	81	16	>18.3	
20. reverse current direction=300°	“ “	UM3	18.3	115	66	66	15	>18.3	
21. average Q=0.43 MGD	“ “	UM3/FF	18.3	14	81	82	12	6	13
22. Q/4=0.9 MGD	“ “	UM3/FF	18.3	29	68	69	13	9	9
23. Q/2=1.8 MGD	“ “	UM3/FF	18.3	57	65	65	14	15	4
24. 2*Q=7.2 MGD	“ “	UM3	18.3	229	65	65	17	>18.3	
Far-field model sensitivity to diffusion parameter:									
25. alpha=0.0001	Petersburg 1 8/2005	UM3/FF	183	114	202	203	14	23	167
26. alpha=0.000453	“ “	UM3/FF	183	114	1090	1091	14	23	167
27. Linear eddy diffusivity	“ “	UM3/FF	183	114	397	399	14	23	167

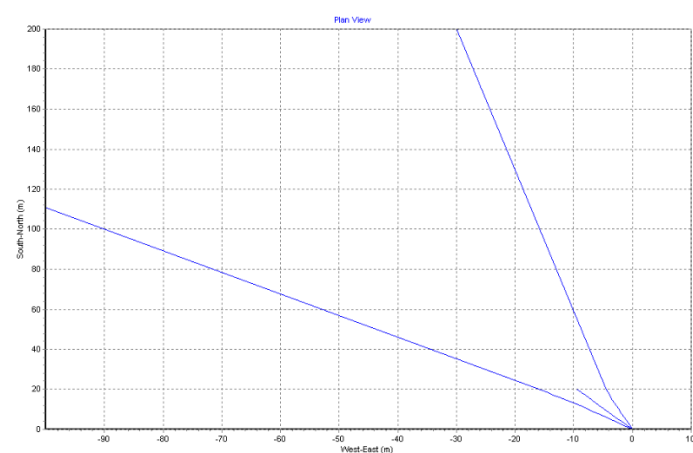


Figure 13. Petersburg Discharge Plume Boundary Plan View from Above

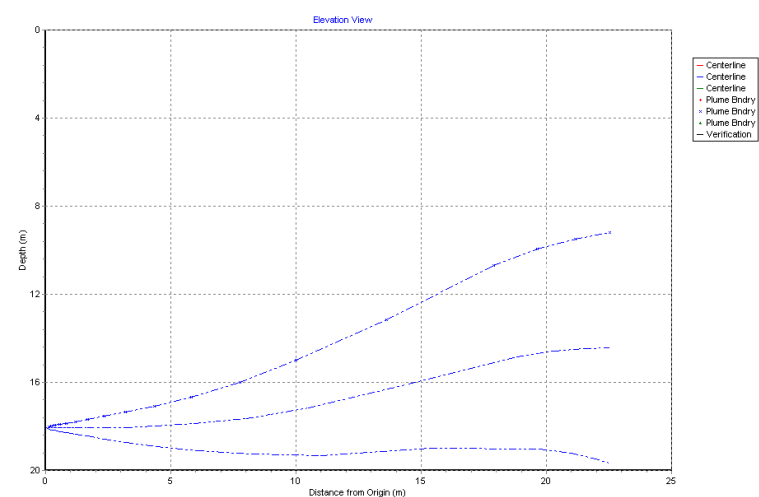


Figure 14. Petersburg Discharge Plume Centerline and Boundary Profile View from Side

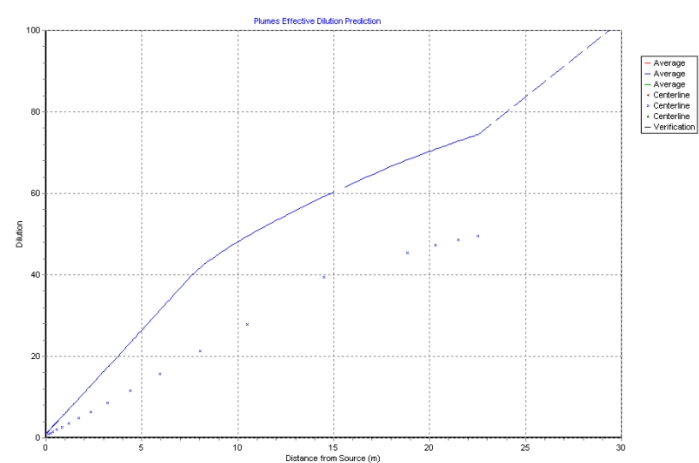


Figure 15. Petersburg Discharge Plume Average and Centerline Dilution vs. Distance from Outfall

SITKA

The wastewater treated at Sitka is discharged 114 m offshore in the Middle Channel of Sitka Sound (Figure 16), from a 16-port diffuser at a depth of 24.4 m (MLLW). The permitted maximum flow is 5.3 MGD.

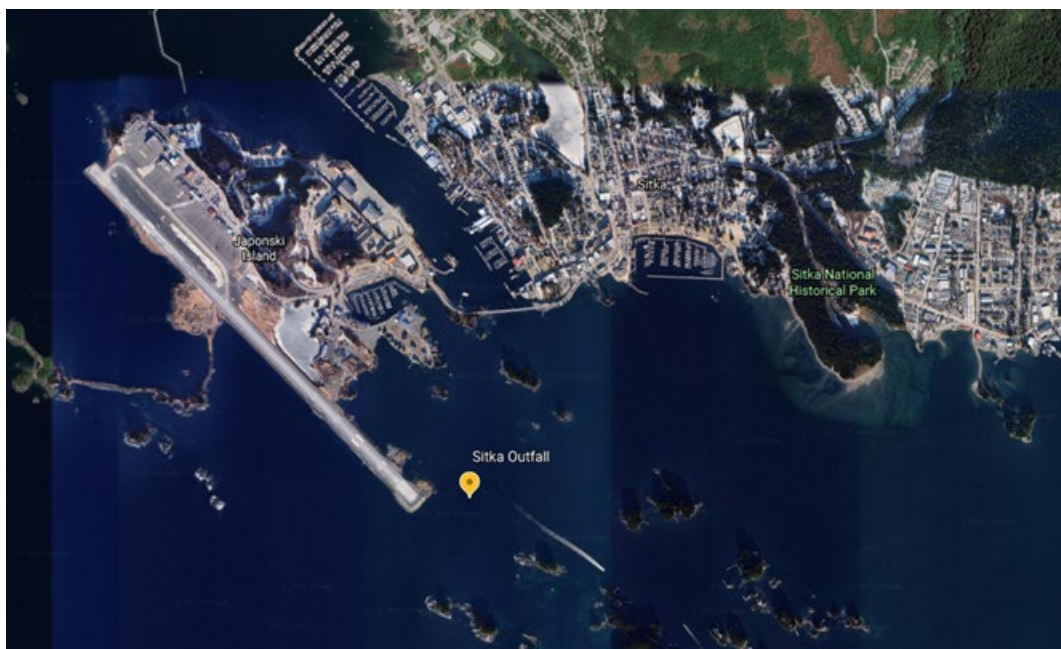


Figure 16. Aerial View of the POTW Outfall Location at Sitka

According to the permit fact sheet, the Middle Channel has relatively weak tidal currents, rotating in a clockwise pattern, which are superimposed on the seaward flow of fresh water in Sitka Sound. The net current is toward the southeast and included an easterly wind-driven component. The direction of transport of effluent from the outfall varies, depending upon the tidal stage and direction of prevailing winds. NOAA tidal current predictions for Sitka Harbor, Channel off Harbor Island (PCT4166) were used to calculate the 10th percentile current velocity used for modeling, 1.7 cm/s, and the average ebb and flood tidal velocities, 10.3 and 8.0 cm/s.

Other site-specific data for the wastewater discharge, outfall, and ambient receiving water is summarized in Table 2. Detailed vertical ambient profiles were only available for one location (Site C, a reference station west of the outfall) that was in sampled in the months of April and July in 2010 and 2015. Preliminary initial dilution simulations made with UM3 for these four available ambient profiles, determined that the July 2010 vertical profile from Site C (Figure 17) was limiting in terms of minimizing effluent dilution (Table 6, simulations 1, 2, 8 and 9).

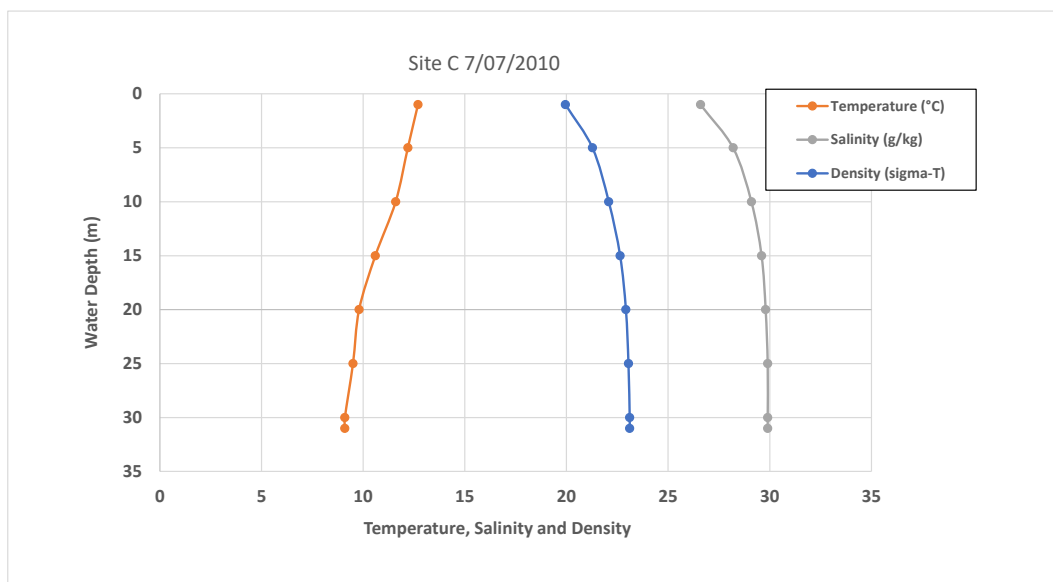


Figure 17. Vertical Ambient Profile of Temperature, Salinity and Density in Sitka Mixing Zone Resulting in Least Mixing

Mixing zone dilution modeling results for Sitka are summarized in Table 6. The two initial mixing models, DKHW and UM3, combined with the Brooks far-field model gave similar results for dilution at a distance of 1*depth (sims. 2 and 5); simulation results for the downstream-only cross-diffuser merging approach and the third initial mixing model, NRFIELD, also fell within this range of DFs. DKHW gave slightly more conservative dilution predictions, so that initial mixing model was selected for further analysis at Sitka.

The initial mixing model was combined with the Brooks far-field model to extend dilution predictions beyond the initial mixing region. Because the nearest shoreline was within ten times the plume diameter (calculated as the 10*depth mixing zone distance), it was assumed to impose a boundary constraint on far-field mixing. Following the guidance of Frick et al. (2010), we based far-field predictions at Sitka on the linear eddy diffusivity (LED) parameterization in FARFIELD. Sensitivity of DF predictions to this assumption is shown in Table 6 (simulations 14 vs. 25 and 26).

Dilution factors at distances of 1*depth to 10*depth range from 87 to 227 (Table 6, simulations 11-14); accounting for bacterial decay had a negligible effect on dilution factors. It should be noted that the 5*depth and 10*depth distances (122 and 244 m) are greater than the distance from the diffuser to shore (114 m), so it may be appropriate to truncate DF predictions at the distance to shore. Graphical examples of the dilution model predictions are presented in Figures 18 (plan view from above of the discharge plume boundary), 19 (profile view from the side of the discharge plume centerline and boundary) and 20 (discharge plume average and centerline dilution vs. distance from the outfall). As shown in Table 6, the plume was trapped at a depth of 10 m by the ambient density stratification, the initial mixing region extended 6.9 m from the outfall, and the travel time to the mixing zone boundaries ranged from 17 minutes (MZ=1*depth) to 232 minutes (MZ=10*depth). A dilution factor of 86 was predicted for the boundary of the initial mixing region and at the distance to the shore (114 m) the DF was 138.

The sensitivity of the initial mixing model to a number of inputs (effluent temperature, current velocity and direction, and discharge flow rate) is demonstrated in simulations 16-24 (Table 6). DFs were moderately sensitive to variation in ambient velocity (DFs increase with velocity, simulations 17-19) and effluent flow rate (DFs decrease with Q, simulations 22-24).

Table 6. Sitka Mixing Zone Dilution Modeling Results

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min) ¹⁵
1. MZ=1*depth	Sitka C 7/2015	UM3(half spacing)/FF	24.4	11	131	133	9	7	17
2. “ “	Sitka C 7/2010	” “	24.4	12	118	119	12	6	18
3. “ “	Sitka C 7/2010	” “	16.0	12	113	114	12	6	10
4. “ “	Sitka C 7/2010	NRFIELD	16.0	12	89		10		
5. “ “	Sitka C 7/2010	DKHW(half spacing)/FF	24.4	12	87	87	10	7	17
6. “ “	“ “;	UM3(DS-only, 8 portsx5.3")/FF	24.4	11	109	110	11	7	17
7. “ “	“ “	DKHW(DS-only, 8 portsx5.3")/FF	24.4	11	90	90	10	8	16
8. “ “	Sitka C 4/2010	UM3(half-spacing)/FF	24.4	12	179	181	4	7	17
9. “ “	Sitka C 4/2015	” “	24.4	11	172	174	5	7	17
Linear eddy diffusivity (LED) far-field model and different mixing zone distances:									
10. MZ= initial mixing region	Sitka C 7/2010	DKHW(half-spacing)	6.9	12	86	86			1
11. MZ=1*depth	“ “	DKHW(half-spacing)/FF-LED	24.4	12	87	87	10	7	17
12. MZ=2*depth	“ “	“ “	48.8	12	97	97	10	7	41
13. MZ=5*depth	“ “	“ “	122 ¹⁶	12	143	143	10	7	113
14. MZ=10*depth	“ “	“ “	244 ¹⁶	12	227	227	10	7	232

¹⁵ Travel time to MZ boundary was calculated only for distances exceeding length of initial mixing region.

¹⁶ Distance is greater than the distance from the diffuser to shore.

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min) ¹⁵
15. MZ=distance to nearest shore	“ “	“ “	114	12	138	138	10	7	105
Model sensitivity:									
16. avg. effluent T=14° C	Sitka C 7/2010	DKHW(half-spacing)/FF-LED	24.4	12	87	87	10	7	17
17. ½*current v=0.85 cm/s	“ “	“ “	“ “	12	79	79	9	7	35
18. 2*current v=3.4 cm/s	“ “	“ “	“ “	12	119	119	11	9	8
19. average current v=10.3cm/s	“ “	“ “	“ “	12	187	187	15	22	0.5
20. reverse current direction=45°	“ “	“ “	“ “	12	87	87	10	7	17
21. current dir +30°	“ “	“ “	“ “	12	131	131	12	7	17
22. average Q=0.98 MGD	“ “	“ “	“ “	2	208	208	15	4	20
23. Q/2=2.65 MGD	“ “	“ “	“ “	6	121	121	12	5	19
24. 2*Q=10.6 MGD	“ “	“ “	“ “	23	66	66	8	12	12
Far-field model sensitivity to diffusion parameter:									
25. alpha=0.0001	Sitka C 7/2010	DKHW(half-spacing)/FF	244	12	126	126	10	7	233
26. alpha=0.000453	“ “	“ “	“ “	12	426	426	10	7	233

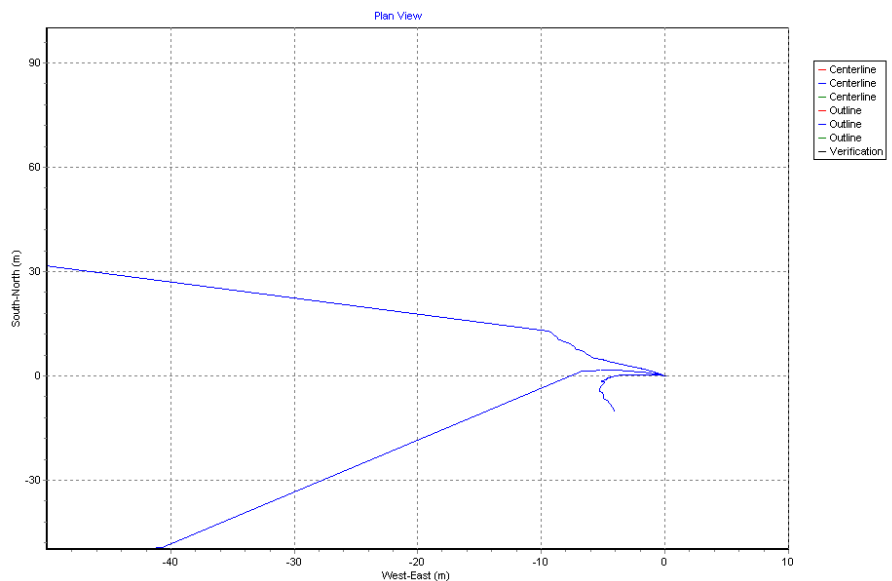


Figure 18. Sitka Discharge Plume Boundary Plan View from Above

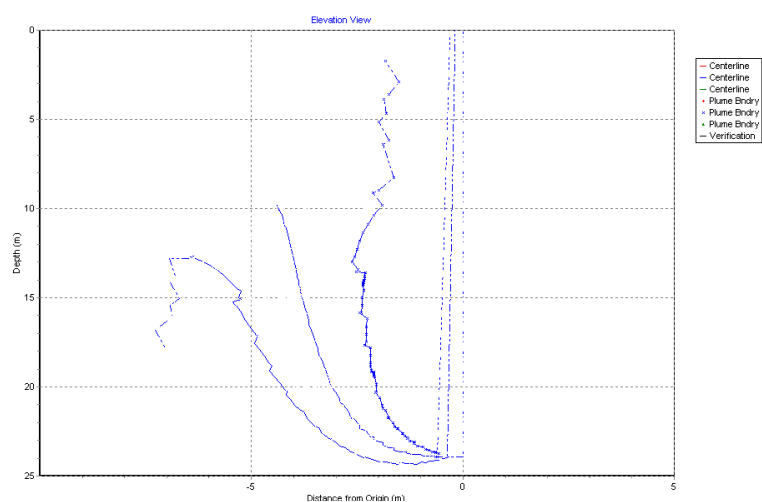


Figure 19. Sitka Discharge Plume Centerline and Boundary Profile View from Side

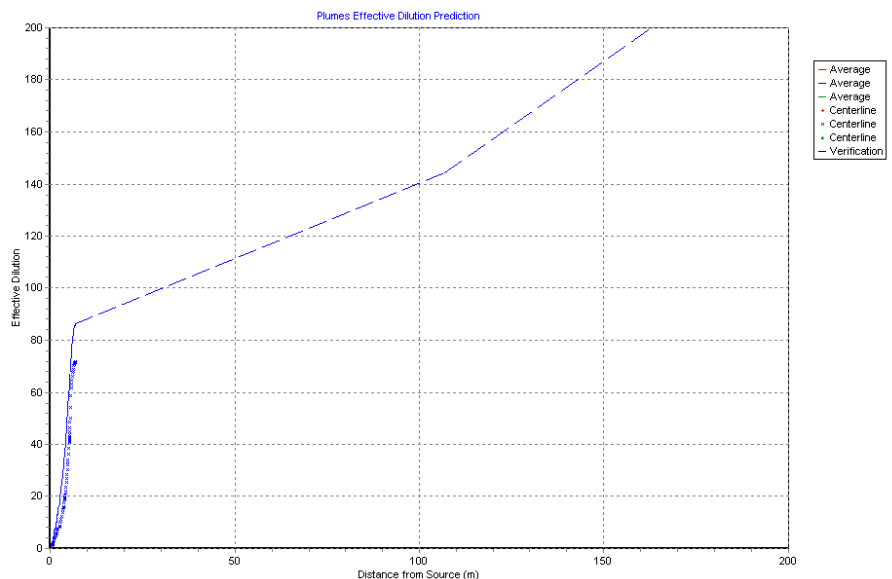


Figure 20. Sitka Discharge Plume Average and Centerline Dilution vs. Distance from Outfall
(Figure is based on graphic output by VP; DFs in far field (beyond 7 m) are overestimated because VP assumes 4/3-power law instead of linear eddy diffusivity).

SKAGWAY

Wastewater treated at Skagway is discharged 125 m offshore in Tiaya Inlet (Figure 21), at a depth of 18.3 m (MLLW), from an 8-port diffuser. The permitted maximum flow rate is 0.63 MGD.



Figure 21. Aerial View of the POTW Outfall Location at Skagway

According to the permit fact sheet, Taiya Inlet is a deep fjord with a 457 m average depth. Taiya Inlet supports a classic fjord-type, two-layer circulation, with a large saline lower layer and a very thin upper brackish layer. The circulation of the inlet is dependent on tides and freshwater flow into the inlet. There are no obstructions to impede circulation near the outfall. Stratification in Taiya Inlet is dependent on freshwater inflows from the Taiya and Skagway Rivers with the highest stratification typically occurs during the high runoff summer period from June through August. As noted in the 2007 permit reapplication, a small cross-current (2 cm/s) was present under stratified condition in a June 1999 temperature/salinity data set.

NOAA 6-minute tidal current predictions from Taiya Inlet (SEA0825) were used to calculate the 10th percentile and average tidal current velocities (Table 2). The 10th percentile current velocity used for modeling was 1.4 cm/s, while the average ebb and flood tidal velocities were 6.9 and 12.2 cm/s.

Other site-specific data for the wastewater discharge, outfall, and ambient receiving water is summarized in Table 2. Vertical profiles of temperature and salinity measured in Taiya Inlet were available for five locations that were sampled in October 2002, July and August 2004 and June 2005. Preliminary initial dilution simulations made with UM3 for all available profiles, determined that the June 2005 vertical profile measured at site 1 (shown in Figure 22) was limiting in terms of minimizing effluent dilution¹⁷. That profile was used for all subsequent dilution modeling at Skagway.

¹⁷ A different vertical profile measured in June 2005 at site 5 (a site in the cruise ship terminal harbor nearest to freshwater inflow from the Skagway River) actually produced smaller DF predictions. However, the unusually low

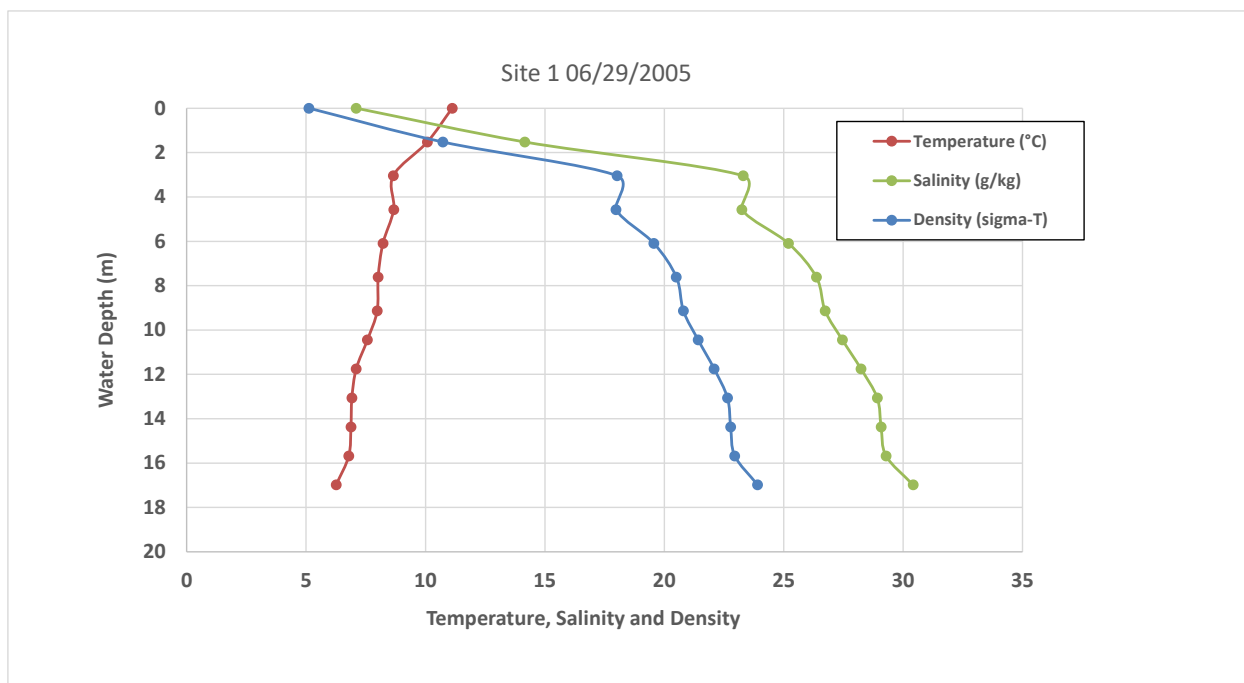


Figure 22. Vertical Ambient Profile of Temperature, Salinity and Density in Skagway Mixing Zone Resulting in Least Mixing

Mixing zone dilution modeling results for Skagway are summarized in Table 7. Two of the applicable initial mixing models, UM3 and DKHW, gave similar results for dilution at a distance of 1*depth, for both cross-diffuser merging approaches (simulations 11-13). UM3 gave slightly more conservative dilution predictions, so that initial mixing model was selected for further analysis at Skagway. We also applied the third initial mixing model, NRFIELD, that predicted DFs reasonably comparable to UM3 (simulations 14 vs. 15) at a distance shorter than 1*depth (5.9 m).

The initial mixing model was combined with the Brooks far-field model to extend dilution predictions beyond the initial mixing region. Because the nearest shoreline was within ten times the plume diameter (calculated as the 10*depth mixing zone distance), it was assumed to impose a boundary constraint on far-field mixing. Following the guidance of Frick et al. (2010), we based far-field predictions at Skagway on the linear eddy diffusivity (LED) parameterization in FARFIELD. Sensitivity of DF predictions to this assumption is shown in Table 7 (simulations 23 vs. 33 and 34).

Dilution factors at distances of 1*depth to 10*depth range from 56 to 330 (Table 7, simulations 20-23); accounting for bacterial decay had a negligible effect on dilution factors. It should be noted that the 10*depth distance (183 m) is greater than the distance from the diffuser to shore (125 m), so it may be appropriate to truncate DF predictions at the distance to shore. Graphical examples of the dilution model predictions are presented in Figures 23 (plan view from above of the discharge plume boundary), 24

salinity of the upper 3-4 m of that profile led to difficulties in modeling dilution over the range of parameters and conditions of interest, so the site 1 June 2005 profile (that was the next most conservative in terms of limiting DFs) was used instead.

(profile view from the side of the discharge plume centerline and boundary) and 25 (discharge plume average and centerline dilution vs. distance from the outfall). As shown in Table 7, the plume was trapped at a depth of 15 m by the ambient density stratification, the initial mixing region extended 3.5 m from the outfall, and the travel time to the mixing zone boundaries ranged from 18 minutes ($MZ=1*\text{depth}$) to 214 minutes ($MZ=10*\text{depth}$). A dilution factor of 42 was predicted for the boundary of the initial mixing region and at the distance to the shore (125 m) the DF was 233.

The sensitivity of the initial mixing model to a number of inputs (effluent temperature, current velocity and direction, and discharge flow rate) is demonstrated in simulations 25-32 (Table 7). DFs were moderately sensitive to variation in ambient velocity (minimum DFs at velocities near 2 cm/s, simulations 26-28) and effluent flow rate (DFs decrease with Q, simulations 30-32).

Table 7. Skagway Mixing Zone Dilution Modeling Results

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min)
1. MZ=1*depth	Skagway site 1 10/02	UM3 (half spacing) /FF	18.3	10	129	130	9	4	17
2. “ “	Skagway site 2 10/02	” “	18.3	10	145	147	7	5	16
3. “ “	Skagway site 4 10/02	” “	18.3	10	127	128	9	4	17
4. “ “	Skagway site 1 7/2004	” “	18.3	10	94	95	12	4	18
5. “ “	Skagway site 2 7/2004	” “	18.3	10	97	97	12	4	17
6. “ “	Skagway site 4 7/2004	” “	18.3	10	79	79	13	4	17
7. “ “	Skagway site 1 8/2004	” “	18.3	10	130	131	9	4	17
8. “ “	Skagway site 2 8/2004	” “	18.3	10	113	114	10	4	17
9. “ “	Skagway site 4 8/2004	” “	18.3	10	82	83	13	4	17
10. “ “	Skagway site 1 6/2005	” “	18.3	10	59	59	15	3	18
11. “ “	“ “	UM3(DS-only, 4x3.95")/FF	18.3	10	59	59	14	5	16
12. “ “	“ “	DKHW(half spacing)/FF	18.3	10	62	63	16	3	18
13. “ “	“ “	DKHW(DS-only, 4x3.95")/FF	18.3	10	66	66	15	4	17
14. “ “	“ “	NRFIELD	5.9	10	39		14		
15. “ “	“ “	UM3(half spacing) /FF	5.9	10	42	42	15	3	3
16. “ “	Skagway site 2 6/2005	” “	18.3	10	80	80	13	4	17
17. “ “	Skagway site 4 6/2005	” “	18.3	10	100	100	12	4	17
18. “ “	Skagway site 5 6/2005	” “	18.3	9	39	39	16	2	19
Linear eddy diffusivity (LED) far-field model and different mixing zone distances:									
19. MZ= initial mixing region	Skagway site 1 6/2005	UM3(half spacing)	3.5	10	42	42	15		0.7

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min)
20. MZ=1*depth	“ “	UM3(half spacing) /FF-LED	18.3	10	56	56	15	3	18
21. MZ=2*depth	“ “	“ “	36.6	10	86	86	15	3	39
22. MZ=5*depth	“ “	“ “	91.5	10	177	178	15	3	105
23. MZ=10*depth	“ “	“ “	183 ¹⁸	10	330	331	15	3	214
24. MZ=distance to nearest shore	“ “	“ “	125	10	233	234	15	3	145
Model sensitivity:									
25. avg. effluent T=14.7° C	Skagway site 1 6/2005	UM3(half spacing) /FF-LED	18.3	10	56	56	15	3	18
26. ½*current v=0.7 cm/s	“ “	“ “	“ “	10	76	76	15	3	36
27. 2*current v=2.8 cm/s	“ “	“ “	“ “	10	52	52	15	4	9
28. average current v=12.2 cm/s	“ “	“ “	“ “	10	101	101	17	6	2
29. reverse current direction=170°	“ “	“ “	“ “	10	56	56	14	5	19
30. average Q=0.27 MGD				4	73	73	15	2	19
31. Q=0.5 MGD	“ “	“ “	“ “	8	60	60	15	3	18

¹⁸ Distance is greater than the distance from the diffuser to shore.

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min)
32. 2*Q=1.26 MGD	“ “	“ “	“ “	20	49	49	15	5	16
Far-field model sensitivity to diffusion parameter:									
33. alpha=0.0001	Skagway site 1 6/2005	UM3(half spacing) /FF	183	10	173	174	15	3	214
34. alpha=0.000453	“ “	“ “	183	10	1100	1103	15	3	214

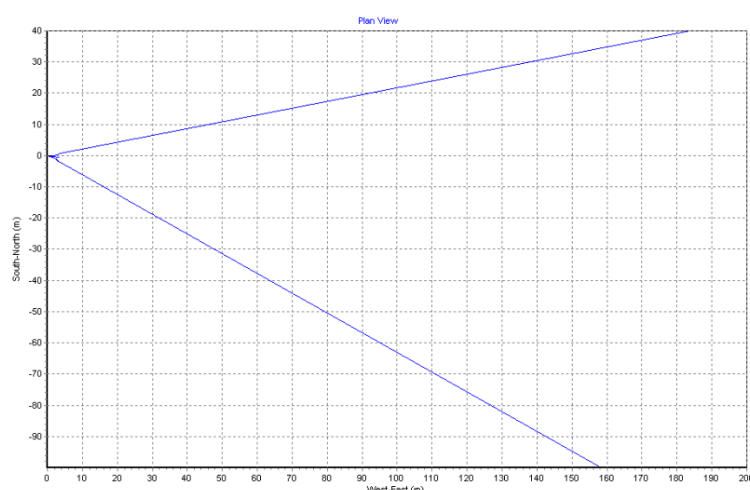


Figure 23. Skagway Discharge Plume Boundary Plan View from Above

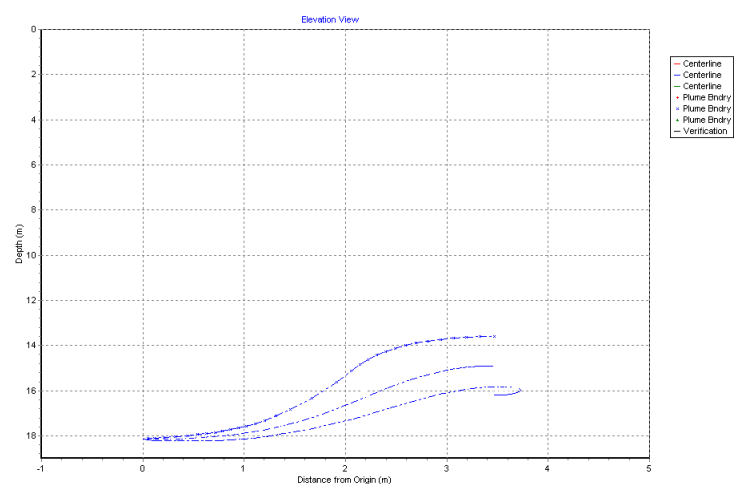


Figure 24. Skagway Discharge Plume Centerline and Boundary Profile View from Side

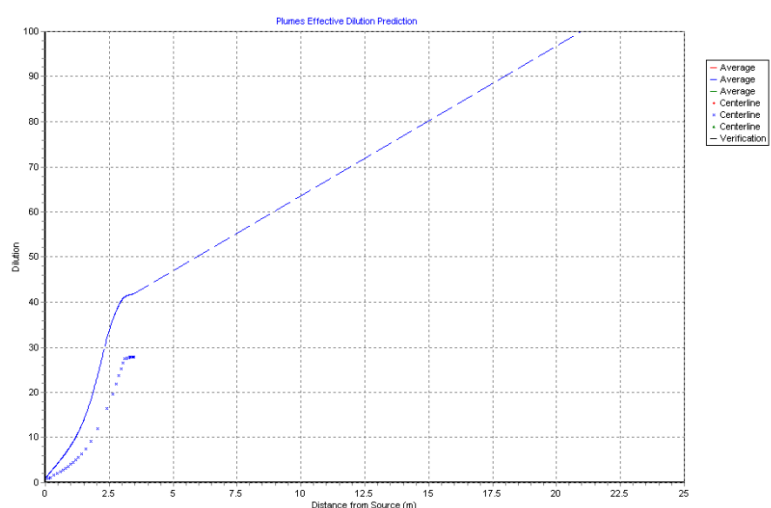


Figure 25. Skagway Discharge Plume Average and Centerline Dilution vs. Distance from Outfall
(Figure is based on graphic output by VP; DFs in far field (beyond 3 m) are overestimated because VP assumes 4/3-power law instead of linear eddy diffusivity)

WRANGELL

The wastewater treated at Wrangell is discharged 457 m offshore in the Zimovia Strait (Figure 26), at a depth of 30.5 m (MLLW), from a 16-port diffuser. The permitted maximum flow rate is 3.0 MGD.

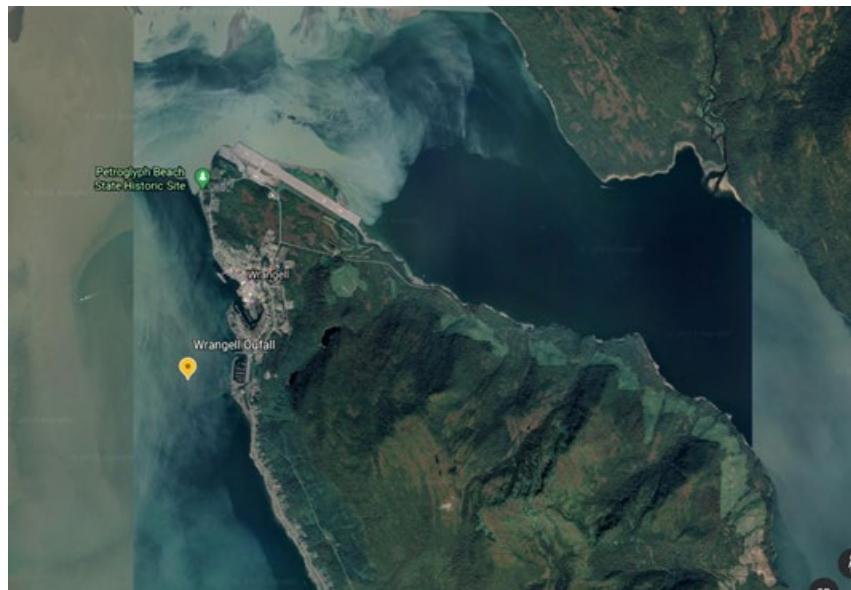


Figure 26. Aerial View of the POTW Outfall Location at Wrangell

According to the permit fact sheet, Zimovia Strait has a net northwest seaward exchange with the Gulf of Alaska. The maximum current velocity is around 51.4 cm/sec (1.0 knot) and the water circulation patterns do not vary seasonally. Strong currents provide vertical mixing, minimize the vertical density gradient, and prevent stratification. Also, according to the permit fact sheet, prior dilution modeling in Zimovia Strait used a conservative current speed of 2.35 cm/sec and no stratification. NOAA tidal current predictions for Wrangell Harbor (PCT3131) were used to calculate the 10th percentile current velocity used for modeling, 4.0 cm/s, and the average ebb and flood tidal velocities, 20.8 and 23.5 cm/s.

Other site-specific data for the wastewater discharge, outfall, and ambient receiving water is summarized in Table 2. Vertical profiles of temperature and salinity measured in Zimovia strait at the ZID boundaries were available for two mixing zone locations that were sampled in August of 2015, 2016 and 2017. Preliminary initial dilution simulations made with UM3 for all profiles, determined that the vertical profile measured at station 4 in August of 2016 (shown in Figure 27) was limiting in terms of minimizing effluent dilution. That profile was used for all subsequent dilution modeling at Wrangell.

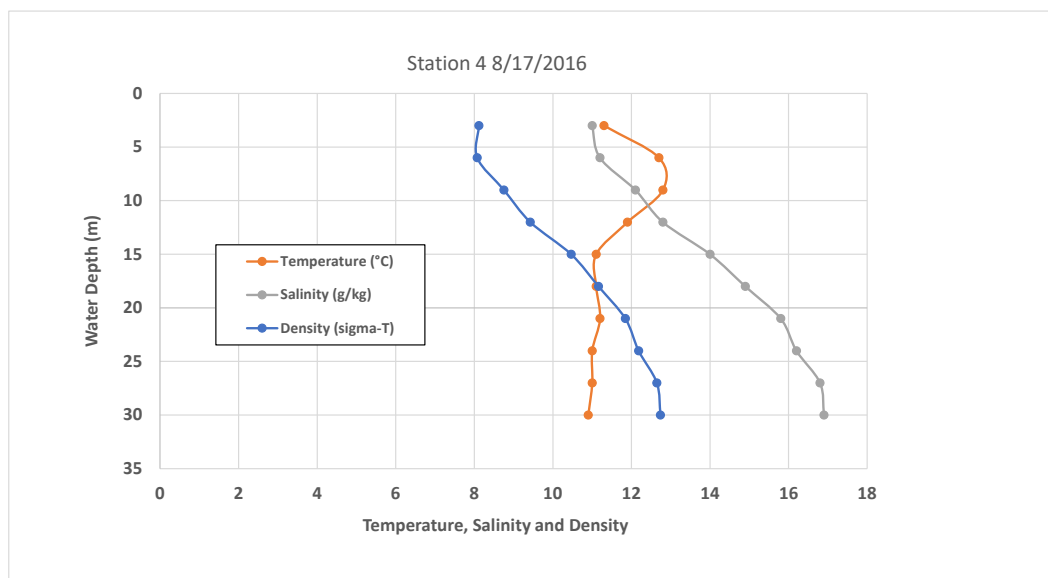


Figure 27. Vertical Ambient Profile of Temperature, Salinity and Density in Wrangell Mixing Zone Resulting in Least Mixing

Mixing zone dilution modeling results for Wrangell are summarized in Table 8. Two of the applicable initial mixing models, UM and DKHW, gave different results for dilution at a distance of 1*depth (30.5 m; simulations 3 vs. 4). The third initial mixing model, NRFIELD, predicted a lower DF at a distance shorter than 1*depth (16.8 m; simulations 5 vs. 6). UM3 gave more conservative DF results (simulation 7) when run using the downstream-only cross-diffuser merging, so we selected this approach for further analysis at Wrangell. The initial mixing model was combined with the Brooks far-field model to extend dilution predictions beyond the initial mixing region. Sensitivity of the far-field model to bounding values of the diffusion parameter α was found to have a significant effect on dilution factors, as was substituting the 4/3-power law with linear eddy diffusivity.

Dilution factors at distances of 1*depth to 10*depth range from 112 to 229 (Table 8, simulations 10-13); accounting for bacterial decay had a negligible effect on dilution factors. Graphical examples of the dilution model predictions are presented in Figures 28 (plan view from above of the discharge plume boundary), 29 (profile view from the side of the discharge plume centerline and boundary) and 30 (discharge plume average and centerline dilution vs. distance from the outfall). As shown in Table 8, the plume was trapped at a depth of 24 m by the ambient density stratification, the initial mixing region extended 12 m from the outfall, and the travel time to the mixing zone boundaries ranged from 8 minutes (MZ=1*depth) to 122 minutes (MZ=10*depth). A dilution factor of 112 was predicted for the boundary of the initial mixing region and at the distance to the shore (457 m) the DF was 323.

The initial mixing model was moderately sensitive to a number of inputs (effluent temperature, current velocity and direction, and discharge flow rate) is demonstrated in simulations 16-24 (Table 8). DFs were sensitive to variation in ambient velocity (dilution increasing with velocity, simulations 17-19) and effluent flow rate (dilution decreases with Q, simulations 21-24).

Table 8. Wrangell Mixing Zone Dilution Modeling Results

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min) ¹⁹
1. MZ=1*depth	Wrangell station 4 8/2015	UM3(half spacing)/FF	30.5	34	262	274	23	15	7
2. “ “	Wrangell station 3 8/2016	“ “	“ “	33	232	243	23	13	8
3. “ “	Wrangell station 4 8/2016	“ “	“ “	32	153	160	25	10	8
4. “ “	“ “	DKHW(half spacing)/FF	“ “	32	228	228	26	11	8
5. “ “	“ “	UM3 (half spacing)/FF	16.8	32	153	157	25	10	3
6. “ “	“ “	NRFIELD	16.8	33	75		25		
7. “ “	“ “	UM3(DS-only, 8x3.95")/FF	30.5	33	112	117	24	12	8
8. “ “	Wrangell station 3 8/2017	UM3(half-spacing)/FF	“ “	39	494	516	17	25	2
9. “ “	Wrangell station 4 8/2017	“ “	“ “	40	743	791	6	21	4
Dilution at different distances:									
10. MZ= initial mixing region	Wrangell station 4 8/2016	UM3 (DS-only, 8x3.95")	12	33	112	113	24		2
11. MZ=1*depth	“ “	UM3(DS-only, 8x3.95")/FF	30.5	33	112	113	24	12	8
12. MZ=2*depth	“ “	“ “	61	33	115	115	24	12	20
13. MZ=5*depth	“ “	“ “	152.5	33	149	149	24	12	59
14. MZ=10*depth	“ “	“ “	305	33	229	230	24	12	122

¹⁹ Travel time to MZ boundary was calculated only for distances exceeding length of initial mixing region.

Model simulation	Ambient input	Model(s)	MZ distance (m)	Froude number	Dilution factor	Dilution factor w/ bacteria decay	Trapping depth (m)	Length of initial mixing region (m)	Travel time to MZ boundary (min) ¹⁹
15. MZ=distance to nearest shore	“ “	“ “	457	33	323	325	24	12	185
Model sensitivity:									
16. avg. effluent T=17.3° C	Wrangell station 4 8/2016	UM3(DS-only, 8x3.95")/FF	30.5	33	112	112	24	12	8
17. ½*current v=2 cm/s	“ “	“ “	“ “	33	86	86	24	11	16
18. 2*current v=8 cm/s	“ “	“ “	“ “	33	198	199	25	15	3
19. ave. current v=23.5 cm/s	“ “	UM3 (DS-only, 8x3.95")	“ “	33	412	412	27	31	2
20. reverse current direction=270°	“ “	UM3(DS-only, 8x3.95")/FF	“ “	33	112	113	24	12	8
21. ave. Q=0.36 MGD	“ “	“ “	“ “	3.9	243	244	26	5	11
22. Q/4=0.75 MGD	“ “	“ “	“ “	8.1	161	161	25	6	10
23. Q/2=1.5 MGD	“ “	“ “	“ “	16	125	126	25	8	9
24. 2*Q=6.0 MGD	“ “	“ “	“ “	65	119	120	25	18	5
Far-field model sensitivity to diffusion parameter:									
25. alpha=0.0001	Wrangell station 4 8/2016	UM3(DS-only, 8x3.95")/FF	305	33	130	131	24	12	122
26. alpha=0.000453	“ “	“ “	“ “	33	321	323	24	12	122
27. Linear eddy diffusivity	“ “	“ “	“ “	33	203	204	24	12	122

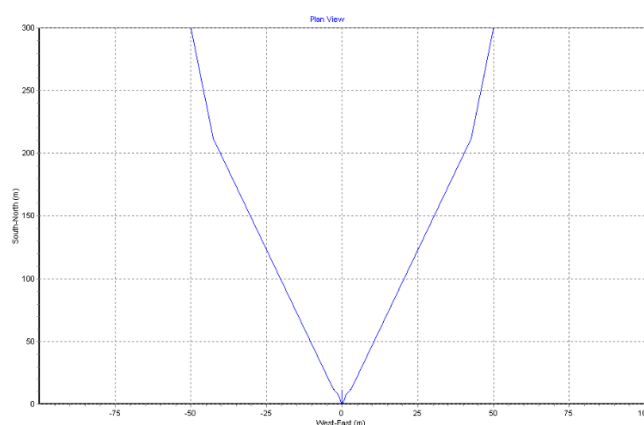


Figure 28. Wrangell Discharge Plume Boundary Plan View from Above

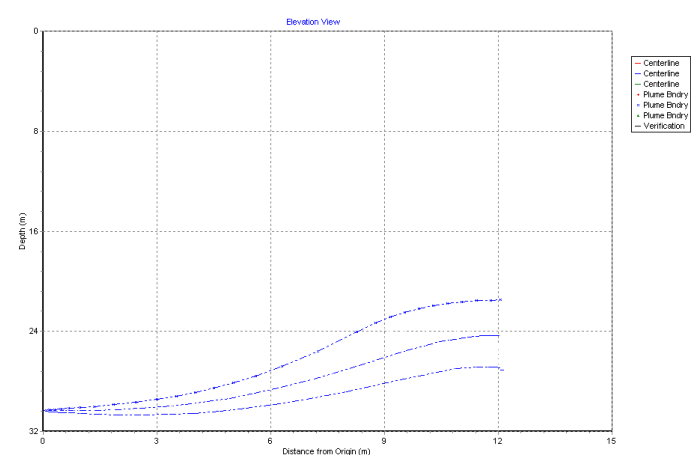


Figure 29. Wrangell Discharge Plume Centerline and Boundary Profile View from Side

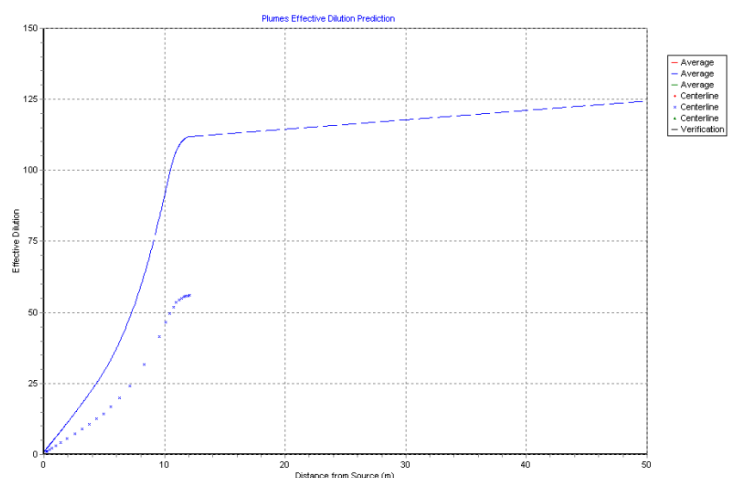


Figure 30. Wrangell Discharge Plume Average and Centerline Dilution vs. Distance from Outfall

SUMMARY

A summary of the average dilution predictions at various distances (corresponding to 1-10 times the depth of discharge) from the discharge point at each Alaskan mixing zone location is presented in Table 9. As indicated in this table, some of the distances exceed the distance from the outfall to the nearest shore. Under some conditions the tidal currents could direct the discharge plume towards the shore and, upon reaching this boundary, further mixing would likely not occur. The distance from the outfall to nearest shore at each location and the predicted DFs and travel times for these distances are presented in Table 10. The dilution predictions are also graphed as a function of distance from the outfall (Figure 31). In this figure, DFs for Ketchikan, Sitka and Skagway have been truncated at the distance to shore.

Table 9. Average Dilution Factor Predictions at Distances from the Discharge Point Corresponding to 1-10 Times the Depth of Discharge

Location	1*depth			2*depth			5*depth			10*depth		
	Distance (m)	DF	Time (min)	Distance (m)	DF	Time (min)	Distance (m)	DF	Time (min)	Distance (m)	DF	Time (min)
Haines	21.3	100	4	43	136	19	107	330	65	213	766	143
Ketchikan	29.9	52	5	60	62	13	150	105	39	299*	179	81
Petersburg	18.3	67	1	37	90	15	92	256	72	183	647	167
Sitka	24.4	87	17	49	97	41	122*	143	113	244*	227	232
Skagway	18.3	56	18	37	86	39	92	177	105	183*	330	214
Wrangell	30.5	112	8	61	115	20	153	149	59	305	229	122

* Distance greater than the distance from the outfall to shore.

Table 10. Average Dilution Factor Predictions at the Distance from the Outfall to Shore

Location	Distance from outfall to shore (m)	DF at distance from outfall to shore	Travel time to shore (min)
Haines	549	2770	386
Ketchikan	221	141	59
Petersburg	366	1720	358
Sitka	114	138	105
Skagway	125	233	145
Wrangell	457	323	185

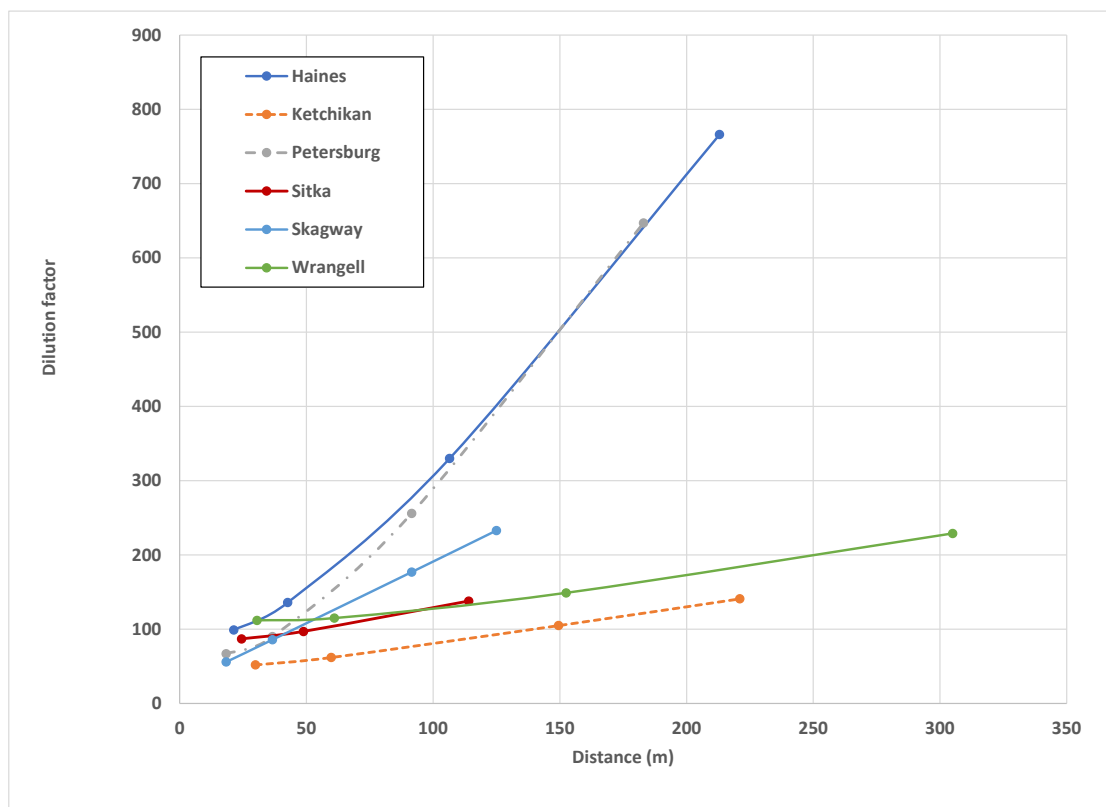


Figure 31. DF Predictions Graphed as a Function of Distance from the Outfall
(predictions are DFs for distances corresponding to 1-10 times the depth of discharge; in the cases of Ketchikan, Sitka and Skagway, DFs have been truncated at the distances to the shore)

A summary of the dilution factors predicted at the initial mixing region boundaries is presented in Table 11. For each location this table includes the distance to this boundary, the predicted DF and the travel times to the boundary. Compared to the depth-based distances in Table 9, the initial mixing region boundary distances are quite short, although the DFs at a distance of 1*depth are comparable (within 25%) of the initial mixing region dilution factors.

Table 11. Dilution Factor Predictions at Distances Equal to Initial Mixing Region Boundaries

Location	Initial Mixing Region Boundary (m)	DF	Travel Time to Boundary (min)
Haines	16	99	1
Ketchikan	13	51	1
Petersburg	23	74	1
Sitka	6.9	86	1
Skagway	3.5	42	0.7
Wrangell	12	112	2

The far-field model was also used to calculate the distances required to attain the FC criteria (i.e., the DFs in Table 1). These distances, presented in Table 11, range from 3.4 to 135 km to attain the 43/100 mL FC criterion and 7.2 to 420 km to attain the 14/100 mL FC criterion. These distances greatly exceed the mixing zone sizes certified by the state in the current wastewater discharge permits for the six POTW facilities.

Table 12. Dilution Factors and Mixing Zone Distances Required to Attain FC Criteria

Location	DF required to attain the 43/100 mL FC criterion	Distance to attain the 43/100 mL FC criterion (km)	DF required to attain the 14/100 mL FC criterion	Distance to attain the 14/100 mL FC criterion (km)
Haines	50,000	4.0	150,000	8.3
Ketchikan	67,000	135	210,000	420
Petersburg	47,000	3.4	140,000	7.2
Sitka	87,000	126	270,000	390
Skagway	60,000	36	190,000	114
Wrangell	4,400	3.9	14,000	8.9

REFERENCES

Dissing, D. and G. Wendler. 1998. Solar Radiation Climatology of Alaska. Theor. Appl. Climatol. 61, pp. 161-175.

Environmental Protection Agency (EPA). 1991. Technical Support Document for Water Quality-based Toxics Control. United States Environmental Protection Agency, Office of Water. Washington, D.C. March 1991. EPA/505/2-90-001.

Environmental Protection Agency (EPA). 1994. Dilution Models for Effluent Discharges, 3rd Edition. United States Environmental Protection Agency, Office of Research and Development. Washington, DC. June 1994. EPA/600/R-94/086.

Environmental Protection Agency (EPA). 2003. Dilution Models for Effluent Discharges, 4th Edition (Visual Plumes). United States Environmental Protection Agency, National Exposure Research Laboratory. Research Triangle Park, NC. March 2003. EPA/600/R-03/025.

Frick, W., Ahmed, A., George, K. and P. Roberts. 2010. On Visual Plumes and associated applications. Presented at the 6th International Conference on Marine Waste Water Discharges and Coastal Environment. Langkawi, Malaysia. October 2010.

Frick, W. and P.J.W. Roberts. 2019. Visual Plumes (Plumes20.exe) October 2019 Update, the UM3 plume-water surface reflection approximation and mixing zone endpoints (<https://ftp.waterboards.ca.gov/Surface%20reflection%20tech.docx>).

MixZone Inc. 2020. CorHyd Internal Diffuser Hydraulics Model User Manual. December 15, 2020.

Reese, C., George, K. and Gerry Brown. 2021. Mixing zones 101 (PowerPoint presentation). Alaska Department of Environmental Conservation (<https://dec.alaska.gov/media/16267/mixing-zones.pdf>, accessed April 21, 2021).

Washington Department of Ecology (DoE). 2018. Permit Writer's Manual (Revised January 2015/ Updated September 2018). Publication no. 92-109 Part 1. Appendix C. Water Quality Program, Washington State Department of Ecology. Olympia, Washington (<https://fortress.wa.gov/ecy/publications/SummaryPages/92109part1.html>).

APPENDIX: VP AND FARFIELD²⁰ OUTPUT FOR EACH LOCATION

Haines (model output for 1*depth, 2*depth, 5*depth and 10*depth)

Contents of the memo box (may not be current and must be updated manually)

Project "C:\Plumes20\Haines" memo4

Model configuration items checked: Brooks far-field solution;

Channel width (m) 100

Start case for graphs 1

Max detailed graphs 10 (limits plots that can overflow memory)

Elevation Projection Plane (deg) 0

Shore vector (m,deg) not checked

Bacteria model : Mancini (1978) coliform model

PDS sfc. model heat transfer : Medium

Equation of State : S, T

Similarity Profile : Default profile (k=2.0, ...)

Diffuser port contraction coefficient 0.61

Light absorption coefficient 0.16

Farfield increment (m) 200

UM3 aspiration coefficient 0.1

Output file: text output tab

Output each ?? steps 100

Maximum dilution reported 100000

Text output format : Standard

Max vertical reversals : to max rise or fall

/ UM3. 6/23/2021 5:19:37 AM

Case 1; ambient file C:\Plumes20\Haines_Skagway_1_Jun05.006.db; Diffuser table record 1: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-l	m/s	deg	m0.67/s2	sigma-T
0.0	0.023	90.00	7.100	11.12	0.0	0.000192	0.023	90.00	0.0003	5.180276
1.523	0.023	90.00	14.16	10.08	0.0	0.000194	0.023	90.00	0.0003	10.78304
3.047	0.023	90.00	23.30	8.650	0.0	0.000193	0.023	90.00	0.0003	18.06627
4.570	0.023	90.00	23.25	8.670	0.0	0.000193	0.023	90.00	0.0003	18.02474
6.090	0.023	90.00	25.20	8.220	0.0	0.000193	0.023	90.00	0.0003	19.60292
7.617	0.023	90.00	26.37	8.020	0.0	0.000193	0.023	90.00	0.0003	20.54204
9.140	0.023	90.00	26.74	7.980	0.0	0.000193	0.023	90.00	0.0003	20.83621
10.45	0.023	90.00	27.46	7.570	0.0	0.000193	0.023	90.00	0.0003	21.45192
11.75	0.023	90.00	28.24	7.100	0.0	0.000193	0.023	90.00	0.0003	22.12180
13.06	0.023	90.00	28.92	6.920	0.0	0.000193	0.023	90.00	0.0003	22.67724
14.37	0.023	90.00	29.08	6.880	0.0	0.000192	0.023	90.00	0.0003	22.80770
15.68	0.023	90.00	29.29	6.790	0.0	0.000192	0.023	90.00	0.0003	22.98359
16.98	0.023	90.00	30.42	6.260	0.0	0.000192	0.023	90.00	0.0003	23.93584

²⁰ If required.

22.00 0.023 90.00 34.78 4.213 0.0 0.000192 0.023 90.00 0.0003 27.61629

Diffuser table:

P-diaVer angl H-Angle SourceX SourceY Ports Spacing MZ-dis Isoplth P-depth Ttl-flo Eff-sal
 Temp Polutnt
 (in) (deg) (deg) (m) (m) () (ft) (m)(concent) (m) (MGD) (psu) (C)(col/dl)
 3.0000 0.0 90.000 0.0 0.0 2.0000 15.000 21.300 200.00 21.100 2.9000 0.0 15.800
 2.13E+6

Simulation:

Froude No: 178.8; Strat No: 2.20E-3; Spcg No: 76.82; k: 992.9; eff den (sigmaT) -0.960860; eff vel
 22.84(m/s);

Depth Amb-cur P-dia Polutnt Dilutn x-posn y-posn Iso dia
 Step (m) (cm/s) (in) (col/dl) () (m) (m) (m)
 0 21.10 2.300 2.343 2.130E+6 1.000 0.0 0.0 0.0; 10.68 T-90hr,
 100 21.10 2.300 23.86 208749.0 10.20 0.000 1.346 0.6058; 10.68 T-90hr,
 160 21.03 2.300 77.28 63725.7 33.42 0.000 4.775 1.9614; bottom hit; 10.65 T-90hr,
 200 20.49 2.300 166.7 28847.1 73.76 0.000 10.62 4.2261; 10.42 T-90hr,
 204 20.37 2.300 179.9 26645.8 79.84 0.000 11.48 4.5599; trap level; 10.37 T-90hr,
 205 20.34 2.300 183.3 26122.1 81.44 0.000 11.71 4.6475; merging; 10.36 T-90hr,
 232 19.97 2.300 305.7 21392.8 99.34 0.000 16.27 7.7425; local maximum rise or fall;
 10.20 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0; CL(m): 16.274

Lmz(m): 16.274

forced entrain 1 1.873 1.132 7.764 1.000

Rate sec-1 0.00019515 dy-1 16.8607 kt: 0.000062421 Amb Sal 33.0175

Const Eddy Diffusivity. Farfield dispersion based on wastefield width of 12.34 m

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif
 (col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)
 21392.8 99.34 12.34 16.27 2.78E-4 0.0 16.27 2.300 90.00 3.00E-4 6.2421E-5
 20539.8 99.48 14.21 21.30 0.061 0.0 16.27 2.300 90.00 3.00E-4 6.2421E-5
 18354.2 113.1 20.80 37.57 0.258 0.0 16.27 2.300 90.00 3.00E-4 6.2421E-5

count: 1

;

5:19:40 AM. amb fills: 4

/ UM3. 6/23/2021 5:20:06 AM

Case 1; ambient file C:\Plumes20\Haines_Skagway_1_Jun05.006.db; Diffuser table record 1: -----

Ambient Table:

Depth Amb-cur Amb-dir Amb-sal Amb-tem Amb-pol Solar rad Far-spdl Far-dir Disprsn
 Density
 m m/s deg psu C kg/kg s-1 m/s deg m0.67/s2 sigma-T
 0.0 0.023 90.00 7.100 11.12 0.0 0.000194 0.023 90.00 0.0003 5.180276
 1.523 0.023 90.00 14.16 10.08 0.0 0.000198 0.023 90.00 0.0003 10.78304
 3.047 0.023 90.00 23.30 8.650 0.0 0.000197 0.023 90.00 0.0003 18.06627
 4.570 0.023 90.00 23.25 8.670 0.0 0.000196 0.023 90.00 0.0003 18.02474
 6.090 0.023 90.00 25.20 8.220 0.0 0.000196 0.023 90.00 0.0003 19.60292
 7.617 0.023 90.00 26.37 8.020 0.0 0.000196 0.023 90.00 0.0003 20.54204
 9.140 0.023 90.00 26.74 7.980 0.0 0.000196 0.023 90.00 0.0003 20.83621
 10.45 0.023 90.00 27.46 7.570 0.0 0.000196 0.023 90.00 0.0003 21.45192

11.75	0.023	90.00	28.24	7.100	0.0	0.000196	0.023	90.00	0.0003	22.12180
13.06	0.023	90.00	28.92	6.920	0.0	0.000195	0.023	90.00	0.0003	22.67724
14.37	0.023	90.00	29.08	6.880	0.0	0.000195	0.023	90.00	0.0003	22.80770
15.68	0.023	90.00	29.29	6.790	0.0	0.000195	0.023	90.00	0.0003	22.98359
16.98	0.023	90.00	30.42	6.260	0.0	0.000195	0.023	90.00	0.0003	23.93584
22.00	0.023	90.00	34.78	4.213	0.0	0.000195	0.023	90.00	0.0003	27.61629

Diffuser table:

P-dia	Ver angl	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.0000	0.0	90.000	0.0	0.0	2.0000	15.000	42.600	200.00	21.100	2.9000	0.0 15.800
2.13E+6											

Simulation:

Froude No: 178.8; Strat No: 2.20E-3; Spcg No: 76.82; k: 992.9; eff den (sigmaT) -0.960860; eff vel 22.84(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(m)
0	21.10	2.300	2.343 2.130E+6	1.000	0.0	0.0	0.05935; 10.68 T-90hr,
100	21.10	2.300	23.86 208749.0	10.20	0.000	1.346	0.6058; 10.68 T-90hr,
160	21.03	2.300	77.28 63725.7	33.42	0.000	4.775	1.9614; bottom hit; 10.65 T-90hr,
200	20.49	2.300	166.7 28847.1	73.76	0.000	10.62	4.2261; 10.42 T-90hr,
204	20.37	2.300	179.9 26645.8	79.84	0.000	11.48	4.5599; trap level; 10.37 T-90hr,
205	20.34	2.300	183.3 26122.1	81.44	0.000	11.71	4.6475; merging; 10.36 T-90hr,
232	19.97	2.300	305.7 21392.8	99.34	0.000	16.27	7.7425; local maximum rise or fall;
10.20							T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0; CL(m): 16.274

Lmz(m): 16.274

forced entrain 1 1.873 1.132 7.764 1.000

Rate sec-1 0.00019515 dy-1 16.8607 kt: 0.000062421 Amb Sal 33.0175

Const Eddy Diffusivity. Farfield dispersion based on wastefield width of 12.34 m

conc	dilutn	width	distnce	time	bckgrnd	decay	current	cur-dir	eddydif
(col/dl)		(m)	(m)	(hrs)	(col/dl)	(ly/hr)	(cm/s)	angle(m0.67/s2)	
21392.8	99.34	12.34	16.27	2.78E-4	0.0	16.27	2.300	90.00	3.00E-4 6.2421E-5
19386.1	118.7	23.00	42.60	0.318	0.0	16.27	2.300	90.00	3.00E-4 6.2421E-5
15243.7	136.7	30.62	58.87	0.515	0.0	16.27	2.300	90.00	3.00E-4 6.2421E-5

count: 1

;

5:20:07 AM. amb fills: 4

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)
 This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm.
 The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)^{4/3}$.

INPUT						
4/3 Power Law $E_o = (\alpha)(width)^{4/3}$ (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	99.34	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	12.34	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	16.27	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	42.6	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width)^{4/3} m^2/sec$	0.0003					
4. Horizontal current speed (m/sec)	0.023	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	2.14E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.95E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
		$E_o = 8.5548E-03 \text{ m}^2/s$ $Beta = 3.6170E-01 \text{ unitless}$				
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	0.317995 169	26.33	42.6	1.36E+02	1.56E+04	137

/ UM3. 6/23/2021 5:20:24 AM

Case 1; ambient file C:\Plumes20\Haines_Skagway_1_Jun05.006.db; Diffuser table record 1: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdx	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.023	90.00	7.100	11.12	0.0	0.000194	0.023	90.00	0.0003
1.523	0.023	90.00	14.16	10.08	0.0	0.000198	0.023	90.00	0.0003
3.047	0.023	90.00	23.30	8.650	0.0	0.000197	0.023	90.00	0.0003
4.570	0.023	90.00	23.25	8.670	0.0	0.000196	0.023	90.00	0.0003
6.090	0.023	90.00	25.20	8.220	0.0	0.000196	0.023	90.00	0.0003
7.617	0.023	90.00	26.37	8.020	0.0	0.000196	0.023	90.00	0.0003
9.140	0.023	90.00	26.74	7.980	0.0	0.000196	0.023	90.00	0.0003
10.45	0.023	90.00	27.46	7.570	0.0	0.000196	0.023	90.00	0.0003
11.75	0.023	90.00	28.24	7.100	0.0	0.000196	0.023	90.00	0.0003
13.06	0.023	90.00	28.92	6.920	0.0	0.000195	0.023	90.00	0.0003
14.37	0.023	90.00	29.08	6.880	0.0	0.000195	0.023	90.00	0.0003
15.68	0.023	90.00	29.29	6.790	0.0	0.000195	0.023	90.00	0.0003
16.98	0.023	90.00	30.42	6.260	0.0	0.000195	0.023	90.00	0.0003
22.00	0.023	90.00	34.78	4.213	0.0	0.000195	0.023	90.00	0.0003

Diffuser table:

P-dia	Ver angl	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.0000	0.0	90.000	0.0	0.0	2.0000	15.000	106.50	200.00	21.100	2.9000	0.0
2.13E+6											

Simulation:

Froude No: 178.8; Strat No: 2.20E-3; Spcg No: 76.82; k: 992.9; eff den (sigmaT) -0.960860; eff vel 22.84(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Iso dia
Step	(m)	(cm/s)	(in)(col/dl)	()	(m)	(m)	(m)
0	21.10	2.300	2.343	2.130E+6	1.000	0.0	0.0
100	21.10	2.300	23.86	208749.0	10.20	0.000	1.346
160	21.03	2.300	77.28	63725.7	33.42	0.000	4.775
200	20.49	2.300	166.7	28847.1	73.76	0.000	10.62
204	20.37	2.300	179.9	26645.8	79.84	0.000	11.48
205	20.34	2.300	183.3	26122.1	81.44	0.000	11.71
232	19.97	2.300	305.7	21392.8	99.34	0.000	16.27

10.20 T-90hr,
 Horiz plane projections in effluent direction: radius(m): 0.0; CL(m): 16.274

Lmz(m): 16.274

forced entrain 1 1.873 1.132 7.764 1.000

Rate sec-1 0.00019515 dy-1 16.8607 kt: 0.000062421 Amb Sal 33.0175

Const Eddy Diffusivity. Farfield dispersion based on wastefield width of 12.34 m

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif
 (col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)

21392.8	99.34	12.34	16.27	2.78E-4	0.0	16.27	2.300	90.00	3.00E-4	6.2421E-5
16299.5	181.1	56.68	106.5	1.090	0.0	16.27	2.300	90.00	3.00E-4	6.2421E-5
10795.8	194.1	66.75	122.8	1.287	0.0	16.27	2.300	90.00	3.00E-4	6.2421E-5

count: 1
;
5:20:24 AM. amb fills: 4

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)
 This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm.
 The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)^{4/3}$.

INPUT						
4/3 Power Law $E_o = (\alpha)(width)^{4/3}$ (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	99.34	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	12.34	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	16.27	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	106.5	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width)^{4/3} m^2/sec$	0.0003					
4. Horizontal current speed (m/sec)	0.023	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	2.14E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.95E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
		$E_o = 8.5548E-03 \text{ m}^2/s$ $Beta = 3.6170E-01 \text{ unitless}$				
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	1.0897343	90.23	106.5	3.30E+02	6.43E+03	331

/ UM3. 6/23/2021 5:20:41 AM

Case 1; ambient file C:\Plumes20\Haines_Skagway_1_Jun05.006.db; Diffuser table record 1: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spnd	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.023	90.00	7.100	11.12	0.0	0.000194	0.023	90.00	0.0003
1.523	0.023	90.00	14.16	10.08	0.0	0.000198	0.023	90.00	0.0003
3.047	0.023	90.00	23.30	8.650	0.0	0.000197	0.023	90.00	0.0003
4.570	0.023	90.00	23.25	8.670	0.0	0.000196	0.023	90.00	0.0003
6.090	0.023	90.00	25.20	8.220	0.0	0.000196	0.023	90.00	0.0003
7.617	0.023	90.00	26.37	8.020	0.0	0.000196	0.023	90.00	0.0003
9.140	0.023	90.00	26.74	7.980	0.0	0.000196	0.023	90.00	0.0003
10.45	0.023	90.00	27.46	7.570	0.0	0.000196	0.023	90.00	0.0003
11.75	0.023	90.00	28.24	7.100	0.0	0.000196	0.023	90.00	0.0003
13.06	0.023	90.00	28.92	6.920	0.0	0.000195	0.023	90.00	0.0003
14.37	0.023	90.00	29.08	6.880	0.0	0.000195	0.023	90.00	0.0003
15.68	0.023	90.00	29.29	6.790	0.0	0.000195	0.023	90.00	0.0003
16.98	0.023	90.00	30.42	6.260	0.0	0.000195	0.023	90.00	0.0003
22.00	0.023	90.00	34.78	4.213	0.0	0.000195	0.023	90.00	0.0003

Diffuser table:

P-dia	Ver angl	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.0000	0.0	90.000	0.0	0.0	2.0000	15.000	213.00	200.00	21.100	2.9000	0.0
2.13E+6											

Simulation:

Froude No: 178.8; Strat No: 2.20E-3; Spcg No: 76.82; k: 992.9; eff den (sigmaT) -0.960860; eff vel 22.84(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(m)
0	21.10	2.300	2.343 2.130E+6	1.000	0.0	0.0	0.05935; 10.68 T-90hr,
100	21.10	2.300	23.86 208749.0	10.20	0.000	1.346	0.6058; 10.68 T-90hr,
160	21.03	2.300	77.28 63725.7	33.42	0.000	4.775	1.9614; bottom hit; 10.65 T-90hr,
200	20.49	2.300	166.7 28847.1	73.76	0.000	10.62	4.2261; 10.42 T-90hr,
204	20.37	2.300	179.9 26645.8	79.84	0.000	11.48	4.5599; trap level; 10.37 T-90hr,
205	20.34	2.300	183.3 26122.1	81.44	0.000	11.71	4.6475; merging; 10.36 T-90hr,
232	19.97	2.300	305.7 21392.8	99.34	0.000	16.27	7.7425; local maximum rise or fall; 10.20 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0; CL(m): 16.274

Lmz(m): 16.274

forced entrain 1 1.873 1.132 7.764 1.000

Rate sec-1 0.00019515 dy-1 16.8607 kt: 0.000062421 Amb Sal 33.0175

Const Eddy Diffusivity. Farfield dispersion based on wastefield width of 12.34 m

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif

(col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)

21392.8 99.34 12.34 16.27 2.78E-4 0.0 16.27 2.300 90.00 3.00E-4 6.2421E-5

12646.5 246.9 121.4 200.0 2.219 0.0 16.27 2.300 90.00 3.00E-4 6.2421E-5
 8191.65 256.7 134.2 216.3 2.416 0.0 16.27 2.300 90.00 3.00E-4 6.2421E-5

count: 1

;

5:20:41 AM. amb fills: 4

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)^{4/3}$.

INPUT						
4/3 Power Law $E_o = (\alpha)(width)^{4/3}$ (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	99.34	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	12.34	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	16.27	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	213	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width)^{4/3} m^2/sec$	0.0003					
4. Horizontal current speed (m/sec)	0.023	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional)		(these inputs do not affect calculated farfield dilution factors)				
Pollutant concentration after initial dilution (any units)	2.14E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.95E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
		$E_o = 8.5548E-03 \text{ m}^2/s$ $Beta = 3.6170E-01 \text{ unitless}$				
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	2.375966 184	196.73	213	7.66E+02	2.77E+03	768

Ketchikan (model output for 1*depth, 2*depth, 5*depth and 10*depth)

Contents of the memo box (may not be current and must be updated manually)
 Project "C:\Plumes20\Ketchikan_1port" memo

Model configuration items checked: Brooks far-field solution;

Channel width (m) 100
 Start case for graphs 1
 Max detailed graphs 10 (limits plots that can overflow memory)
 Elevation Projection Plane (deg) 0
 Shore vector (m,deg) not checked
 Bacteria model : Mancini (1978) coliform model
 PDS sfc. model heat transfer : Medium
 Equation of State : S, T
 Similarity Profile : Default profile (k=2.0, ...)
 Diffuser port contraction coefficient 0.61
 Light absorption coefficient 0.16
 Farfield increment (m) 200
 UM3 aspiration coefficient 0.1
 Output file: text output tab
 Output each ?? steps 100
 Maximum dilution reported 100000
 Text output format : Standard
 Max vertical reversals : to max rise or fall

/ UM3. 6/23/2021 5:27:49 AM

Case 1; ambient file C:\Plumes20\Ketchikan_3_July1997.004.db; Diffuser table record 3: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2	sigma-T
0.0	0.059	140.0	24.50	15.20	0.0	0.000196	0.059	140.0	0.0003	17.89918
1.000	0.059	140.0	24.50	15.20	0.0	0.0002	0.059	140.0	0.0003	17.89918
16.10	0.059	140.0	26.80	13.80	0.0	0.0002	0.059	140.0	0.0003	19.93814
33.90	0.059	140.0	30.90	8.000	0.0	0.000199	0.059	140.0	0.0003	24.08526

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal	Temp
Polutnt											
(in)	(deg)	(deg)	(m)	(m)	()	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)	
12.000	0.0	205.00	0.0	0.0	1.0000	29.900	100.00	29.600	3.4560	0.0	20.500 20000.0

Simulation:

Froude No: 14.08; Strat No: 1.68E-3; Spcg No: 9.00E+8; k: 57.66; eff den (sigmaT) -1.837438; eff vel 3.402(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in)(col/dl)	()	(m)	(m)	(s)	(m)
0	29.60	5.900	9.372 20000.0	1.000	0.0	0.0	0.0	0.2374; 13.41 T-90hr,
100	29.37	5.900	61.18 2975.1	6.722	-2.606	-1.081	3.096	1.5410; 13.32 T-90hr,

200 27.61 5.900 135.6 1142.4 17.50 -6.017 -2.060 14.40 3.3681; 12.62 T-90hr,
 249 24.16 5.900 233.0 562.5 35.49 -9.308 -2.435 34.83 5.6507; trap level; 11.26 T-90hr,
 276 22.92 5.900 300.9 445.7 44.77 -10.56 -2.414 45.33 7.2032; begin overlap; 10.77 T-
 90hr,
 300 22.48 5.900 333.7 414.4 48.13 -11.13 -2.377 50.59 7.9496; 10.60 T-90hr,
 400 21.94 5.900 383.7 388.9 51.25 -12.54 -2.254 64.07 9.1014; 10.40 T-90hr,
 417 21.94 5.900 385.5 387.6 51.42 -12.73 -2.235 65.91 9.1403; local maximum rise or
 fall; 10.39 T-90hr,
 Horiz plane projections in effluent direction: radius(m): 2.4839; CL(m): 12.480
 Lmz(m): 14.964
 forced entrain 1 1.28E+9 7.663 9.791 1.000
 Rate sec-1 0.00019971 dy-1 17.2550 kt: 0.000059972 Amb Sal 28.1446
 4/3 Power Law. Farfield dispersion based on wastefield width of 9.79 m
 conc dilutn width distnce time bckgrnd decay current cur-dir eddydif
 (col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)
 387.592 51.42 9.799 12.92 2.78E-4 0.0 16.00 5.900 140.0 3.00E-4 5.9972E-5
 372.140 52.31 12.10 29.90 0.0802 0.0 16.00 5.900 140.0 3.00E-4 5.9972E-5
 346.023 56.38 13.95 42.82 0.141 0.0 16.00 5.900 140.0 3.00E-4 5.9972E-5
 count: 1
 ;
 5:27:49 AM. amb fills: 4

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)$.

INPUT						
<p align="center">Linear Eddy Diffusivity $E_o = (\alpha)(width)$ (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	51.42	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	9.79	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	12.92	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	29.9	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width) m^2/sec$	6.42E-04					
4. Horizontal current speed (m/sec)	0.059	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	3.88E+02	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	2.00E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			$E_o = 6.2830E-03 \quad m^2/s$ $Beta = 1.3053E-01 \quad \text{unitless}$			
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	7.99E-02	16.98	29.90	5.22E+01	3.82E+02	52

/ UM3. 6/23/2021 5:28:05 AM

Case 1; ambient file C:\Plumes20\Ketchikan_3_July1997.004.db; Diffuser table record 3: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.059	140.0	24.50	15.20	0.0	0.000195	0.059	140.0	0.0003
1.000	0.059	140.0	24.50	15.20	0.0	0.0002	0.059	140.0	0.0003
16.10	0.059	140.0	26.80	13.80	0.0	0.0002	0.059	140.0	0.0003
33.90	0.059	140.0	30.90	8.000	0.0	0.000199	0.059	140.0	0.0003

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal	Temp
Polutnt											
(in)	(deg)	(deg)	(m)	(m)	()	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)	
12.000	0.0	205.00	0.0	0.0	1.0000	59.800	100.00	29.600	3.4560	0.0	20.500

Simulation:

Froude No: 14.08; Strat No: 1.68E-3; Spcg No: 9.00E+8; k: 57.66; eff den (sigmaT) -1.837438; eff vel 3.402(m/s);

Step	Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
	(m)	(cm/s)	(in)	(col/dl)	()	(m)	(m)	(s)	(m)
0	29.60	5.900	9.372	20000.0	1.000	0.0	0.0	0.0	0.2222; 13.41 T-90hr,
100	29.37	5.900	61.18	2975.1	6.722	-2.606	-1.081	3.096	1.5410; 13.32 T-90hr,
200	27.61	5.900	135.6	1142.4	17.50	-6.017	-2.060	14.40	3.3681; 12.62 T-90hr,
249	24.16	5.900	233.0	562.5	35.49	-9.308	-2.435	34.83	5.6507; trap level; 11.26 T-90hr,
276	22.92	5.900	300.9	445.7	44.77	-10.56	-2.414	45.33	7.2032; begin overlap; 10.77 T-90hr,
300	22.48	5.900	333.7	414.4	48.13	-11.13	-2.377	50.59	7.9496; 10.60 T-90hr,
400	21.94	5.900	383.7	388.9	51.25	-12.54	-2.254	64.07	9.1014; 10.40 T-90hr,
417	21.94	5.900	385.5	387.6	51.42	-12.73	-2.235	65.91	9.1403; local maximum rise or fall; 10.39 T-90hr,

Horiz plane projections in effluent direction: radius(m): 2.4839; CL(m): 12.480

Lmz(m): 14.964

forced entrain 1 1.28E+9 7.663 9.791 1.000

Rate sec-1 0.00019971 dy-1 17.2550 kt: 0.000059972 Amb Sal 28.1446

4/3 Power Law. Farfield dispersion based on wastefield width of 9.79 m

conc	dilutn	width	distnce	time	bckgrnd	decay	current	cur-dir	eddydif
(col/dl)		(m)	(m)	(hrs)	(col/dl)	(ly/hr)	(cm/s)	angle(m0.67/s2)	
387.592	51.42	9.799	12.92	2.78E-4	0.0	16.00	5.900	140.0	3.00E-4
361.000	64.47	16.52	59.80	0.221	0.0	16.00	5.900	140.0	3.00E-4
273.501	71.65	18.57	72.72	0.282	0.0	16.00	5.900	140.0	3.00E-4

count: 1

;

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)$.

INPUT						
<p align="center">Linear Eddy Diffusivity $E_o = (\alpha)(width)$ (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	51.42	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	9.79	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	12.92	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	59.8	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width) m^2/sec$	6.42E-04					
4. Horizontal current speed (m/sec)	0.059	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	3.88E+02	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	2.00E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			$E_o = 6.2830E-03 \quad m^2/s$ $Beta = 1.3053E-01 \quad unitless$			
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	2.21E-01	46.88	59.80	6.24E+01	3.19E+02	63

5:28:05 AM. amb fills: 4

/ UM3. 6/23/2021 5:28:34 AM

Case 1; ambient file C:\Plumes20\Ketchikan_3_July1997.004.db; Diffuser table record 3: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spnd	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.059	140.0	24.50	15.20	0.0	0.000195	0.059	140.0	0.0003 17.89918
1.000	0.059	140.0	24.50	15.20	0.0	0.0002	0.059	140.0	0.0003 17.89918
16.10	0.059	140.0	26.80	13.80	0.0	0.0002	0.059	140.0	0.0003 19.93814
33.90	0.059	140.0	30.90	8.000	0.0	0.000199	0.059	140.0	0.0003 24.08526

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal	Temp
Polutnt											
(in)	(deg)	(deg)	(m)	(m)	()	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)	
12.000	0.0	205.00	0.0	0.0	1.0000	149.50	100.00	29.600	3.4560	0.0	20.500 20000.0

Simulation:

Froude No: 14.08; Strat No: 1.68E-3; Spcg No: 9.00E+8; k: 57.66; eff den (sigmaT) -1.837438; eff vel 3.402(m/s);

Step	Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
	(m)	(cm/s)	(in)	(col/dl)	()	(m)	(m)	(s)	(m)
0	29.60	5.900	9.372	20000.0	1.000	0.0	0.0	0.0	0.2222; 13.41 T-90hr,
100	29.37	5.900	61.18	2975.1	6.722	-2.606	-1.081	3.096	1.5410; 13.32 T-90hr,
200	27.61	5.900	135.6	1142.4	17.50	-6.017	-2.060	14.40	3.3681; 12.62 T-90hr,
249	24.16	5.900	233.0	562.5	35.49	-9.308	-2.435	34.83	5.6507; trap level; 11.26 T-90hr,
276	22.92	5.900	300.9	445.7	44.77	-10.56	-2.414	45.33	7.2032; begin overlap; 10.77 T-90hr,
300	22.48	5.900	333.7	414.4	48.13	-11.13	-2.377	50.59	7.9496; 10.60 T-90hr,
400	21.94	5.900	383.7	388.9	51.25	-12.54	-2.254	64.07	9.1014; 10.40 T-90hr,
417	21.94	5.900	385.5	387.6	51.42	-12.73	-2.235	65.91	9.1403; local maximum rise or fall; 10.39 T-90hr,

Horiz plane projections in effluent direction: radius(m): 2.4839; CL(m): 12.480

Lmz(m): 14.964

forced entrain 1 1.28E+9 7.663 9.791 1.000

Rate sec-1 0.00019971 dy-1 17.2550 kt: 0.000059972 Amb Sal 28.1446

4/3 Power Law. Farfield dispersion based on wastefield width of 9.79 m

conc	dilutn	width	distnce	time	bckgrnd	decay	current	cur-dir	eddydif
(col/dl)	(m)	(m)	(hrs)	(col/dl)	(ly/hr)	(cm/s)	angle(m0.67/s2)		
387.592	51.42	9.799	12.92	2.78E-4	0.0	16.00	5.900	140.0	3.00E-4 5.9972E-5
329.541	122.8	32.26	149.5	0.643	0.0	16.00	5.900	140.0	3.00E-4 5.9972E-5
149.151	132.4	34.81	162.4	0.704	0.0	16.00	5.900	140.0	3.00E-4 5.9972E-5

count: 1

;

5:28:34 AM. amb fills: 4

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)$.

INPUT						
<p align="center">Linear Eddy Diffusivity $E_o = (\alpha)(width)$ (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	51.42	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	9.79	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	12.92	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	149.5	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width) m^2/sec$	6.42E-04					
4. Horizontal current speed (m/sec)	0.059	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	3.88E+02	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	2.00E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			$E_o = 6.2830E-03 \quad m^2/s$ $Beta = 1.3053E-01 \quad \text{unitless}$			
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	6.43E-01	136.58	149.50	1.05E+02	1.89E+02	106

/ UM3. 6/23/2021 5:28:46 AM

Case 1; ambient file C:\Plumes20\Ketchikan_3_July1997.004.db; Diffuser table record 3: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spd	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.059	140.0	24.50	15.20	0.0	0.000195	0.059	140.0	0.0003
1.000	0.059	140.0	24.50	15.20	0.0	0.0002	0.059	140.0	0.0003
16.10	0.059	140.0	26.80	13.80	0.0	0.0002	0.059	140.0	0.0003
33.90	0.059	140.0	30.90	8.000	0.0	0.000199	0.059	140.0	0.0003

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal	Temp
Polutnt											
(in)	(deg)	(deg)	(m)	(m)	()	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)	
12.000	0.0	205.00	0.0	0.0	1.0000	299.00	100.00	29.600	3.4560	0.0	20.500

Simulation:

Froude No: 14.08; Strat No: 1.68E-3; Spcg No: 9.00E+8; k: 57.66; eff den (sigmaT) -1.837438; eff vel 3.402(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in)(col/dl)	()	(m)	(m)	(s)	(m)
0	29.60	5.900	9.372	20000.0	1.000	0.0	0.0	0.2222; 13.41 T-90hr,
100	29.37	5.900	61.18	2975.1	6.722	-2.606	-1.081	3.096 1.5410; 13.32 T-90hr,
200	27.61	5.900	135.6	1142.4	17.50	-6.017	-2.060	14.40 3.3681; 12.62 T-90hr,
249	24.16	5.900	233.0	562.5	35.49	-9.308	-2.435	34.83 5.6507; trap level; 11.26 T-90hr,
276	22.92	5.900	300.9	445.7	44.77	-10.56	-2.414	45.33 7.2032; begin overlap; 10.77 T-90hr,
300	22.48	5.900	333.7	414.4	48.13	-11.13	-2.377	50.59 7.9496; 10.60 T-90hr,
400	21.94	5.900	383.7	388.9	51.25	-12.54	-2.254	64.07 9.1014; 10.40 T-90hr,
417	21.94	5.900	385.5	387.6	51.42	-12.73	-2.235	65.91 9.1403; local maximum rise or fall; 10.39 T-90hr,

Horiz plane projections in effluent direction: radius(m): 2.4839; CL(m): 12.480

Lmz(m): 14.964

forced entrain 1 1.28E+9 7.663 9.791 1.000

Rate sec-1 0.00019971 dy-1 17.2550 kt: 0.000059972 Amb Sal 28.1446

4/3 Power Law. Farfield dispersion based on wastefield width of 9.79 m

conc	dilutn	width	distnce	time	bckgrnd	decay	current	cur-dir	eddydif
(col/dl)	(m)	(m)	(hrs)	(col/dl)	(ly/hr)	(cm/s)	angle(m0.67/s2)		
387.592	51.42	9.799	12.92	2.78E-4	0.0	16.00	5.900	140.0	3.00E-4
313.051	161.8	42.56	200.0	0.881	0.0	16.00	5.900	140.0	3.00E-4
94.9421	348.2	91.63	400.0	1.823	0.0	16.00	5.900	140.0	3.00E-4
54.9006	361.8	95.21	412.9	1.884	0.0	16.00	5.900	140.0	3.00E-4

count: 2

;

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)$.

INPUT						
<p align="center">Linear Eddy Diffusivity $E_o = (\alpha)(width)$ (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	51.42	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	9.79	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	12.92	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	299	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width) m^2/sec$	6.42E-04					
4. Horizontal current speed (m/sec)	0.059	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	3.88E+02	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	2.00E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			$E_o = 6.2830E-03 \quad m^2/s$ $Beta = 1.3053E-01 \quad \text{unitless}$			
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	1.35E+00	286.08	299.00	1.79E+02	1.11E+02	180

Petersburg (model output for 1*depth, 2*depth, 5*depth and 10*depth)

Contents of the memo box (may not be current and must be updated manually)
 Project "C:\Plumes20\Petersburg" me

Model configuration items checked: Brooks far-field solution;

Channel width (m) 100

Start case for graphs 1

Max detailed graphs 10 (limits plots that can overflow memory)

Elevation Projection Plane (deg) 0

Shore vector (m,deg) not checked

Bacteria model : Mancini (1978) coliform model

PDS sfc. model heat transfer : Medium

Equation of State : S, T

Similarity Profile : Default profile (k=2.0, ...)

Diffuser port contraction coefficient 0.61

Light absorption coefficient 0.16

Farfield increment (m) 200

UM3 aspiration coefficient 0.1

Output file: text output tab

Output each ?? steps 100

Maximum dilution reported 100000

Text output format : Standard

Max vertical reversals : to max rise or fall

/ UM3. 6/23/2021 5:40:38 AM

Case 1; ambient file C:\Plumes20\Petersburg_1_Aug05.002.db; Diffuser table record 1: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2 sigma-T
0.0	0.016	120.0	25.80	9.500	0.0	0.000195	0.016	120.0	0.0003 19.89413
9.150	0.016	120.0	28.10	8.200	0.0	0.000196	0.016	120.0	0.0003 21.86897
18.29	0.016	120.0	30.90	7.300	0.0	0.000196	0.016	120.0	0.0003 24.18118
20.00	0.016	120.0	31.42	7.132	0.0	0.000195	0.016	120.0	0.0003 24.61448

Diffuser table:

P-dia	Ver angl	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
4.0000	0.0	115.00	0.0	0.0	2.0000	10.000	18.300	200.00	18.070	3.6000	0.0 14.600
2.02E+6											

Simulation:

Froude No: 114.5; Strat No: 7.46E-4; Spcg No: 38.41; k: 996.7; eff den (sigmaT) -0.776899; eff vel 15.95(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in)(col/dl)	()	(m)	(m)	(s)	(m)
0	18.07	1.600	3.124	2.020E+6	1.000	0.0	0.0	0.0 0.0746; 9.342 T-90hr,

100 18.07 1.600 27.00 233103.2 8.665 -0.637 1.364 0.470 0.6855; 9.340 T-90hr,
 177 17.70 1.600 121.5 50815.2 39.73 -3.202 6.837 9.667 3.0831; merging; 9.198 T-90hr,
 200 16.92 1.600 192.0 38804.9 51.98 -4.867 10.37 20.86 4.8693; 8.895 T-90hr,
 212 15.74 1.600 258.0 32719.8 61.58 -6.629 14.10 35.23 6.5408; trap level; 8.436 T-
 90hr,
 221 14.97 1.600 323.8 29956.8 67.21 -7.796 16.57 45.91 8.2053; MZ dis; 8.143 T-90hr,
 forced entrain 1 1.914 3.095 8.224 0.970
 Rate sec-1 0.00019604 dy-1 16.9376 kt: 0.000077955 Amb Sal 29.8950
 Mixing Zone reached in near-field, no far-field calculation attempted

;
 5:40:38 AM. amb fills: 4
 / UM3. 6/23/2021 5:40:52 AM
 Case 1; ambient file C:\Plumes20\Petersburg_1_Aug05.002.db; Diffuser table record 1: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-sp	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.016	120.0	25.80	9.500	0.0	0.000195	0.016	120.0	0.0003 19.89413
9.150	0.016	120.0	28.10	8.200	0.0	0.000196	0.016	120.0	0.0003 21.86897
18.29	0.016	120.0	30.90	7.300	0.0	0.000196	0.016	120.0	0.0003 24.18118
20.00	0.016	120.0	31.42	7.132	0.0	0.000195	0.016	120.0	0.0003 24.61448

Diffuser table:

P-dia	Ver angl	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	(ft)	(m)	(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
4.0000	0.0	115.00	0.0	0.0	2.0000	10.000	36.600	200.00	18.070	3.6000	0.0 14.600

2.02E+6

Simulation:

Froude No: 114.5; Strat No: 7.46E-4; Spcg No: 38.41; k: 996.7; eff den (sigmaT) -0.776899; eff vel 15.95(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(s)	(m)
0	18.07	1.600	3.124 2.020E+6	1.000	0.0	0.0	0.0	0.07918; 9.342 T-90hr,
100	18.07	1.600	27.00 233103.2	8.665	-0.637	1.364	0.470	0.6855; 9.340 T-90hr,
177	17.70	1.600	121.5 50815.2	39.73	-3.202	6.837	9.667	3.0831; merging; 9.198 T-90hr,
200	16.92	1.600	192.0 38804.9	51.98	-4.867	10.37	20.86	4.8693; 8.895 T-90hr,
212	15.74	1.600	258.0 32719.8	61.58	-6.629	14.10	35.23	6.5408; trap level; 8.436 T- 90hr,
269	14.43	1.600	412.1 27015.9	74.42	-9.596	20.37	63.81	10.443; local maximum rise or fall; 7.935 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.03203; CL(m): 22.520
 Lmz(m): 22.552
 forced entrain 1 2.252 3.642 10.47 1.000
 Rate sec-1 0.00019608 dy-1 16.9412 kt: 0.000080118 Amb Sal 29.7168
 4/3 Power Law. Farfield dispersion based on wastefield width of 13.51 m
 conc dilutn width distnce time bckgrnd decay current cur-dir eddydif
 (col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)

27015.9 74.42 13.51 22.52 2.78E-4 0.0 16.25 1.600 120.0 3.00E-4 8.0118E-5
24577.8 89.58 21.72 36.60 0.245 0.0 16.25 1.600 120.0 3.00E-4 8.0118E-5
13316.6 149.2 37.30 59.12 0.636 0.0 16.25 1.600 120.0 3.00E-4 8.0118E-5

count: 1

;

5:40:52 AM. amb fills: 4

/ UM3. 6/23/2021 5:41:05 AM

Case 1; ambient file C:\Plumes20\Petersburg_1_Aug05.002.db; Diffuser table record 1: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn
Density	m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg
	m0.67/s2	sigma-T							
0.0	0.016	120.0	25.80	9.500	0.0	0.000195	0.016	120.0	0.0003
9.150	0.016	120.0	28.10	8.200	0.0	0.000196	0.016	120.0	0.0003
18.29	0.016	120.0	30.90	7.300	0.0	0.000196	0.016	120.0	0.0003
20.00	0.016	120.0	31.42	7.132	0.0	0.000195	0.016	120.0	0.0003

Diffuser table:

P-dia	Ver angl	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt	(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)	(concent)	(m)
	(MGD)	(psu)	(C)	(col/dl)							
4.0000	0.0	115.00	0.0	0.0	2.0000	10.000	91.500	200.00	18.070	3.6000	0.0
2.02E+6											

Simulation:

Froude No: 114.5; Strat No: 7.46E-4; Spcg No: 38.41; k: 996.7; eff den (sigmaT) -0.776899; eff vel 15.95(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in)	(col/dl)	()	(m)	(m)	(s)
0	18.07	1.600	3.124	2.020E+6	1.000	0.0	0.0	0.0
100	18.07	1.600	27.00	233103.2	8.665	-0.637	1.364	0.470
177	17.70	1.600	121.5	50815.2	39.73	-3.202	6.837	9.667
200	16.92	1.600	192.0	38804.9	51.98	-4.867	10.37	20.86
212	15.74	1.600	258.0	32719.8	61.58	-6.629	14.10	35.23
269	14.43	1.600	412.1	27015.9	74.42	-9.596	20.37	63.81

9.342 T-90hr, 0.6855; 9.340 T-90hr, 3.0831; merging; 9.198 T-90hr, 4.8693; 8.895 T-90hr, 6.5408; trap level; 8.436 T-90hr, local maximum rise or fall; 7.935 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.03203; CL(m): 22.520

Lmz(m): 22.552

forced entrain 1 2.252 3.642 10.47 1.000

Rate sec-1 0.00019608 dy-1 16.9412 kt: 0.000080118 Amb Sal 29.7168

4/3 Power Law. Farfield dispersion based on wastefield width of 13.51 m

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif

(col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)

27015.9 74.42 13.51 22.52 2.78E-4 0.0 16.25 1.600 120.0 3.00E-4 8.0118E-5
18670.4 255.8 64.12 91.50 1.198 0.0 16.25 1.600 120.0 3.00E-4 8.0118E-5
5869.71 340.7 85.44 114.0 1.589 0.0 16.25 1.600 120.0 3.00E-4 8.0118E-5

count: 1

; 5:41:06 AM. amb fills: 4

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)
 This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm.
 The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)^{4/3}$.

INPUT						
4/3 Power Law $E_o = (\alpha)(width)^{4/3}$ (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	74.42	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	13.51	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	22.52	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	91.5	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width)^{4/3} m^2/sec$	0.0003					
4. Horizontal current speed (m/sec)	0.016	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	2.70E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.96E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
		$E_o = 9.6530E-03 \text{ m}^2/s$ $Beta = 5.3588E-01 \text{ unitless}$				
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	1.197569 444	68.98	91.5	2.56E+02	7.86E+03	257

/ UM3. 6/23/2021 5:41:17 AM

Case 1; ambient file C:\Plumes20\Petersburg_1_Aug05.002.db; Diffuser table record 1: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spnd	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.016	120.0	25.80	9.500	0.0	0.000195	0.016	120.0	0.0003
9.150	0.016	120.0	28.10	8.200	0.0	0.000196	0.016	120.0	0.0003
18.29	0.016	120.0	30.90	7.300	0.0	0.000196	0.016	120.0	0.0003
20.00	0.016	120.0	31.42	7.132	0.0	0.000195	0.016	120.0	0.0003

Diffuser table:

P-dia	Ver angl	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
4.0000	0.0	115.00	0.0	0.0	2.0000	10.000	183.00	200.00	18.070	3.6000	0.0
2.02E+6											

Simulation:

Froude No: 114.5; Strat No: 7.46E-4; Spcg No: 38.41; k: 996.7; eff den (sigmaT) -0.776899; eff vel 15.95(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in)(col/dl)	()	(m)	(m)	(s)	(m)
0	18.07	1.600	3.124 2.020E+6	1.000	0.0	0.0	0.0	0.07916; 9.342 T-90hr,
100	18.07	1.600	27.00 233103.2	8.665	-0.637	1.364	0.470	0.6855; 9.340 T-90hr,
177	17.70	1.600	121.5 50815.2	39.73	-3.202	6.837	9.667	3.0831; merging; 9.198 T-90hr,
200	16.92	1.600	192.0 38804.9	51.98	-4.867	10.37	20.86	4.8693; 8.895 T-90hr,
212	15.74	1.600	258.0 32719.8	61.58	-6.629	14.10	35.23	6.5408; trap level; 8.436 T-90hr,
269	14.43	1.600	412.1 27015.9	74.42	-9.596	20.37	63.81	10.443; local maximum rise or fall; 7.935 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.03203; CL(m): 22.520

Lmz(m): 22.552

forced entrain 1 2.252 3.642 10.47 1.000

Rate sec-1 0.00019608 dy-1 16.9412 kt: 0.000080118 Amb Sal 29.7168

4/3 Power Law. Farfield dispersion based on wastefield width of 13.51 m

conc	dilutn	width	distnce	time	bckgrnd	decay	current	cur-dir	eddydif
(col/dl)		(m)	(m)	(hrs)	(col/dl)	(ly/hr)	(cm/s)	angle(m0.67/s2)	
27015.9	74.42	13.51	22.52	2.78E-4	0.0	16.25	1.600	120.0	3.00E-4
11807.9	646.9	162.2	183.0	2.786	0.0	16.25	1.600	120.0	3.00E-4
2638.61	760.1	190.6	205.5	3.177	0.0	16.25	1.600	120.0	3.00E-4

count: 1

;

5:41:17 AM. amb fills: 4

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)
This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm.
The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)^{4/3}$.

INPUT						
4/3 Power Law $E_o = (\alpha)(width)^{4/3}$ (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	74.42	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	13.51	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	22.52	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	183	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width)^{4/3} m^2/sec$	0.0003					
4. Horizontal current speed (m/sec)	0.016	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	2.70E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.96E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
		$E_o = 9.6530E-03 \text{ m}^2/s$ $Beta = 5.3588E-01 \text{ unitless}$				
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	2.786111 111	160.48	183	6.47E+02	3.11E+03	650

Sitka (model output for 1*depth, 2*depth, 5*depth and 10*depth)

Contents of the memo box (may not be current and must be updated manually)
 Project "C:\Plumes20\Sitka" memo

Model configuration items checked: Brooks far-field solution; Report effective dilution; ;

Channel width (m) 100
 Start case for graphs 1
 Max detailed graphs 10 (limits plots that can overflow memory)
 Elevation Projection Plane (deg) 0
 Shore vector (m,deg) not checked
 Bacteria model : Mancini (1978) coliform model
 PDS sfc. model heat transfer : Medium
 Equation of State : S, T
 Similarity Profile : Default profile (k=2.0, ...)
 Diffuser port contraction coefficient 1
 Light absorption coefficient 0.16
 Farfield increment (m) 100
 UM3 aspiration coefficient 0.1
 Output file: text output tab
 Output each ?? steps 100
 Maximum dilution reported 100000
 Text output format : Standard
 Max vertical reversals : to max rise or fall

/ uDKHLRD; for extra details examine output file \Plumes20\dkhwisp.out

Case 1; ambient file C:\Plumes20\Sitka_C_Jul10.005.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-l	m/s	deg	m0.67/s2	sigma-T
0.0	0.017	225.0	26.60	12.70	0.0	0.000196	0.017	225.0	0.0003	19.98988
1.000	0.017	225.0	26.60	12.70	0.0	0.000198	0.017	225.0	0.0003	19.98988
5.000	0.017	225.0	28.20	12.20	0.0	0.000198	0.017	225.0	0.0003	21.31369
10.00	0.017	225.0	29.10	11.60	0.0	0.000198	0.017	225.0	0.0003	22.11543
15.00	0.017	225.0	29.60	10.60	0.0	0.000197	0.017	225.0	0.0003	22.67329
20.00	0.017	225.0	29.80	9.800	0.0	0.000197	0.017	225.0	0.0003	22.95817
25.00	0.017	225.0	29.90	9.500	0.0	0.000196	0.017	225.0	0.0003	23.08290
30.00	0.017	225.0	29.90	9.100	0.0	0.000196	0.017	225.0	0.0003	23.14401

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
4.0000	0.0	300.00	0.0	0.0	16.000	13.000	24.400	200.00	23.940	5.3000	0.0 15.000
3.74E+6											

Simulation:

Froude No: 11.60; Strat No: 5.45E-4; Spcg No: 39.00; k: 105.3; eff den (sigmaT) -0.836341; eff vel 1.790(m/s);

Step	Depth (m)	Amb-cur (cm/s)	P-dia (in)	Polutnt (col/dl)	net Dil ()	x-posn (m)	y-posn (m)	Time (s)	Iso dia (m)
0	23.94	1.700	4.000	3.740E+6	0.0	0.0	0.0	0.0	0.1014; 11.44 T-90hr,
1	23.94	1.700	4.000	3.740E+6	1.000	0.0	0.0	0.0	0.1016; 11.44 T-90hr,
2	23.93	1.700	10.94	1.929E+6	1.939	-0.497	0.285	0.320	0.2780; 11.43 T-90hr,
3	23.92	1.700	14.30	1.472E+6	2.540	-0.585	0.334	0.385	0.3632; 11.43 T-90hr,
5	23.90	1.700	21.15	988111.0	3.785	-0.763	0.432	0.566	0.5372; 11.42 T-90hr,
7	23.87	1.700	28.20	733621.0	5.098	-0.940	0.527	0.820	0.7162; 11.41 T-90hr,
9	23.80	1.700	38.91	519516.6	7.199	-1.202	0.662	1.331	0.9883; 11.38 T-90hr,
11	23.64	1.700	52.78	364415.9	10.26	-1.539	0.825	2.240	1.3405; 11.32 T-90hr,
13	23.42	1.700	63.65	283591.1	13.19	-1.848	0.963	3.349	1.6165; merging; 11.24 T-90hr,
17	22.83	1.700	76.78	206140.1	18.14	-2.365	1.164	5.764	1.9498; 11.01 T-90hr,
21	22.14	1.700	87.81	163240.4	22.91	-2.776	1.297	8.271	2.2298; 10.75 T-90hr,
27	21.03	1.700	104.8	125663.6	29.76	-3.270	1.419	12.28	2.6616; 10.33 T-90hr,
55	19.66	1.700	131.6	99789.2	37.48	-3.747	1.497	17.53	3.3416; 9.805 T-90hr,
67	17.85	1.700	164.7	79160.1	47.25	-4.268	1.537	24.48	4.1811; 9.113 T-90hr,
79	15.49	1.700	218.5	62651.8	59.70	-4.873	1.525	33.78	5.5450; 8.222 T-90hr,
133	12.24	1.700	351.2	49337.1	75.81	-5.704	1.423	48.38	8.9048; 7.033 T-90hr,
151	9.808	1.700	947.0	43327.2	86.32	-6.744	1.206	68.20	24.008; 6.180 T-90hr,

4/3 Power Law. Farfield dispersion based on wastefield width of 83.49 m

conc (col/dl)	dilutn (m)	width (m)	distnce (hrs)	time (col/dl)	bckgrnd (ly/hr)	decay (cm/s)	current angle(m0.67/s2)	cur-dir	eddydif
43327.2	86.32	83.51	6.851	2.78E-4	0.0	8.000	1.700	225.0	3.00E-4 5.5441E-5
3.53E+6	87.12	100.3	24.40	0.287	0.0	8.000	1.700	225.0	3.00E-4 5.5441E-5
9.94E+5	89.08	107.1	31.25	0.399	0.0	8.000	1.700	225.0	3.00E-4 5.5441E-5

count: 1

;

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)$.

INPUT						
<p align="center">Linear Eddy Diffusivity $E_o = (\alpha)(width)$ (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	86.32	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	83.49	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	6.851	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	24.4	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width) m^2/sec$	1.31E-03					
4. Horizontal current speed (m/sec)	0.017	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	4.33E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.95E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			$E_o = 1.0947E-01 \quad m^2/s$ $Beta = 9.2555E-01 \quad \text{unitless}$			
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	2.87E-01	17.549	24.40	8.70E+01	4.30E+04	87

/ uDKHLRD; for extra details examine output file \Plumes20\dkhwisp.out

Case 1; ambient file C:\Plumes20\Sitka_C_Jul10.005.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spd	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.017	225.0	26.60	12.70	0.0	0.000196	0.017	225.0	0.0003
1.000	0.017	225.0	26.60	12.70	0.0	0.000198	0.017	225.0	0.0003
5.000	0.017	225.0	28.20	12.20	0.0	0.000198	0.017	225.0	0.0003
10.00	0.017	225.0	29.10	11.60	0.0	0.000198	0.017	225.0	0.0003
15.00	0.017	225.0	29.60	10.60	0.0	0.000197	0.017	225.0	0.0003
20.00	0.017	225.0	29.80	9.800	0.0	0.000197	0.017	225.0	0.0003
25.00	0.017	225.0	29.90	9.500	0.0	0.000196	0.017	225.0	0.0003
30.00	0.017	225.0	29.90	9.100	0.0	0.000196	0.017	225.0	0.0003

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
4.0000	0.0	300.00	0.0	0.0	16.000	13.000	48.800	200.00	23.940	5.3000	0.0
3.74E+6											

Simulation:

Froude No: 11.60; Strat No: 5.45E-4; Spcg No: 39.00; k: 105.3; eff den (sigmaT) -0.836341; eff vel 1.790(m/s);

Depth	Amb-cur	P-dia	Polutnt	net Dil	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(s)	(m)
0	23.94	1.700	4.000 3.740E+6	1.000	0.0	0.0	0.0	0.1014; 11.44 T-90hr,
1	23.94	1.700	4.000 3.740E+6	1.000	0.0	0.0	0.0	0.1016; 11.44 T-90hr,
2	23.93	1.700	10.94 1.929E+6	1.939	-0.497	0.285	0.320	0.2780; 11.43 T-90hr,
3	23.92	1.700	14.30 1.472E+6	2.540	-0.585	0.334	0.385	0.3632; 11.43 T-90hr,
5	23.90	1.700	21.15 988111.0	3.785	-0.763	0.432	0.566	0.5372; 11.42 T-90hr,
7	23.87	1.700	28.20 733621.0	5.098	-0.940	0.527	0.820	0.7162; 11.41 T-90hr,
9	23.80	1.700	38.91 519516.6	7.199	-1.202	0.662	1.331	0.9883; 11.38 T-90hr,
11	23.64	1.700	52.78 364415.9	10.26	-1.539	0.825	2.240	1.3405; 11.32 T-90hr,
13	23.42	1.700	63.65 283591.1	13.19	-1.848	0.963	3.349	1.6165; merging; 11.24 T-90hr,
17	22.83	1.700	76.78 206140.1	18.14	-2.365	1.164	5.764	1.9498; 11.01 T-90hr,
21	22.14	1.700	87.81 163240.4	22.91	-2.776	1.297	8.271	2.2298; 10.75 T-90hr,
27	21.03	1.700	104.8 125663.6	29.76	-3.270	1.419	12.28	2.6616; 10.33 T-90hr,
55	19.66	1.700	131.6 99789.2	37.48	-3.747	1.497	17.53	3.3416; 9.805 T-90hr,
67	17.85	1.700	164.7 79160.1	47.25	-4.268	1.537	24.48	4.1811; 9.113 T-90hr,
79	15.49	1.700	218.5 62651.8	59.70	-4.873	1.525	33.78	5.5450; 8.222 T-90hr,
133	12.24	1.700	351.2 49337.1	75.81	-5.704	1.423	48.38	8.9048; 7.033 T-90hr,
151	9.808	1.700	947.0 43327.2	86.32	-6.744	1.206	68.20	24.008; 6.180 T-90hr,
4/3 Power Law. Farfield dispersion based on wastefield width of 83.49 m								
conc dilutn width distnce time bckgrnd decay current cur-dir eddydif								
(col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)								
43327.2	86.32	83.51	6.851	2.78E-4	0.0	8.000	1.700	225.0 3.00E-4 5.5441E-5

3.26E+6	98.22	125.2	48.80	0.686	0.0	8.000	1.700	225.0	3.00E-4	5.5441E-5
2.14E+5	102.8	132.5	55.65	0.798	0.0	8.000	1.700	225.0	3.00E-4	5.5441E-5

count: 1
;

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)$.

INPUT						
<p align="center">Linear Eddy Diffusivity $E_o = (\alpha)(width)$ (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	86.32	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	83.49	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	6.851	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	48.8	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width) m^2/sec$	1.31E-03					
4. Horizontal current speed (m/sec)	0.017	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	4.33E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.95E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			$E_o = 1.0947E-01 \text{ m}^2/s$ $Beta = 9.2555E-01 \text{ unitless}$			
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	6.85E-01	41.949	48.80	9.65E+01	3.87E+04	97

/ uDKHLRD; for extra details examine output file \Plumes20\dkhwhisp.out

Case 1; ambient file C:\Plumes20\Sitka_C_Jul10.005.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.017	225.0	26.60	12.70	0.0	0.000196	0.017	225.0	0.0003
1.000	0.017	225.0	26.60	12.70	0.0	0.000198	0.017	225.0	0.0003
5.000	0.017	225.0	28.20	12.20	0.0	0.000198	0.017	225.0	0.0003
10.00	0.017	225.0	29.10	11.60	0.0	0.000198	0.017	225.0	0.0003
15.00	0.017	225.0	29.60	10.60	0.0	0.000197	0.017	225.0	0.0003
20.00	0.017	225.0	29.80	9.800	0.0	0.000197	0.017	225.0	0.0003
25.00	0.017	225.0	29.90	9.500	0.0	0.000196	0.017	225.0	0.0003
30.00	0.017	225.0	29.90	9.100	0.0	0.000196	0.017	225.0	0.0003

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
4.0000	0.0	300.00	0.0	0.0	16.000	13.000	122.00	200.00	23.940	5.3000	0.0
3.74E+6											

Simulation:

Froude No: 11.60; Strat No: 5.45E-4; Spcg No: 39.00; k: 105.3; eff den (sigmaT) -0.836341; eff vel 1.790(m/s);

Step	Depth	Amb-cur	P-dia	Polutnt	net Dil	x-posn	y-posn	Time	Iso dia
	(m)	(cm/s)	(in)	(col/dl)	()	(m)	(m)	(s)	(m)
0	23.94	1.700	4.000	3.740E+6	1.000	0.0	0.0	0.0	0.1014; 11.44 T-90hr,
1	23.94	1.700	4.000	3.740E+6	1.000	0.0	0.0	0.0	0.1016; 11.44 T-90hr,
2	23.93	1.700	10.94	1.929E+6	1.939	-0.497	0.285	0.320	0.2780; 11.43 T-90hr,
3	23.92	1.700	14.30	1.472E+6	2.540	-0.585	0.334	0.385	0.3632; 11.43 T-90hr,
5	23.90	1.700	21.15	988111.0	3.785	-0.763	0.432	0.566	0.5372; 11.42 T-90hr,
7	23.87	1.700	28.20	733621.0	5.098	-0.940	0.527	0.820	0.7162; 11.41 T-90hr,
9	23.80	1.700	38.91	519516.6	7.199	-1.202	0.662	1.331	0.9883; 11.38 T-90hr,
11	23.64	1.700	52.78	364415.9	10.26	-1.539	0.825	2.240	1.3405; 11.32 T-90hr,
13	23.42	1.700	63.65	283591.1	13.19	-1.848	0.963	3.349	1.6165; merging; 11.24 T-90hr,
17	22.83	1.700	76.78	206140.1	18.14	-2.365	1.164	5.764	1.9498; 11.01 T-90hr,
21	22.14	1.700	87.81	163240.4	22.91	-2.776	1.297	8.271	2.2298; 10.75 T-90hr,
27	21.03	1.700	104.8	125663.6	29.76	-3.270	1.419	12.28	2.6616; 10.33 T-90hr,
55	19.66	1.700	131.6	99789.2	37.48	-3.747	1.497	17.53	3.3416; 9.805 T-90hr,
67	17.85	1.700	164.7	79160.1	47.25	-4.268	1.537	24.48	4.1811; 9.113 T-90hr,
79	15.49	1.700	218.5	62651.8	59.70	-4.873	1.525	33.78	5.5450; 8.222 T-90hr,
133	12.24	1.700	351.2	49337.1	75.81	-5.704	1.423	48.38	8.9048; 7.033 T-90hr,
151	9.808	1.700	947.0	43327.2	86.32	-6.744	1.206	68.20	24.008; 6.180 T-90hr,
4/3 Power Law. Farfield dispersion based on wastefield width of 83.49 m									
	conc	dilutn	width	distnce	time	bckgrnd	decay	current	cur-dir
	(col/dl)	(m)	(m)	(hrs)	(col/dl)	(ly/hr)	(cm/s)	angle(m0.67/s2)	eddydif
	43327.2	86.32	83.51	6.851	2.78E-4	0.0	8.000	1.700	225.0
	2.76E+6	138.1	183.2	100.0	1.522	0.0	8.000	1.700	225.0

46877.1 236.4 315.8 200.0 3.156 0.0 8.000 1.700 225.0 3.00E-4 5.5441E-5
 23592.2 243.8 325.7 206.9 3.268 0.0 8.000 1.700 225.0 3.00E-4 5.5441E-5
 count: 2
 ;

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (Eo in m²/sec) is calculated as Eo = (alpha)(width).

INPUT						
<p align="center">Linear Eddy Diffusivity Eo=(alpha)(width) (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	86.32	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	83.49	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	6.851	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	122	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where Eo=(alpha)(width) m ² /sec	1.31E-03					
4. Horizontal current speed (m/sec)	0.017	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	4.33E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day ⁻¹)	1.95E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			Eo =	1.0947E-01	m ² /s	
			Beta =	9.2555E-01	unitless	
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	1.88E+00	115.149	122.00	1.43E+02	2.61E+04	143

/ uDKHLRD; for extra details examine output file \Plumes20\dkhwhisp.out

Case 1; ambient file C:\Plumes20\Sitka_C_Jul10.005.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2
0.0	0.017	225.0	26.60	12.70	0.0	0.000196	0.017	225.0	0.0003
1.000	0.017	225.0	26.60	12.70	0.0	0.000198	0.017	225.0	0.0003
5.000	0.017	225.0	28.20	12.20	0.0	0.000198	0.017	225.0	0.0003
10.00	0.017	225.0	29.10	11.60	0.0	0.000198	0.017	225.0	0.0003
15.00	0.017	225.0	29.60	10.60	0.0	0.000197	0.017	225.0	0.0003
20.00	0.017	225.0	29.80	9.800	0.0	0.000197	0.017	225.0	0.0003
25.00	0.017	225.0	29.90	9.500	0.0	0.000196	0.017	225.0	0.0003
30.00	0.017	225.0	29.90	9.100	0.0	0.000196	0.017	225.0	0.0003

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	(ft)	(m)	(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
4.0000	0.0	300.00	0.0	0.0	16.000	13.000	244.00	200.00	23.940	5.3000	0.0
3.74E+6											

Simulation:

Froude No: 11.60; Strat No: 5.45E-4; Spcg No: 39.00; k: 105.3; eff den (sigmaT) -0.836341; eff vel 1.790(m/s);

Step	Depth	Amb-cur	P-dia	Polutnt	net Dil	x-posn	y-posn	Time	Iso dia
	(m)	(cm/s)	(in)	(col/dl)	(ft)	(m)	(m)	(s)	(m)
0	23.94	1.700	4.000	3.740E+6	1.000	0.0	0.0	0.0	0.1014; 11.44 T-90hr,
1	23.94	1.700	4.000	3.740E+6	1.000	0.0	0.0	0.0	0.1016; 11.44 T-90hr,
2	23.93	1.700	10.94	1.929E+6	1.939	-0.497	0.285	0.320	0.2780; 11.43 T-90hr,
3	23.92	1.700	14.30	1.472E+6	2.540	-0.585	0.334	0.385	0.3632; 11.43 T-90hr,
5	23.90	1.700	21.15	988111.0	3.785	-0.763	0.432	0.566	0.5372; 11.42 T-90hr,
7	23.87	1.700	28.20	733621.0	5.098	-0.940	0.527	0.820	0.7162; 11.41 T-90hr,
9	23.80	1.700	38.91	519516.6	7.199	-1.202	0.662	1.331	0.9883; 11.38 T-90hr,
11	23.64	1.700	52.78	364415.9	10.26	-1.539	0.825	2.240	1.3405; 11.32 T-90hr,
13	23.42	1.700	63.65	283591.1	13.19	-1.848	0.963	3.349	1.6165; merging; 11.24 T-90hr,
17	22.83	1.700	76.78	206140.1	18.14	-2.365	1.164	5.764	1.9498; 11.01 T-90hr,
21	22.14	1.700	87.81	163240.4	22.91	-2.776	1.297	8.271	2.2298; 10.75 T-90hr,
27	21.03	1.700	104.8	125663.6	29.76	-3.270	1.419	12.28	2.6616; 10.33 T-90hr,
55	19.66	1.700	131.6	99789.2	37.48	-3.747	1.497	17.53	3.3416; 9.805 T-90hr,
67	17.85	1.700	164.7	79160.1	47.25	-4.268	1.537	24.48	4.1811; 9.113 T-90hr,
79	15.49	1.700	218.5	62651.8	59.70	-4.873	1.525	33.78	5.5450; 8.222 T-90hr,
133	12.24	1.700	351.2	49337.1	75.81	-5.704	1.423	48.38	8.9048; 7.033 T-90hr,
151	9.808	1.700	947.0	43327.2	86.32	-6.744	1.206	68.20	24.008; 6.180 T-90hr,
4/3 Power Law. Farfield dispersion based on wastefield width of 83.49 m									
	conc	dilutn	width	distnce	time	bckgrnd	decay	current	cur-dir
	(col/dl)	(m)	(m)	(hrs)	(col/dl)	(ly/hr)	(cm/s)	angle(m0.67/s2)	eddydif
	43327.2	86.32	83.51	6.851	2.78E-4	0.0	8.000	1.700	225.0
	2.76E+6	138.1	183.2	100.0	1.522	0.0	8.000	1.700	225.0

46877.1 236.4 315.8 200.0 3.156 0.0 8.000 1.700 225.0 3.00E-4 5.5441E-5
 17411.5 352.0 470.5 300.0 4.790 0.0 8.000 1.700 225.0 3.00E-4 5.5441E-5
 13591.4 360.5 481.8 306.9 4.902 0.0 8.000 1.700 225.0 3.00E-4 5.5441E-5

count: 3

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (Eo in m²/sec) is calculated as $E_o = (\alpha)(\text{width})$.

INPUT						
Linear Eddy Diffusivity $E_o = (\alpha)(\text{width})$ (Grace/Brooks equation 7-65)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	86.32	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	83.49	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	6.851	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	244	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(\text{width})$ m ² /sec	1.31E-03					
4. Horizontal current speed (m/sec)	0.017	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	4.33E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day ⁻¹)	1.95E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
		Eo = 1.0947E-01 m ² /s				
		Beta = 9.2555E-01 unitless				
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	3.87E+00	237.149	244.00	2.27E+02	1.65E+04	227

Skagway (model output for 1*depth, 2*depth, 5*depth and 10*depth)

Contents of the memo box (may not be current and must be updated manually)
 Project "C:\Plumes20\Skagway" memo

Model configuration items checked: Brooks far-field solution;

Channel width (m) 100

Start case for graphs 1

Max detailed graphs 10 (limits plots that can overflow memory)

Elevation Projection Plane (deg) 0

Shore vector (m,deg) not checked

Bacteria model : Mancini (1978) coliform model

PDS sfc. model heat transfer : Medium

Equation of State : S, T

Similarity Profile : Default profile (k=2.0, ...)

Diffuser port contraction coefficient 0.61

Light absorption coefficient 0.16

Farfield increment (m) 200

UM3 aspiration coefficient 0.1

Output file: text output tab

Output each ?? steps 100

Maximum dilution reported 100000

Text output format : Standard

Max vertical reversals : to max rise or fall

/ UM3. 6/23/2021 5:51:09 AM

Case 1; ambient file C:\Plumes20\Skagway_1_Jun05.005.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-sp	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-l	m/s	deg	m0.67/s2	sigma-T
0.0	0.014	350.0	7.100	11.12	0.0	0.000194	0.014	350.0	0.0003	5.180276
1.523	0.014	350.0	14.16	10.08	0.0	0.000197	0.014	350.0	0.0003	10.78304
3.047	0.014	350.0	23.30	8.650	0.0	0.000197	0.014	350.0	0.0003	18.06627
4.570	0.014	350.0	23.25	8.670	0.0	0.000196	0.014	350.0	0.0003	18.02474
6.090	0.014	350.0	25.20	8.220	0.0	0.000196	0.014	350.0	0.0003	19.60292
7.617	0.014	350.0	26.37	8.020	0.0	0.000196	0.014	350.0	0.0003	20.54204
9.140	0.014	350.0	26.74	7.980	0.0	0.000195	0.014	350.0	0.0003	20.83621
10.45	0.014	350.0	27.46	7.570	0.0	0.000195	0.014	350.0	0.0003	21.45192
11.75	0.014	350.0	28.24	7.100	0.0	0.000195	0.014	350.0	0.0003	22.12180
13.06	0.014	350.0	28.92	6.920	0.0	0.000195	0.014	350.0	0.0003	22.67724
14.37	0.014	350.0	29.08	6.880	0.0	0.000195	0.014	350.0	0.0003	22.80770
15.68	0.014	350.0	29.29	6.790	0.0	0.000195	0.014	350.0	0.0003	22.98359
16.98	0.014	350.0	30.42	6.260	0.0	0.000195	0.014	350.0	0.0003	23.93584
20.00	0.014	350.0	33.05	5.029	0.0	0.000195	0.014	350.0	0.0003	26.14924

Diffuser table:

P-dia VertAng H-Angle SourceX SourceY Ports Spacing MZ-dis Isoplth P-depth Ttl-flo Eff-sal
 Temp Polutnt

(in) (deg) (deg) (m) (m) () (ft) (m)(concent) (m) (MGD) (psu) (C)(col/dl)
 3.0000 0.0 350.00 0.0 0.0 8.0000 3.5000 18.300 200.00 18.150 0.6300 0.0 17.300
 2.59E+6

Simulation:

Froude No: 10.06; Strat No: 2.47E-3; Spcg No: 17.93; k: 88.59; eff den (sigmaT) -1.214163; eff vel
 1.240(m/s);

Step	Depth (m)	Amb-cur (cm/s)	P-dia (in)	Polutnt (col/dl)	Dilutn ()	x-posn (m)	y-posn (m)	Time (s)	Iso dia (m)	
0	18.15	1.400	2.343	2.590E+6	1.000	0.0	0.0	0.0	0.0594;	9.458 T-90hr,
100	18.07	1.400	12.32	471750.7	5.490	0.639	-0.113	1.673	0.3130;	9.424 T-90hr,
200	17.61	1.400	21.87	219905.3	11.77	1.318	-0.232	6.056	0.5554;	9.240 T-90hr,
267	16.05	1.400	42.65	85238.4	30.34	2.296	-0.405	19.44	1.0826;	trap level, merging;
										8.615 T-90hr,
300	15.34	1.400	63.27	67833.1	38.10	2.732	-0.482	28.58	1.6057;	8.339 T-90hr,
318	15.20	1.400	71.39	65187.4	39.64	2.853	-0.503	31.31	1.8117;	begin overlap; 8.285
										T-90hr,
400	14.95	1.400	94.95	62151.2	41.55	3.192	-0.563	39.26	2.4091;	8.187 T-90hr,
480	14.90	1.400	102.6	61721.1	41.83	3.409	-0.601	44.43	2.6036;	local maximum rise or
										fall; 8.170 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0000; CL(m): 3.4620

Lmz(m): 3.4620

forced entrain 1 14.06 3.247 2.606 1.000

Rate sec-1 0.00019534 dy-1 16.8772 kt: 0.000078146 Amb Sal 29.1654

4/3 Power Law. Farfield dispersion based on wastefield width of 10.07 m

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif

(col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)

61721.1 41.83 10.08 3.462 2.78E-4 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5

55457.0 59.02 19.36 18.30 0.295 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5

38485.5 66.05 21.80 21.76 0.363 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5

count: 1

;

5:51:09 AM. amb fills: 4

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)$.

INPUT						
<p align="center">Linear Eddy Diffusivity $E_o = (\alpha)(width)$ (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	41.83	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	10.07	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	3.462	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	18.3	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width) m^2/sec$	6.48E-04					
4. Horizontal current speed (m/sec)	0.014	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	6.17E+04	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.95E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			$E_o = 6.5237E-03 \quad m^2/s$ $Beta = 5.5529E-01 \quad \text{unitless}$			
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	2.94E-01	14.838	18.30	5.61E+01	4.60E+04	56

/ UM3. 6/23/2021 5:51:23 AM

Case 1; ambient file C:\Plumes20\Skagway_1_Jun05.005.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2	sigma-T
0.0	0.014	350.0	7.100	11.12	0.0	0.000194	0.014	350.0	0.0003	5.180276
1.523	0.014	350.0	14.16	10.08	0.0	0.000197	0.014	350.0	0.0003	10.78304
3.047	0.014	350.0	23.30	8.650	0.0	0.000197	0.014	350.0	0.0003	18.06627
4.570	0.014	350.0	23.25	8.670	0.0	0.000196	0.014	350.0	0.0003	18.02474
6.090	0.014	350.0	25.20	8.220	0.0	0.000196	0.014	350.0	0.0003	19.60292
7.617	0.014	350.0	26.37	8.020	0.0	0.000196	0.014	350.0	0.0003	20.54204
9.140	0.014	350.0	26.74	7.980	0.0	0.000196	0.014	350.0	0.0003	20.83621
10.45	0.014	350.0	27.46	7.570	0.0	0.000195	0.014	350.0	0.0003	21.45192
11.75	0.014	350.0	28.24	7.100	0.0	0.000195	0.014	350.0	0.0003	22.12180
13.06	0.014	350.0	28.92	6.920	0.0	0.000195	0.014	350.0	0.0003	22.67724
14.37	0.014	350.0	29.08	6.880	0.0	0.000195	0.014	350.0	0.0003	22.80770
15.68	0.014	350.0	29.29	6.790	0.0	0.000195	0.014	350.0	0.0003	22.98359
16.98	0.014	350.0	30.42	6.260	0.0	0.000195	0.014	350.0	0.0003	23.93584
20.00	0.014	350.0	33.05	5.029	0.0	0.000195	0.014	350.0	0.0003	26.14924

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.0000	0.0	350.00	0.0	0.0	8.0000	3.5000	36.600	200.00	18.150	0.6300	0.0 17.300
2.59E+6											

Simulation:

Froude No: 10.06; Strat No: 2.47E-3; Spcg No: 17.93; k: 88.59; eff den (sigmaT) -1.214163; eff vel 1.240(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(s)	(m)
0	18.15	1.400	2.343 2.590E+6	1.000	0.0	0.0	0.0	0.05945; 9.458 T-90hr,
100	18.07	1.400	12.32 471750.7	5.490	0.639	-0.113	1.673	0.3130; 9.424 T-90hr,
200	17.61	1.400	21.87 219905.3	11.77	1.318	-0.232	6.056	0.5554; 9.240 T-90hr,
267	16.05	1.400	42.65 85238.4	30.34	2.296	-0.405	19.44	1.0826; trap level, merging;
8.615								T-90hr,
300	15.34	1.400	63.27 67833.1	38.10	2.732	-0.482	28.58	1.6057; 8.339 T-90hr,
318	15.20	1.400	71.39 65187.4	39.64	2.853	-0.503	31.31	1.8117; begin overlap; 8.285
T-90hr,								
400	14.95	1.400	94.95 62151.2	41.55	3.192	-0.563	39.26	2.4091; 8.187 T-90hr,
480	14.90	1.400	102.6 61721.1	41.83	3.409	-0.601	44.43	2.6036; local maximum rise or
fall; 8.170								T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0000; CL(m): 3.4620

Lmz(m): 3.4620

forced entrain 1 14.06 3.247 2.606 1.000
 Rate sec-1 0.00019534 dy-1 16.8772 kt: 0.000078146 Amb Sal 29.1654
 4/3 Power Law. Farfield dispersion based on wastefield width of 10.07 m
 conc dilutn width distnce time bckgrnd decay current cur-dir eddydif
 (col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)
 61721.1 41.83 10.08 3.462 2.78E-4 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
 50071.9 100.1 33.29 36.60 0.658 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
 23499.3 108.8 36.19 40.06 0.726 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
 count: 1
 ;
 5:51:23 AM. amb fills: 4

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)$.

INPUT						
<p align="center">Linear Eddy Diffusivity $E_o = (\alpha)(width)$ (Grace/Brooks equation 7-65)</p>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	41.83	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	10.07	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	3.462	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	36.6	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width) m^2/sec$	6.48E-04					
4. Horizontal current speed (m/sec)	0.014	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional)						
Pollutant concentration after initial dilution (any units)	6.17E+04	(these inputs do not affect calculated farfield dilution factors)				
Pollutant first-order decay rate constant (day^{-1})	1.95E-04	(e.g. effluent volume fraction = 1/initial dilution)				
<p align="center">OUTPUT</p>						
			<p>$E_o = 6.5237E-03 \quad m^2/s$ $Beta = 5.5529E-01 \quad unitless$</p>			
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	6.58E-01	33.138	36.60	8.58E+01	3.01E+04	86

/ UM3. 6/23/2021 5:51:35 AM

Case 1; ambient file C:\Plumes20\Skagway_1_Jun05.005.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-l	m/s	deg	m0.67/s2	sigma-T
0.0	0.014	350.0	7.100	11.12	0.0	0.000194	0.014	350.0	0.0003	5.180276
1.523	0.014	350.0	14.16	10.08	0.0	0.000197	0.014	350.0	0.0003	10.78304
3.047	0.014	350.0	23.30	8.650	0.0	0.000197	0.014	350.0	0.0003	18.06627
4.570	0.014	350.0	23.25	8.670	0.0	0.000196	0.014	350.0	0.0003	18.02474
6.090	0.014	350.0	25.20	8.220	0.0	0.000196	0.014	350.0	0.0003	19.60292
7.617	0.014	350.0	26.37	8.020	0.0	0.000196	0.014	350.0	0.0003	20.54204
9.140	0.014	350.0	26.74	7.980	0.0	0.000196	0.014	350.0	0.0003	20.83621
10.45	0.014	350.0	27.46	7.570	0.0	0.000195	0.014	350.0	0.0003	21.45192
11.75	0.014	350.0	28.24	7.100	0.0	0.000195	0.014	350.0	0.0003	22.12180
13.06	0.014	350.0	28.92	6.920	0.0	0.000195	0.014	350.0	0.0003	22.67724
14.37	0.014	350.0	29.08	6.880	0.0	0.000195	0.014	350.0	0.0003	22.80770
15.68	0.014	350.0	29.29	6.790	0.0	0.000195	0.014	350.0	0.0003	22.98359
16.98	0.014	350.0	30.42	6.260	0.0	0.000195	0.014	350.0	0.0003	23.93584
20.00	0.014	350.0	33.05	5.029	0.0	0.000195	0.014	350.0	0.0003	26.14924

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.0000	0.0	350.00	0.0	0.0	8.0000	3.5000	91.500	200.00	18.150	0.6300	0.0 17.300
2.59E+6											

Simulation:

Froude No: 10.06; Strat No: 2.47E-3; Spcg No: 17.93; k: 88.59; eff den (sigmaT) -1.214163; eff vel 1.240(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(s)	(m)
0	18.15	1.400	2.343 2.590E+6	1.000	0.0	0.0	0.0	0.05945; 9.458 T-90hr,
100	18.07	1.400	12.32 471750.7	5.490	0.639	-0.113	1.673	0.3130; 9.424 T-90hr,
200	17.61	1.400	21.87 219905.3	11.77	1.318	-0.232	6.056	0.5554; 9.240 T-90hr,
267	16.05	1.400	42.65 85238.4	30.34	2.296	-0.405	19.44	1.0826; trap level, merging;
8.615 T-90hr,								
300	15.34	1.400	63.27 67833.1	38.10	2.732	-0.482	28.58	1.6057; 8.339 T-90hr,
318	15.20	1.400	71.39 65187.4	39.64	2.853	-0.503	31.31	1.8117; begin overlap; 8.285
T-90hr,								
400	14.95	1.400	94.95 62151.2	41.55	3.192	-0.563	39.26	2.4091; 8.187 T-90hr,
480	14.90	1.400	102.6 61721.1	41.83	3.409	-0.601	44.43	2.6036; local maximum rise or
fall; 8.170 T-90hr,								

Horiz plane projections in effluent direction: radius(m): 0.0000; CL(m): 3.4620

Lmz(m): 3.4620

forced entrain 1 14.06 3.247 2.606 1.000

Rate sec-1 0.00019534 dy-1 16.8772 kt: 0.000078146 Amb Sal 29.1654

4/3 Power Law. Farfield dispersion based on wastefield width of 10.07 m

```

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif
(col/dl)      (m)  (m)  (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)
61721.1 41.83 10.08 3.462 2.78E-4 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
36855.9 263.9 87.83 91.50 1.747 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
9323.75 275.8 91.82 94.96 1.816 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
count: 1
;
5:51:35 AM. amb fills: 4

```

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.) This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (Eo in m²/sec) is calculated as Eo = (alpha)(width).

INPUT						
<div>Linear Eddy Diffusivity</div> <div>Eo=(alpha)(width)</div> <div>(Grace/Brooks equation 7-65)</div>						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution		41.83	(e.g. dilution at end of computations with UDKHDEN)			
Estimated initial width (B) of plume after initial dilution (meters)		10.07	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)			
Travel distance of plume after initial dilution (meters)		3.462	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)			
2. Distance from outfall to mixing zone boundary (meters)		91.5	(e.g. distance to the chronic mixing zone boundary)			
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where Eo=(alpha)(width) m²/sec		6.48E-04				
4. Horizontal current speed (m/sec)		0.014	(e.g. same value specified for UDKHDEN or PLUMES)			
5. Pollutant initial concentration and decay (optional)			(these inputs do not affect calculated farfield dilution factors)			
Pollutant concentration after initial dilution (any units)		6.17E+04	(e.g. effluent volume fraction = 1/initial dilution)			
Pollutant first-order decay rate constant (day⁻¹)		1.95E-04	(e.g. enter 0 for conservative pollutants)			
OUTPUT						
			Eo =	6.5237E-03	m²/s	
			Beta =	5.5529E-01	unitless	
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	1.75E+00	88.038	91.50	1.77E+02	1.46E+04	178

/ UM3. 6/23/2021 5:51:47 AM

Case 1; ambient file C:\Plumes20\Skagway_1_Jun05.005.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdl	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2	sigma-T
0.0	0.014	350.0	7.100	11.12	0.0	0.000194	0.014	350.0	0.0003	5.180276
1.523	0.014	350.0	14.16	10.08	0.0	0.000197	0.014	350.0	0.0003	10.78304
3.047	0.014	350.0	23.30	8.650	0.0	0.000197	0.014	350.0	0.0003	18.06627
4.570	0.014	350.0	23.25	8.670	0.0	0.000196	0.014	350.0	0.0003	18.02474
6.090	0.014	350.0	25.20	8.220	0.0	0.000196	0.014	350.0	0.0003	19.60292
7.617	0.014	350.0	26.37	8.020	0.0	0.000196	0.014	350.0	0.0003	20.54204
9.140	0.014	350.0	26.74	7.980	0.0	0.000196	0.014	350.0	0.0003	20.83621
10.45	0.014	350.0	27.46	7.570	0.0	0.000195	0.014	350.0	0.0003	21.45192
11.75	0.014	350.0	28.24	7.100	0.0	0.000195	0.014	350.0	0.0003	22.12180
13.06	0.014	350.0	28.92	6.920	0.0	0.000195	0.014	350.0	0.0003	22.67724
14.37	0.014	350.0	29.08	6.880	0.0	0.000195	0.014	350.0	0.0003	22.80770
15.68	0.014	350.0	29.29	6.790	0.0	0.000195	0.014	350.0	0.0003	22.98359
16.98	0.014	350.0	30.42	6.260	0.0	0.000195	0.014	350.0	0.0003	23.93584
20.00	0.014	350.0	33.05	5.029	0.0	0.000195	0.014	350.0	0.0003	26.14924

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.0000	0.0	350.00	0.0	0.0	8.0000	3.5000	183.00	200.00	18.150	0.6300	0.0 17.300
2.59E+6											

Simulation:

Froude No: 10.06; Strat No: 2.47E-3; Spcg No: 17.93; k: 88.59; eff den (sigmaT) -1.214163; eff vel 1.240(m/s);

Depth	Amb-cur	P-dia	Polutnt	Dilutn	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(s)	(m)
0	18.15	1.400	2.343 2.590E+6	1.000	0.0	0.0	0.0	0.05945; 9.458 T-90hr,
100	18.07	1.400	12.32 471750.7	5.490	0.639	-0.113	1.673	0.3130; 9.424 T-90hr,
200	17.61	1.400	21.87 219905.3	11.77	1.318	-0.232	6.056	0.5554; 9.240 T-90hr,
267	16.05	1.400	42.65 85238.4	30.34	2.296	-0.405	19.44	1.0826; trap level, merging;
8.615 T-90hr,								
300	15.34	1.400	63.27 67833.1	38.10	2.732	-0.482	28.58	1.6057; 8.339 T-90hr,
318	15.20	1.400	71.39 65187.4	39.64	2.853	-0.503	31.31	1.8117; begin overlap; 8.285
T-90hr,								
400	14.95	1.400	94.95 62151.2	41.55	3.192	-0.563	39.26	2.4091; 8.187 T-90hr,
480	14.90	1.400	102.6 61721.1	41.83	3.409	-0.601	44.43	2.6036; local maximum rise or
fall; 8.170 T-90hr,								

Horiz plane projections in effluent direction: radius(m): 0.0000; CL(m): 3.4620

Lmz(m): 3.4620

forced entrain 1 14.06 3.247 2.606 1.000

Rate sec-1 0.00019534 dy-1 16.8772 kt: 0.000078146 Amb Sal 29.1654

4/3 Power Law. Farfield dispersion based on wastefield width of 10.07 m

```

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif
(col/dl)      (m)  (m)  (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)
61721.1 41.83 10.08 3.462 2.78E-4 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
22115.3 634.0 211.0 183.0 3.563 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
3965.60 649.9 216.3 186.5 3.631 0.0 16.30 1.400 350.0 3.00E-4 7.8146E-5
count: 1
;
5:51:47 AM. amb fills: 4
    
```

Brook's Linear Diffusivity

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the linear diffusivity Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.) This sheet differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm. The initial diffusion coefficient (Eo in m²/sec) is calculated as Eo = (alpha)(width).

INPUT						
			Linear Eddy Diffusivity Eo=(alpha)(width) (Grace/Brooks equation 7-65)			
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution			41.83	(e.g. dilution at end of computations with UDKHDEN)		
Estimated initial width (B) of plume after initial dilution (meters)			10.07	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)		
Travel distance of plume after initial dilution (meters)			3.462	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)		
2. Distance from outfall to mixing zone boundary (meters)			183	(e.g. distance to the chronic mixing zone boundary)		
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where Eo=(alpha)(width) m ² /sec			6.48E-04			
4. Horizontal current speed (m/sec)			0.014	(e.g. same value specified for UDKHDEN or PLUMES)		
5. Pollutant initial concentration and decay (optional)			(these inputs do not affect calculated farfield dilution factors)			
Pollutant concentration after initial dilution (any units)			6.17E+04	(e.g. effluent volume fraction = 1/initial dilution)		
Pollutant first-order decay rate constant (day ⁻¹)			1.95E-04	(e.g. enter 0 for conservative pollutants)		
OUTPUT						
			Eo =	6.5237E-03	m ² /s	
			Beta =	5.5529E-01	unitless	
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	3.56E+00	179.538	183.00	3.30E+02	7.82E+03	331

Wrangell (model output for 1*depth, 2*depth, 5*depth and 10*depth)

Contents of the memo box (may not be current and must be updated manually)
 Project "C:\Plumes20\Wrangell" memoQ=

Model configuration items checked: Brooks far-field solution; Report effective dilution;

Channel width (m) 100
 Start case for graphs 1
 Max detailed graphs 10 (limits plots that can overflow memory)
 Elevation Projection Plane (deg) 0
 Shore vector (m,deg) not checked
 Bacteria model : Mancini (1978) coliform model
 PDS sfc. model heat transfer : Medium
 Equation of State : S, T
 Similarity Profile : Default profile (k=2.0, ...)
 Diffuser port contraction coefficient 0.61
 Light absorption coefficient 0.16
 Farfield increment (m) 200
 UM3 aspiration coefficient 0.1
 Output file: text output tab
 Output each ?? steps 100
 Maximum dilution reported 100000
 Text output format : Standard
 Max vertical reversals : to max rise or fall

/ UM3. 8/3/2021 9:23:16 AM

Case 1; ambient file C:\Plumes20\Wrangell_4_Aug16.004.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-sp	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2	sigma-T
0.0	0.040	90.00	11.00	11.30	0.0	0.000194	0.040	90.00	0.0003	8.178952
3.000	0.040	90.00	11.00	11.30	0.0	0.000194	0.040	90.00	0.0003	8.178952
6.000	0.040	90.00	11.20	12.70	0.0	0.000194	0.040	90.00	0.0003	8.137535
9.000	0.040	90.00	12.10	12.80	0.0	0.000194	0.040	90.00	0.0003	8.815796
12.00	0.040	90.00	12.80	11.90	0.0	0.000194	0.040	90.00	0.0003	9.487716
15.00	0.040	90.00	14.00	11.10	0.0	0.000194	0.040	90.00	0.0003	10.52628
18.00	0.040	90.00	14.90	11.10	0.0	0.000194	0.040	90.00	0.0003	11.22223
21.00	0.040	90.00	15.80	11.20	0.0	0.000194	0.040	90.00	0.0003	11.90396
24.00	0.040	90.00	16.20	11.00	0.0	0.000194	0.040	90.00	0.0003	12.24129
27.00	0.040	90.00	16.80	11.00	0.0	0.000194	0.040	90.00	0.0003	12.70520
30.00	0.040	90.00	16.90	10.90	0.0	0.000194	0.040	90.00	0.0003	12.79661
31.00	0.040	90.00	16.93	10.87	0.0	0.000194	0.040	90.00	0.0003	12.82707

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)

3.9500 0.0 90.000 0.0 0.0 8.0000 32.000 30.500 200.00 30.350 3.0000 0.0 18.400
 1.91E+5

Simulation:

Froude No: 32.56; Strat No: 8.40E-4; Spcg No: 124.5; k: 85.17; eff den (sigmaT) -1.415928; eff vel 3.407(m/s);

Step	Depth (m)	Amb-cur (cm/s)	P-dia (in)	Polutnt (col/dl)	net Dil ()	x-posn (m)	y-posn (m)	Time (s)	Iso dia (m)	
0	30.35	4.000	3.085	191000.0	1.000	0.0	0.0	0.0	0.0	0.0; 14.06 T-90hr,
100	30.32	4.000	21.88	25869.1	7.383	0.000	1.223	1.461	0.5546	14.05 T-90hr,
200	29.23	4.000	75.55	6306.8	30.29	0.000	5.127	18.85	1.9038	13.64 T-90hr,
265	25.85	4.000	147.1	2462.3	77.57	0.000	9.228	57.16	3.6599	trap level; 12.34 T-90hr,
300	24.85	4.000	191.4	1914.4	99.77	0.000	10.45	72.89	4.7344	11.95 T-90hr,
301	24.84	4.000	192.3	1907.0	100.2	0.000	10.47	73.16	4.7551	begin overlap; 11.95 T-90hr,
400	24.32	4.000	227.5	1702.3	112.2	0.000	11.88	93.03	5.6075	11.75 T-90hr,
415	24.32	4.000	228.3	1697.3	112.5	0.000	12.05	95.47	5.6269	local maximum rise or fall; 11.75 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0; CL(m): 12.046

Lmz(m): 12.046

forced entrain 1 143.3 6.034 5.800 1.000

Rate sec-1 0.00019572 dy-1 16.9100 kt: 0.000054521 Amb Sal 16.2632

Plumes not merged, Brooks method may be overly conservative.

4/3 Power Law. Farfield dispersion based on wastefield width of 74.08 m

conc (col/dl)	dilutn (m)	width (m)	distnce (m)	time (hrs)	bckgrnd (col/dl)	decay (ly/hr)	current (cm/s)	cur-dir angle(m0.67/s2)	eddydif (m)
1697.28	112.0	74.09	12.05	2.78E-4	0.0	16.34	4.000	90.00	3.00E-4 5.4521E-5
1632.35	112.0	81.17	30.50	0.128	0.0	16.34	4.000	90.00	3.00E-4 5.4521E-5
1668.65	112.4	85.91	42.55	0.212	0.0	16.34	4.000	90.00	3.00E-4 5.4521E-5

count: 1

;

9:23:18 AM. amb fills: 4

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)
 This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm.
 The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)^{4/3}$.

INPUT						
4/3 Power Law Eo=(alpha)*(width) ^{4/3} (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	112	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	74.08	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	12.05	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	30.5	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where Eo=(alpha)(width) ^{4/3} m ² /sec	0.0003					
4. Horizontal current speed (m/sec)	0.04	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional)		(these inputs do not affect calculated farfield dilution factors)				
Pollutant concentration after initial dilution (any units)	1.70E+03	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day ⁻¹)	1.96E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
			Eo = 9.3337E-02 Beta = 3.7799E-01	m ² /s unitless		
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	0.128125	18.45	30.5	1.12E+02	1697	113

/ UM3. 8/3/2021 9:24:14 AM

Case 1; ambient file C:\Plumes20\Wrangell_4_Aug16.004.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spdx	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2 sigma-T
0.0	0.040	90.00	11.00	11.30	0.0	0.000195	0.040	90.00	0.0003 8.178952
3.000	0.040	90.00	11.00	11.30	0.0	0.000196	0.040	90.00	0.0003 8.178952
6.000	0.040	90.00	11.20	12.70	0.0	0.000196	0.040	90.00	0.0003 8.137535
9.000	0.040	90.00	12.10	12.80	0.0	0.000196	0.040	90.00	0.0003 8.815796
12.00	0.040	90.00	12.80	11.90	0.0	0.000196	0.040	90.00	0.0003 9.487716
15.00	0.040	90.00	14.00	11.10	0.0	0.000196	0.040	90.00	0.0003 10.52628
18.00	0.040	90.00	14.90	11.10	0.0	0.000196	0.040	90.00	0.0003 11.22223
21.00	0.040	90.00	15.80	11.20	0.0	0.000196	0.040	90.00	0.0003 11.90396
24.00	0.040	90.00	16.20	11.00	0.0	0.000196	0.040	90.00	0.0003 12.24129
27.00	0.040	90.00	16.80	11.00	0.0	0.000196	0.040	90.00	0.0003 12.70520
30.00	0.040	90.00	16.90	10.90	0.0	0.000196	0.040	90.00	0.0003 12.79661
31.00	0.040	90.00	16.93	10.87	0.0	0.000196	0.040	90.00	0.0003 12.82707

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.9500	0.0	90.000	0.0	0.0	8.0000	32.000	61.000	200.00	30.350	3.0000	0.0 18.400
1.91E+5											

Simulation:

Froude No: 32.56; Strat No: 8.40E-4; Spcg No: 124.5; k: 85.17; eff den (sigmaT) -1.415928; eff vel 3.407(m/s);

Depth	Amb-cur	P-dia	Polutnt	net Dil	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	() (m)	(m)	(s)	(m)	
0	30.35	4.000	3.085 191000.0	1.000	0.0	0.0	0.0	0.07603; 14.06 T-90hr,
100	30.32	4.000	21.88 25869.1	7.383	0.000	1.223	1.461	0.5546; 14.05 T-90hr,
200	29.23	4.000	75.55 6306.8	30.29	0.000	5.127	18.85	1.9038; 13.64 T-90hr,
265	25.85	4.000	147.1 2462.3	77.57	0.000	9.228	57.16	3.6599; trap level; 12.34 T-90hr,
300	24.85	4.000	191.4 1914.4	99.77	0.000	10.45	72.89	4.7344; 11.95 T-90hr,
301	24.84	4.000	192.3 1907.0	100.2	0.000	10.47	73.16	4.7551; begin overlap; 11.95 T-90hr,
400	24.32	4.000	227.5 1702.3	112.2	0.000	11.88	93.03	5.6075; 11.75 T-90hr,
415	24.32	4.000	228.3 1697.3	112.5	0.000	12.05	95.47	5.6269; local maximum rise or fall; 11.75 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0; CL(m): 12.046

Lmz(m): 12.046

forced entrain 1 143.3 6.034 5.800 1.000

Rate sec-1 0.00019572 dy-1 16.9100 kt: 0.000054521 Amb Sal 16.2632

Plumes not merged, Brooks method may be overly conservative.

4/3 Power Law. Farfield dispersion based on wastefield width of 74.08 m

```

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif
(col/dl)      (m)   (m)   (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)
1697.28 112.0 74.09 12.05 2.78E-4 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5
1565.88 114.7 93.35 61.00 0.340 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5
1596.09 117.5 98.31 73.05 0.424 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5
count: 1
;
9:24:14 AM. amb fills: 4

```

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)
This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm.
The initial diffusion coefficient (Eo in m²/sec) is calculated as $E_o = (\alpha)(\text{width})^{4/3}$.

INPUT						
4/3 Power Law $E_o = (\alpha)(\text{width})^{4/3}$ (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	112	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	74.08	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	12.05	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	61	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(\text{width})^{4/3}$ m ² /sec	0.0003					
4. Horizontal current speed (m/sec)	0.04	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional)						
Pollutant concentration after initial dilution (any units)	1.70E+03	(these inputs do not affect calculated farfield dilution factors)				
Pollutant first-order decay rate constant (day ⁻¹)	1.96E-04	(e.g. effluent volume fraction = 1/initial dilution) (e.g. enter 0 for conservative pollutants)				
OUTPUT						
				Eo = 9.3337E-02 m ² /s		
				Beta = 3.7799E-01 unitless		
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	0.339930556	48.95	61	1.15E+02	1657	115

/ UM3. 8/3/2021 9:24:33 AM

Case 1; ambient file C:\Plumes20\Wrangell_4_Aug16.004.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spd	Far-dir	Disprsn
Density									
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2 sigma-T
0.0	0.040	90.00	11.00	11.30	0.0	0.000195	0.040	90.00	0.0003 8.178952
3.000	0.040	90.00	11.00	11.30	0.0	0.000196	0.040	90.00	0.0003 8.178952
6.000	0.040	90.00	11.20	12.70	0.0	0.000196	0.040	90.00	0.0003 8.137535
9.000	0.040	90.00	12.10	12.80	0.0	0.000196	0.040	90.00	0.0003 8.815796
12.00	0.040	90.00	12.80	11.90	0.0	0.000196	0.040	90.00	0.0003 9.487716
15.00	0.040	90.00	14.00	11.10	0.0	0.000196	0.040	90.00	0.0003 10.52628
18.00	0.040	90.00	14.90	11.10	0.0	0.000196	0.040	90.00	0.0003 11.22223
21.00	0.040	90.00	15.80	11.20	0.0	0.000196	0.040	90.00	0.0003 11.90396
24.00	0.040	90.00	16.20	11.00	0.0	0.000196	0.040	90.00	0.0003 12.24129
27.00	0.040	90.00	16.80	11.00	0.0	0.000196	0.040	90.00	0.0003 12.70520
30.00	0.040	90.00	16.90	10.90	0.0	0.000196	0.040	90.00	0.0003 12.79661
31.00	0.040	90.00	16.93	10.87	0.0	0.000196	0.040	90.00	0.0003 12.82707

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.9500	0.0	90.000	0.0	0.0	8.0000	32.000	152.50	200.00	30.350	3.0000	0.0 18.400
1.91E+5											

Simulation:

Froude No: 32.56; Strat No: 8.40E-4; Spcg No: 124.5; k: 85.17; eff den (sigmaT) -1.415928; eff vel 3.407(m/s);

Depth	Amb-cur	P-dia	Polutnt	net Dil	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(s)	(m)
0	30.35	4.000	3.085 191000.0	1.000	0.0	0.0	0.0	0.07603; 14.06 T-90hr,
100	30.32	4.000	21.88 25869.1	7.383	0.000	1.223	1.461	0.5546; 14.05 T-90hr,
200	29.23	4.000	75.55 6306.8	30.29	0.000	5.127	18.85	1.9038; 13.64 T-90hr,
265	25.85	4.000	147.1 2462.3	77.57	0.000	9.228	57.16	3.6599; trap level; 12.34 T-90hr,
300	24.85	4.000	191.4 1914.4	99.77	0.000	10.45	72.89	4.7344; 11.95 T-90hr,
301	24.84	4.000	192.3 1907.0	100.2	0.000	10.47	73.16	4.7551; begin overlap; 11.95 T-90hr,
400	24.32	4.000	227.5 1702.3	112.2	0.000	11.88	93.03	5.6075; 11.75 T-90hr,
415	24.32	4.000	228.3 1697.3	112.5	0.000	12.05	95.47	5.6269; local maximum rise or fall; 11.75 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0; CL(m): 12.046

Lmz(m): 12.046

forced entrain 1 143.3 6.034 5.800 1.000

Rate sec-1 0.00019572 dy-1 16.9100 kt: 0.000054521 Amb Sal 16.2632

Plumes not merged, Brooks method may be overly conservative.

4/3 Power Law. Farfield dispersion based on wastefield width of 74.08 m

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif

(col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)
1697.28 112.0 74.09 12.05 2.78E-4 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5
1382.28 148.5 133.1 152.5 0.976 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5
1220.33 154.2 138.7 164.5 1.059 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5

count: 1

;

9:24:33 AM. amb fills: 4

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm.

The initial diffusion coefficient (E_o in m^2/sec) is calculated as $E_o = (\alpha)(width)^{4/3}$.

INPUT						
4/3 Power Law $E_o = (\alpha)(width)^{4/3}$ (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	112	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	74.08	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	12.05	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	152.5	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(width)^{4/3} m^2/sec$	0.0003					
4. Horizontal current speed (m/sec)	0.04	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	1.70E+03	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day^{-1})	1.96E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
		$E_o = 9.3337E-02 \text{ m}^2/s$ $Beta = 3.7799E-01 \text{ unitless}$				
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	0.975347222	140.45	152.5	1.49E+02	1280	149

/ UM3. 8/3/2021 9:24:50 AM

Case 1; ambient file C:\Plumes20\Wrangell_4_Aug16.004.db; Diffuser table record 2: -----

Ambient Table:

Depth	Amb-cur	Amb-dir	Amb-sal	Amb-tem	Amb-pol	Solar rad	Far-spd	Far-dir	Disprsn	
Density										
m	m/s	deg	psu	C	kg/kg	s-1	m/s	deg	m0.67/s2	sigma-T
0.0	0.040	90.00	11.00	11.30	0.0	0.000195	0.040	90.00	0.0003	8.178952
3.000	0.040	90.00	11.00	11.30	0.0	0.000196	0.040	90.00	0.0003	8.178952
6.000	0.040	90.00	11.20	12.70	0.0	0.000196	0.040	90.00	0.0003	8.137535
9.000	0.040	90.00	12.10	12.80	0.0	0.000196	0.040	90.00	0.0003	8.815796
12.00	0.040	90.00	12.80	11.90	0.0	0.000196	0.040	90.00	0.0003	9.487716
15.00	0.040	90.00	14.00	11.10	0.0	0.000196	0.040	90.00	0.0003	10.52628
18.00	0.040	90.00	14.90	11.10	0.0	0.000196	0.040	90.00	0.0003	11.22223
21.00	0.040	90.00	15.80	11.20	0.0	0.000196	0.040	90.00	0.0003	11.90396
24.00	0.040	90.00	16.20	11.00	0.0	0.000196	0.040	90.00	0.0003	12.24129
27.00	0.040	90.00	16.80	11.00	0.0	0.000196	0.040	90.00	0.0003	12.70520
30.00	0.040	90.00	16.90	10.90	0.0	0.000196	0.040	90.00	0.0003	12.79661
31.00	0.040	90.00	16.93	10.87	0.0	0.000196	0.040	90.00	0.0003	12.82707

Diffuser table:

P-dia	VertAng	H-Angle	SourceX	SourceY	Ports	Spacing	MZ-dis	Isoplth	P-depth	Ttl-flo	Eff-sal
Temp	Polutnt										
(in)	(deg)	(deg)	(m)	(m)	()	(ft)	(m)(concent)	(m)	(MGD)	(psu)	(C)(col/dl)
3.9500	0.0	90.000	0.0	0.0	8.0000	32.000	305.00	200.00	30.350	3.0000	0.0 18.400
1.91E+5											

Simulation:

Froude No: 32.56; Strat No: 8.40E-4; Spcg No: 124.5; k: 85.17; eff den (sigmaT) -1.415928; eff vel 3.407(m/s);

Depth	Amb-cur	P-dia	Polutnt	net Dil	x-posn	y-posn	Time	Iso dia
Step	(m)	(cm/s)	(in) (col/dl)	()	(m)	(m)	(s)	(m)
0	30.35	4.000	3.085 191000.0	1.000	0.0	0.0	0.0	0.07603; 14.06 T-90hr,
100	30.32	4.000	21.88 25869.1	7.383	0.000	1.223	1.461	0.5546; 14.05 T-90hr,
200	29.23	4.000	75.55 6306.8	30.29	0.000	5.127	18.85	1.9038; 13.64 T-90hr,
265	25.85	4.000	147.1 2462.3	77.57	0.000	9.228	57.16	3.6599; trap level; 12.34 T-90hr,
300	24.85	4.000	191.4 1914.4	99.77	0.000	10.45	72.89	4.7344; 11.95 T-90hr,
301	24.84	4.000	192.3 1907.0	100.2	0.000	10.47	73.16	4.7551; begin overlap; 11.95 T-90hr,
400	24.32	4.000	227.5 1702.3	112.2	0.000	11.88	93.03	5.6075; 11.75 T-90hr,
415	24.32	4.000	228.3 1697.3	112.5	0.000	12.05	95.47	5.6269; local maximum rise or fall; 11.75 T-90hr,

Horiz plane projections in effluent direction: radius(m): 0.0; CL(m): 12.046

Lmz(m): 12.046

forced entrain 1 143.3 6.034 5.800 1.000

Rate sec-1 0.00019572 dy-1 16.9100 kt: 0.000054521 Amb Sal 16.2632

Plumes not merged, Brooks method may be overly conservative.

4/3 Power Law. Farfield dispersion based on wastefield width of 74.08 m

conc dilutn width distnce time bckgrnd decay current cur-dir eddydif

(col/dl) (m) (m) (hrs)(col/dl) (ly/hr) (cm/s) angle(m0.67/s2)
 1697.28 112.0 74.09 12.05 2.78E-4 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5
 1295.62 171.8 155.5 200.0 1.306 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5
 819.357 286.6 261.7 400.0 2.694 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5
 642.616 294.2 268.7 412.0 2.778 0.0 16.34 4.000 90.00 3.00E-4 5.4521E-5

count: 2

;

9:24:50 AM. amb fills: 4

Brook's four-third Power Law

FARFIELD.XLS: Far-field dilution of initially diluted effluent plumes using the 4/3 power law Brooks model as presented by Grace (R.A. Grace. Marine outfall systems: planning, design, and construction. Prentice-Hall, Inc.)

This approach differs from the PLUMES approach by assuming different units for alpha depending on the far-field algorithm.

The initial diffusion coefficient (Eo in m²/sec) is calculated as $E_o = (\alpha)(\text{width})^{4/3}$.

INPUT						
4/3 Power Law $E_o = (\alpha)(\text{width})^{4/3}$ (Grace/Brooks equation 7-66)						
1. Plume and diffuser characteristics at start of far-field mixing						
Flux-average dilution factor after initial dilution	112	(e.g. dilution at end of computations with UDKHDEN)				
Estimated initial width (B) of plume after initial dilution (meters)	74.08	(e.g. eqn 70 of EPA/600/R-94/086 for diffuser length and plume diameter)				
Travel distance of plume after initial dilution (meters)	12.05	(e.g. "Y" from UDKHDEN or horizontal distance from PLUMES output)				
2. Distance from outfall to mixing zone boundary (meters)	305	(e.g. distance to the chronic mixing zone boundary)				
3. Diffusion parameter "alpha" per equations 7-62 of Grace, where $E_o = (\alpha)(\text{width})^{4/3}$ m ² /sec	0.0003					
4. Horizontal current speed (m/sec)	0.04	(e.g. same value specified for UDKHDEN or PLUMES)				
5. Pollutant initial concentration and decay (optional) (these inputs do not affect calculated farfield dilution factors)						
Pollutant concentration after initial dilution (any units)	1.70E+03	(e.g. effluent volume fraction = 1/initial dilution)				
Pollutant first-order decay rate constant (day ⁻¹)	1.96E-04	(e.g. enter 0 for conservative pollutants)				
OUTPUT						
		Eo =	9.3337E-02	m ² /s		
		Beta =	3.7799E-01	unitless		
	Far-field Travel Time (hours)	Far-field Travel Distance (m)	Total Travel Distance (m)	Effluent Dilution	Pollutant Concentration	
Dilution at mixing zone boundary:	2.034375	292.95	305	2.29E+02	829	230