


Lead and Copper Rule Improvements (LCRI) Timeline

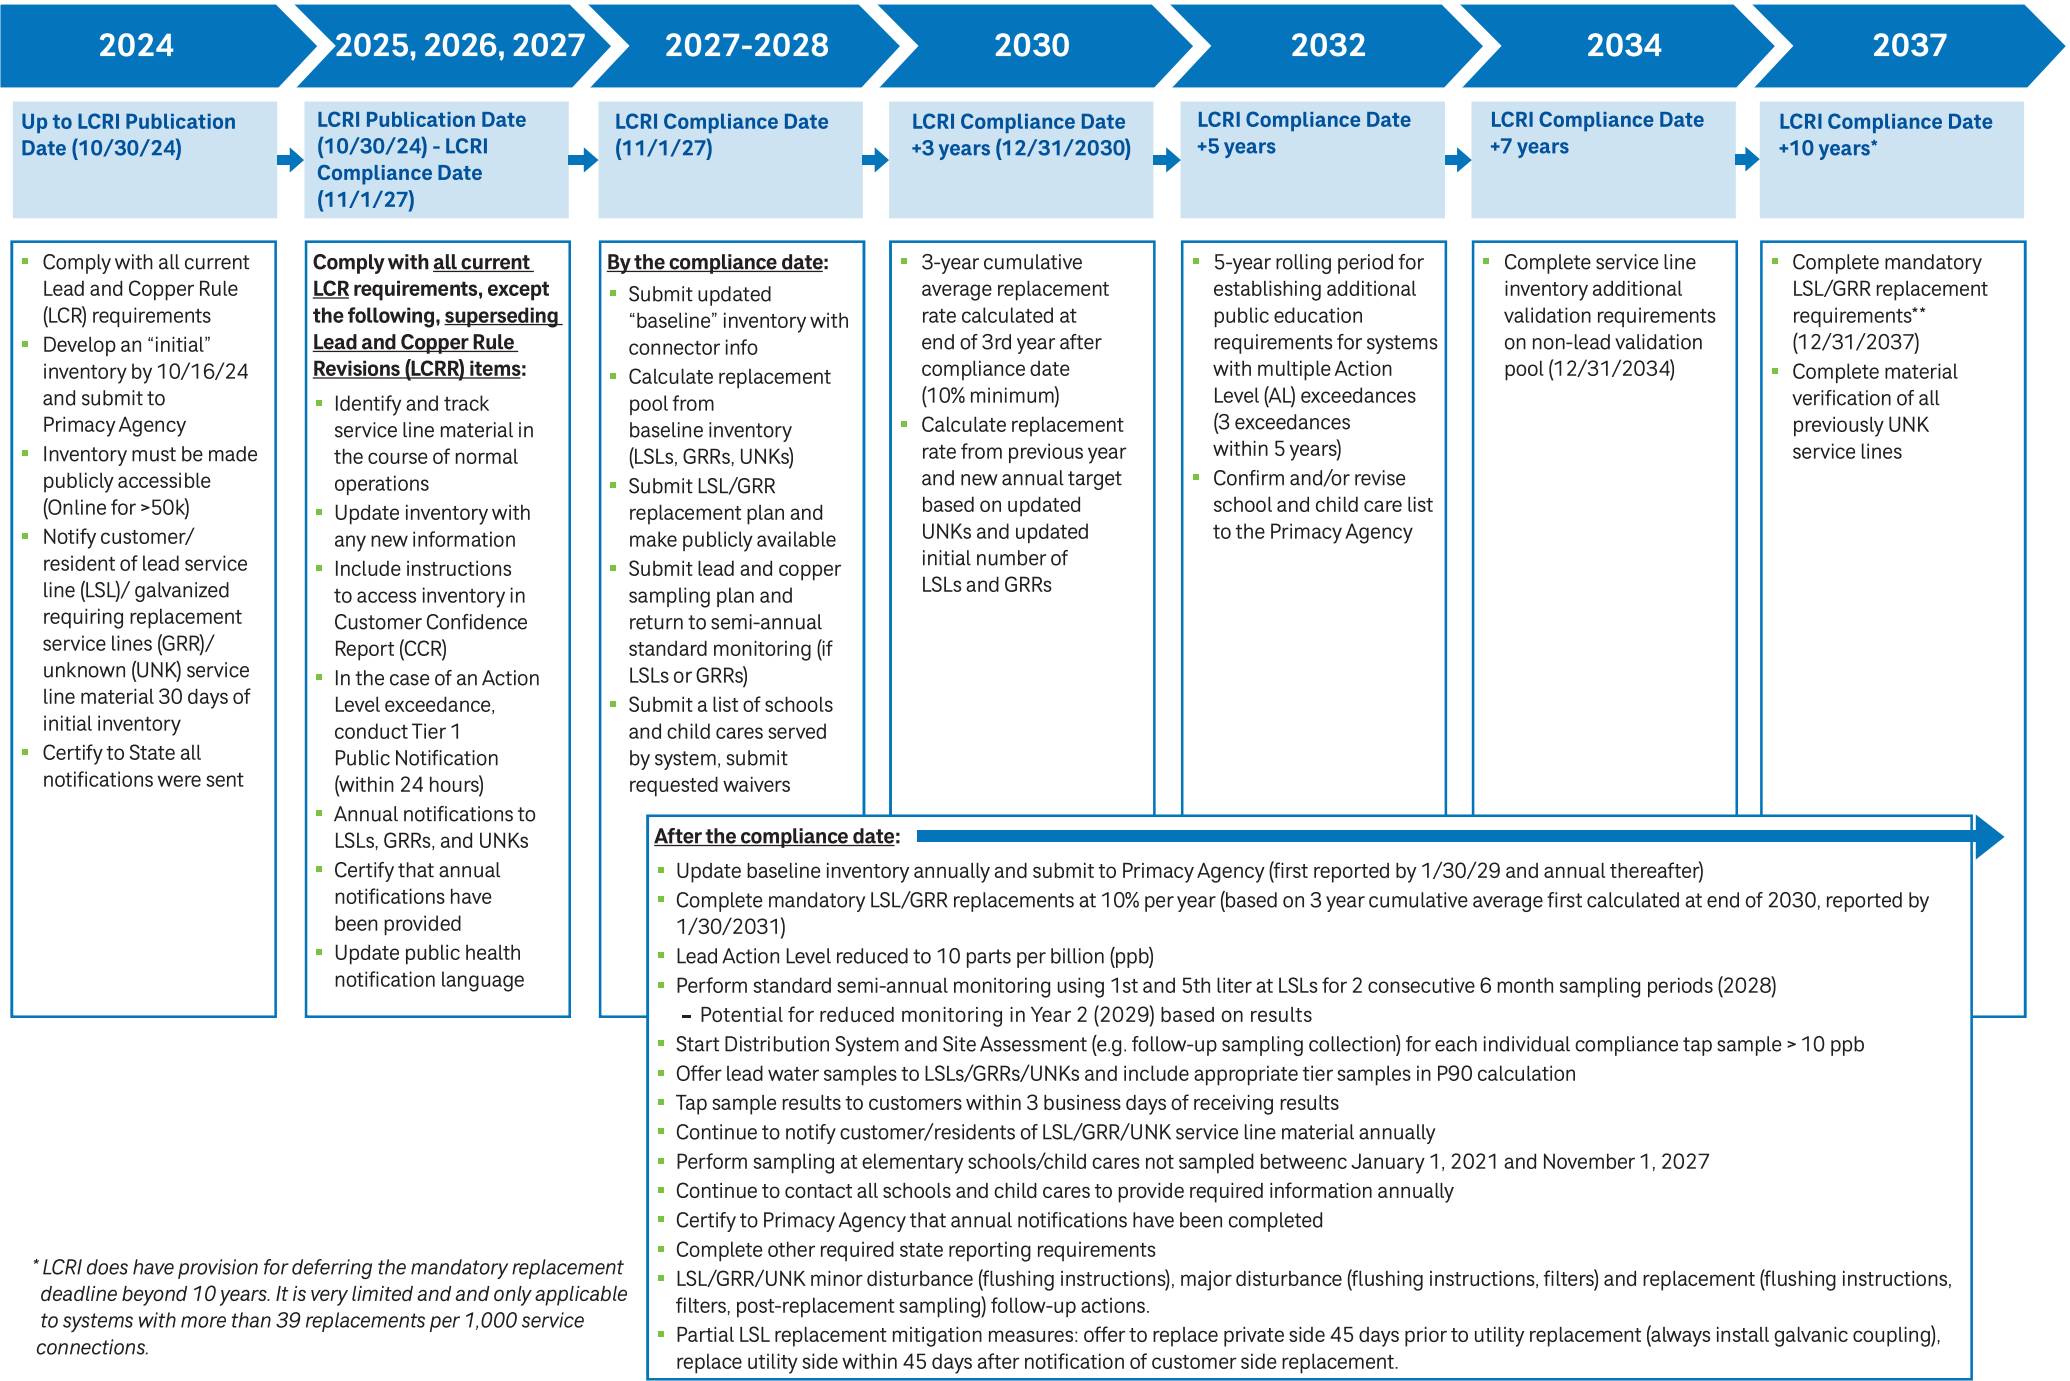

* LCRI does have provision for deferring the mandatory replacement deadline beyond 10 years. It is very limited and only applicable to systems with more than 39 replacements per 1,000 service connections.