


3-16

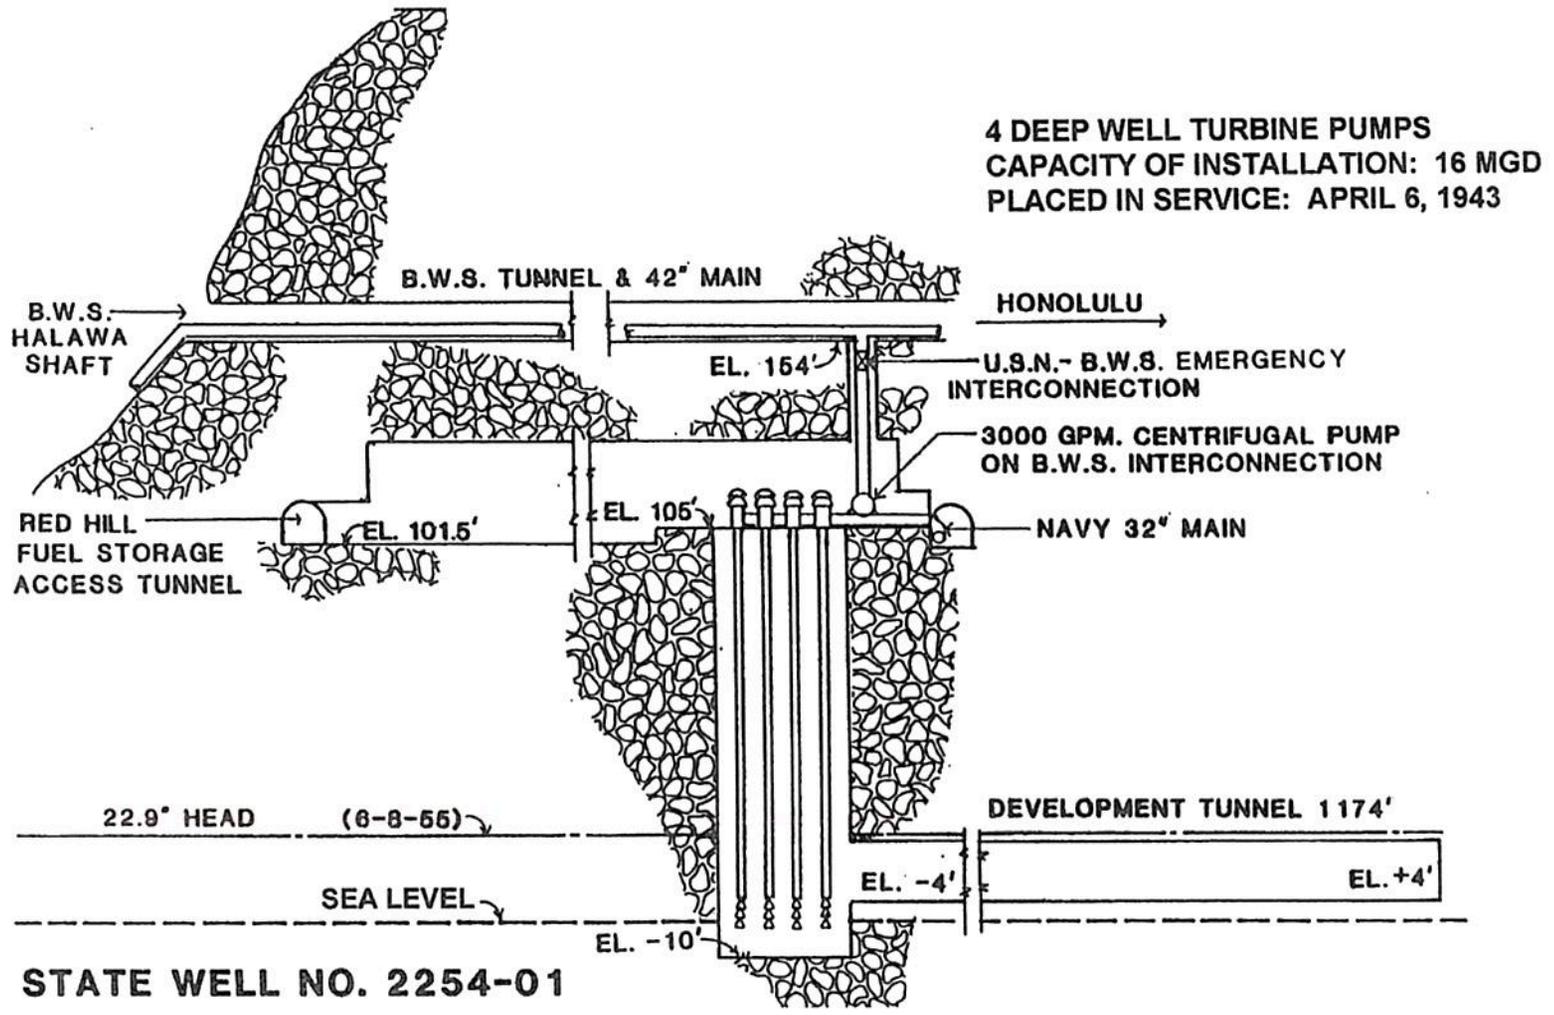


UTILITY SYSTEM ASSESSMENT OF THE JOINT BASE PEARL HARBOR-HICKAM POTABLE WATER SYSTEM

**RED HILL WATER PLANT
SECTION VIEW OF SHAFT**

FIGURE 3.5-5

3-19

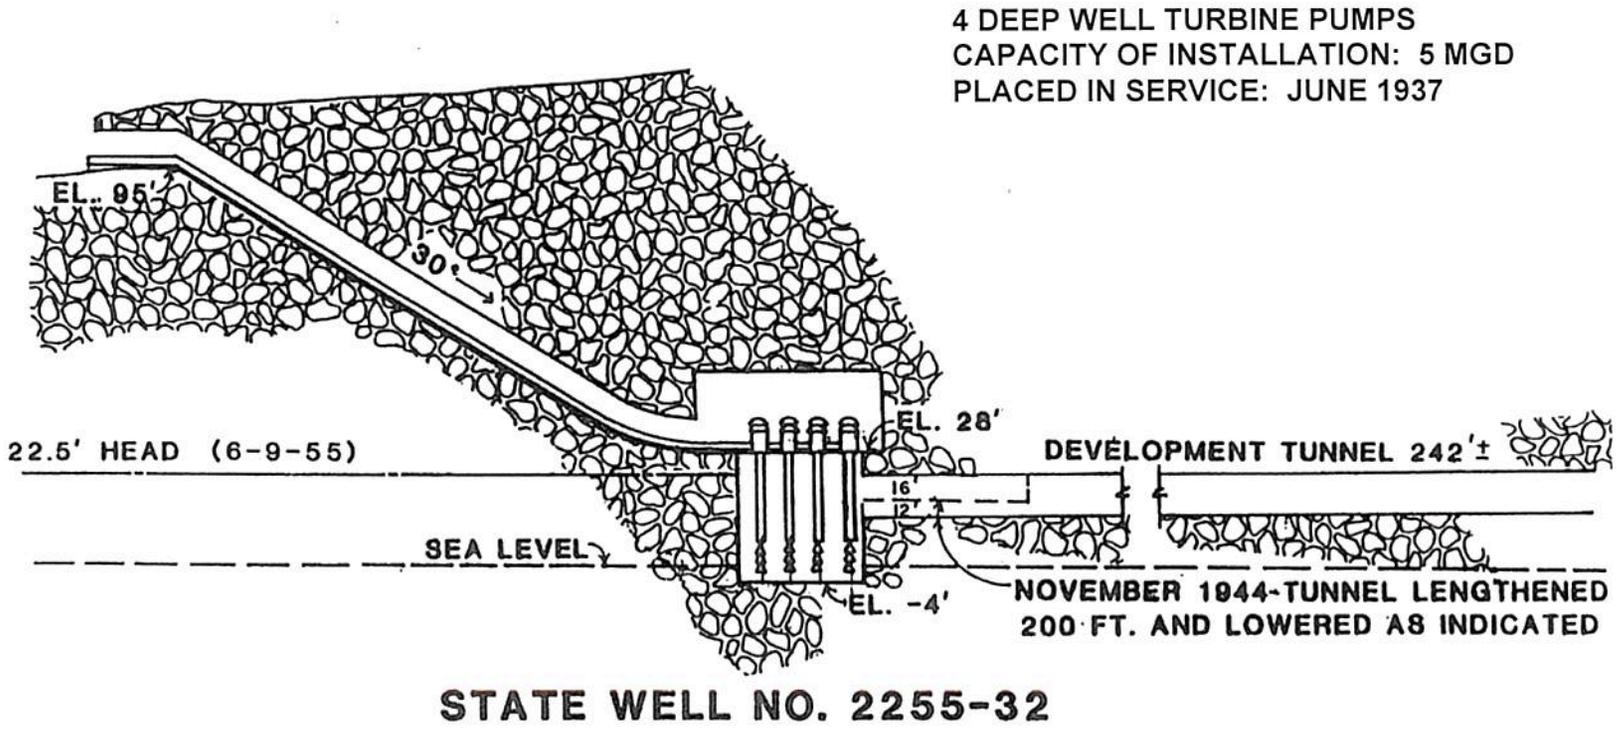


UTILITY SYSTEM ASSESSMENT OF THE JOINT BASE PEARL HARBOR-HICKAM POTABLE WATER SYSTEM

**HALAWA WATER PLANT
SECTION VIEW OF SHAFT**

FIGURE 3.5-7

4 DEEP WELL TURBINE PUMPS
CAPACITY OF INSTALLATION: 21 MGD
PLACED IN SERVICE: NOV. 1951

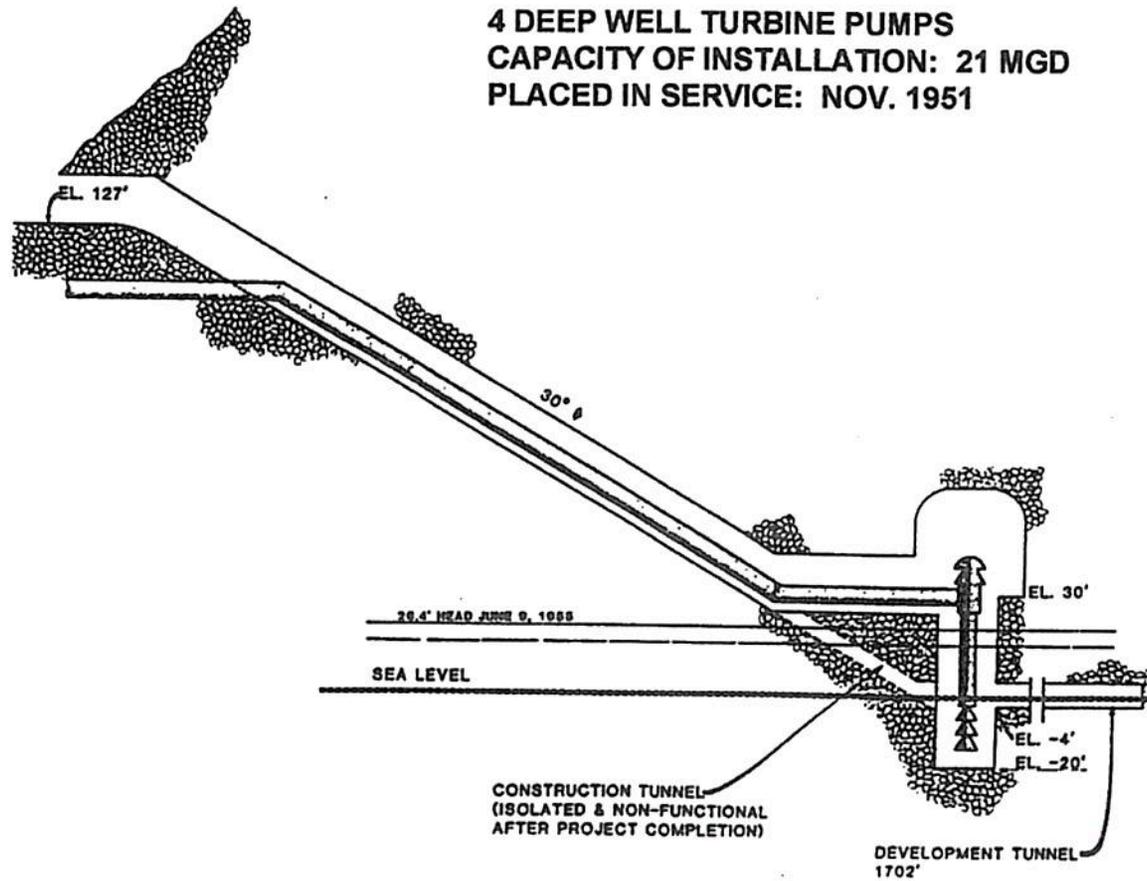

STATE WELL NO. 2558-10

UTILITY SYSTEM ASSESSMENT OF THE JOINT BASE PEARL HARBOR-HICKAM POTABLE WATER SYSTEM

WAIAWA WATER PLANT
SECTION VIEW OF SHAFT

FIGURE 3.5-3